



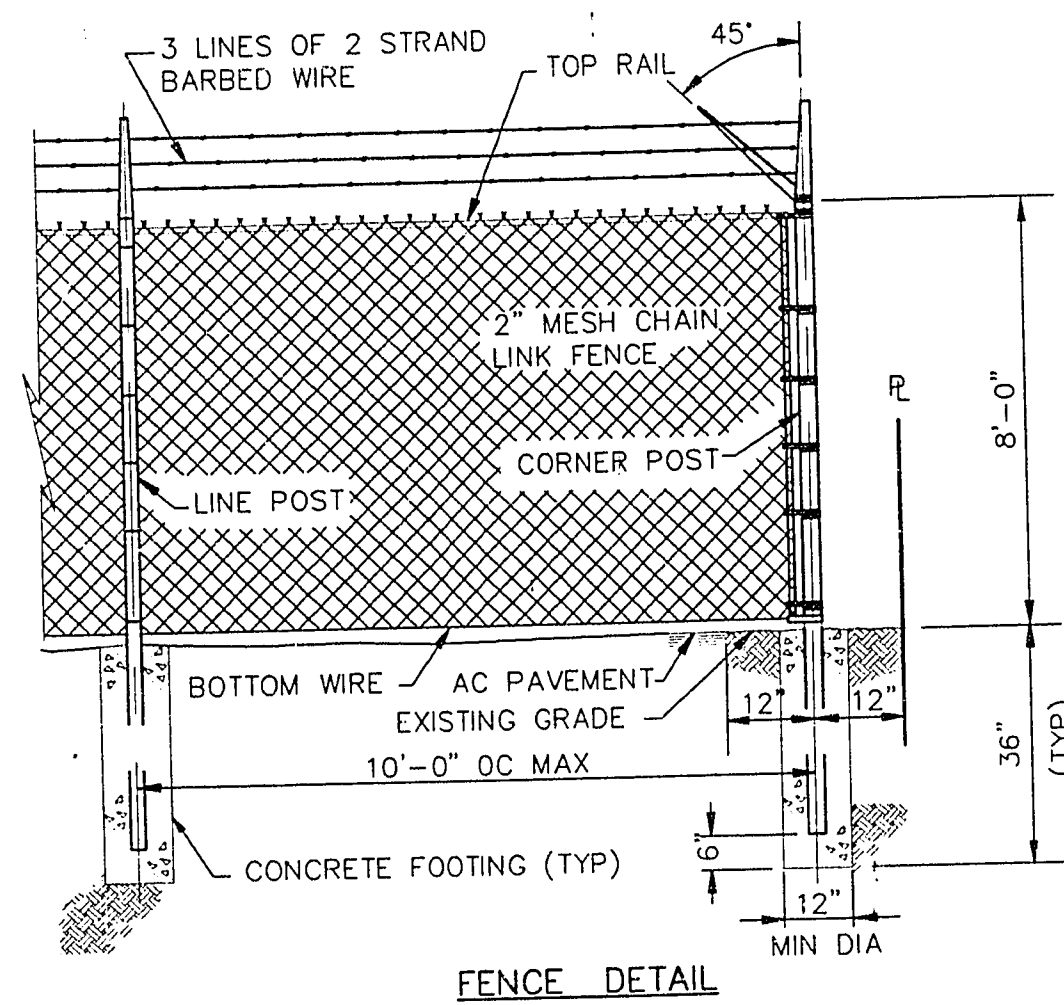

- NOTES:
1. FENCE POST SPACING AT 10'-0" OC WITHOUT PRIVACY SLATS.
 2. FENCE POST SPACING AT 8'-0" OC WITH PRIVACY SLATS.

CHAIN LINK FENCE DETAIL

1

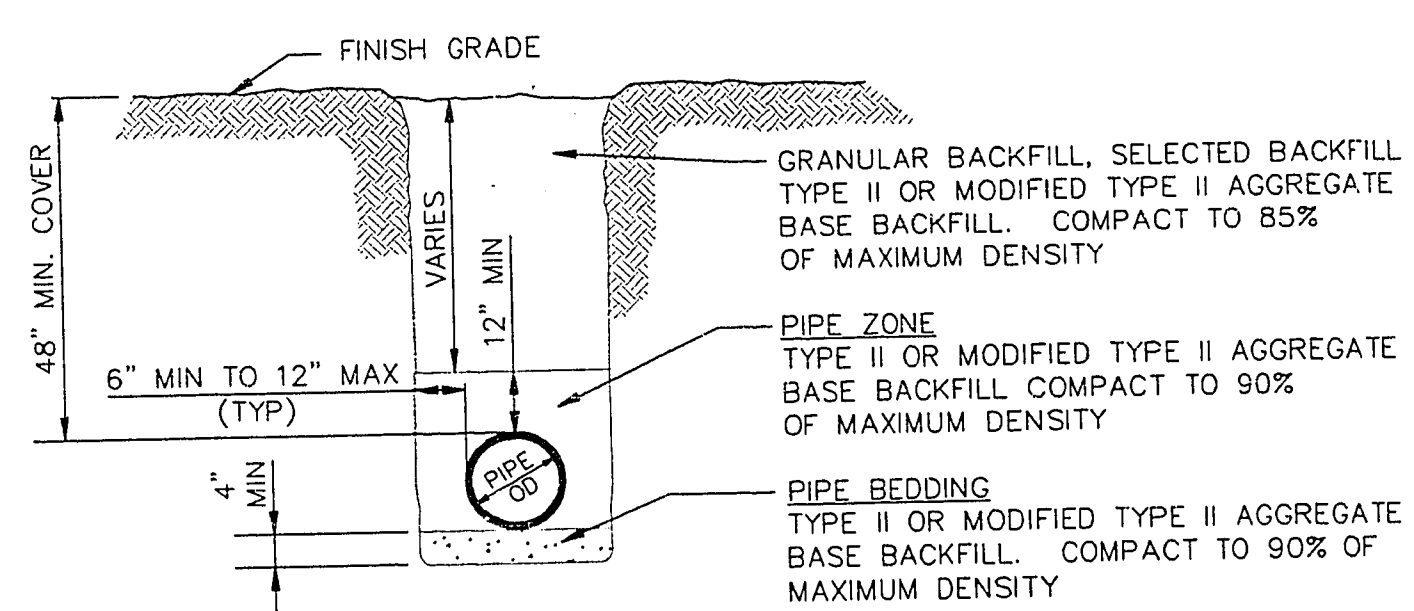


UNPAVED AREAS
TRENCH SECTION BACKFILL SPECIFICATION

2

NOTES FOR PAVED AND UNPAVED AREAS

1. ACCEPTABLE METHODS OF COMPACTION
 - A. BEDDING AND PIPE ZONE AREAS:
FLOODING AND JETTING, IF AGENCY APPROVED, OR MECHANICAL COMPACTION (NDOT RIGHT-OF-WAY, MECHANICAL COMPACTION ONLY).
 - B. ABOVE PIPE ZONE:
FLOODING AND JETTING OR MECHANICAL COMPACTION (NDOT RIGHT-OF-WAY, MECHANICAL COMPACTION ONLY).
2. TRENCH EXCAVATION SHALL COMPLY WITH THE CURRENT REGULATIONS AS DETERMINED BY THE NEVADA OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION.
3. REFERENCE: UNIFORM STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OFF-SITE IMPROVEMENTS CLARK COUNTY AREA NEVADA, LATEST EDITION OR IMPROVEMENT STANDARDS DEPARTMENT OF PUBLIC WORKS, CLARK COUNTY NEVADA, LATEST EDITION, AS APPLICABLE.
4. FOR PIPE LOCATOR RIBBON AND TYPICAL INSTALLATION SEE 5 CT2.
5. REFER TO THE UNIFORM DESIGN AND CONSTRUCTION STANDARDS FOR WATER DISTRIBUTION SYSTEMS, TABLE E, "BACKFILL MATERIALS" FOR AGGREGATE TYPES AND SIZES.
6. FOR NOMINAL PIPE DIAMETERS 12" OR LESS, A 42" MINIMUM COVER IS ALLOWED.

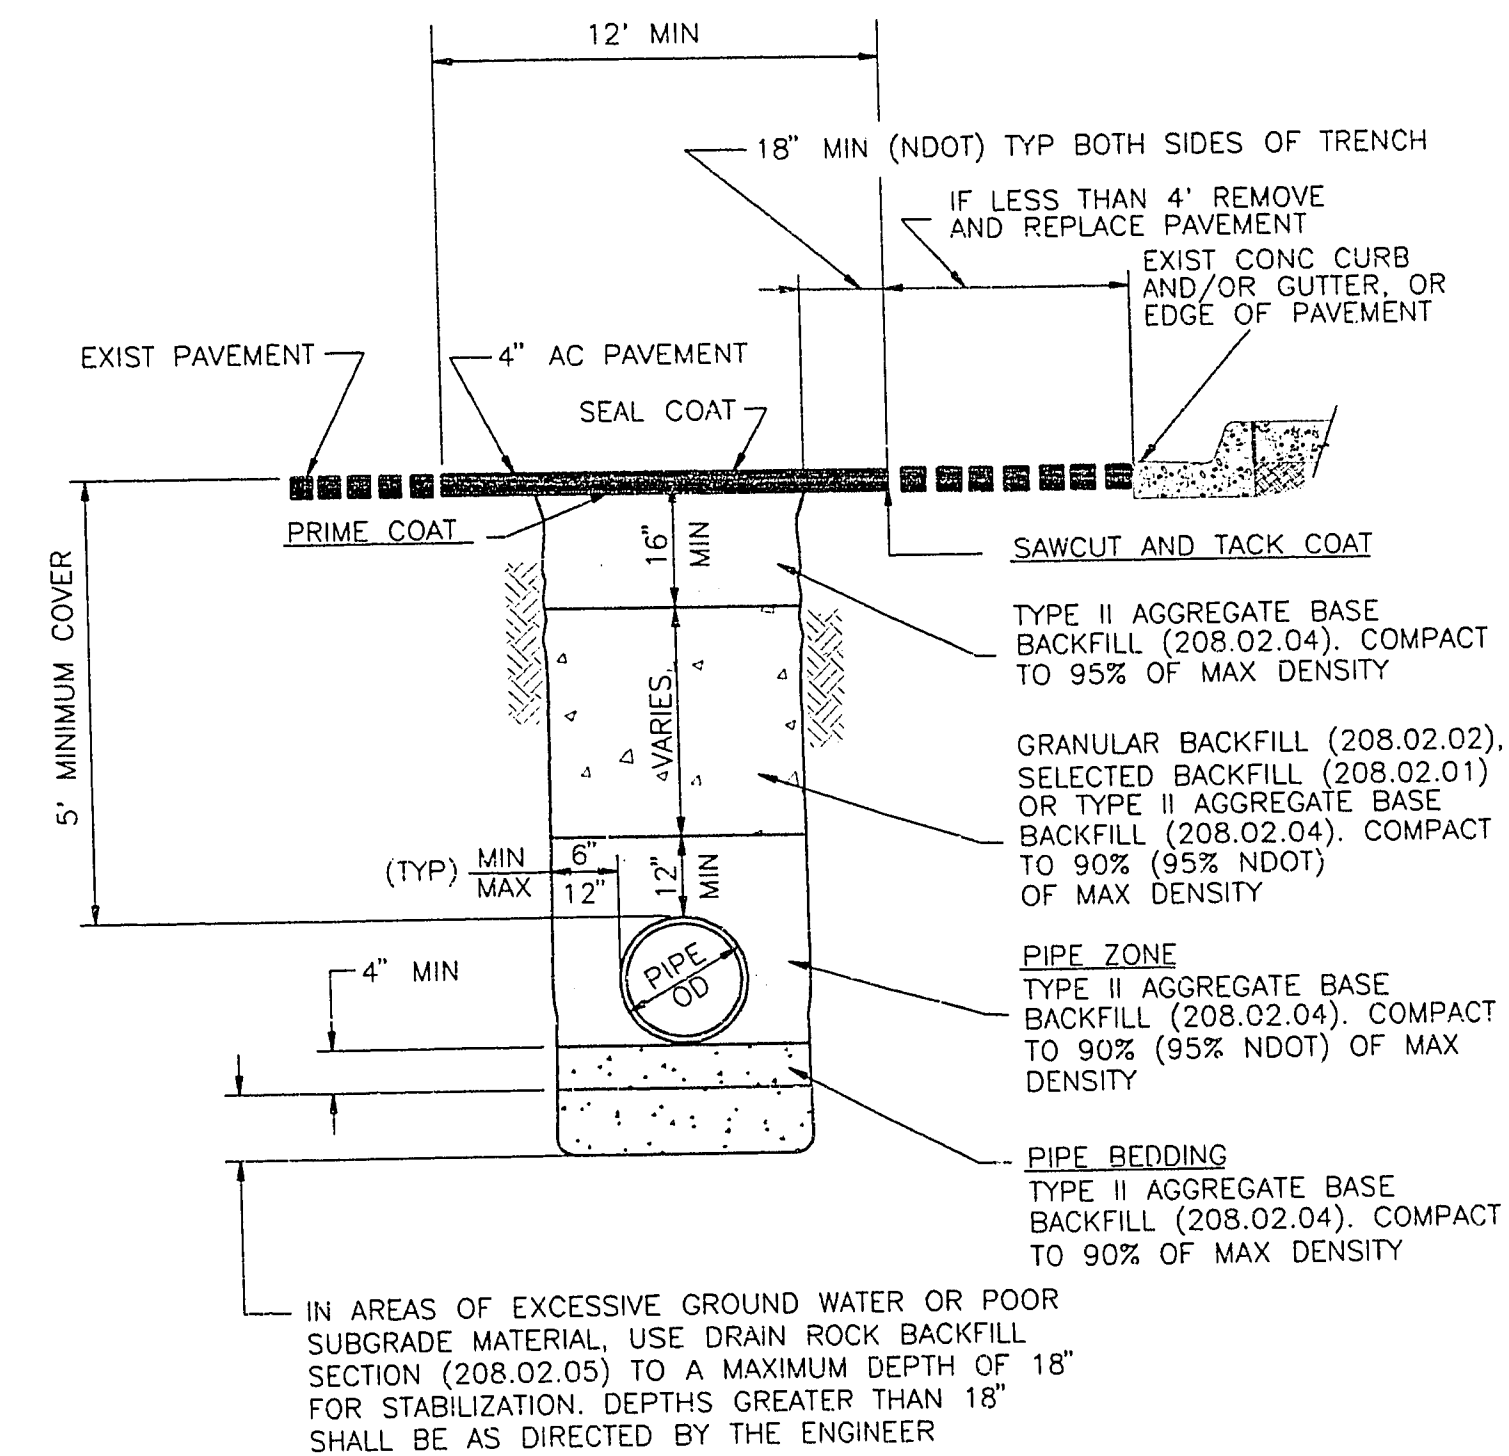

PAVED AREAS (STREET R/W GREATER THAN 60')
TRENCH SECTION BACKFILL SPECIFICATION

3

LAS VEGAS VALLEY WATER DISTRICT
1001 S. VALLEY VIEW BOULEVARD
LAS VEGAS, NEVADA 89153
(702) 870-2011

EQUIP WELL NOS. 114 AND 115

STANDARD DETAILS

VERIFY SCALE

1/2" = 0' 1/2"

BAR REPRESENTS ONE AND ONE-HALF INCHES ON ORIGINAL

DRAWN BY: F.P. AKINS

CHECKED BY: G.E. WALLACE

RECOMMENDED BY: JEROME A. STUEVE

ACCEPTED BY: SHAWN P. MOLLUS

DATE: 12/5/95

DATE: 12/6/95

DATE: 12/6/95

DATE: 12-13-95

CONTRACT NUMBER

791

DRAWING NUMBER C14

SHEET 14 OF 35

565-276

138-08-SE