





1820

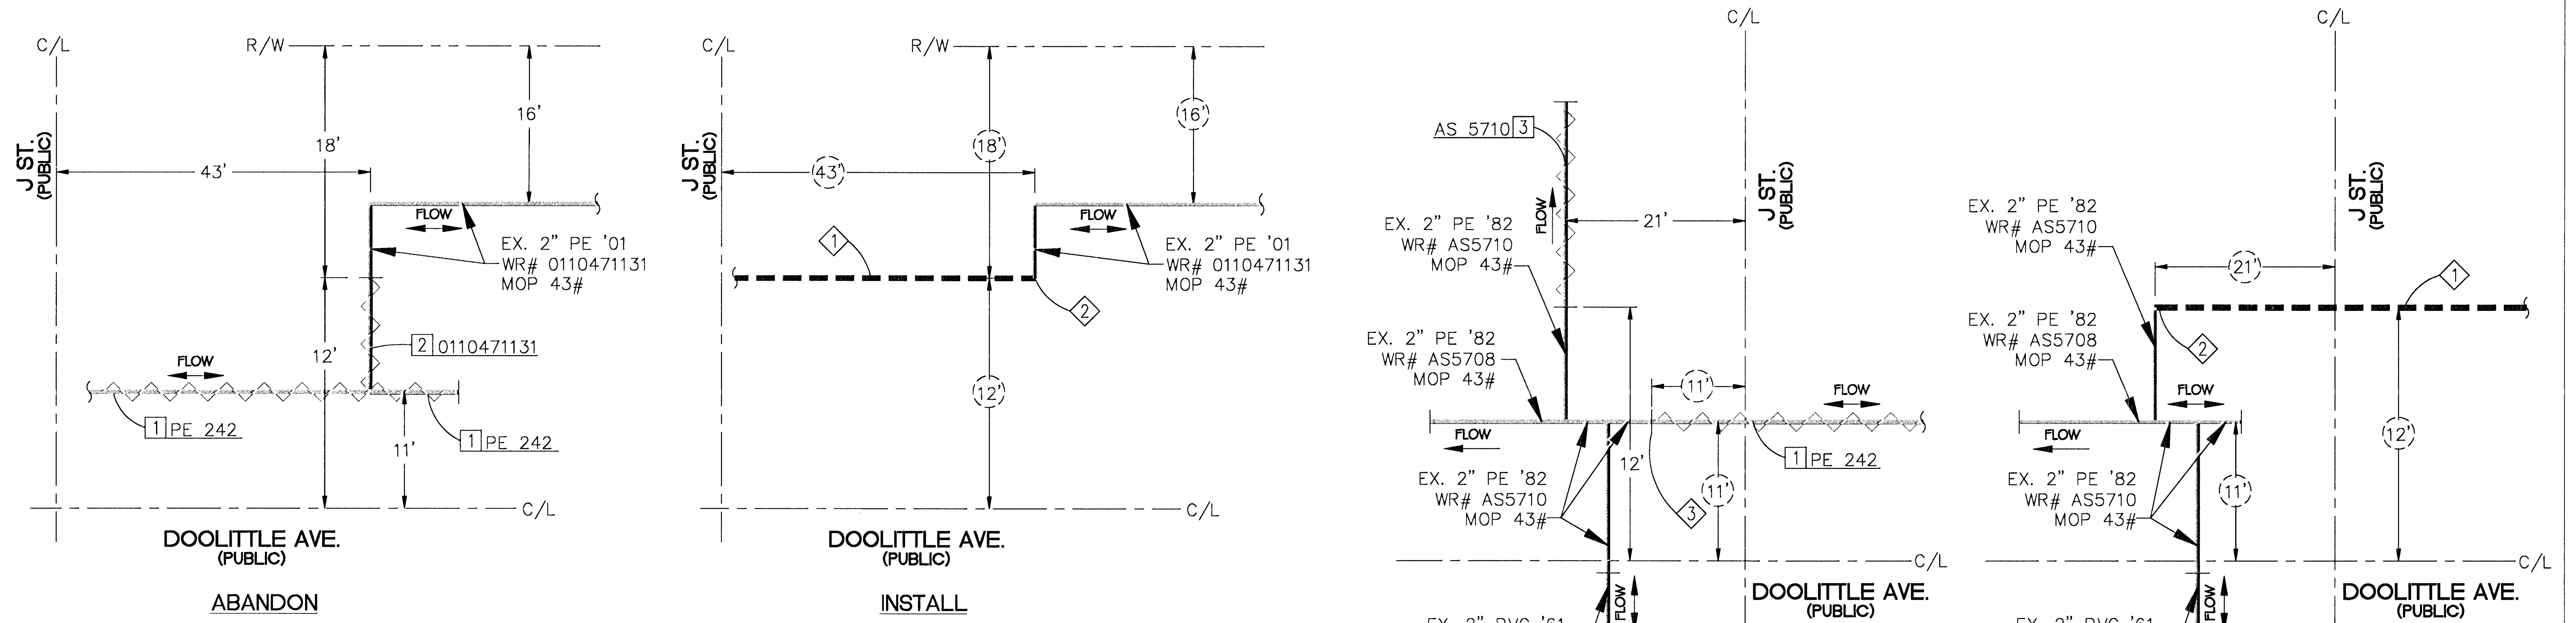

TIE-IN DETAIL
(SEE SHEET 3)
A
N.T.S.

TIE-IN DETAIL
(SEE SHEET 3)
B
N.T.S.

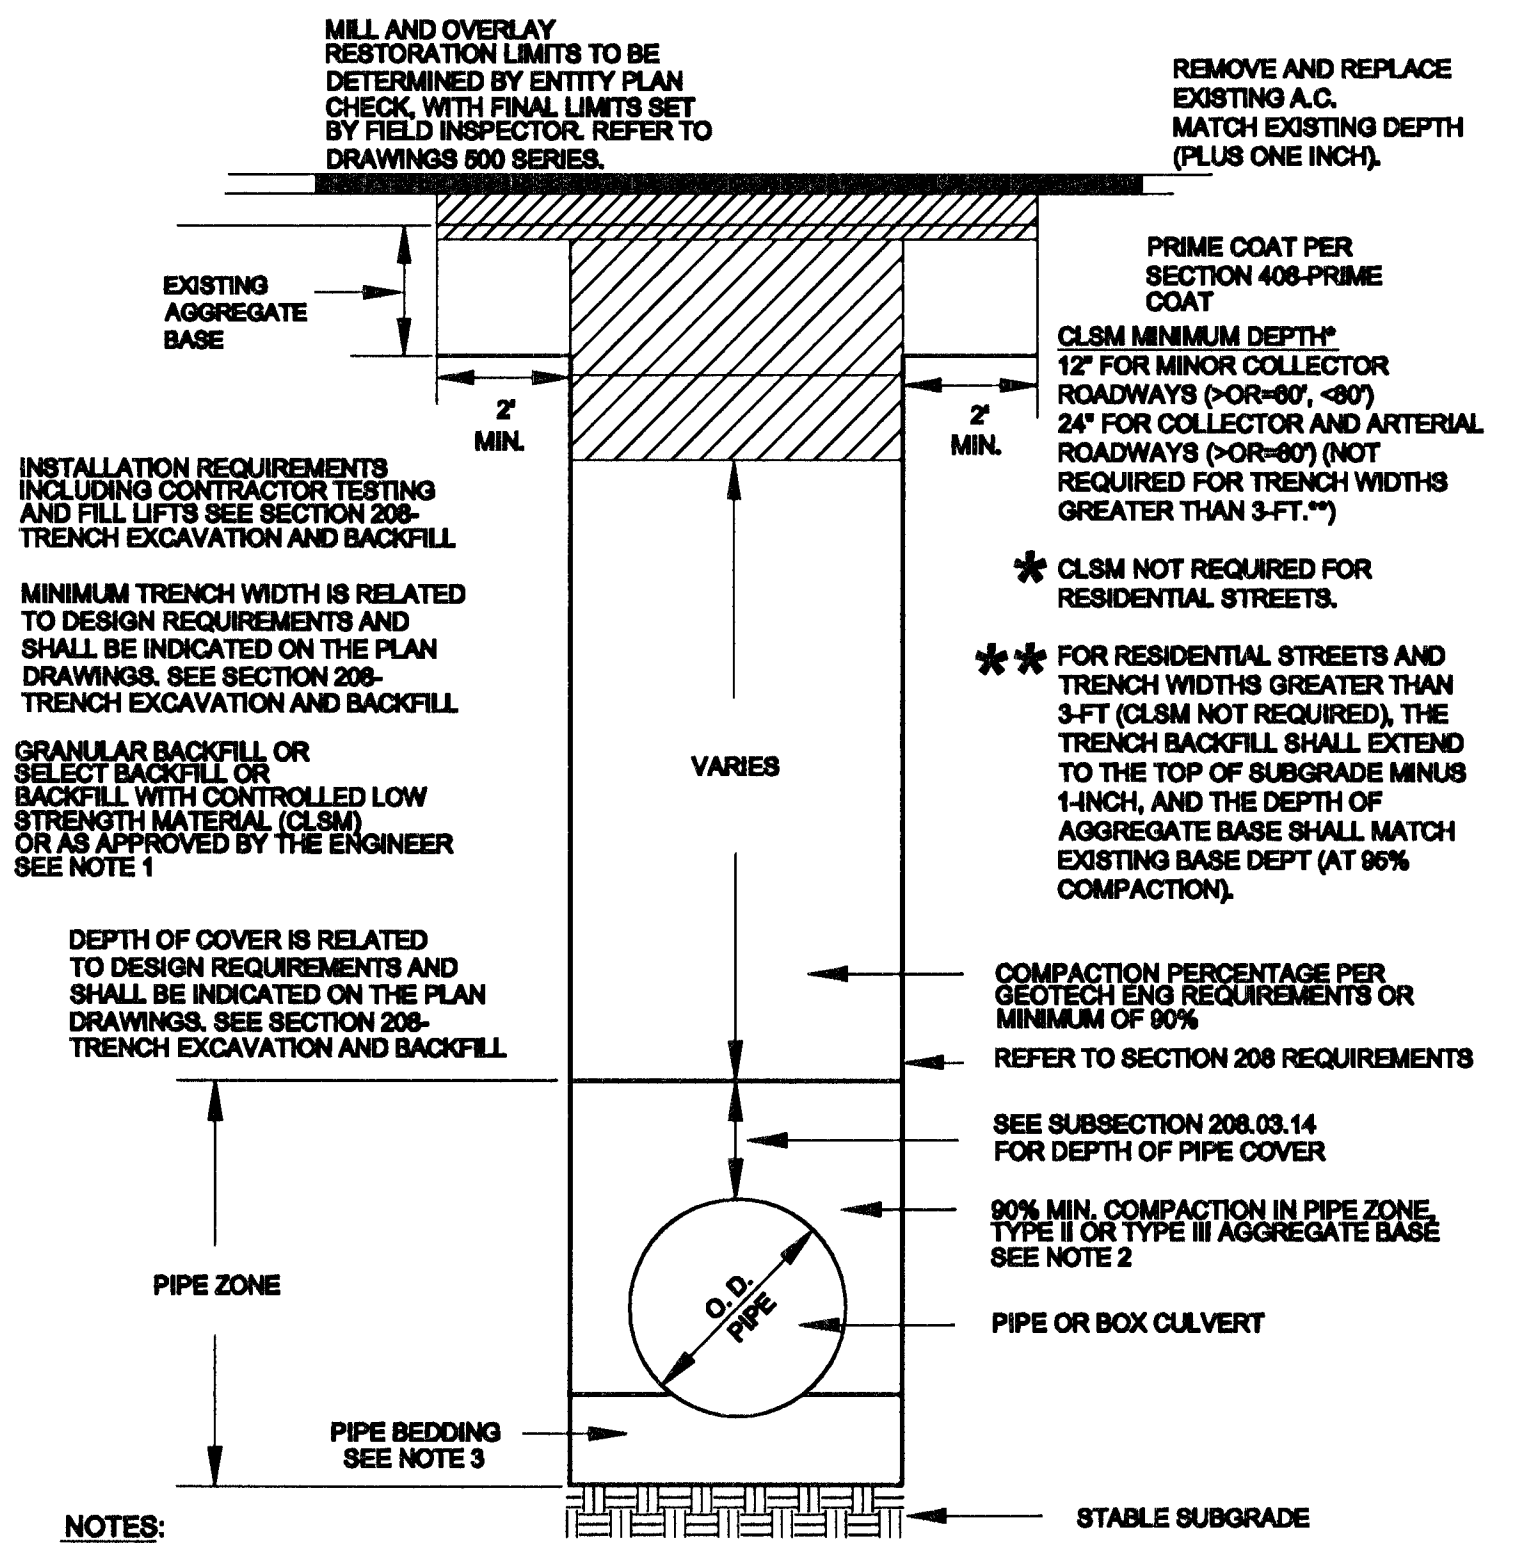

- NOTES:**
- NO STONES OR LUMPS GREATER THAN 3" PERMITTED IN TRENCH 2' OR LESS IN WIDTH.
 - TRENCH WIDTH, BEDDING, SUBGRADE AND PIPE ZONE REQUIREMENTS FOR UTILITY INSTALLATIONS SHALL CONFORM TO THE RESPECTIVE ENTITY REQUIREMENTS.
 - CRUSHED ROCK MAY BE USED FOR PIPE BEDDING ONLY IF MATERIAL USE HAS BEEN SPECIFICALLY APPROVED BY THE GOVERNING AGENCY. SEE STANDARD DRAWING NO. 606 FOR PIPE BEDDING METHODS.
 - LAS VEGAS VALLEY WATER DISTRICT REQUIRES PIPE BEDDING AND BACKFILL WITHIN THE PIPE ZONE TO BE OF THE SAME MATERIAL.

PROPOSED FACILITIES:

- ① PROP. 2" PE
- ② PROP. 2" PE ELBOW (140-3067)
- ③ PROP. 2" PE CAP (140-3060)

ABANDONED FACILITIES:

- ① ABANDON EX. 2" STL '61 MOP 43#
- ② ABANDON EX. 2" PE '01 MOP 43#
- ③ ABANDON EX. 2" PE '82 MOP 43#

RTC STD DWG 503

DESCRIPTION BY DATE APPVD REVISIONS	AS-BUILT DRAWING-PRESSURE TEST DATA TEST MEDIUM TEST METHOD TEST PRESS. (PSI) TIME DATE PERFORMED BY	VISUAL INSPECTION CERTIFICATION I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT I HAVE PERFORMED. NAME DATE	CONSTRUCTION INSPECTOR FOREMAN REVIEWED BY SEE SHEET 2	ISOLATION AREA 092	W.R. NO. 1709310	ENGINEER/TECH: MAXWELL HUGHES ACCOUNT REP:	PHONE: 702-365-2022 P-ONE:
						PROJECT CONTACT: MAXWELL HUGHES SHEET NO: 4 OF 4 SCALE: N.T.S. DATE: 04/04/2013	DWN. BY: ZONE ENG CHKD. BY: APPROV. BY:
SOUTHWEST GAS CORPORATION	TAX CODES UNIT NO. UNIT TYPE INSTL. RETIRED INSTL. RETIRED PROPOSED COMPLETED PROPERTY UNITS	AS-BUILT ACCEPTED BY DATE POSTED BY DATE POSTING GOOD BY DATE	PERMIT INFORMATION CITY OF LAS VEGAS TAX CODE 02-0200	LOCATION T20S R61E SEC 21 M.D.M.	ATLAS #/FILE # x624y524	SI-CLV-DOOLITTLE AND J 2" REPLACEMENT	