


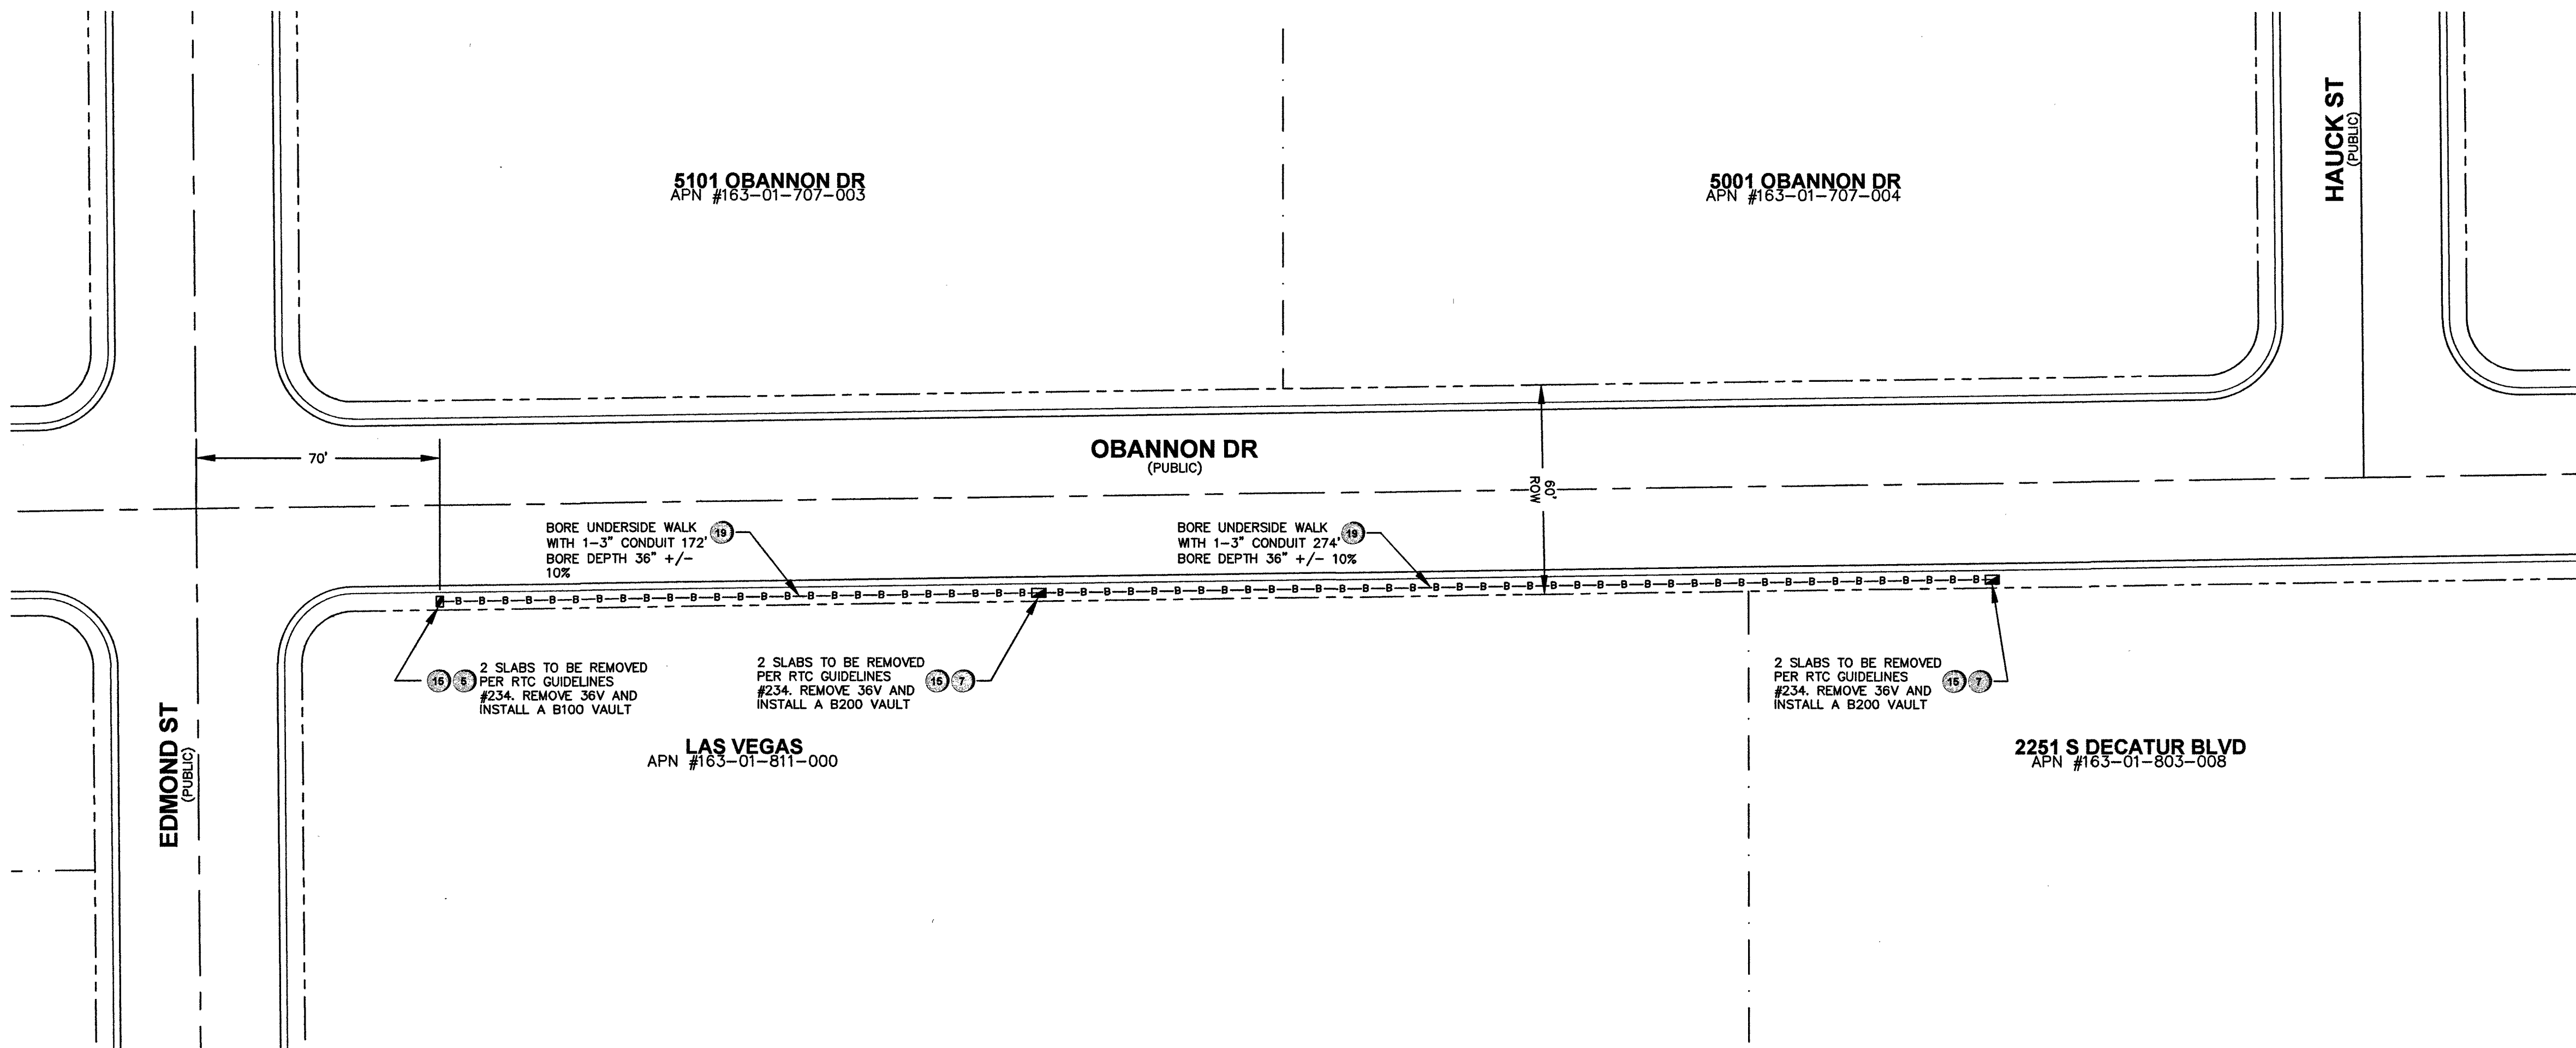

1

INSTALL B-36 PULL BOX (24\"X36\"X24\")

2

EXISTING B-36 PULL BOX (24\"X36\"X24\")

3

INSTALL B-50 PULL BOX (13\"X24\"X24\")

4

EXISTING B-50 PULL BOX (13\"X24\"X24\")

5

INSTALL B-100 PULL BOX (24\"X36\"X24\")

6

EXISTING B-100 PULL BOX (24\"X36\"X24\")

7

INSTALL T-200 CATV VAULT (30\"X48\"X36\")

8

EXISTING T-200 CATV VAULT (30\"X48\"X36\")

9

INSTALL T-400 CATV VAULT (36\"X60\"X36\")

10

EXISTING T-400 CATV VAULT (36\"X60\"X36\")

11

INSTALL T-600 CATV VAULT (48\"X72\"X36\")

12

EXISTING T-600 CATV VAULT (48\"X72\"X36\")

13

INSTALL NEW CATV PEDESTAL

14

EXISTING NEW CATV PEDESTAL

15

R&R S/W SLAB(S)

16

POTHOLE

17

---c---c--- SIDEWALK/DIRT TRENCH INSTALL

18

---c---c--- ASPHALT/STREET TRENCH INSTALL

19

---B---B--- PROPOSED BORE

20

---X---X--- EXISTING CATV CONDUIT(S)

21

---OHC--- PROPOSED OVERHEAD FIBER OPTIC CABLE OR COAX INSTALL

22

---XOHC--- EXISTING OVERHEAD FIBER OPTIC CABLE OR COAX

23

--- --- U.G. FIBER/COAX PULL

24

--- --- RIGHT OF WAY LINE

25

--- --- LOT/PROPERTY LINE

26

--- --- EDGE OF PAVEMENT

27

[P] EXISTING NVE PULL BOX

28

[T] EXISTING TELCO PULL BOX

29

[TM] EXISTING TELCO MANHOLE

30

[T] EXISTING TELCO POLE

31

[NVE] EXISTING NVE TRANSMISSION POLE

32

[X] EXISTING JOINT POLE

33

[X] EXISTING JOINT POLE WITH TRANSFORMER

34

[Y] POLE ANCHOR

35

[Y] EXISTING NVE TRANSFORMER

36

[TS] SNWA TEST STATION

37

[CPS] COX POWER SUPPLY (49\"X24\"X52\")

38

[RC] INSTALL RHINO CABINET

39

[RQ] RISER POLE/QUADRANT DETAIL RISER OWNERSHIP NOTED

40

[R] RAILROAD

41

[MH] EXISTING MANHOLE (SS),(SD)...ETC

42

--- --- 1in CONDUIT LATERAL

43

44

45

LEGEND

1-45

DISCLAIMER NOTE

UTILITY LOCATIONS SHOWN HEREON ARE APPROXIMATE ONLY. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE EXACT HORIZONTAL AND VERTICAL LOCATION OF ALL EXISTING UNDERGROUND AND OVERHEAD UTILITIES PRIOR TO COMMENCING CONSTRUCTION. NO REPRESENTATION IS MADE THAT ALL EXISTING UTILITIES ARE SHOWN HEREON. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR UTILITIES NOT SHOWN OR UTILITIES NOT SHOWN IN THEIR PROPER LOCATIONS.

AVOID CUTTING UNDERGROUND UTILITY LINES. IT'S COSTLY. CALL 811 BEFORE YOU DIG OR 1-800-227-2600 UNDERGROUND SERVICE (USA)

AVOID OVERHEAD POWER LINE CONTACT. CALL BEFORE YOU OVERHEAD 1-702-227-2929 NEVADA POWER ENVIRONMENT AND SAFETY SERVICE DEPARTMENT

COX

1700 VEGAS DRIVE LAS VEGAS, NEVADA 89106 PHONE: (702) 545-1606 FAX: (702) 545-2606

CITY OF LAS VEGAS

333 N. RANCHO DRIVE LAS VEGAS, NEVADA 89106 (702) 229-6885

PROJECT LOCATION:

EDMOND & OBANNON

SUB-CONTRACTOR:

IES

3120 POST ROAD LAS VEGAS, NV. 89120

ENTITY NOTES:

SHEET No:

1

SHEET 1 OF 1

APPROVED FOR CONSTRUCTION

THIS APPROVAL IS FOR WORK IN CLV R/W OR CLV EASEMENT ONLY. OBTAINING PERMISSION OR EASEMENT FOR WORK SHOWN IN PRIVATE PROPERTY IS THE RESPONSIBILITY OF THE UTILITY.

APPROVAL: [Signature] DATE: 12/7/16

PERMIT # 12026-20 DRAWN BY: MMR DATE: 11/11/16 SCALE: 1\"/>