

THE REDUCED PRESSURE DETECTOR ASSEMBLIES SHALL BE INSTALLED IN ACCORDANCE WITH THE UDACS PLATE NO. 59. NO WATER SHALL BE TAKEN FROM A SERVICE REQUIRING BACKFLOW PREVENTION UNTIL THE ASSEMBLY HAS BEEN SUCCESSFULLY TESTED BY LVVWD. ANY BLOCK WALL OR OTHER FENCE MATERIAL SHALL BE DESIGNED AND CONSTRUCTED AROUND THE OUTSIDE OF THE EASEMENT(S) SO AS TO ALLOW LVVWD DIRECT ACCESS FROM THE ADJACENT RIGHT-OF-WAY. EASEMENTS SHALL BE CLEARLY MARKED OR STAKED PRIOR TO THE START OF CONSTRUCTION.

REDUCED PRESSURE PRINCIPLE ASSEMBLY (5)-1 1/2"; (2)-2"; (1)-1"

INSTALL PIPELINE MARKER BALLS IN TRENCH ABOVE EACH HORIZONTAL ELBOW FITTING, PER UDACS PLATE NO. 15.

FOR SUBDIVISIONS HAVING AN ONSITE FIRE PROTECTION WATER LOOP CONNECTED TO THE OFFSITE OR ONSITE POTABLE WATER MAIN BY MEANS OF A BACKFLOW PREVENTION DEVICE OR PUMP AND SEPARATE FROM THE ONSITE DOMESTIC/POTABLE WATER SUPPLY LINES (I.E. COMMERCIAL SUBDIVISIONS):

- A. SUBMIT ANY PROVISIONS TO PERIODICALLY CIRCULATE AND/OR FLUSH POTABLE WATER THROUGH THE FIRE PROTECTION WATER LINES OR ELSE.
- B. THE FIRE PROTECTION WATER IS CONSIDERED NON-POTABLE AND THEREFORE:
- i. THE FIRE PROTECTION WATER SHALL ADHERE TO THE UOACS SEPARATION REQUIREMENTS OF SUBSECTIONS 2-23.101 7-22, AND 2.04 AS NON-POTABLE WATER LINES (i.e. 6" MINIMUM HORIZONTAL SEPARATION AND 6" MINIMUM VERTICAL SEPARATION FROM POTABLE WATER LINES).
 - ii. SEPARATION OF THE FIRE WATER LINES FROM THE STORM AND SANITARY SEWER LINES (i.e. 5'-6" MINIMUM HORIZONTAL SEPARATION) SHOULD BE MAINTAINED IN ORDER TO PREVENT THE OFFSITE POTABLE WATER AFTER THE BACKFLOW PREVENTION DEVICE.

TREES, SHRUBS, OR DECORATIVE ROCKS, AND ANY BLOCK WALL OR OTHER FENCE MATERIAL SHALL BE DESIGNED AND CONSTRUCTED AROUND THE EASEMENT(S) TO ALLOW THE DISTRICT DIRECT ACCESS TO THE VAULT(S), BACKFLOW ASSEMBLIES, AND PIPING FROM THE ADJACENT RIGHT-OF-WAY.

WARNING FIRE LANE (NON-POTABLE WATER)
ALL EXISTING, RELOCATED OR PROPOSED DCDA/RPDA
INSTALLATIONS

"TO COMPLY WITH THE FEDERAL SAFE DRINKING WATER ACT, THE FIRE LINE OR ANY OF ITS COMPONENTS, SHALL NOT BE USED FOR POTABLE DRINKING WATER AT ANY TIME"

PROTECT IN PLACE AND ADJUST LVVWD EXISTING FACILITIES TO FINISHED GRADE. ALL LVVWD FACILITIES SHALL BE ACCESSIBLE AT ALL TIMES.

ANNULAR SPACE BETWEEN PIPE AND CASING SHALL BE FILLED WITH FINE SAND OR CONTROLLED LOW STRENGTH MATERIAL (CLSM 50 PSI - 75 PSI). SEE UDACS PLATES 16, 17, 18 AND 19 FOR BEDDING AND BACKFILL REQUIREMENTS.

INSTALL WATERLINE IN STEEL CASING PER UDACS PLATES NO.21 AND 23. MINIMUM CLEARANCE IS REQUIRED ABOVE THE TOP OF THE CASING. FROM THE UPPER BENDS THROUGHOUT THE LOWERED SECTION OF THE PIPE. DUCTILE IRON PIPE WITH RESTRAINED JOINTS IS REQUIRED. IN ADDITION, THRUST BLOCKS ARE TO BE INSTALLED AT THE UPPER BENDS.

NOTE:
ALL SEWER/STORM DRAINS CROSSING WATER LINES MUST CONFORM TO SECTION 2.22 OF THE UNIFORM DESIGN AND CONSTRUCTION STANDARDS FOR POTABLE WATER SYSTEMS (UDACS) FOR WATER AND STORM MAIN CROSSINGS AND CLEARANCES.



SCALE: 1"=30'

SOUTH 00°0657 WEST, BEING THE WEST LINE OF THE GOVERNMENT LOT 11 LYING WITHIN THE SOUTHWEST QUARTER (SW 1/4) OF SECTION 17, TOWNSHIP 19 SOUTH, RANGE 60 EAST, M.D.M., AS SHOWN IN BOOK 140, PAGE 12 OF PLATS IN THE CLARK COUNTY, NEVADA RECORDER'S OFFICE

BENCHMARK
CITY OF LAS VEGAS BENCHMARK # 5LV90 17S6

A RIVET AND PLATE IN THE TOP OF CURB AT THE NORTHWEST CORNER OF OSO BLANCA ROAD AND DURANGO DRIVE.

NO.	ITEM	UDACS: PLATE NO. PER UNIFORM DESIGN AND CONSTRUCTION STANDARDS FOR WATER DISTRIBUTION SYSTEMS
①	INSTALL PVC WATER LINE (C-900) (SIZE PER PLAN) PER UDACS PLATE NO. 17	
②	INSTALL 45° BEND (SAME SIZE AS LINE) PER UDACS PLATE NO. 31.	
③	INSTALL 90° BEND (SAME SIZE AS LINE) PER UDACS PLATE NO. 31.	
④	INSTALL TEE (SIZE PER PLAN) PER UDACS PLATE NO. 31.	

5	INSTALL FIRE HYDRANT ASSEMBLY PER UDACS PLATE NO. 40.
6	INSTALL GATE VALVE (SAME SIZE AS LINE) PER UDACS PLATE NO. 30 & 39.
7	INSTALL 12"X8" TAPPING SLEEVE W/8" TAPPING VALVE PER UDACS PLATE NO. 34 & SEC 2.24.01
8	INSTALL 8" RPPA PER UDACS PLATE NO. 59.
9	POINT OF CONNECTION. SEE PLUMBING PLANS FOR CONTINUATION.
10	INSTALL COPPER TYPE "K" WATER LINE (SIZE PER PLAN) PER UDACS PLATE NO. 4.
11	INSTALL PVC WATER LINE (SIZE PER PLAN) PER UDACS PLATE NO. 17.
12	INSTALL 12"x 2" SERVICE SADDLE PER UDACS PLATE NO. 4.
13	INSTALL 12"x 1 1/2" SERVICE SADDLE PER UDACS PLATE NO. 4.
14	INSTALL 12"x 1" SERVICE SADDLE PER UDACS PLATE NO. 4.
15	INSTALL 2" DOMESTIC METER PER UDACS PLATE NO. 4 WITH 2" RPPA PER UDACS PLATE NO. 8.
16	INSTALL 1 1/2" DOMESTIC METER PER UDACS PLATE NO. 4 WITH 1 1/2" RPPA PER UDACS PLATE NO. 8.
17	INSTALL 1" DOMESTIC METER PER UDACS PLATE NO. 4 WITH 1" RPPA PER UDACS PLATE NO. 8.
18	POINT OF CONNECTION. SEE LANDSCAPING PLANS FOR CONTINUATION.
19	RELOCATE EXISTING FIRE HYDRANT IN ACCORDANCE WITH UDACS PLATE NO. 40.
20	INSTALL POST INDICATOR VALVE W/ ADJUSTABLE TYOE INDICATOR POST (MUELLER PART # A-20806) AND SUPERVISORY CONTROL VALVE SWITCH (POTTER PART # 1010107) OR APPROVED EQUIVALENT.
21	INSTALL VEHICULAR PROTECTION BOLLARD PER UDACS PLATE NO. 75.
22	INSTALL REDUCER (SIZE PER PLAN)

NO.		ITEM	*SS STD PER DESIGN AND CONSTRUCTION STANDARDS FOR WASTEWATER COLLECTION SYSTEMS
1	INSTALL	PVC SEWER LINE (SDR-35) PER DCSWCS, DWG. NO. SD-15, DWG. NO. SD-17. (PAVED AREA)	
2	INSTALL	WYE PER DCSWCS DWG. NO. SD-22 AND DETAIL 'U' SHEET C8.01.	
3	REMOVE	EXISTING CAP AND CONNECT TO EXISTING SEWER MAIN.	
4	INSTALL	48" SSMH PER DCSWCS DWG. NO. SD-1A, SD-1B AND SD-4.	
5	POINT OF	CONNECTION. SEE PLUMBING PLANS FOR CONTINUATION AND USE.	
6	INSTALL	60" SSMH PER DCSWCS DWG. NO. SD-1A, SD-1B AND SD-4.	
7	INSTALL	6" CLEAN-OUT PER DCSWCS DWG. # SD-26 WITH TRAFFIC RATED LID.	
8	STORM DRAIN/EXIST.	WATER LINE CROSSING. PER UDACS PLATE NO. 23 SEE SHEET C5.05.	
9	INSTALL	SEWER BACK VALVE WATER VALVE SAME SIZE AS LINE SHOWN.	

FIRE FLOW INFORMATION BLOCK

USE/OCCUPANCY M

TYPE OF CONSTRUCTION V-B

FIRE FLOW 1500 GPM @ 20 PSI

AUTOMATIC FIRE SPRINKLERS X YES/NO
NFPA 13 X 130 130
ESFR YES/NO

SQAURE FOOTAGE 12,900

LARGEST AREA BETWEEN 4 HOUR WALLS NO

BUILDING HEIGHT 28'

OF STORIES INCLUDING BASEMENT 1

HIGH PILED COMBUSTIBLE STORAGE YES/NO X

OF HYDRANTS INSTALLED 2

1st Submitted 10/24/16 APPROVED FOR CONSTRUCTION
 L.A.S. VEGAS VALLEY WATER DISTRICT ENGINEERING SERVICES MANAGER
 DATE: 5/3/17 PROJECT NO: 124663
 LVWDMD APPROVED FIRE FLOW 1875 GPM AT 20 PSI RESIDUAL
 SHEETS: C1.01, C1.02, C4.05, C4.06, C4.07, C4.09, C4.10, C4.11, C4.12, C4.13,
 C5.01, C5.02, C5.03, C5.04, (C5.05, C5.12 NDOT).

UDACS NOTE
ALL WATER FACILITIES CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE "UNIFORM DESIGN AND CONSTRUCTION STANDARDS FOR POTABLE WATER DISTRIBUTION SYSTEMS" UDACS, LATEST EDITION.

ALL NON-POTABLE FIRE WATER LINES CROSSING POTABLE DOMESTIC WATER LINES ARE TO BE INSTALLED WITH A "VERTICAL SEPARATION OF NO LESS THAN SIX INCHES..." AND IN ACCORDANCE WITH THE UDACS 2.23.01, 2.04.03, 2.22.02.B1, AND 2.22.02.B2.

107V6734

CALL BEFORE YOU DIG
AVOID CUTTING UNDERGROUND
UTILITY LINES. IT'S COSTLY

Call
811
or
1-800-227-2600




COLLINS ENGINEERS ASSUMES NO RESPONSIBILITY FOR EXISTING UTILITY LOCATIONS AND ELEVATIONS. THE UTILITIES SHOWN ON THIS DRAWING HAVE BEEN PLOTTED FROM THE BEST AVAILABLE INFORMATION. IT IS, HOWEVER, THE CONTRACTOR'S RESPONSIBILITY TO FIELD VERIFY THE LOCATION AND ELEVATION OF ALL UTILITIES PRIOR TO THE COMMENCEMENT OF ANY CONSTRUCTION. CONTRACTOR TO FIELD VERIFY ALL EXISTING SITE CONDITIONS PRIOR TO CONSTRUCTION. IF A CONFLICT EXISTS BETWEEN WHAT IS SHOWN ON THESE DRAWINGS AND WHAT EXISTS IN THE FIELD, THE CONTRACTOR IS TO NOTIFY THE ARCHITECT OR ENGINEER IMMEDIATELY.

NDOT PERMIT REQUIRED. CONTRACTOR TO OBTAIN NDOT OCCUPANCY PERMIT PRIOR TO CONSTRUCTION IN NDOT RIGHT OF WAY

[illegible]

H:\CAD\LAND\4136-DELTA\DWG\SHEETS\4136-C5.01-UTIL-D.DWG 04/27/2017 02:21:26 PM

**COLLINS
ENGINEERS^{PC}**
1130 S. DURANGO DR., SUITE 404
LAS VEGAS, NV 89117
PHONE: (702) 248-8000
FAX: (702) 248-8070
www.collinsengr.com

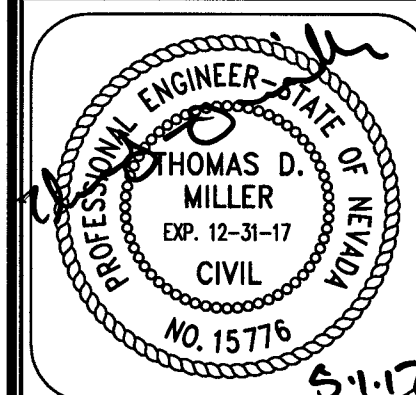

IMPROVEMENT PLANS FOR DC PLAZA

APN:125-17-613-001

UTILITY PLANS

8451 FARM ROAD
LAS VEGAS, NEVADA