


1	PROP. 6" PE MAIN
2	PROP. 6" VALVE (120-8545)
3	PROP. 6" PE COUPLING (140-3445)
4	PROP. 6"x1/2" SVC TEE (160-8058)
5	PROP. 4" PE MAIN
6	PROP. 4" PE VALVE (120-8604)
7	PROP. 4" PE COUPLING (140-3530)
8	PROP. 4"x1/2" SVC TEE (160-8246)

1	ABANDON EX. 6" PE '02 MOP 55#	5'
2	ABANDON EX. 4" PE '01 MOP 55#	2'

1. GAS MAINS SHALL BE PURGED PER OPERATION MANUAL.
2. ALL PIPELINE CONSTRUCTION SHALL CONFORM TO APPLICABLE JURISDICTION SPECIFICATIONS.
3. DO NOT SCALE THIS DRAWING.
4. ALL VALVES TO HAVE STANDS WITH COVERS.
5. WORK AREAS WILL BE 5' X 15' UNLESS OTHERWISE NOTED.
6. ALL VALVE ASSEMBLIES WILL BE A MAXIMUM OF 10' FEET IN LENGTH UNLESS OTHERWISE NOTED OR REQUIRED.
7. TRENCH AND BACKFILL, CONFORM WITH UNIFORM STANDARDS, SPECS, SECTION 208 AND RTC STANDARD 503.
8. STREETS GREATER THAN 60' RIGHT-OF-WAY LONGITUDINAL CUT OVER 5 YEARS OLD, COMPLY WITH RTC STANDARD 500.3.
9. STREETS LESS THAN 60' RIGHT-OF-WAY LONGITUDINAL CUT OVER 5 YEARS OLD, COMPLY WITH RTC STANDARD 500.4.
10. PROTECT EXISTING VALLEY GUTTERS IN PLACE WHEN CROSSING. BORE DO NOT CUT.
11. CAUTION: HIGH PRESSURE GAS/CALL SOUTHWEST GAS AT 702-651-2111 48 HOURS IN ADVANCE FOR STANDBY WHEN EXCAVATING OVER OR NEAR HIGH PRESSURE GAS LINES.

PAVEMENT REPAIR SHALL CONFORM TO RTC:
STANDARD(S):

A1 500.3

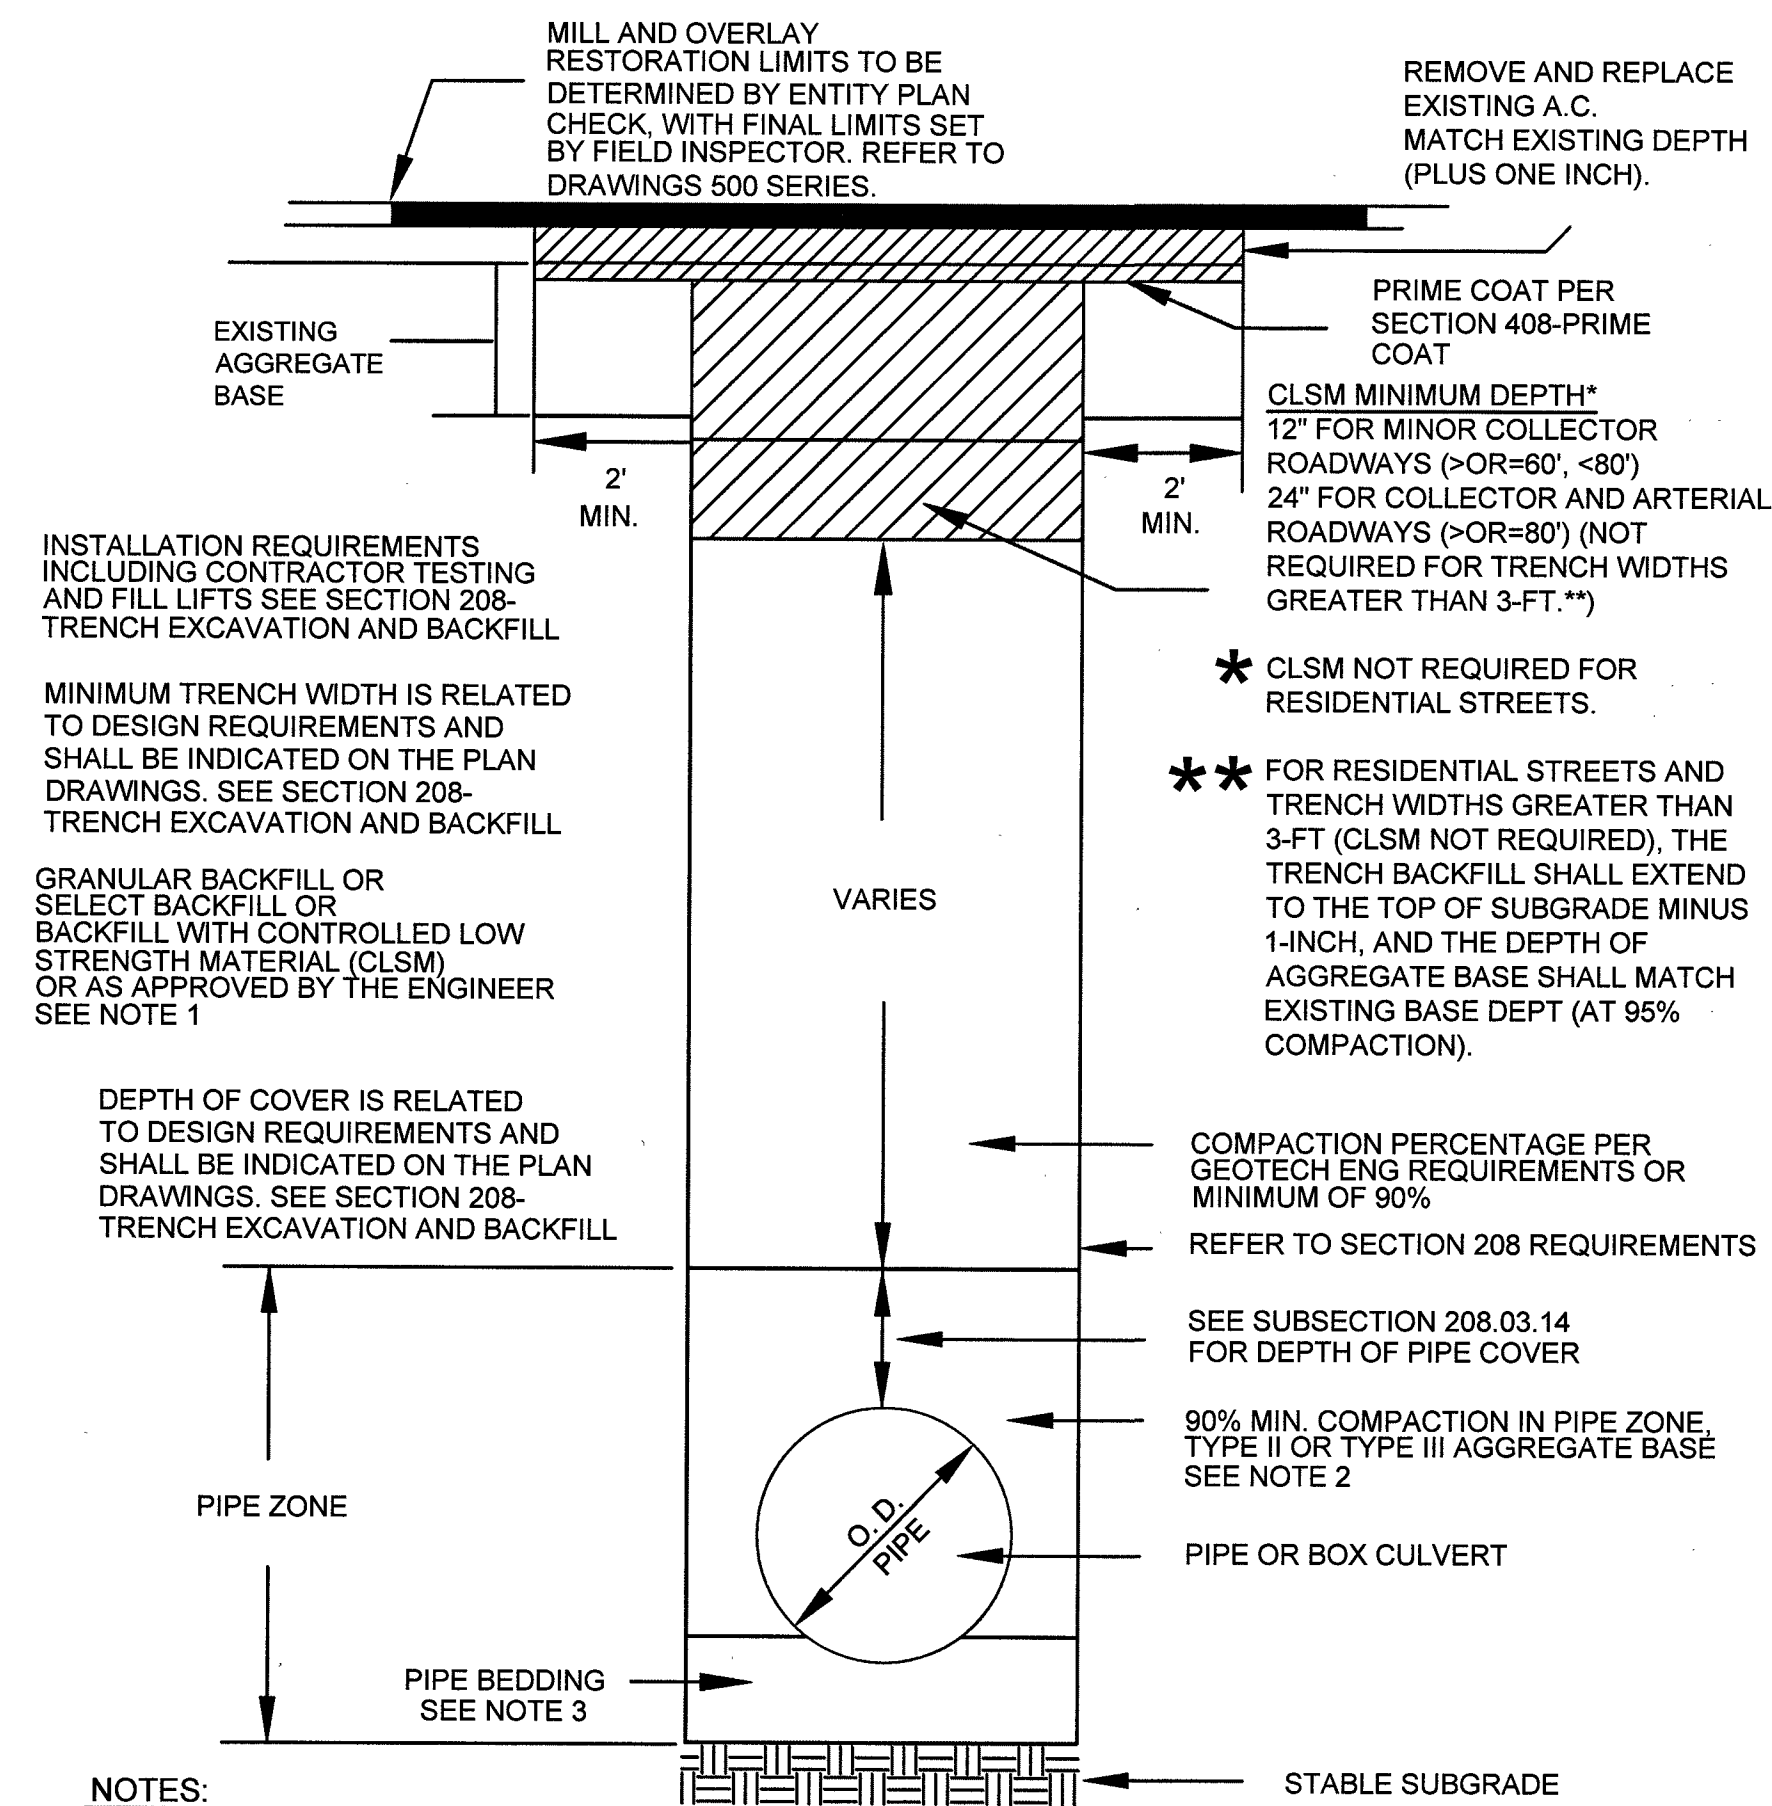

1. NO STONES OR LUMPS GREATER THAN 3" PERMITTED IN TRENCH 2' OR LESS IN WIDTH.
2. TRENCH WIDTH, BEDDING, SUBGRADE AND PIPE ZONE REQUIREMENTS FOR UTILITY INSTALLATIONS SHALL CONFORM TO THE RESPECTIVE ENTITY REQUIREMENTS.
3. CRUSHED ROCK MAY BE USED FOR PIPE BEDDING ONLY IF MATERIAL USE HAS BEEN SPECIFICALLY APPROVED BY THE GOVERNING AGENCY. SEE STANDARD DRAWING NO. 505 FOR PIPE BEDDING METHODS.
4. LAS VEGAS VALLEY WATER DISTRICT REQUIRES PIPE BEDDING AND BACKFILL WITHIN THE PIPE ZONE TO BE OF THE SAME MATERIAL.

RTC STD DWG 503



PRINT: _____ DATE: _____

SIGNATURE: _____

1.						3800106	6" PE		5'	5'		
2.						3800104	4" PE		2'	2'		
3.												
4.												
NO.	DESCRIPTION	BY	DATE	APPVD								
REVISIONS												
 SOUTHWEST GAS CORPORATION												
					TAX CODES	UNIT NO.	UNIT TYPE	INSTL.	RETIRED	INSTL.	RETIRED	
					PROPOSED				COMPLETED			
PROPERTY UNITS												



AS-BUILT DRAWING-PRESSURE TEST DATA	
PIPE DIA. _____	☐ AIR ☐ GAUGE
PIPE LENGTH _____	☐ NITROGEN ☐ CHART
PIPE TYPE _____	☐ WATER GAUGE/ ☐ SOAP PRESS REC SN#
MIN. DURATION _____	START _____ END _____
TEST PRES. (PSIG) _____	
TIME _____	
DATE _____	
PERFORMED BY _____	

VISUAL INSPECTION CERTIFICATION	
I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT I HAVE PERFORMED	
NAME _____	DATE _____
INSPECTOR _____	
FOREMAN _____	
REVIEWED BY _____	
AS-BUILTS ACCEPTED BY _____ DATE _____	
POSTED BY _____	DATE _____
POSTING QC'D BY _____	DATE _____

CONSTRUCTION	
INSPECTOR _____	
FOREMAN _____	
REVIEWED BY _____	
PERMIT INFORMATION	
CITY OF LAS VEGAS	
TAX CODE 02-0200	

ISOLATION AREA	W.R. NO.
323 324	2016450
LOCATION	ATLAS #/TITLE #
T20S R59E SEC 27 M.D.M.	x567y520 x567y518

ENGINEER/TECH: JAMES FRAME	PHONE: 702-365-2172
ACCOUNT REP: _____	PHONE: _____
PROJECT CONTACT: JAMES FRAME	PHONE: 702-365-2172
SHEET NO.: 2 OF 4	SCALE: N.T.S.
DWN. BY: ZONE ENG	CHKD. BY: _____
	APPVD. BY: _____
TITLE	
ISOLATION SEPARATION AREAS 323 & 324	

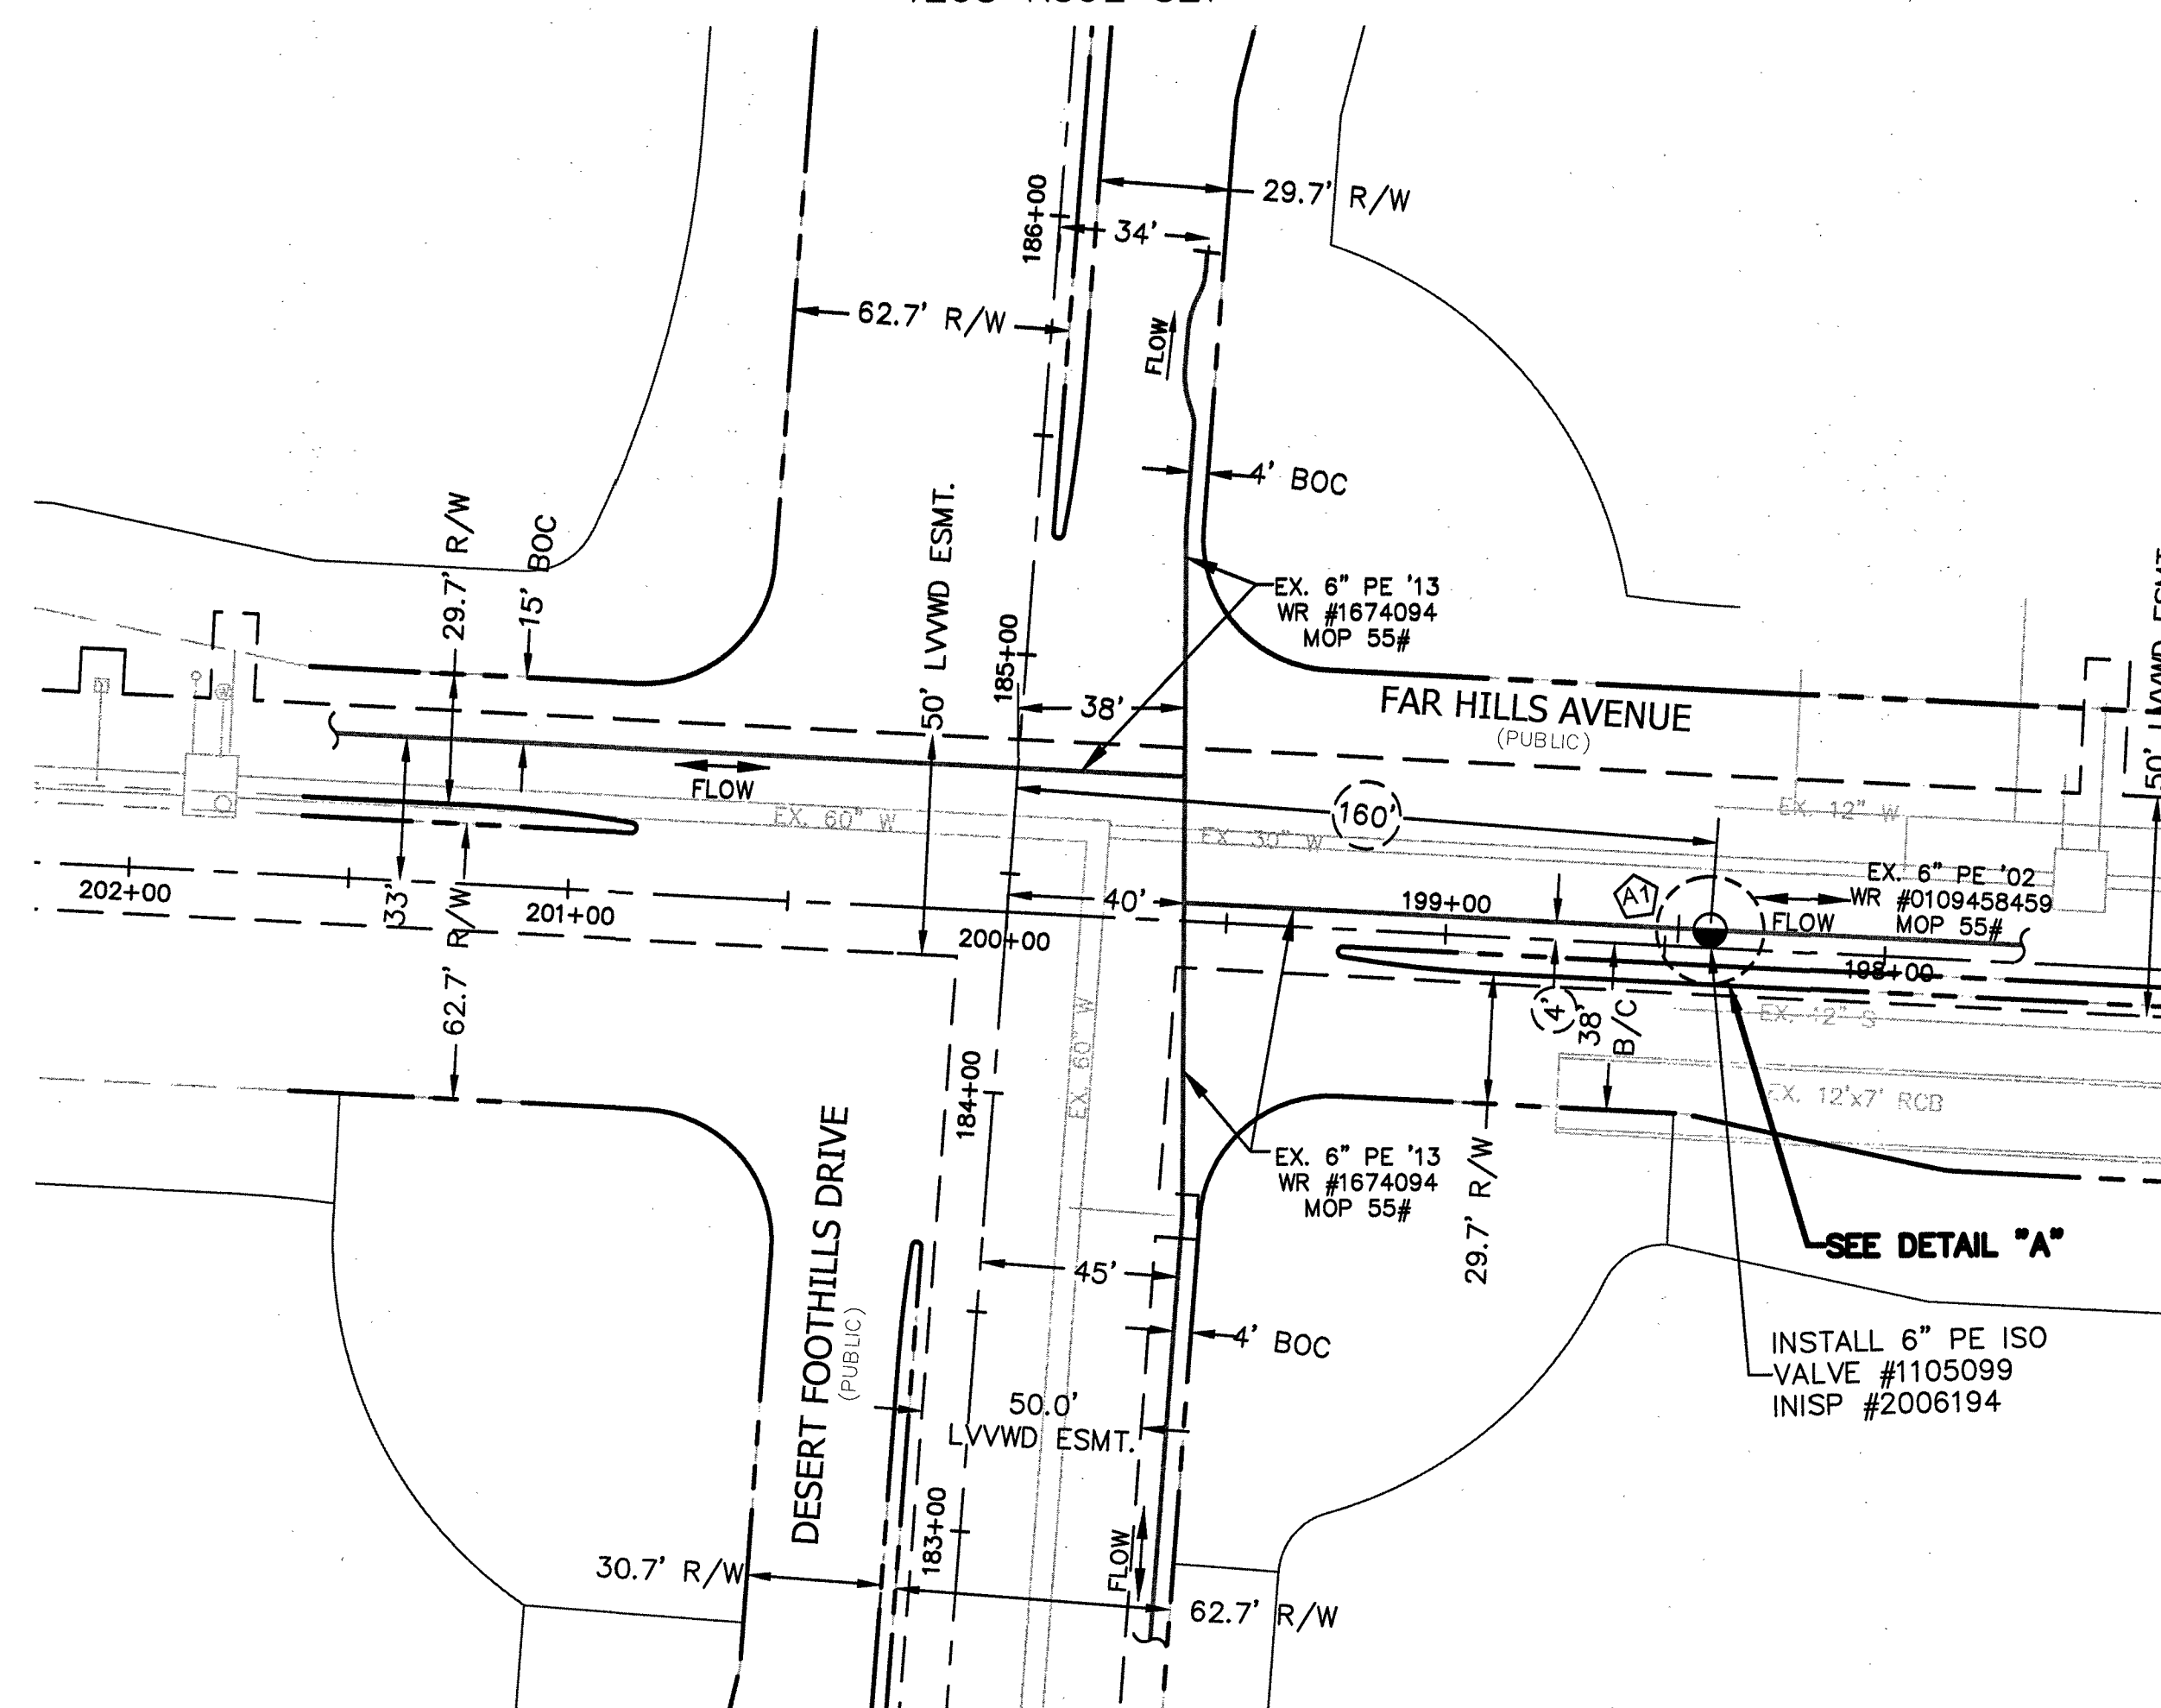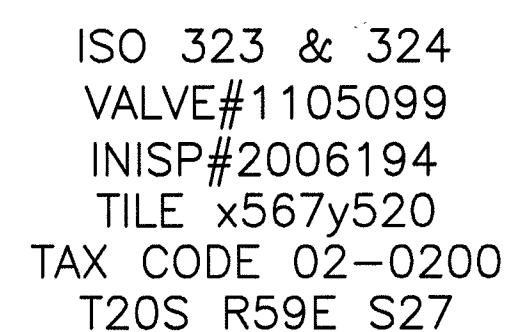


1	PROP. 6" PE MAIN
2	PROP. 6" VALVE (120-8545)
3	PROP. 6" PE COUPLING (140-3445)
4	PROP. 6"x1/2" SVC TEE (160-8058)

1 ABANDON EX. 6" PE '02 MOP 55#



PAVEMENT REPAIR SHALL CONFORM TO RTC:
STANDARD(S):

A1 500.3

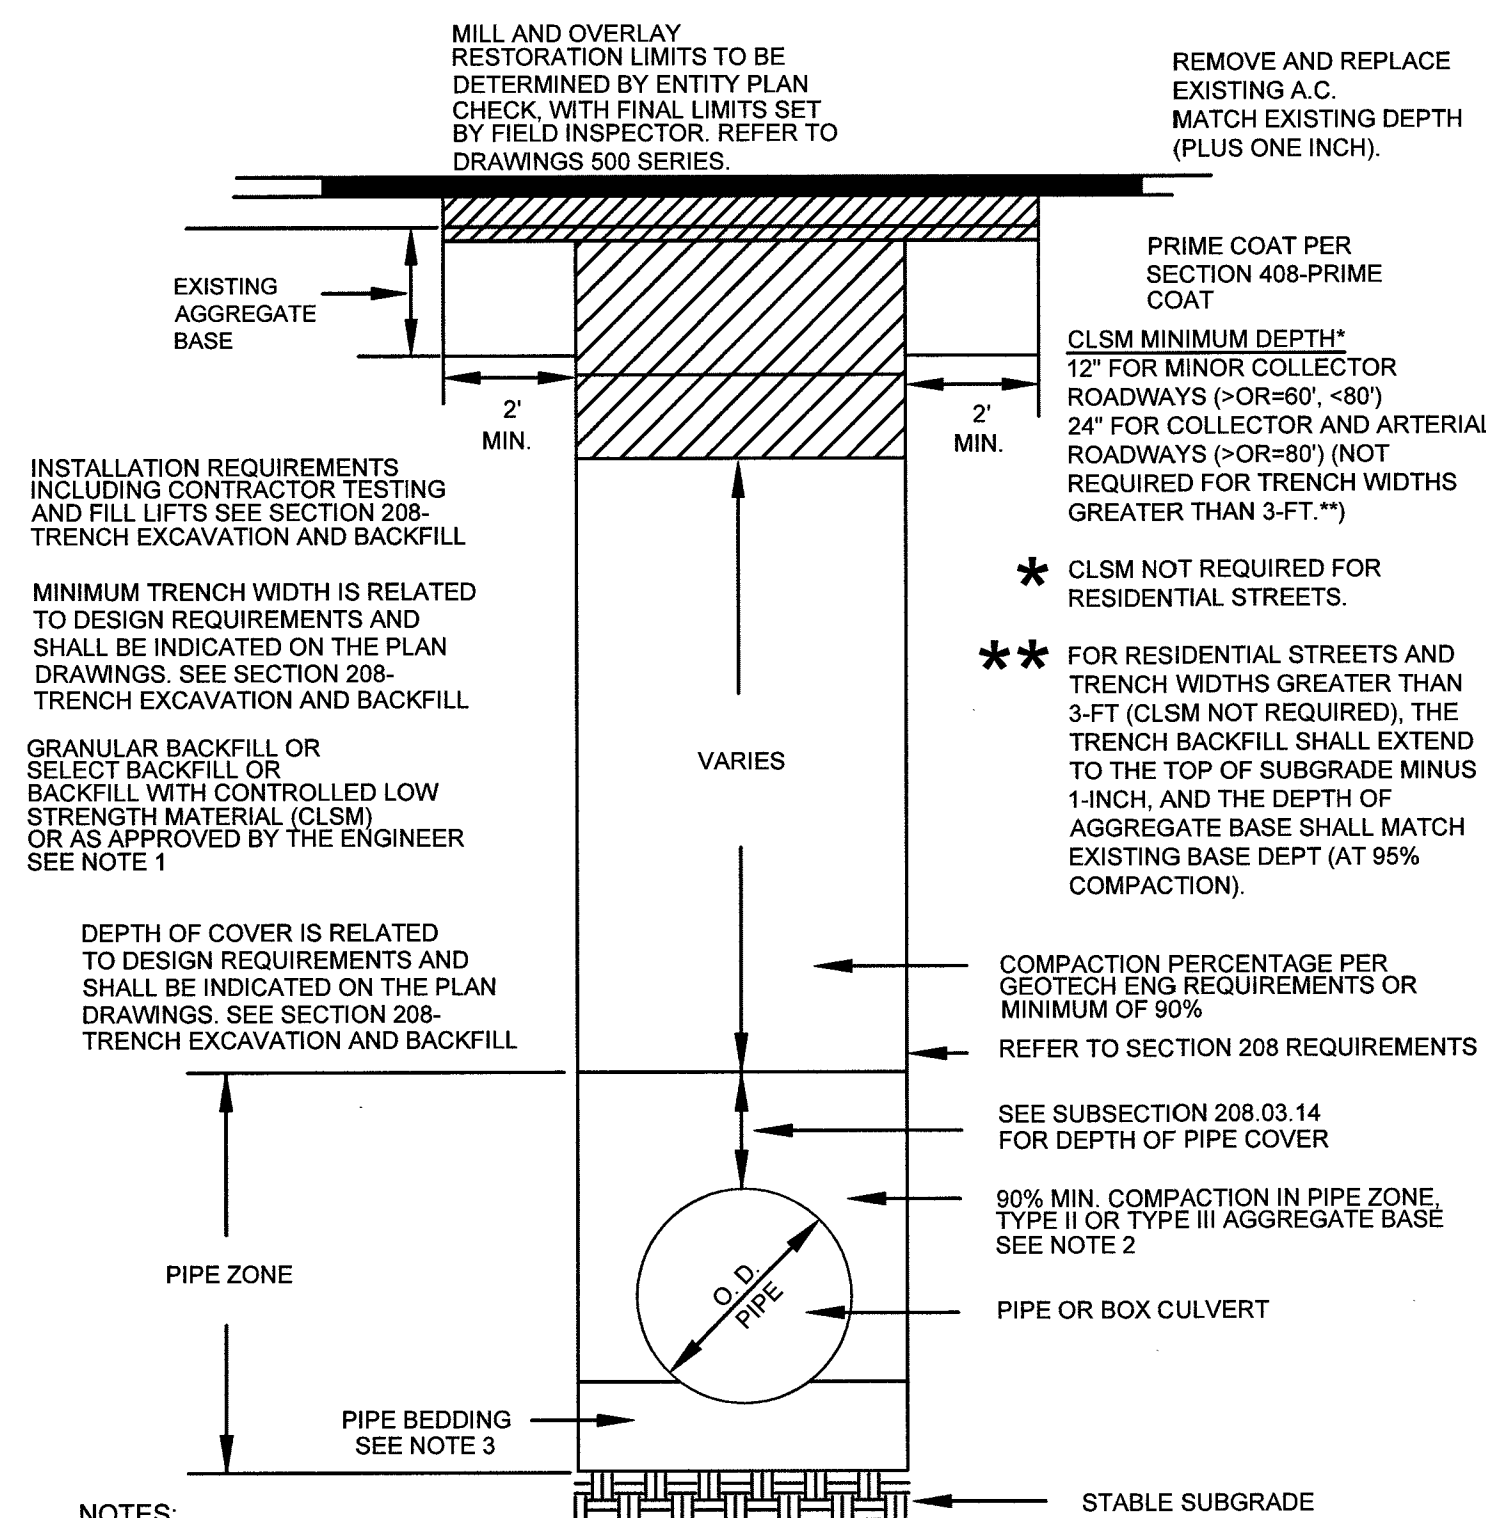

1. NO STONES OR LUMPS GREATER THAN 3" PERMITTED IN TRENCH 2' OR LESS IN WIDTH.
2. TRENCH WIDTH, BEDDING, SUBGRADE AND PIPE ZONE REQUIREMENTS FOR UTILITY INSTALLATIONS SHALL CONFORM TO THE RESPECTIVE ENTITY REQUIREMENTS.
3. CRUSHED ROCK MAY BE USED FOR PIPE BEDDING ONLY IF MATERIAL USE HAS BEEN SPECIFICALLY APPROVED BY THE GOVERNING AGENCY. SEE STANDARD DRAWING NO. 505 FOR PIPE BEDDING.
4. LAS VEGAS VALLEY WATER DISTRICT REQUIRES PIPE BEDDING AND BACKFILL WITHIN THE PIPE ZONE BE THE SAME MATERIAL.

RTC STD DWG 503

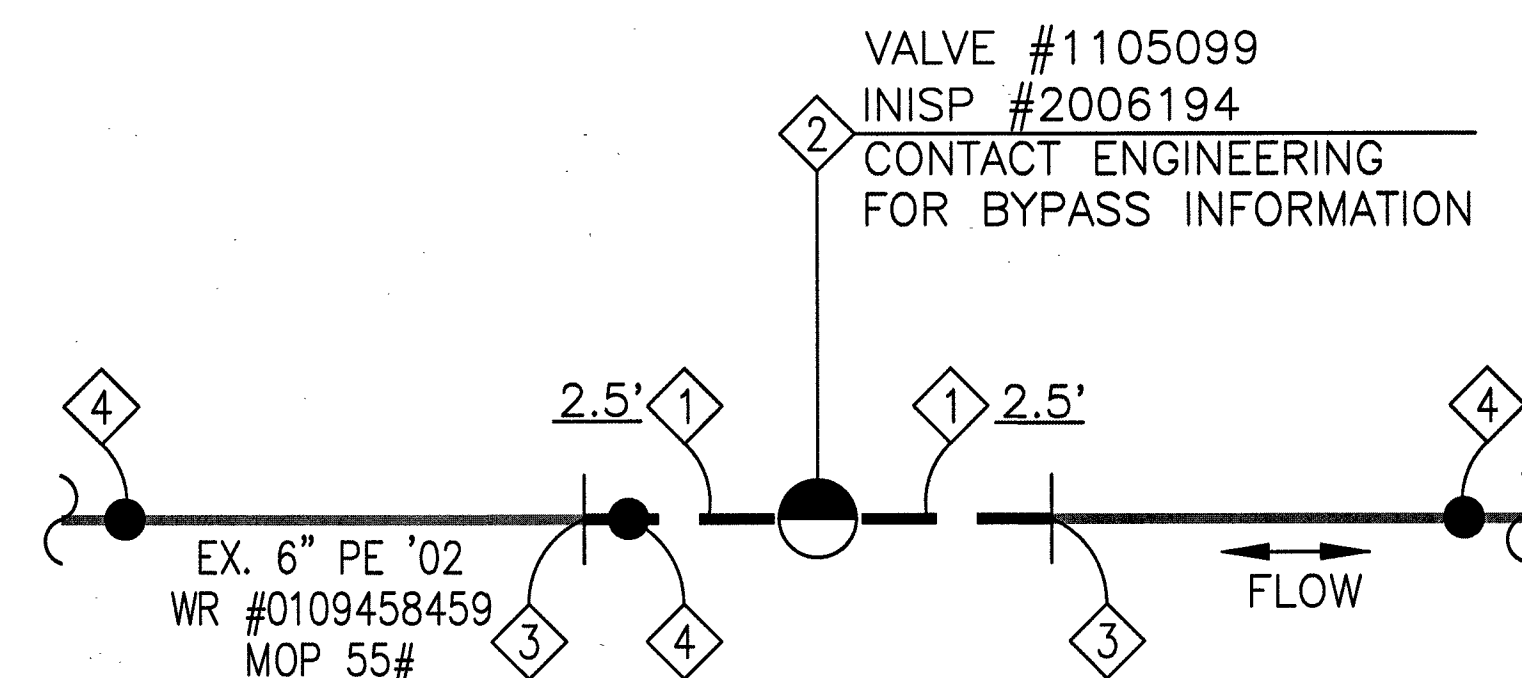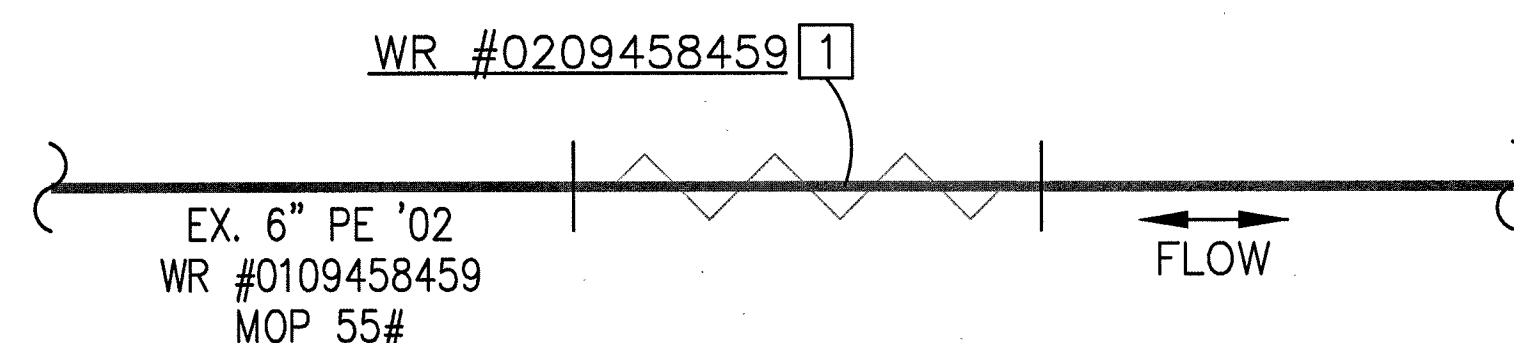


VALVE #1105099
INISIP #2006194
CONTACT ENGINEERING
FOR BYPASS INFORMATION

SYSTEM	D_W_VALLEY
DR. NO.	21DR10002580
SEGMENT M.A.O.P.	N/A
SYSTEM M.A.O.P.	60
SYSTEM M.O.P.	55




811
Know what's **below.**
Call before you dig

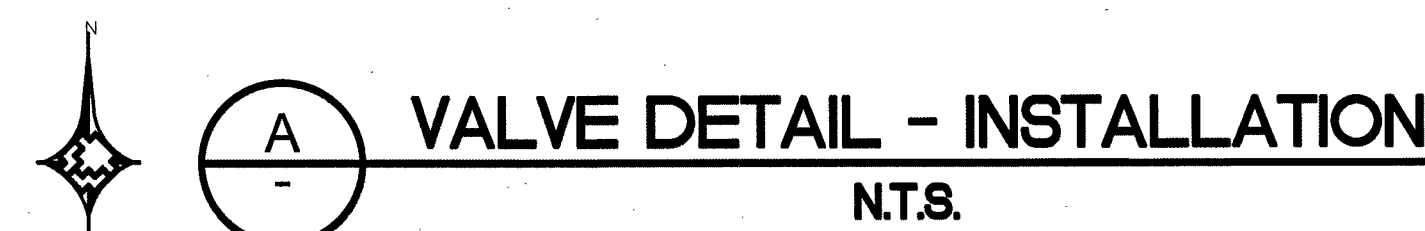

AS-BUILT DRAWING-PRESSURE TEST DATA

		TEST MEDIUM		TEST METHOD	
PIPE DIA.	_____	☐ AIR		☐ GAUGE	
PIPE LENGTH	_____	☐ NITROGEN		☐ CHART	
PIPE TYPE	_____	☐ WATER		☐ GAUGE/	
		☐ SOAP		PRESS REC SN#	
MIN. DURATION	_____	START		END	
TEST PRES. (PSIG)	_____	_____		_____	
TIME	_____	_____		_____	
DATE	_____	_____		_____	
PERFORMED BY	_____	_____		_____	

[illegible]

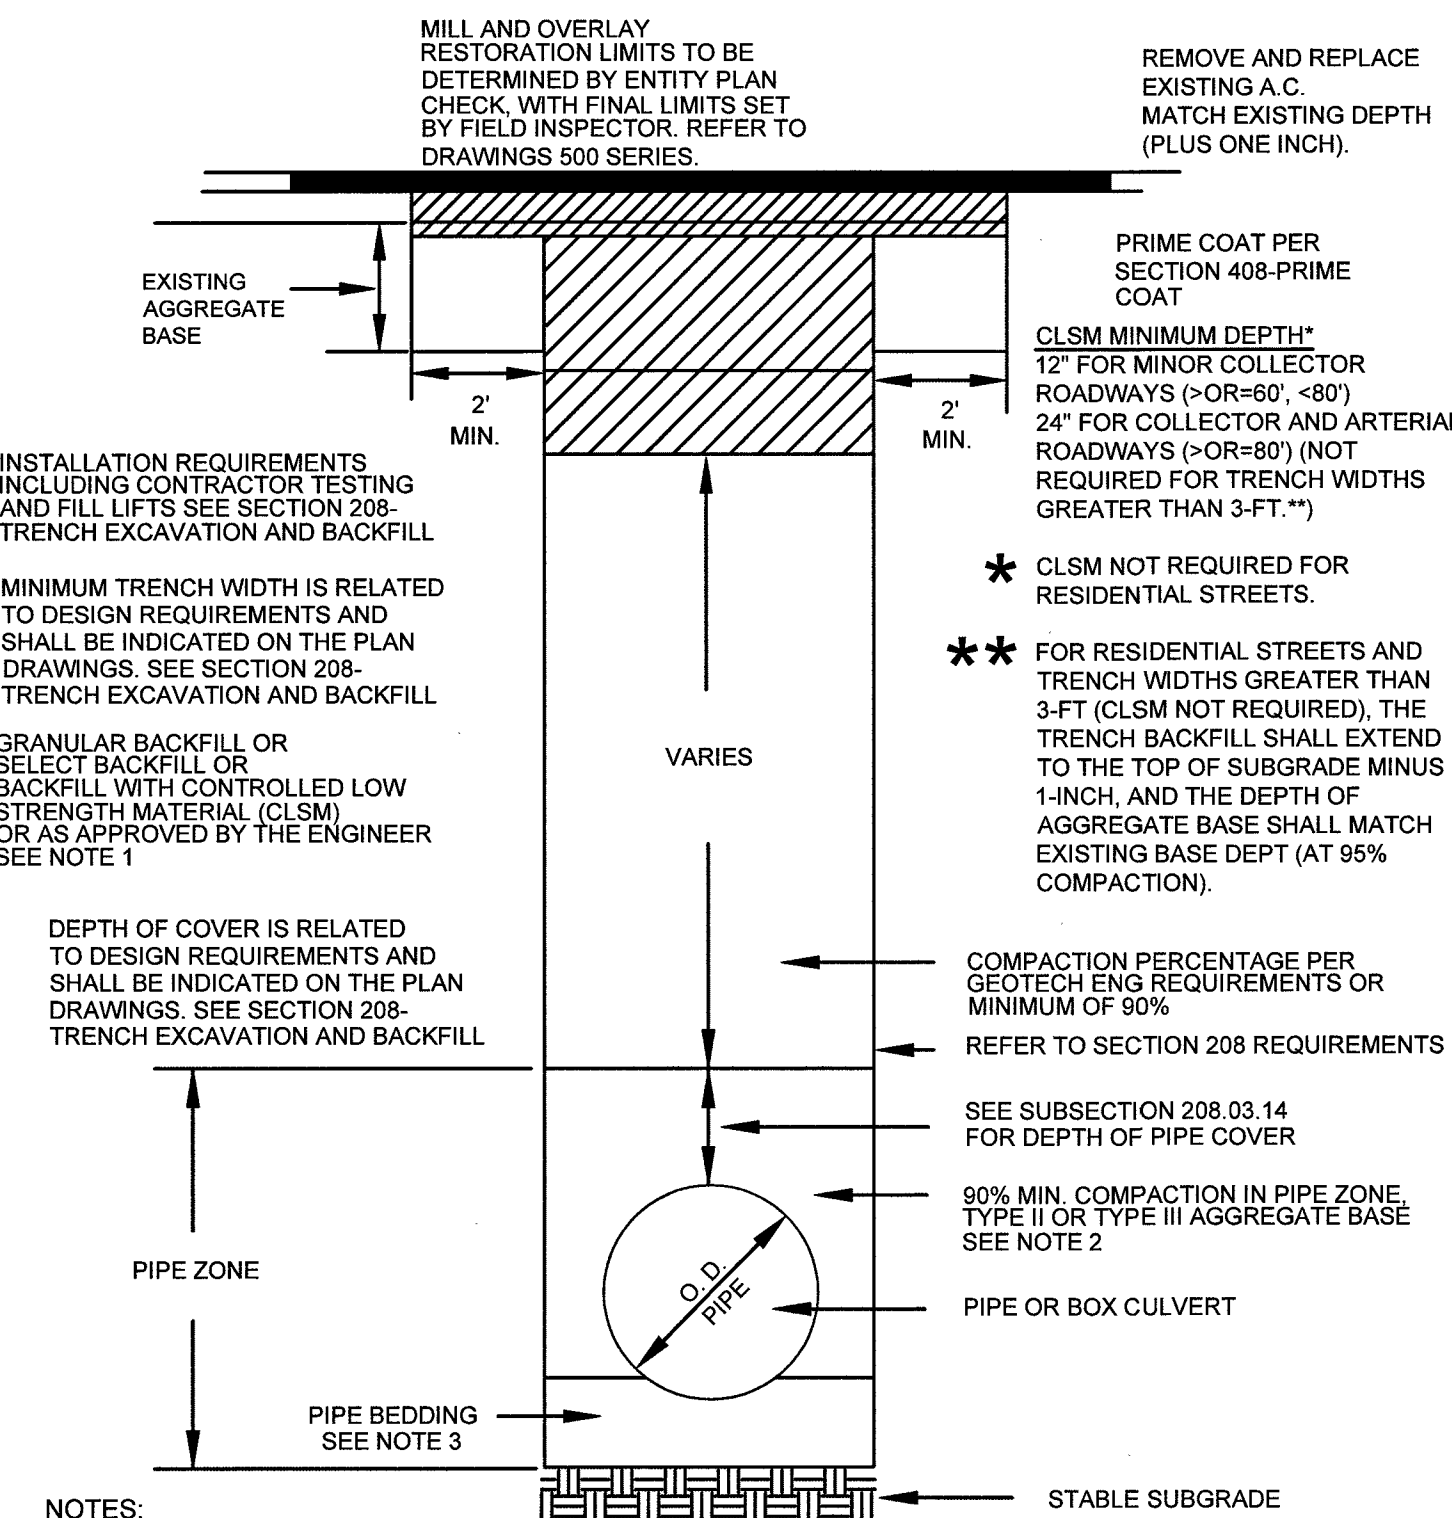


5 PROP. 4" PE
6 PROP. 4" PE VALVE (120-8604)
7 PROP. 4" PE COUPLING (140-3530)
8 PROP. 4"x1/2" SVC TEE (160-8246)


2 ABANDON EX. 4" PE '01 MOP 55#

PAVEMENT REPAIR SHALL CONFORM TO RTC:
STANDARD(S):
A1 500.3

RTC STD DWG 503

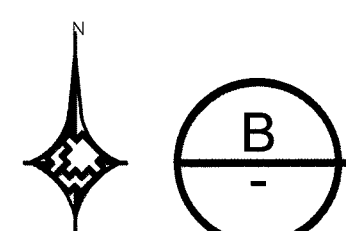

VALVE DETAIL - ABANDONMENT
NTS.

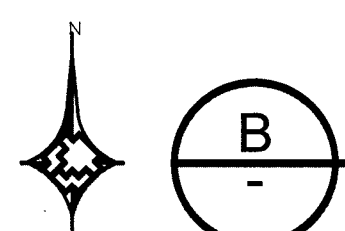

VALVE DETAIL - INSTALLATION

SYSTEM	D_W_VALLEY
DR. NO.	21DR10002580
SEGMENT M.A.O.P.	N/A
SYSTEM M.A.O.P.	60
SYSTEM M.O.P.	55

AS-BUILT DRAWING-PRESSURE TEST DATA			
PIPE DIA. _____	TEST MEDIUM ☐ AIR	TEST METHOD ☐ GAUGE	
PIPE LENGTH _____	☐ NITROGEN	☐ CHART	
PIPE TYPE _____	☐ WATER	☐ GAUGE/ PRESS REC SN#	
MIN. DURATION _____	START _____	END _____	
TEST PRES. (PSIG) _____			
TIME _____			
DATE _____			
PERFORMED BY _____			



SOUTHWEST GAS CORPORATION A DIVISION OF SOUTHWEST ENERGY SERVICES, INC.												<table><tr><td>1.</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>2.</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>3.</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>4.</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>NO.</td><td colspan="4">DESCRIPTION</td><td>BY</td><td colspan="2">DATE</td><td colspan="2">APPVD</td><td colspan="2"></td></tr><tr><td colspan="12">REVISIONS</td></tr><tr><td colspan="12">PROPERTY UNITS</td></tr><tr><td>TAX CODES</td><td>UNIT NO.</td><td>UNIT TYPE</td><td>INSTL.</td><td>RETIRED</td><td>INSTL.</td><td>RETIRED</td><td colspan="5"></td></tr><tr><td colspan="3"></td><td>PROPOSED</td><td>COMPLETED</td><td colspan="7"></td></tr></table>												1.												2.												3.												4.												NO.	DESCRIPTION				BY	DATE		APPVD				REVISIONS												PROPERTY UNITS												TAX CODES	UNIT NO.	UNIT TYPE	INSTL.	RETIRED	INSTL.	RETIRED									PROPOSED	COMPLETED																																																																																											
1.																																																																																																																																																																																																																							
2.																																																																																																																																																																																																																							
3.																																																																																																																																																																																																																							
4.																																																																																																																																																																																																																							
NO.	DESCRIPTION				BY	DATE		APPVD																																																																																																																																																																																																															
REVISIONS																																																																																																																																																																																																																							
PROPERTY UNITS																																																																																																																																																																																																																							
TAX CODES	UNIT NO.	UNIT TYPE	INSTL.	RETIRED	INSTL.	RETIRED																																																																																																																																																																																																																	
			PROPOSED	COMPLETED																																																																																																																																																																																																																			
<table><tr><th colspan="12">AS-BUILT DRAWING-PRESSURE TEST DATA</th></tr><tr><td colspan="2">PIPE DIA. _____</td><td colspan="2">TEST MEDIUM ☐ AIR ☐ GAUGE</td><td colspan="8"></td></tr><tr><td colspan="2">PIPE LENGTH _____</td><td colspan="2">☐ NITROGEN ☐ CHART</td><td colspan="8"></td></tr><tr><td colspan="2">PIPE TYPE _____</td><td colspan="2">☐ WATER ☐ GAUGE/</td><td colspan="8"></td></tr><tr><td colspan="2">MIN. DURATION _____</td><td colspan="2">☐ SOAP ☐ PRESS REC SN#</td><td colspan="8"></td></tr><tr><td colspan="2"></td><td colspan="2">START</td><td colspan="8">END</td></tr><tr><td colspan="2">TEST PRES. (PSIG) _____</td><td colspan="10"></td></tr><tr><td colspan="2">TIME _____</td><td colspan="10"></td></tr><tr><td colspan="2">DATE _____</td><td colspan="10"></td></tr><tr><td colspan="2">PERFORMED BY _____</td><td colspan="10"></td></tr></table>												AS-BUILT DRAWING-PRESSURE TEST DATA												PIPE DIA. _____		TEST MEDIUM ☐ AIR ☐ GAUGE										PIPE LENGTH _____		☐ NITROGEN ☐ CHART										PIPE TYPE _____		☐ WATER ☐ GAUGE/										MIN. DURATION _____		☐ SOAP ☐ PRESS REC SN#												START		END								TEST PRES. (PSIG) _____												TIME _____												DATE _____												PERFORMED BY _____												<table><tr><th colspan="12">VISUAL INSPECTION CERTIFICATION</th></tr><tr><td colspan="12">I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT I HAVE PERFORMED</td></tr><tr><td colspan="4">NAME _____</td><td colspan="8">DATE _____</td></tr><tr><td colspan="12">AS-BUILTS ACCEPTED BY _____ DATE _____</td></tr><tr><td colspan="4">POSTED BY _____</td><td colspan="8">DATE _____</td></tr><tr><td colspan="4">POSTING QC'D BY _____</td><td colspan="8">DATE _____</td></tr></table>												VISUAL INSPECTION CERTIFICATION												I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT I HAVE PERFORMED												NAME _____				DATE _____								AS-BUILTS ACCEPTED BY _____ DATE _____												POSTED BY _____				DATE _____								POSTING QC'D BY _____				DATE _____							
AS-BUILT DRAWING-PRESSURE TEST DATA																																																																																																																																																																																																																							
PIPE DIA. _____		TEST MEDIUM ☐ AIR ☐ GAUGE																																																																																																																																																																																																																					
PIPE LENGTH _____		☐ NITROGEN ☐ CHART																																																																																																																																																																																																																					
PIPE TYPE _____		☐ WATER ☐ GAUGE/																																																																																																																																																																																																																					
MIN. DURATION _____		☐ SOAP ☐ PRESS REC SN#																																																																																																																																																																																																																					
		START		END																																																																																																																																																																																																																			
TEST PRES. (PSIG) _____																																																																																																																																																																																																																							
TIME _____																																																																																																																																																																																																																							
DATE _____																																																																																																																																																																																																																							
PERFORMED BY _____																																																																																																																																																																																																																							
VISUAL INSPECTION CERTIFICATION																																																																																																																																																																																																																							
I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT I HAVE PERFORMED																																																																																																																																																																																																																							
NAME _____				DATE _____																																																																																																																																																																																																																			
AS-BUILTS ACCEPTED BY _____ DATE _____																																																																																																																																																																																																																							
POSTED BY _____				DATE _____																																																																																																																																																																																																																			
POSTING QC'D BY _____				DATE _____																																																																																																																																																																																																																			
<table><tr><th colspan="12">CONSTRUCTION</th></tr><tr><td colspan="4">INSPECTOR _____</td><td colspan="8"></td></tr><tr><td colspan="4">FOREMAN _____</td><td colspan="8"></td></tr><tr><td colspan="4">REVIEWED BY _____</td><td colspan="8"></td></tr><tr><th colspan="12">PERMIT INFORMATION</th></tr><tr><td colspan="12">CITY OF LAS VEGAS</td></tr><tr><td colspan="4">TAX CODE 02-0200</td><td colspan="8"></td></tr></table>												CONSTRUCTION												INSPECTOR _____												FOREMAN _____												REVIEWED BY _____												PERMIT INFORMATION												CITY OF LAS VEGAS												TAX CODE 02-0200												<table><tr><th colspan="2">ISOLATION AREA</th><th colspan="2">W.R. NO.</th></tr><tr><td colspan="2">323 324</td><td colspan="2">2016450</td></tr><tr><th colspan="2">LOCATION</th><th colspan="2">ATLAS #/TITLE #</th></tr><tr><td colspan="2">T20S R59E SEC 27 M.D.M.</td><td colspan="2">x567y520 x567y518</td></tr></table>				ISOLATION AREA		W.R. NO.		323 324		2016450		LOCATION		ATLAS #/TITLE #		T20S R59E SEC 27 M.D.M.		x567y520 x567y518		<table><tr><td colspan="4">ENGINEER/TECH: JAMES FRAME</td><td colspan="4">PHONE: 702-365-2172</td></tr><tr><td colspan="4">ACCOUNT REP: _____</td><td colspan="4">PHONE: _____</td></tr><tr><td colspan="4">PROJECT CONTACT: JAMES FRAME</td><td colspan="4">PHONE: 702-365-2172</td></tr><tr><td colspan="2">SHEET NO: 4 OF 4</td><td colspan="2">SCALE: N.T.S.</td><td colspan="2">DATE: 5/16/17</td><td colspan="2"></td></tr><tr><td colspan="2">DWN. BY: ZONE ENG</td><td colspan="2">CHKD. BY: _____</td><td colspan="2">APPVD. BY: _____</td><td colspan="2"></td></tr><tr><td colspan="8">TITLE</td></tr><tr><td colspan="8">ISOLATION SEPARATION AREAS 323 & 324</td></tr></table>				ENGINEER/TECH: JAMES FRAME				PHONE: 702-365-2172				ACCOUNT REP: _____				PHONE: _____				PROJECT CONTACT: JAMES FRAME				PHONE: 702-365-2172				SHEET NO: 4 OF 4		SCALE: N.T.S.		DATE: 5/16/17				DWN. BY: ZONE ENG		CHKD. BY: _____		APPVD. BY: _____				TITLE								ISOLATION SEPARATION AREAS 323 & 324																																															
CONSTRUCTION																																																																																																																																																																																																																							
INSPECTOR _____																																																																																																																																																																																																																							
FOREMAN _____																																																																																																																																																																																																																							
REVIEWED BY _____																																																																																																																																																																																																																							
PERMIT INFORMATION																																																																																																																																																																																																																							
CITY OF LAS VEGAS																																																																																																																																																																																																																							
TAX CODE 02-0200																																																																																																																																																																																																																							
ISOLATION AREA		W.R. NO.																																																																																																																																																																																																																					
323 324		2016450																																																																																																																																																																																																																					
LOCATION		ATLAS #/TITLE #																																																																																																																																																																																																																					
T20S R59E SEC 27 M.D.M.		x567y520 x567y518																																																																																																																																																																																																																					
ENGINEER/TECH: JAMES FRAME				PHONE: 702-365-2172																																																																																																																																																																																																																			
ACCOUNT REP: _____				PHONE: _____																																																																																																																																																																																																																			
PROJECT CONTACT: JAMES FRAME				PHONE: 702-365-2172																																																																																																																																																																																																																			
SHEET NO: 4 OF 4		SCALE: N.T.S.		DATE: 5/16/17																																																																																																																																																																																																																			
DWN. BY: ZONE ENG		CHKD. BY: _____		APPVD. BY: _____																																																																																																																																																																																																																			
TITLE																																																																																																																																																																																																																							
ISOLATION SEPARATION AREAS 323 & 324																																																																																																																																																																																																																							