


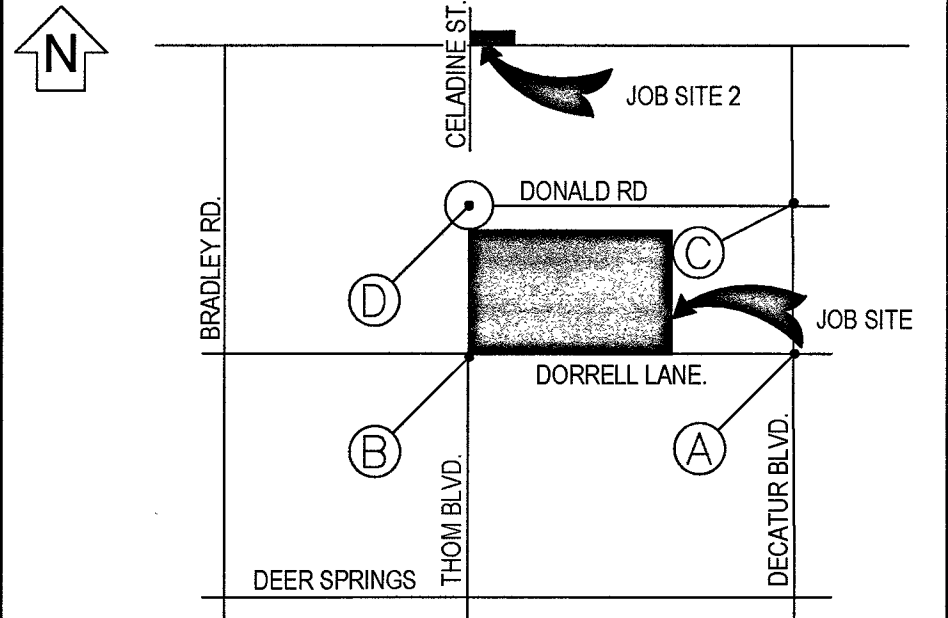

(NOT TO SCALE)

AVOID HITTING OVERHEAD POWER LINES. IT'S COSTLY.  CALL BEFORE YOU DO OVERHEAD CALL 1-702-402-2929	Call before you Dig Avoid cutting underground utility lines. It's costly. CALL  OR 1-800-227-2600 AND CLARK COUNTY TRAFFIC OPERATIONS 1-702-455-6000
--	---

[illegible]

PROJECT PURPOSE:
SERVE RESIDENTIAL SUBDIVISION
(57) HOMES, 320A 120/240V PANELS
STREETLIGHT, 200A 120/240V PEDESTAL
) IRRIGATION, 125A 120/240V PEDESTAL

NVEnergy INFORMATION:
COORDINATOR: STATON, STEVEN
PHONE: (702)332-9107
DESIGNER: YOSEF, NEAL D.F. J.M.
DCA: 285-8182, 219-5761 NORTH
INSPECTOR: 402-3008
STAND BY: 402-4114, 402-4117,402-4118
DISTRICT: LAS VEGAS NORTH

JPA INFORMATION:
JPA ADMIN PHONE: N/A JPA#: N/A

CUSTOMER INFORMATION:
APPLICANT: BEAZER HOMES HOLDINGS LLC
ENGINEER: N/A
CONTACT: DAVE WAGNER ** 702-376-0526
APPROVAL DATE: 01/30/2018

GOVERNMENT INFORMATION:
AGENCY: CITY OF LAS VEGAS
APPROVAL DATE: _____

FOR EACH SERVICE POINT (POINT OF DELIVERY), ENERGY FOR EACH TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. ENERGY FOR ALL NON-TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. CONTACT NVE METER OPERATIONS FOR MULTIPLE RATE CLASS INSTALLATIONS.

L17-00046-U002 10745067-1-WTL2	
PROJ. ID: 3002028151 SCALE: 1" = 30'	
SHEET # 3 OF 5 DATE: 10/05/2017	

1	500.1	0 TO 5 YEARS PAVEMENT RESTORATION LONGITUDINAL CUT
2	500.2	0 TO 5 YEARS PAVEMENT RESTORATION TRANSVERSE CUT
3	500.3	OVER 5 YEARS PAVEMENT RESTORATION LONGITUDINAL CUT. GREATER THAN 60' R.O.W
4	500.4	OVER 5 YRS PAVEMENT RESTORATION LONGITUDINAL CUT. 60' R.O.W OR LESS
5	500.5	OVER 5 YRS PAVEMENT RESTORATION TRANSVERSE ALL R.O.W WIDTHS
6	501.1	TYPICAL UNDERGROUND UTILITY LOCATIONS IN RESIDENTIAL STREETS 60' OR LESS R.O.W.
7	501.1	TYPICAL UTILITY UNDERGROUND LOCATIONS IN STREETS WITH GREATER THAN 60' R.O.W.
8	503	METHOD B FOR RIGID AND FLEXIBLE PIPE TRENCH BACKFILL - PAVED AREAS
9	503.1	METHOD A FOR FLEXIBLE PIPE TRENCH BACKFILL - PAVED AREAS
10		BACKFILL IN UNPAVED AREA AS REQUIRED BY LOCAL CODE OR AS APPROVED BY AGENCY.
12	234	SIDEWALK
13	506	UTILITY POTHOLE REPAIR
14	216	"L" TYPE CURB AND GUTTER

ENERGIZED CABLES...
CALL BEFORE YOU DIG

GOVERNMENT APPROVAL OF THESE DRAWINGS DOES NOT INDICATE APPROVAL OF TRAFFIC CONTROL.
PLEASE REFER TO THE BARRICADE PLAN FOR APPROVED TRAFFIC CONTROL REQUIREMENTS.

ALL SERVICE CONDUCTOR: 4/0 AL. TRI.
ALL TRANSFORMERS: 7200V-120/240V-1Ø PM
LARGEST A/C UNIT SIZE: 5 TONS
NUMBER OF UNITS: 57
MAIN SIZE: 320 AMPS
ESTIMATED KVA PER UNIT: 17 KVA
SQ. FT. OF LARGEST UNIT: 3703 FT²

APPROVED FOR CONSTRUCTION
 THIS APPROVAL IS FOR WORK IN CLV R/W & EASEMENT ONLY. OBTAINING PERMISSIONS OR EASEMENTS FOR WORK SHOWN ON PRIVATE PROPERTY IS THE RESPONSIBILITY OF THE UTILITY.

APPROVAL BY: Shawn Butts DATE: 3-26-18


CONTACT CLV LAND DEVELOPMENT (229-6371)
CLV CONSTRUCTION SERVICES MUST BE NOTIFIED
24 HOURS PRIOR TO COMMENCING CONSTRUCTION
(229-6337)

DATE _____


*NVE INSPECTOR MUST BE NOTIFIED BY FAX 48 HOURS PRIOR TO COMMENCING CONSTRUCTION & WILL VERIFY CITY PERMIT FOR WORK DONE IN STREETS OR SIDEWALK.
FAX PERMIT TO:
LAS VEGAS NORTH (RYAN CENTER): 402-4354
LAS VEGAS SOUTH (BELTWAY CENTER): 402-6864

CENTERLINE STATION TABLE						
#	STREET INTERSECTION	STA	HEADED			
(A)	DORRELL LANE	10+00	WEST			
	DECATUR BLVD	10+00	NORTH			
(B)	DORRELL LANE	23+42.04	WEST			
	THOM BLVD	10+00	SOUTH			
(C)	DONALD RD.	10+00	WEST			
	DECATUR BLVD	16+72.62	NORTH			
(D)	DONALD RD.	21+77.11	WEST			
	ROUNDABOUT	10+00	DEADEND			

STATION TABLE							
MAXIMO STATION	CORNER	CENTER LINE STATION	SIDE	OFFSET CL TO BOC	OFFSET CL TO ROW	OFFSET CL TO SUBSTRUCTURE	SUBSTRUCTURE INFORMATION
(0008)	WEST	15+40.52 FIELD NOTES	RT	25'	30'	25.67'	RS-82 - 7.67' X 3.67' OPERATING NUMBER: UGM69624 PAGE NUMBER: 2 EASEMENT NUMBER: FUTURE TYP. EASEMENT LAYOUT: FUTURE
	EAST	15+82.85 FIELD NOTES	RT	25'	30'	25.67'	
(0143)	WEST	18+40.15 FIELD NOTES	RT	25'	30'	30'	RS-13 - 4.25' X 4.75' OPERATING NUMBER: PM804557 PAGE NUMBER: 2 EASEMENT NUMBER: FUTURE TYP. EASEMENT LAYOUT: FUTURE
	EAST	18+35.90 FIELD NOTES	RT	25'	30'	30'	
(0158)	WEST	22+00.15 FIELD NOTES	RT	25'	30'	30'	RS-13 - 4.25' X 4.75' OPERATING NUMBER: PM101072 PAGE NUMBER: 3 EASEMENT NUMBER: FUTURE TYP. EASEMENT LAYOUT: FUTURE
	EAST	21+95.90 FIELD NOTES	RT	25'	30'	30'	
(0173)	WEST	22+82.37 FIELD NOTES	RT	25'	30'	25.67'	RS-82 - 7.67' X 3.67' OPERATING NUMBER: UGM77256 PAGE NUMBER: 3 EASEMENT NUMBER: FUTURE TYP. EASEMENT LAYOUT: FUTURE
	EAST	22+74.70 FIELD NOTES	RT	25'	30'	25.67'	
(0051)	WEST	17+43.69 FIELD NOTES	LT	20'	25'	20.67'	RS-80 - 4.67' X 3.17' OPERATING NUMBER: PB08518 PAGE NUMBER: 3 EASEMENT NUMBER: FUTURE TYP. EASEMENT LAYOUT: FUTURE
	EAST	17+329.29 FIELD NOTES	LT	20'	25'	20.67'	




APN: 12524503001

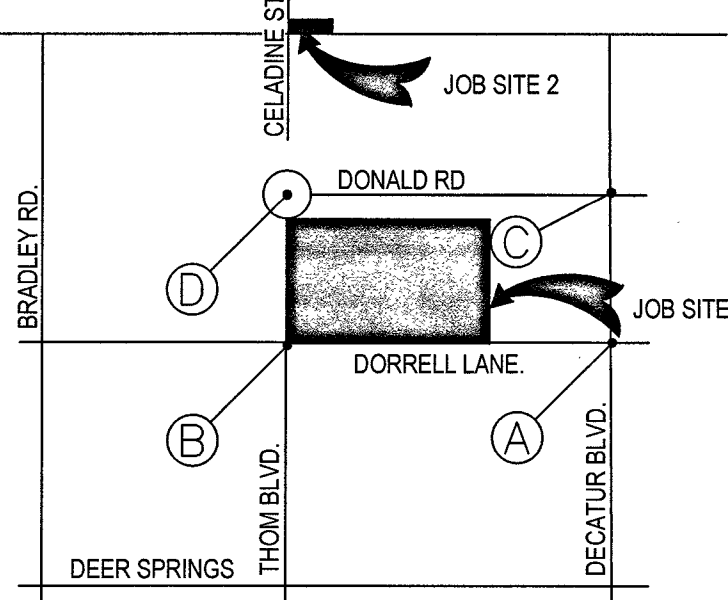

(NOT TO SCALE)

EVERY EFFORT HAS BEEN MADE TO IDENTIFY ALL NVE FACILITIES. THE CUSTOMER SHALL CONFIRM THE EXISTENCE AND LOCATION OF THESE FACILITIES.



CALL
811

OR
1-800-227-2600
AND CLARK COUNTY TRAFFIC OPERATIONS:
1-702-455-6000

NO.	DESCRIPTION	DATE	G.A.
①	UPDATED STREET NAMES AND TRENCH DETAILS PER CLV RED LINES, PG1-5 - N.Y.	03/09/2018	
②			
③			
④			
⑤			
⑥			
⑦			
⑧			
⑨			
⑩			

PROJECT PURPOSE:

SERVE RESIDENTIAL SUBDIVISION
 (57) HOMES, 320A 120/240V PANELS
 (2) STREETLIGHT, 200A 120/240V PEDESTAL
 (3) IRRIGATION, 125A 120/240V PEDESTAL

NVEnergy INFORMATION:
COORDINATOR: STATON, STEVEN
PHONE: (702)332-9107
DESIGNER: YOSEF, NEAL D.F. J.M.
DCA: 285-8182, 219-5761 NORTH
INSPECTOR: 402-3008
STAND BY: 402-4114, 402-4117,402-4118
DISTRICT: LAS VEGAS NORTH

JPA INFORMATION:

JPA ADMIN PHONE: N/A JPA#: N/A
CUSTOMER INFORMATION:

CUSTOMER INFORMATION:

APPLICANT: BEAZER HOMES HOLDINGS LLC
ENGINEER: N/A
CONTACT: DAVE WAGNER ** 702-376-0526
APPROVAL DATE: 01/30/2018

GOVERNMENT INFORMATION:


AGENCY: CITY OF LAS VEGAS
APPROVAL DATE: _____

FOR EACH SERVICE POINT (POINT OF DELIVERY), ENERGY FOR EACH TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. ENERGY FOR ALL NON-TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. CONTACT NVE METER OPERATIONS FOR MULTIPLE RATE CLASS INSTALLATIONS.




DECATUR AND DONALD 1
SUBDIVISION
DECATUR / DONALD


PROJ. ID: 3002028151	SCALE: 1" = 30'
SHEET # 5 OF 5	DATE: 10/05/2017

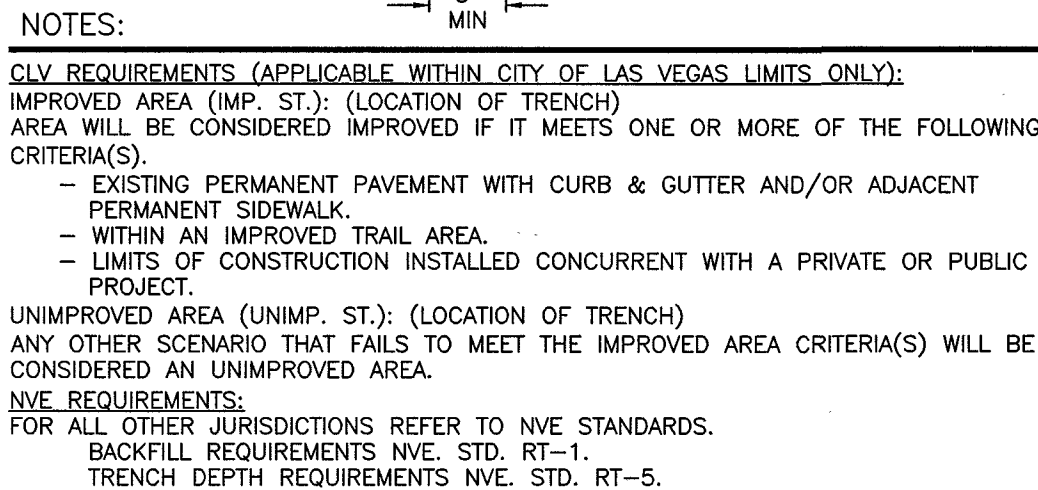

1-2" CONDUIT
SECTION "GG"

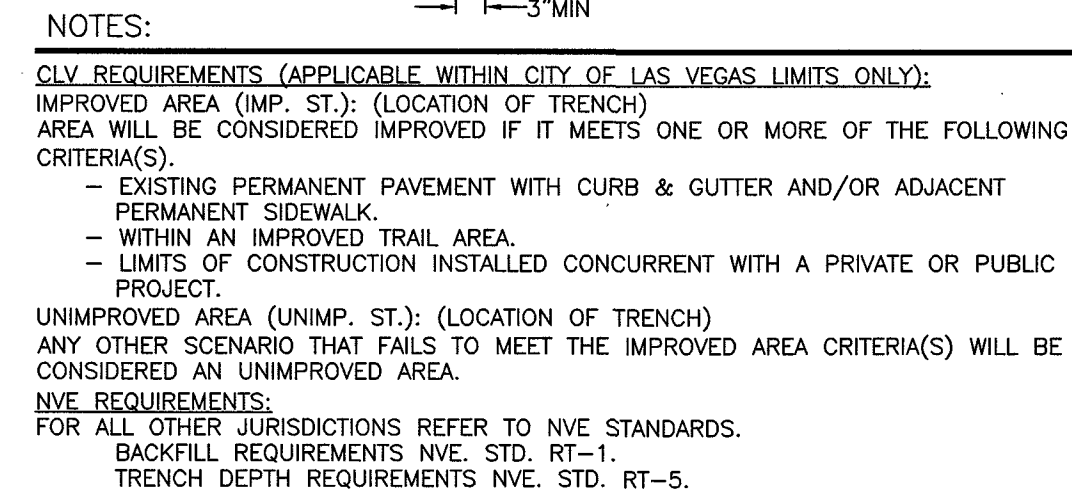

3-2" CONDUITS
SECTION "FF"

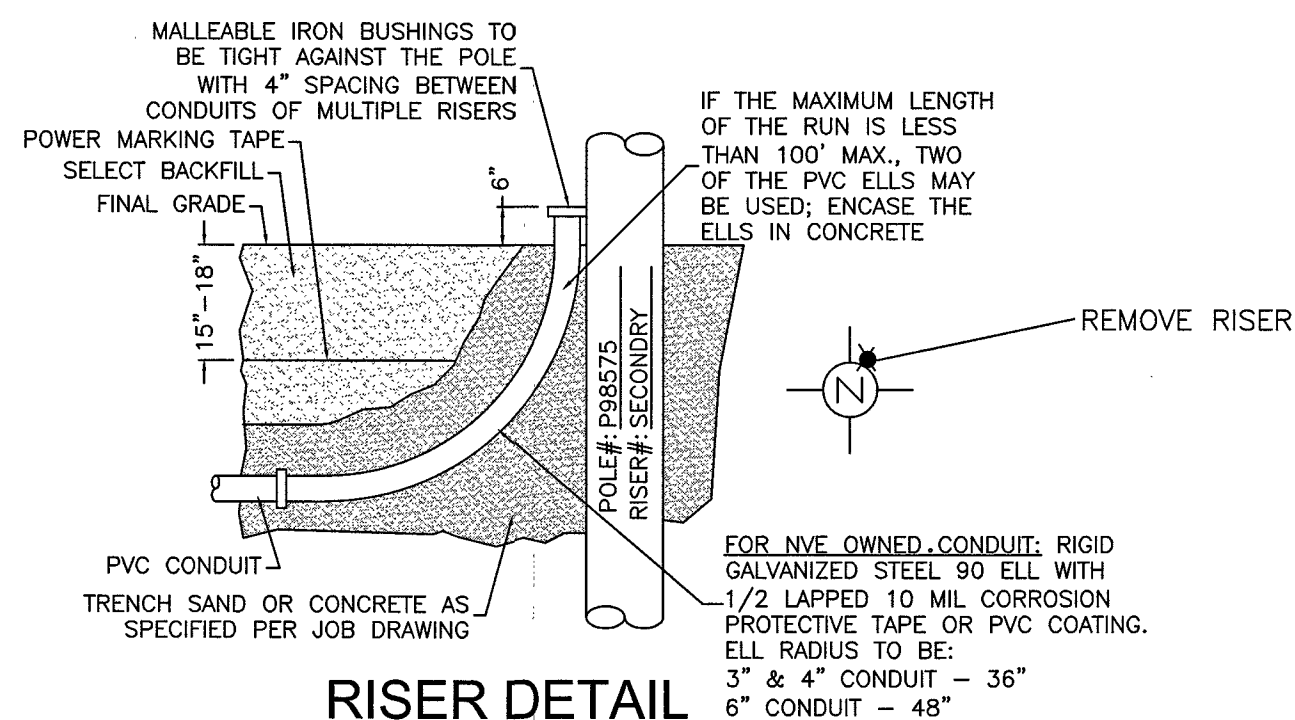

CONDUIT RUN
PER NVE U.G. STD. RR-1
(TYPICAL)

UNLESS OTHERWISE NOTED:

ALL SERVICE CONDUCTOR: 4/0 AL. TRI.
ALL TRANSFORMERS: 7200V-120/240V-1 ϕ PM
LARGEST A/C UNIT SIZE: 5 TONS
NUMBER OF UNITS: 57
MAIN SIZE: 320 AMPS
ESTIMATED KVA PER UNIT: 17 KVA
SQ. FT. OF LARGEST UNIT: 3703 FT²

NOTE: ALL THE ABOVE GROUND UTILITY APPURTENANCES SHALL CONFORM TO THE REQUIREMENTS OF CLV UNIFIED DEVELOPMENT CODE TITLE 19.06 AND 19.08

THIS APPROVAL IS FOR WORK IN CLV R/W & EASEMENT ONLY. OBTAINING PERMISSIONS OR EASEMENTS FOR WORK SHOWN ON PRIVATE PROPERTY IS THE RESPONSIBILITY OF THE UTILITY.

APPROVAL BY: Shane Burt 3-26-

CITY OF LAS VEGAS
PERMIT REQUIRED*

HANSEN

DATE _____

*NVE INSPECTOR MUST BE NOTIFIED BY FAX 48

HOURS PRIOR TO COMMENCING CONSTRUCTION & WILL VERIFY CITY PERMIT FOR WORK DONE IN

WILL VERIFY CITY PERMIT FOR WORK DONE IN
STREETS OR SIDEWALK.


FAX PERMIT TO:

LAS VEGAS NORTH (RYAN CENTER): 402-4354
LAS VEGAS SOUTH (BELTWAY CENTER): 402-686

NV ENERGY SCHEDULING NOTE: DAY (LANE BLOCKS)

THIS PROJECT WAS ESTIMATED WITH THE ASSUMPTION THAT ALL THE WORK BEING PERFORMED ON THIS PROJECT BY NV ENERGY CREWS CAN BE DONE DURING THE DAYTIME AND WILL REQUIRE TRAFFIC CONTROL.

GOVERNMENT APPROVAL OF THESE DRAWINGS DOES NOT INDICATE APPROVAL OF TRAFFIC CONTROL.
PLEASE REFER TO THE BARRICADE PLAN FOR APPROVED TRAFFIC CONTROL REQUIREMENTS.

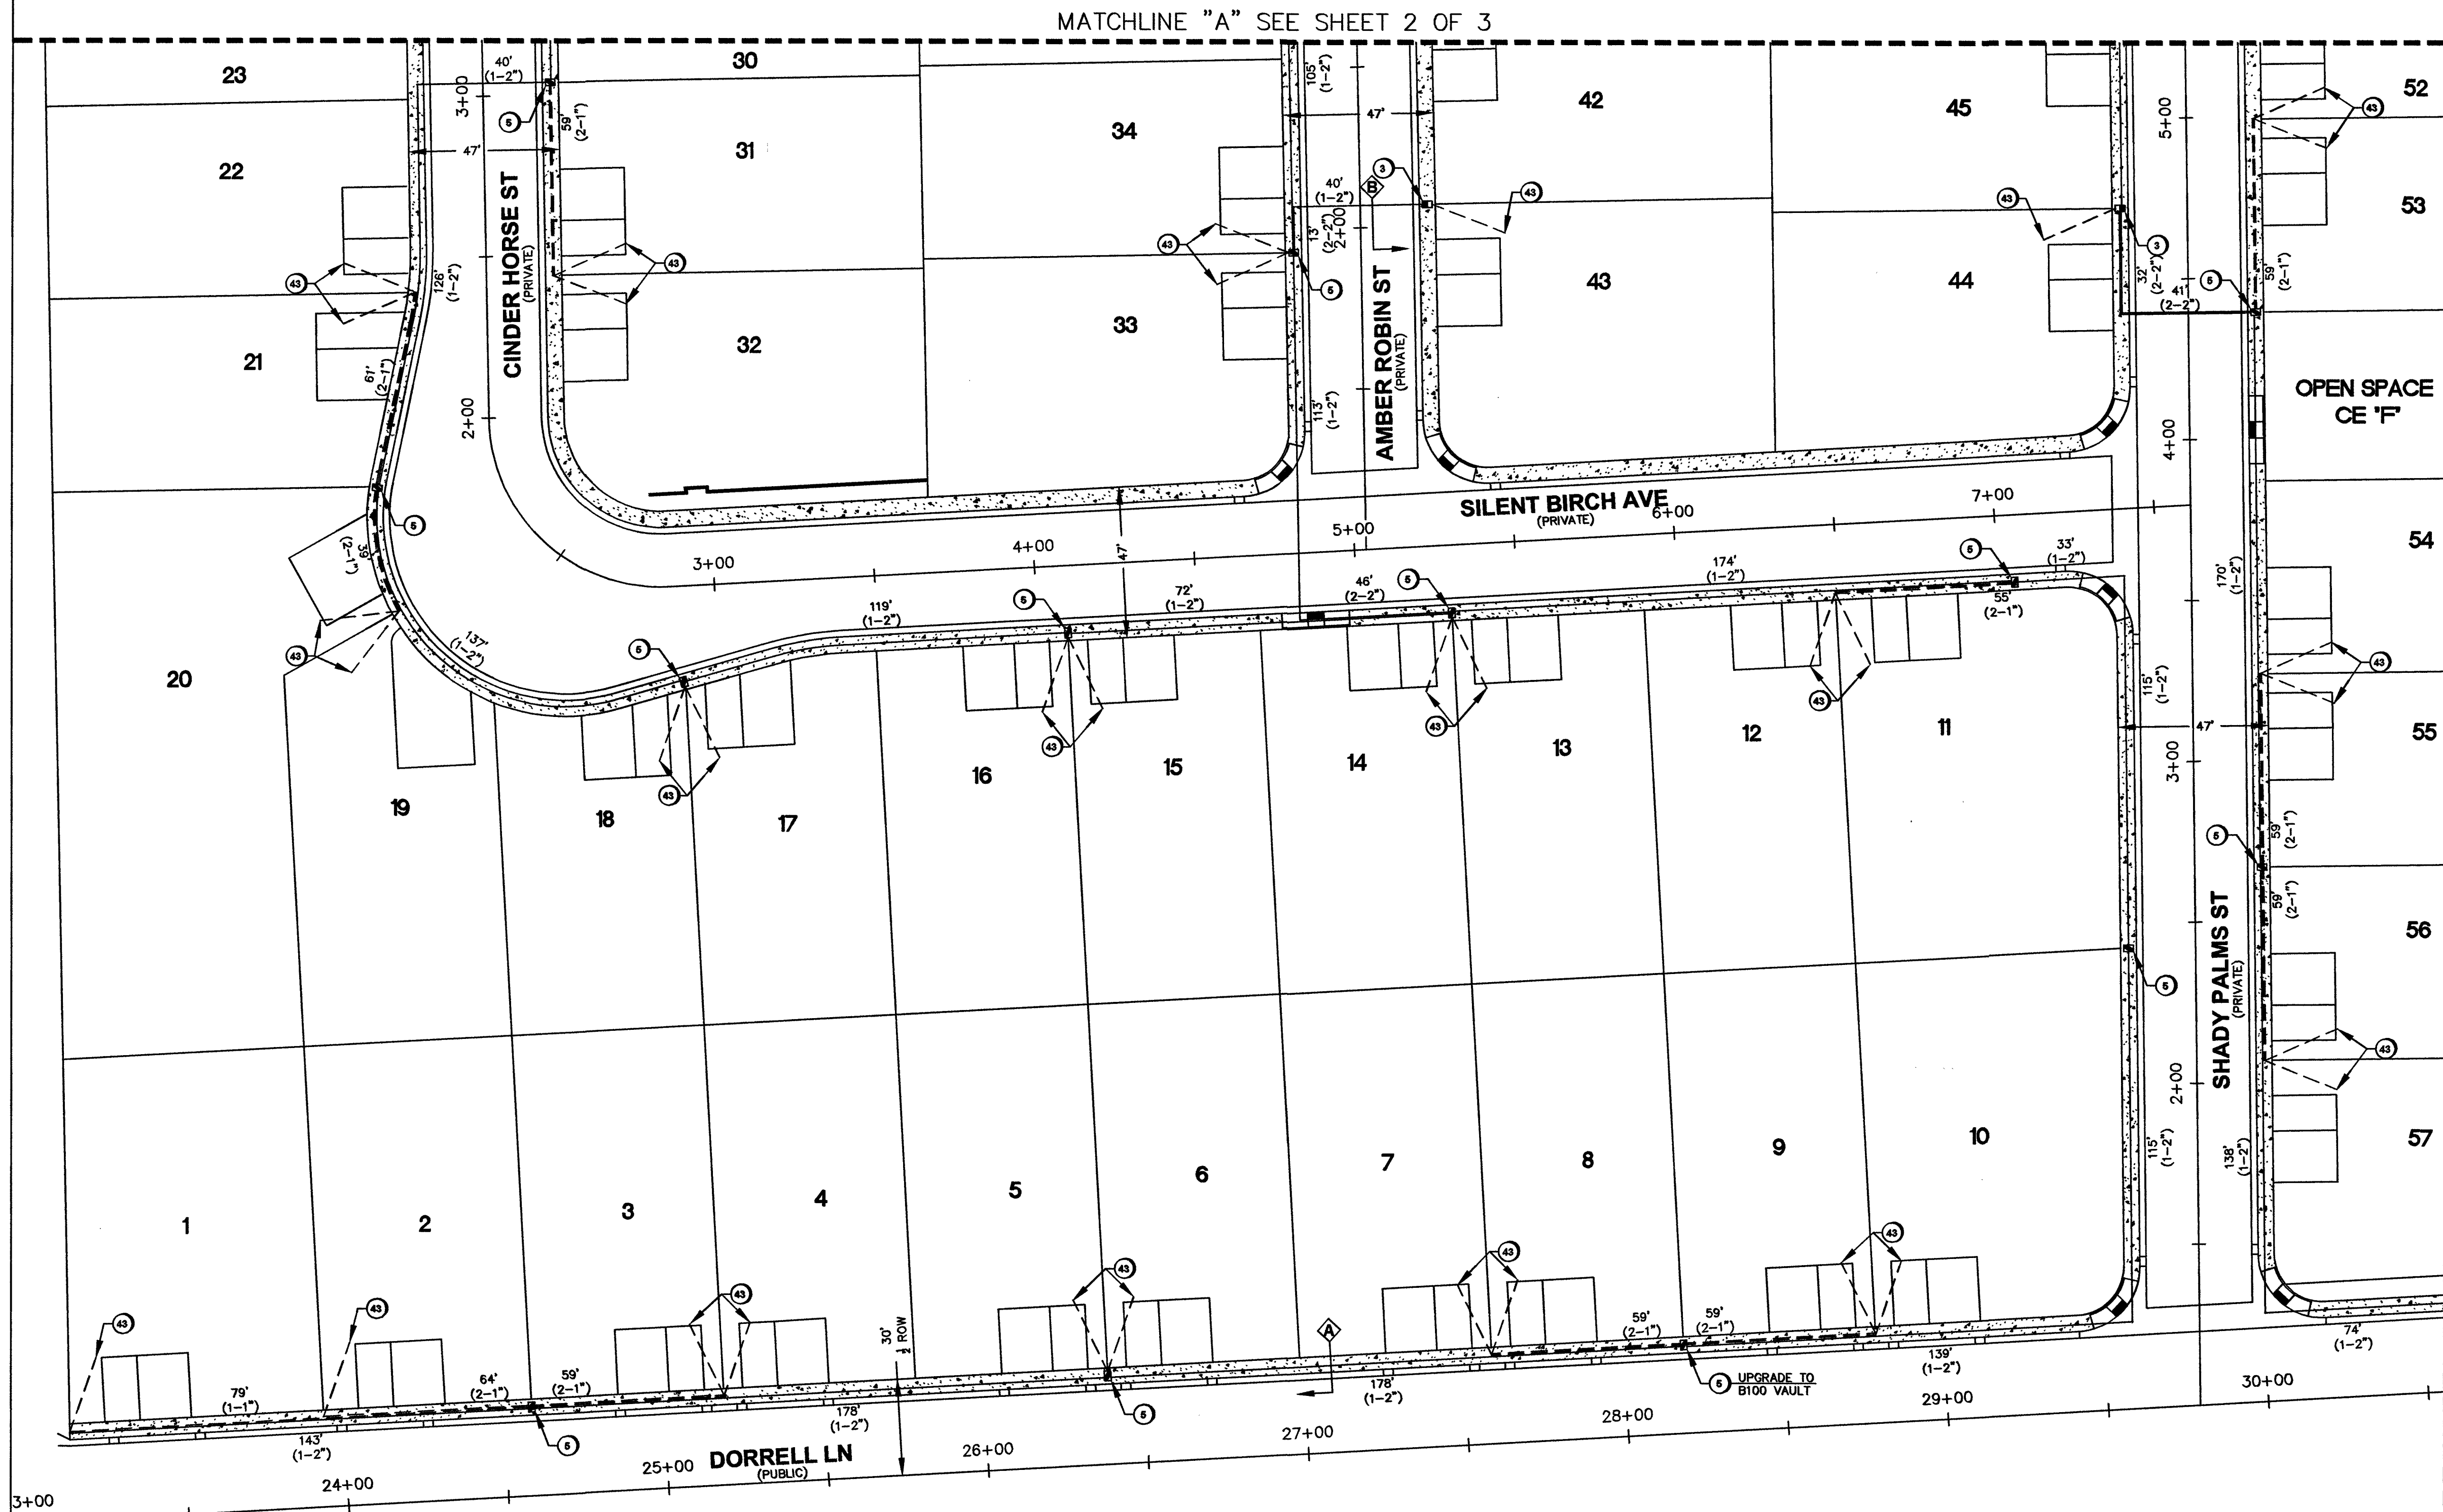

LEGEND	
1	INSTALL B-36 PULL BOX (24"x36"x24")
2	EXISTING B-36 PULL BOX (24"x36"x24")
3	INSTALL B-50 PULL BOX (13"x24"x24")
4	EXISTING B-50 PULL BOX (13"x24"x24")
5	INSTALL B-100 PULL BOX (24"x36"x24")
6	EXISTING B-100 PULL BOX (24"x36"x24")
7	INSTALL T-200 CATV VAULT (30"x48"x36")
8	EXISTING T-200 CATV VAULT (30"x48"x36")
9	INSTALL T-400 CATV VAULT (36"x60"x36")
10	EXISTING T-400 CATV VAULT (36"x60"x36")
11	INSTALL T-800 CATV VAULT (48"x72"x36")
12	EXISTING T-800 CATV VAULT (48"x72"x36")
13	INSTALL NEW CATV PEDESTAL
14	EXISTING NEW CATV PEDESTAL
15	R&R S/W SLAB(S)
16	POT HOLE
17	--- S-SIDEWALK/DIRT TRENCH INSTALL
18	--- A-A-ASPHALT/STREET TRENCH INSTALL
19	--- B-B-PROPOSED BORE
20	--- X-X-EXISTING CATV CONDUIT(S)
21	--- OHC-PROPOSED OVERHEAD FIBER OPTIC CABLE OR COAX INSTALL
22	--- XHC-EXISTING OVERHEAD FIBER OPTIC CABLE OR COAX
23	--- U.G. FIBER/COAX PULL
24	--- RIGHT OF WAY LINE
25	--- LOT/PROPERTY LINE
26	--- EDGE OF PAVEMENT
27	P EXISTING NVE PULL BOX
28	T EXISTING TELCO PULL BOX
29	TM EXISTING TELCO MANHOLE
30	T EXISTING TELCO POLE
31	EXISTING NVE POLE
32	NVE EXISTING NVE TRANSMISSION POLE
33	EXISTING JOINT POLE
34	EXISTING JOINT POLE WITH TRANSFORMER
35	POLE ANCHOR
36	EXISTING NVE TRANSFORMER TRANSFORMER PAD
37	TS SNWA TEST STATION
38	COX POWER SUPPLY (49"x24"x52")
39	INSTALL RHINO CABINET
40	RISER POLE/QUADRANT DETAIL RISER OWNERSHIP NOTED
41	RAILROAD
42	EXISTING MANHOLE (SS),(SD),...ECT
43	--- 1in CONDUIT LATERAL
44	
45	

DISCLAIMER NOTE	
UTILITY LOCATIONS SHOWN HEREON ARE APPROXIMATE ONLY. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE EXACT HORIZONTAL AND VERTICAL LOCATION OF ALL EXISTING UNDERGROUND AND OVERHEAD UTILITIES PRIOR TO COMMENCING CONSTRUCTION. NO REPRESENTATION IS MADE THAT ALL EXISTING UTILITIES ARE SHOWN HEREON. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR UTILITIES NOT SHOWN OR UTILITIES NOT SHOWN IN THEIR PROPER LOCATIONS.	
AVOID CUTTING UNDERGROUND UTILITY LINES. IT'S COSTLY. CALL BEFORE YOU DIG OR 1-800-227-2600 UNDERGROUND SERVICE (USA) AVOID OVERHEAD POWER LINE CONTACT CALL BEFORE YOU OVERHEAD 1-702-227-2929 NEVADA POWER ENVIRONMENT AND SAFETY SERVICE DEPARTMENT	
TOTAL BORE TOTAL DIRT TRENCH TOTAL ASPHALT TRENCH TOTAL TRENCH SIDEWALK REMOVAL/REPAIR TOTAL S/W PANELS TOTAL LINEAR FOOTAGE	

(T19S R60E)

VICINITY MAP (NOT TO SCALE)

REV

REV	DESCRIPTION	DATE	BY
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			
21			
22			
23			
24			
25			
26			
27			
28			
29			
30			
31			
32			
33			
34			
35			
36			
37			
38			
39			
40			
41			
42			
43			
44			
45			

ALL CONSTRUCTION AND MATERIALS SHALL BE IN ACCORDANCE WITH THE "UNIFORM STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OFF-SITE IMPROVEMENTS, CLARK COUNTY AREA NEVADA" LATEST ISSUE; THE "UNIFORM STANDARD DRAWINGS FOR PUBLIC WORKS CONSTRUCTION, CLARK COUNTY AREA NEVADA" LATEST ISSUE; AND OTHER APPLICABLE APPROVED STANDARDS ISSUED BY THE CONTROLLING AGENCY; ALL LOCAL CITY CODES AND ORDINANCES APPLICABLE.

APPROVED FOR CONSTRUCTION

THIS APPROVAL IS FOR WORK IN CLV R/W OR CLV EASEMENT ONLY. OBTAINING PERMISSION OR EASEMENT FOR WORK SHOWN IN PRIVATE PROPERTY IS THE RESPONSIBILITY OF THE UTILITY.

APPROVAL: *Shawn Butts* DATE: 3-26-18

PERMIT # 4050517000000138035

DRAWN BY: WTB

DATE: 2-6-18

SCALE: 1:30

NOTE: N/A

DESIGNED BY: TRUENET

TECH #

APPROVED BY: N/A

BRADLEY DEMARSHUS

COX

1700 VEGAS DRIVE
LAS VEGAS, NEVADA 89106
PHONE: (702) 545-1606
FAX: (702) 545-2806

CITY OF LAS VEGAS

333 N. RANCHO DRIVE
LAS VEGAS, NEVADA 89106
(702) 229-6885

PROJECT LOCATION:
SHEET No: 1075061-1-0750

N DECATUR BLVD & DONALD RD

SUB-CONTRACTOR:

ENTRANCE NOTES:

TBD


1

117-00646-0002

SHEET 1 OF 3

TrueNet# 11997

117-00646-0002 3/15/18

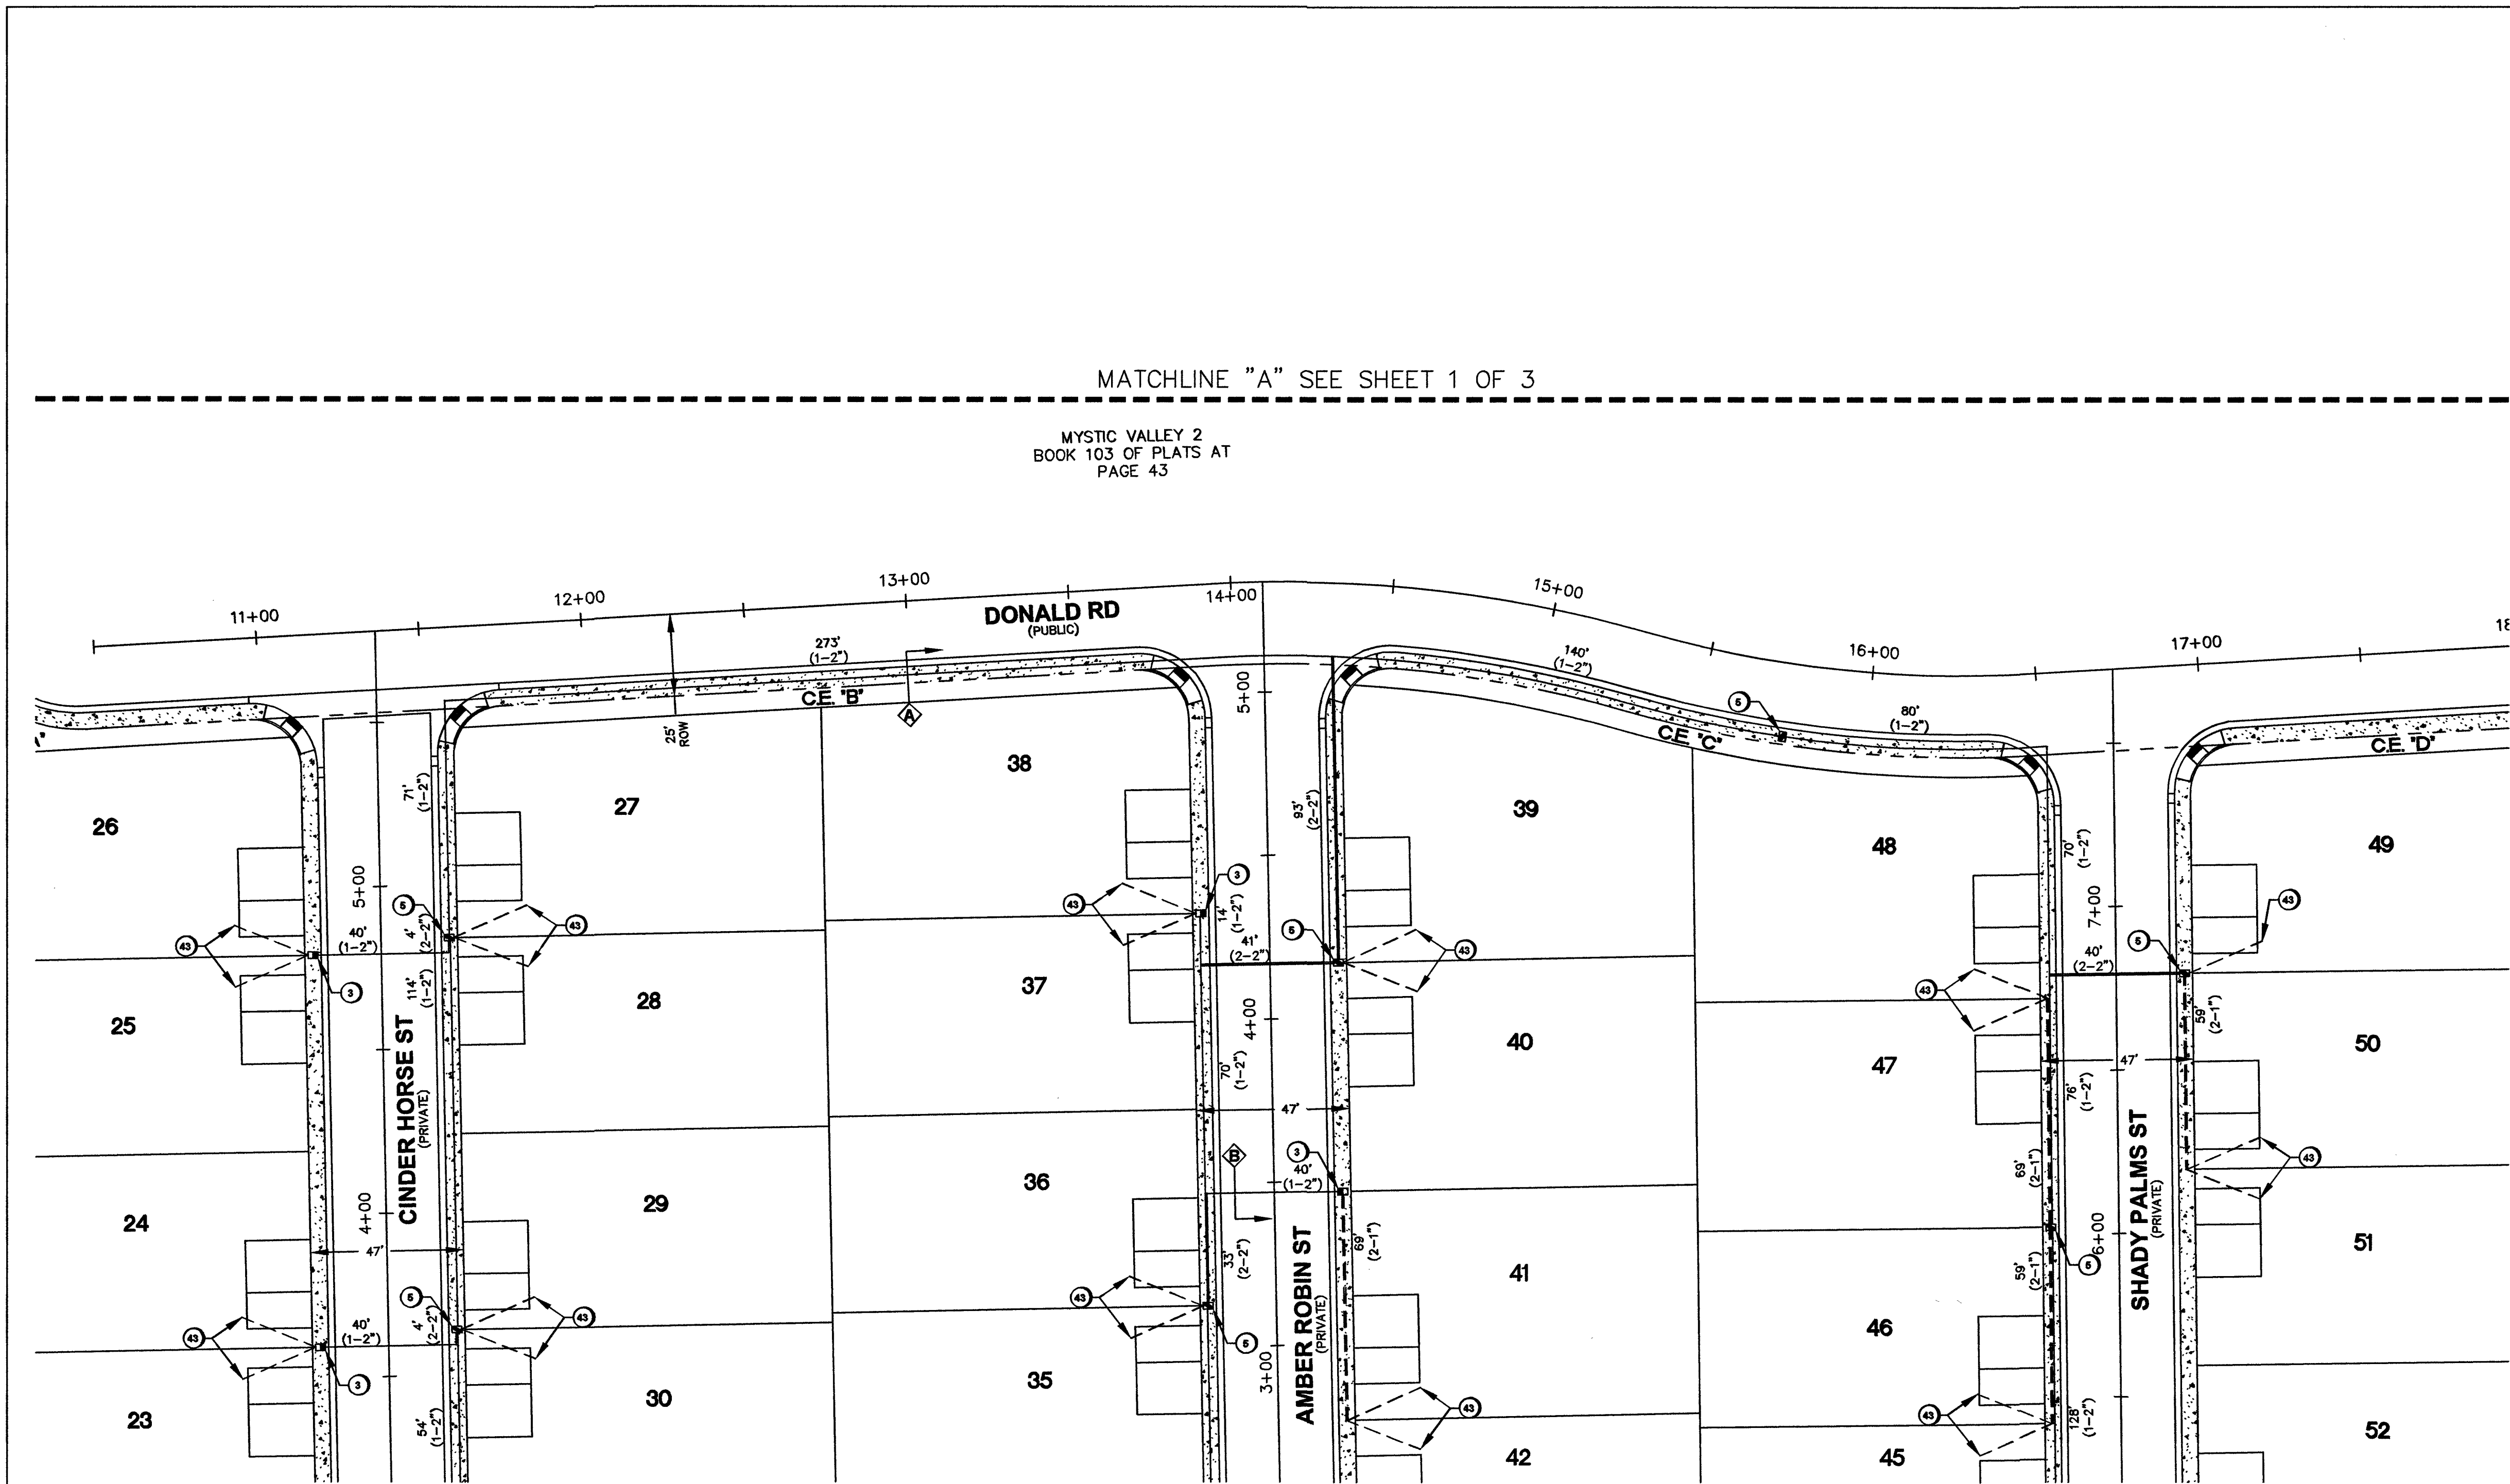

LEGEND	
1	INSTALL B-36 PULL BOX (24"x36"x24")
2	EXISTING B-36 PULL BOX (24"x36"x24")
3	INSTALL B-50 PULL BOX (13"x24"x24")
4	EXISTING B-50 PULL BOX (13"x24"x24")
5	INSTALL B-100 PULL BOX (24"x36"x24")
6	EXISTING B-100 PULL BOX (24"x36"x24")
7	INSTALL T-200 CATV VAULT (30"x48"x36")
8	EXISTING T-200 CATV VAULT (30"x48"x36")
9	INSTALL T-400 CATV VAULT (36"x60"x36")
10	EXISTING T-400 CATV VAULT (36"x60"x36")
11	INSTALL T-600 CATV VAULT (48"x72"x36")
12	EXISTING T-600 CATV VAULT (48"x72"x36")
13	INSTALL NEW CATV PEDESTAL
14	EXISTING NEW CATV PEDESTAL
15	R&R S/W SLAB(S)
16	POTHOLE
17	--- SIDEWALK/DIRT TRENCH INSTALL
18	--- ASPHALT/STREET TRENCH INSTALL
19	--- PROPOSED BORE
20	--- EXISTING CATV CONDUIT(S)
21	--- PROPOSED OVERHEAD FIBER OPTIC CABLE OR COAX INSTALL
22	--- EXISTING OVERHEAD FIBER OPTIC CABLE OR COAX
23	--- U.G. FIBER/COAX PULL
24	--- RIGHT OF WAY LINE
25	--- LOT/PROPERTY LINE
26	--- EDGE OF PAVEMENT
27	P EXISTING NVE PULL BOX
28	T EXISTING TELCO PULL BOX
29	TM EXISTING TELCO MANHOLE
30	T EXISTING TELCO POLE
31	EXISTING NVE POLE
32	NVE EXISTING NVE TRANSMISSION POLE
33	EXISTING JOINT POLE
34	EXISTING JOINT POLE WITH TRANSFORMER
35	POLE ANCHOR
36	EXISTING NVE TRANSFORMER TRANSFORMER PAD
37	TS SNWA TEST STATION
38	COX POWER SUPPLY (49"x24"x52")
39	RC INSTALL RHINO CABINET
40	RISE R POLE/QUADRANT DETAIL RISE R OWNERSHIP NOTED
41	RAILROAD
42	MH EXISTING MANHOLE (SS)(SD)...ECT
43	--- 1in CONDUIT LATERAL
44	
45	

DISCLAIMER NOTE

UTILITY LOCATIONS SHOWN HEREON ARE APPROXIMATE ONLY. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE EXACT HORIZONTAL AND VERTICAL LOCATION OF ALL EXISTING UNDERGROUND AND OVERHEAD UTILITIES PRIOR TO COMMENCING CONSTRUCTION. NO REPRESENTATION IS MADE THAT ALL EXISTING UTILITIES ARE SHOWN HEREON. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR UTILITIES NOT SHOWN OR UTILITIES NOT SHOWN IN THEIR PROPER LOCATIONS.

BEFORE YOU DIG
OR 1-800-227-2800
OR 1-800-227-2800
UNDERGROUND SERVICE (USA)

BEFORE YOU OVERHEAD
CALL BEFORE YOU OVERHEAD
1-702-227-2828
NEVADA POWER ENVIRONMENT AND SAFETY SERVICE DEPARTMENT

BEFORE YOU UNDERGROUND
CALL BEFORE YOU UNDERGROUND
1-702-465-7511
CLARK COUNTY TRAFFIC OPERATIONS
1-702-432-5300
LAS VEGAS AREA COMPUTERIZED SYSTEM

AVOID CUTTING UNDERGROUND UTILITY LINES. IT'S COSTLY.

AVOID OVERHEAD POWER LINE CONTACT

TOTAL BORE
TOTAL DIRT TRENCH
TOTAL ASPHALT TRENCH
TOTAL TRENCH
TOTAL S/W PANELS
TOTAL LINEAR FOOTAGE

(T19S R60E)

VICINITY MAP (NOT TO SCALE)

REVISIONS

REV	DESCRIPTION	DATE	BY
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			
21			
22			
23			
24			
25			
26			
27			
28			
29			
30			
31			
32			
33			
34			
35			
36			
37			
38			
39			
40			
41			
42			
43			
44			
45			
46			
47			
48			
49			
50			
51			
52			

APPROVED FOR CONSTRUCTION

THIS APPROVAL IS FOR WORK IN CLV RW OR CLV EASEMENT ONLY. OBTAINING PERMISSION OR EASEMENT FOR WORK SHOWN IN PRIVATE PROPERTY IS THE RESPONSIBILITY OF THE UTILITY.

Shawn Butts 3-24-18
APPROVAL DATE

PERMIT # 405051700000138035
DRAWN BY: WTB
DATE: 2-6-18
SCALE: 1:30
NODE: N/A
DESIGNED BY: N/A
TRUENET TECH #
N/A
APPROVED BY: N/A
BRADLEY DEMARSHUS

COX
1700 VEGAS DRIVE
LAS VEGAS, NEVADA 89106
PHONE: (702) 546-1606
FAX: (702) 546-2606

CITY OF LAS VEGAS
333 N. RANCHO DRIVE
LAS VEGAS, NEVADA 89106
(702) 229-6885

PROJECT LOCATION:
N DECATUR BLVD & DONALD RD




SUB-CONTRACTOR:
TBD

ENTITY NOTES:
TBD

SHEET No: 107150671-1-0002
SHEET 2 OF 3

1-702-00646-0002

TrueNet# 11997

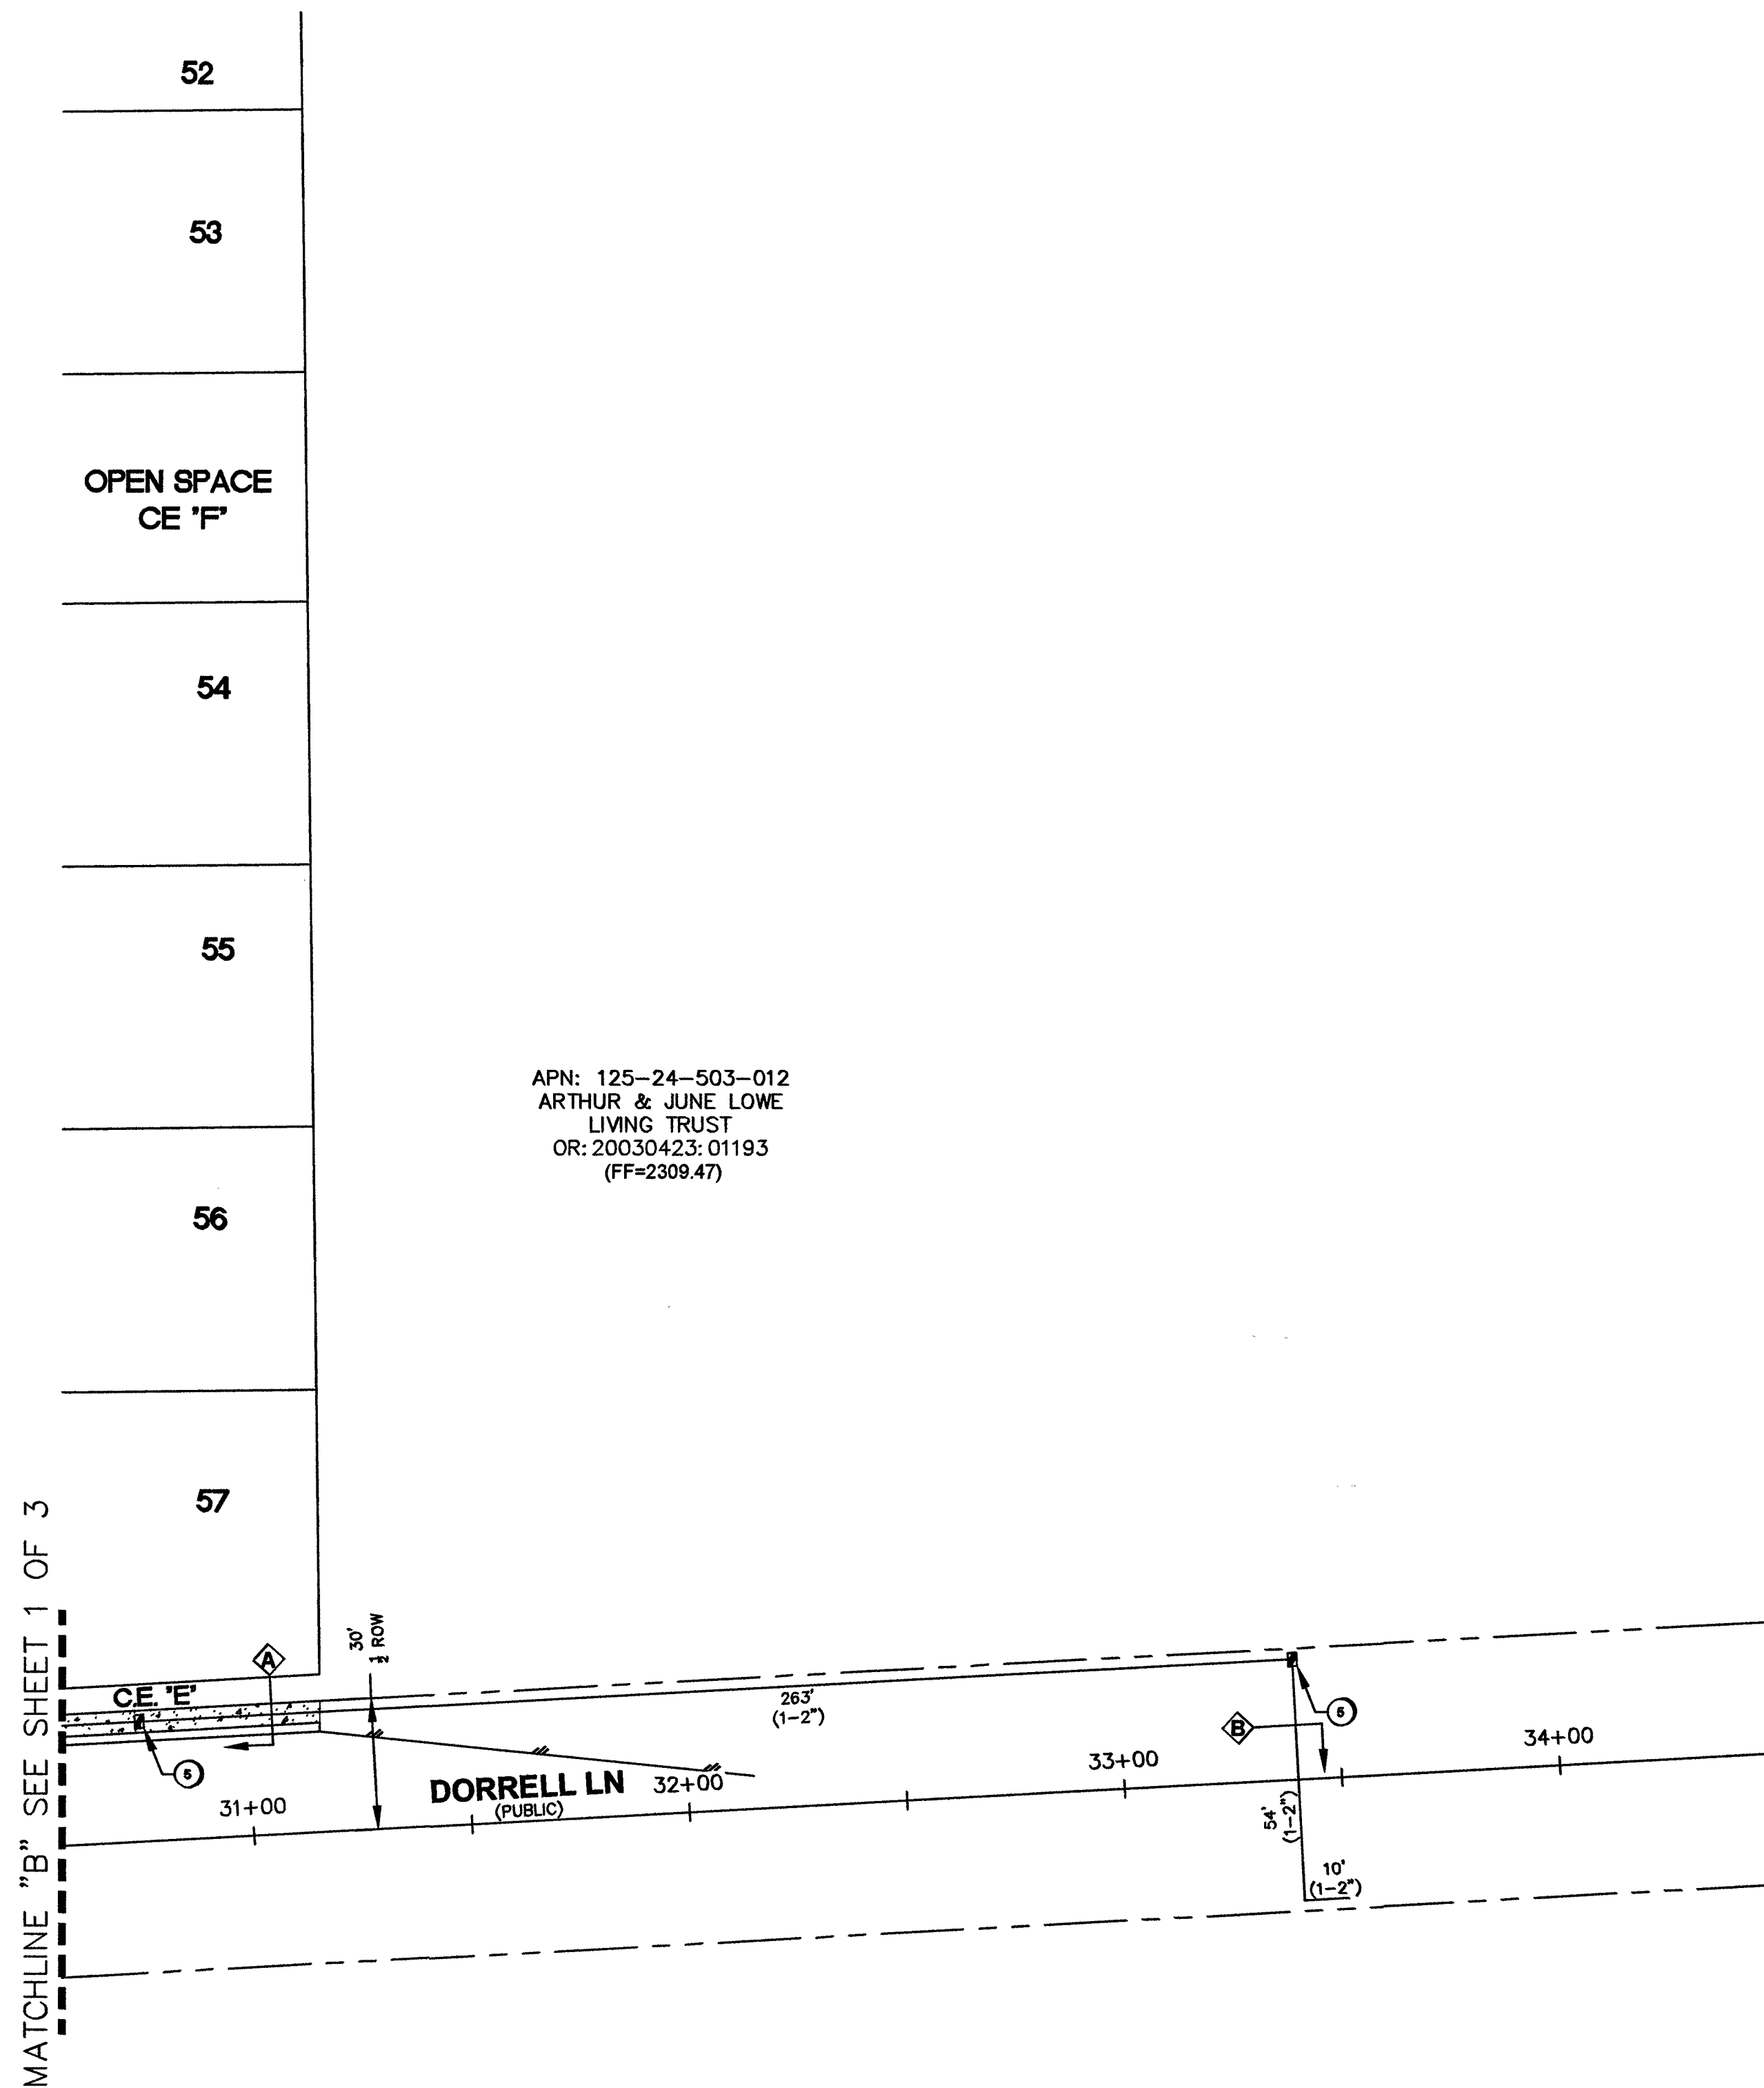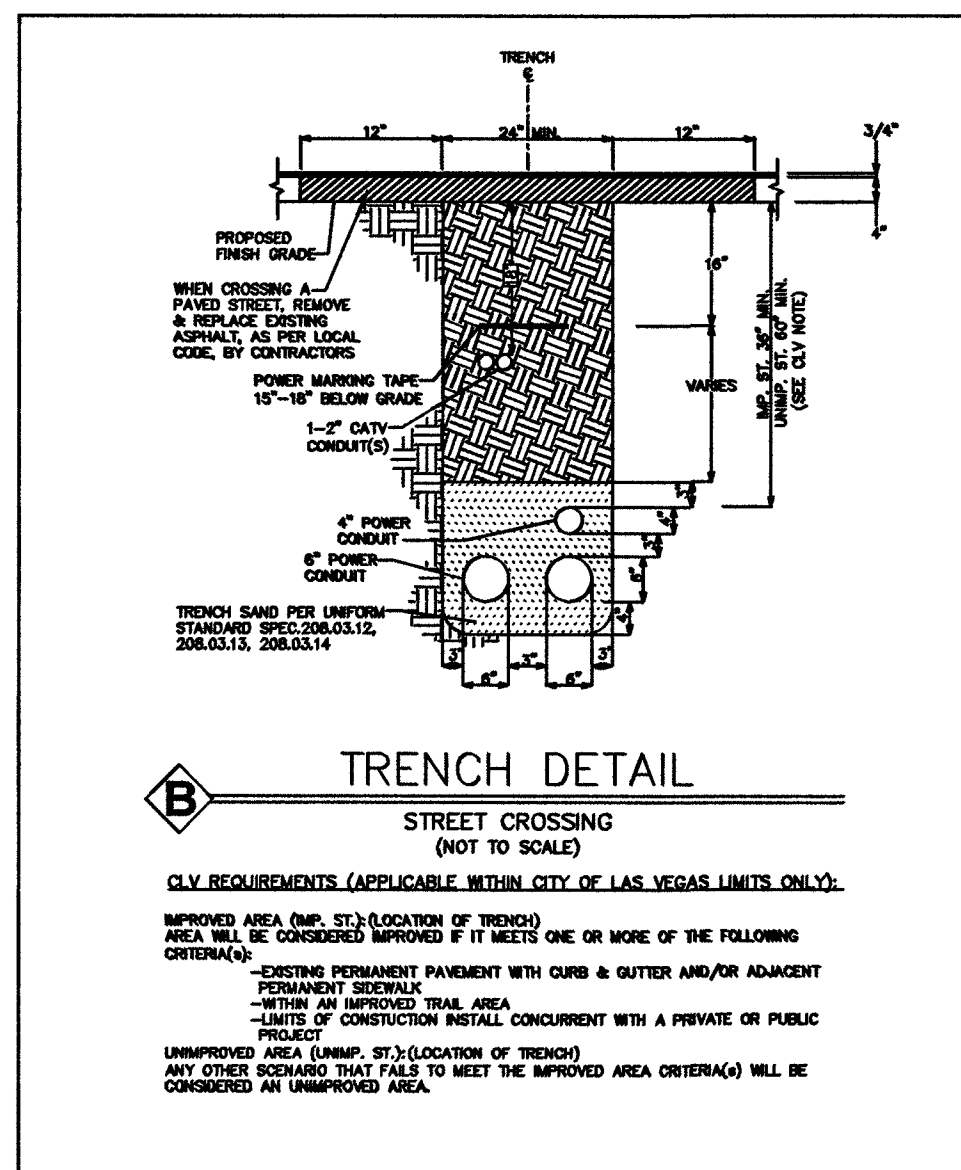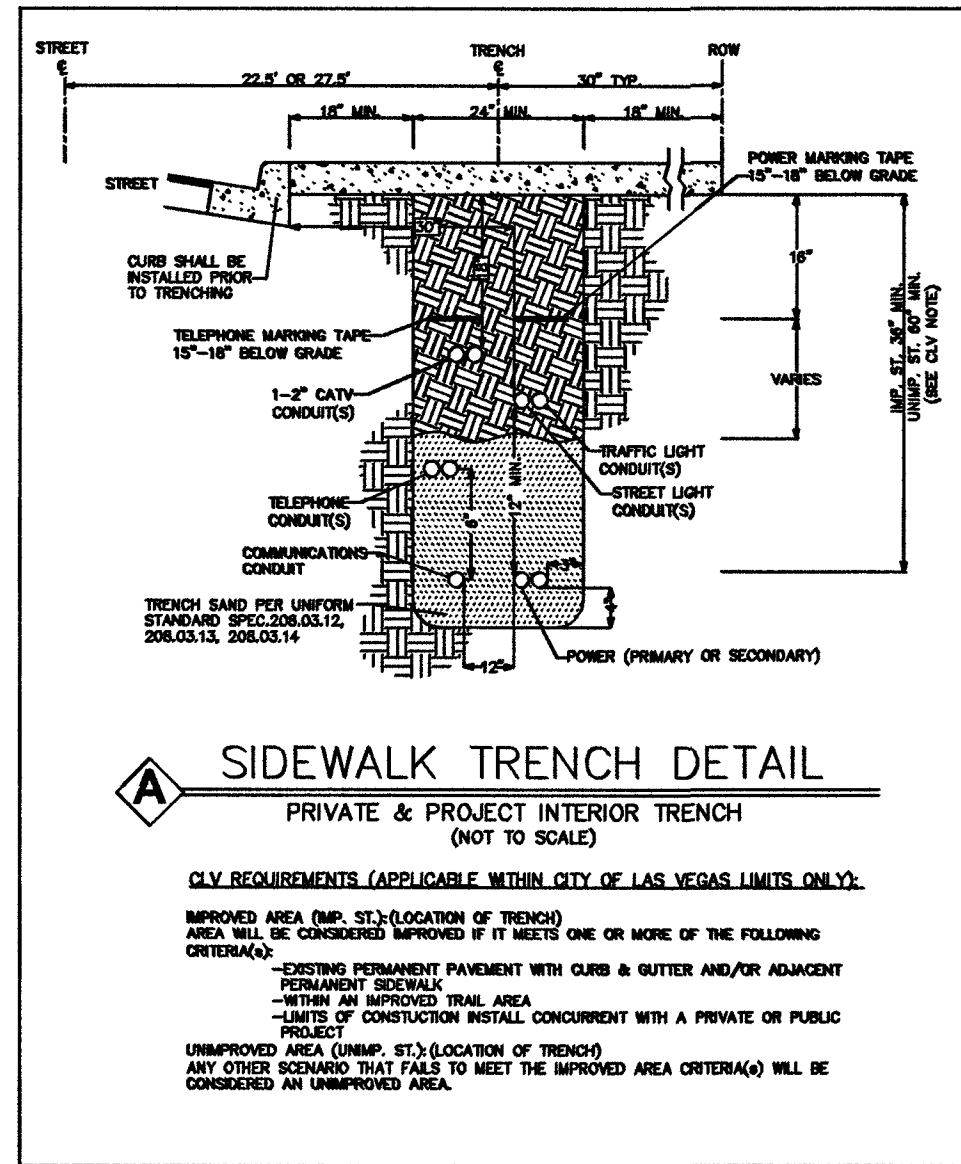

APN: 125-24-503-012
ARTHUR & JUNE LOWE
LIVING TRUST
OR: 20030423: 01193
(FF=2309.47)

LEGEND	
1	INSTALL B-36 PULL BOX (24"x36"x24")
2	EXISTING B-36 PULL BOX (24"x36"x24")
3	INSTALL B-50 PULL BOX (13"x24"x24")
4	EXISTING B-50 PULL BOX (13"x24"x24")
5	INSTALL B-100 PULL BOX (24"x36"x24")
6	EXISTING B-100 PULL BOX (24"x36"x24")
7	INSTALL T-200 CATV VAULT (30"x48"x36")
8	EXISTING T-200 CATV VAULT (30"x48"x36")
9	INSTALL T-400 CATV VAULT (36"x60"x36")
10	EXISTING T-400 CATV VAULT (36"x60"x36")
11	INSTALL T-600 CATV VAULT (48"x72"x36")
12	EXISTING T-600 CATV VAULT (48"x72"x36")
13	INSTALL NEW CATV PEDESTAL
14	EXISTING NEW CATV PEDESTAL
15	R&R S/W SLAB(S)
16	POTHOLE
17	C-C-C-SIDEWALK/DIRT TRENCH INSTALL
18	C-C-C- ASPHALT/STREET TRENCH INSTALL
19	B-B-B- PROPOSED BORE
20	X-X-X- EXISTING CATV CONDUIT(S)
21	OHC- PROPOSED OVERHEAD FIBER OPTIC CABLE OR COAX INSTALL
22	XOHC- EXISTING OVERHEAD FIBER OPTIC CABLE OR COAX
23	U.G. FIBER/COAX PULL
24	RIGHT OF WAY LINE
25	LOT/PROPERTY LINE
26	EDGE OF PAVEMENT
27	P- EXISTING NVE PULL BOX
28	T- EXISTING TELCO PULL BOX
29	TM- EXISTING TELCO MANHOLE
30	T- EXISTING TELCO POLE
31	NVE- EXISTING NVE POLE
32	NVE- EXISTING NVE TRANSMISSION POLE
33	X- EXISTING JOINT POLE
34	X- EXISTING JOINT POLE WITH TRANSFORMER
35	POLE ANCHOR
36	EXISTING NVE TRANSFORMER TRANSFORMER PAD
37	TS- SNWA TEST STATION
38	COX- COX POWER SUPPLY (49"x24"x52")
39	RC- INSTALL RHINO CABINET
40	R- RISER POLE/QUADRANT DETAIL RISER OWNERSHIP NOTED
41	RAILROAD
42	MF- EXISTING MANHOLE (SS)(SD)...ECT
43	1in CONDUIT LATERAL

DISCLAIMER NOTE	
UTILITY LOCATIONS SHOWN HEREON ARE APPROXIMATE ONLY. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE EXACT HORIZONTAL AND VERTICAL LOCATION OF ALL EXISTING UNDERGROUND AND OVERHEAD UTILITIES PRIOR TO COMMENCING CONSTRUCTION. NO REPRESENTATION IS MADE THAT ALL EXISTING UTILITIES ARE SHOWN HEREON. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR UTILITIES NOT SHOWN OR UTILITIES NOT SHOWN IN THEIR PROPER LOCATIONS. AVOID CUTTING UNDERGROUND UTILITY LINES. IT'S COSTLY. CALL 811 BEFORE YOU DIG OR 1-800-227-2600 UNDERGROUND SERVICE (USA)	AVOID OVERHEAD POWER LINE CONTACT CALL BEFORE YOU OVERHEAD 1-702-227-2828 NEVADA POWER ENVIRONMENT AND SAFETY SERVICE DEPARTMENT
TOTAL BORE - TOTAL DIRT TRENCH - TOTAL ASPHALT TRENCH - TOTAL TRENCH - SIDEWALK REMOVAL/REPAIR - TOTAL S/W PANELS - TOTAL LINEAR FOOTAGE -	

(T19S R60E)

VICINITY MAP (NOT TO SCALE)

REVISIONS

REV	DESCRIPTION	DATE	BY
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			
21			
22			
23			
24			
25			
26			
27			
28			
29			
30			
31			
32			
33			
34			
35			
36			
37			
38			
39			
40			
41			
42			
43			
44			
45			

ALL CONSTRUCTION AND MATERIALS SHALL BE IN ACCORDANCE WITH THE "UNIFORM STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OFF-SITE IMPROVEMENTS, CLARK COUNTY AREA NEVADA" LATEST ISSUE; THE "UNIFORM STANDARD DRAWINGS FOR PUBLIC WORKS CONSTRUCTION, CLARK COUNTY AREA NEVADA" LATEST ISSUE; AND OTHER APPLICABLE APPROVED STANDARDS ISSUED BY THE CONTROLLING AGENCY; ALL LOCAL CITY CODES AND ORDINANCES APPLICABLE.

APPROVED FOR CONSTRUCTION

THIS APPROVAL IS FOR WORK IN CLV R/W OR CLV EASEMENT ONLY. OBTAINING PERMISSION OR EASEMENT FOR WORK SHOWN IN PRIVATE PROPERTY IS THE RESPONSIBILITY OF THE UTILITY.

APPROVAL: *Shawn Batten* DATE: 3-26-18

PERMIT # 405051700000138035
DRAWN BY: WTB
DATE: 2-6-18
SCALE: 1:30
NODE: N/A
DESIGNED BY: TRUENET
TECH #
N/A
APPROVED BY: BRADLEY DEMARSHUS

COX
1700 VEGAS DRIVE
LAS VEGAS, NEVADA 89106
PHONE: (702) 545-1606
FAX: (702) 545-2606

CITY OF LAS VEGAS
333 N. RANCHO DRIVE
LAS VEGAS, NEVADA 89106
(702) 229-6885

PROJECT LOCATION: N DECATUR BLVD & DONALD RD

SUB-CONTRACTOR: TBD

ENTITY NOTES: TBD

SHEET No: 10745067-1-0012
3
L17-00646-0002
SHEET 3 OF 3

TrueNet# 11907