


QUANTITIES:

DESCRIPTION	UNIT	QUANTITY
FIRE HYDRANT	EA.	1
6" A.C.P.	L.F.	3
8" A.C.P.	L.F.	13
8" Y 8" 6" TEE	EA.	1
6" GATE VALVE	EA.	1
5 3/4" SCREW TYPE BUFFALO VALVE BOX	EA.	1
8 1/2" C.L.V. FIRE DEPT WATER VALVE COVER	EA.	1
3/2" PRE-MOULDED EXPANSION JOINT MATERIAL	L.F.	16
S-F 1000 CONCRETE	C.Y.	0.5
TYPE 2 GRAVEL	CY.	0.5

SCALE: 1"=20'

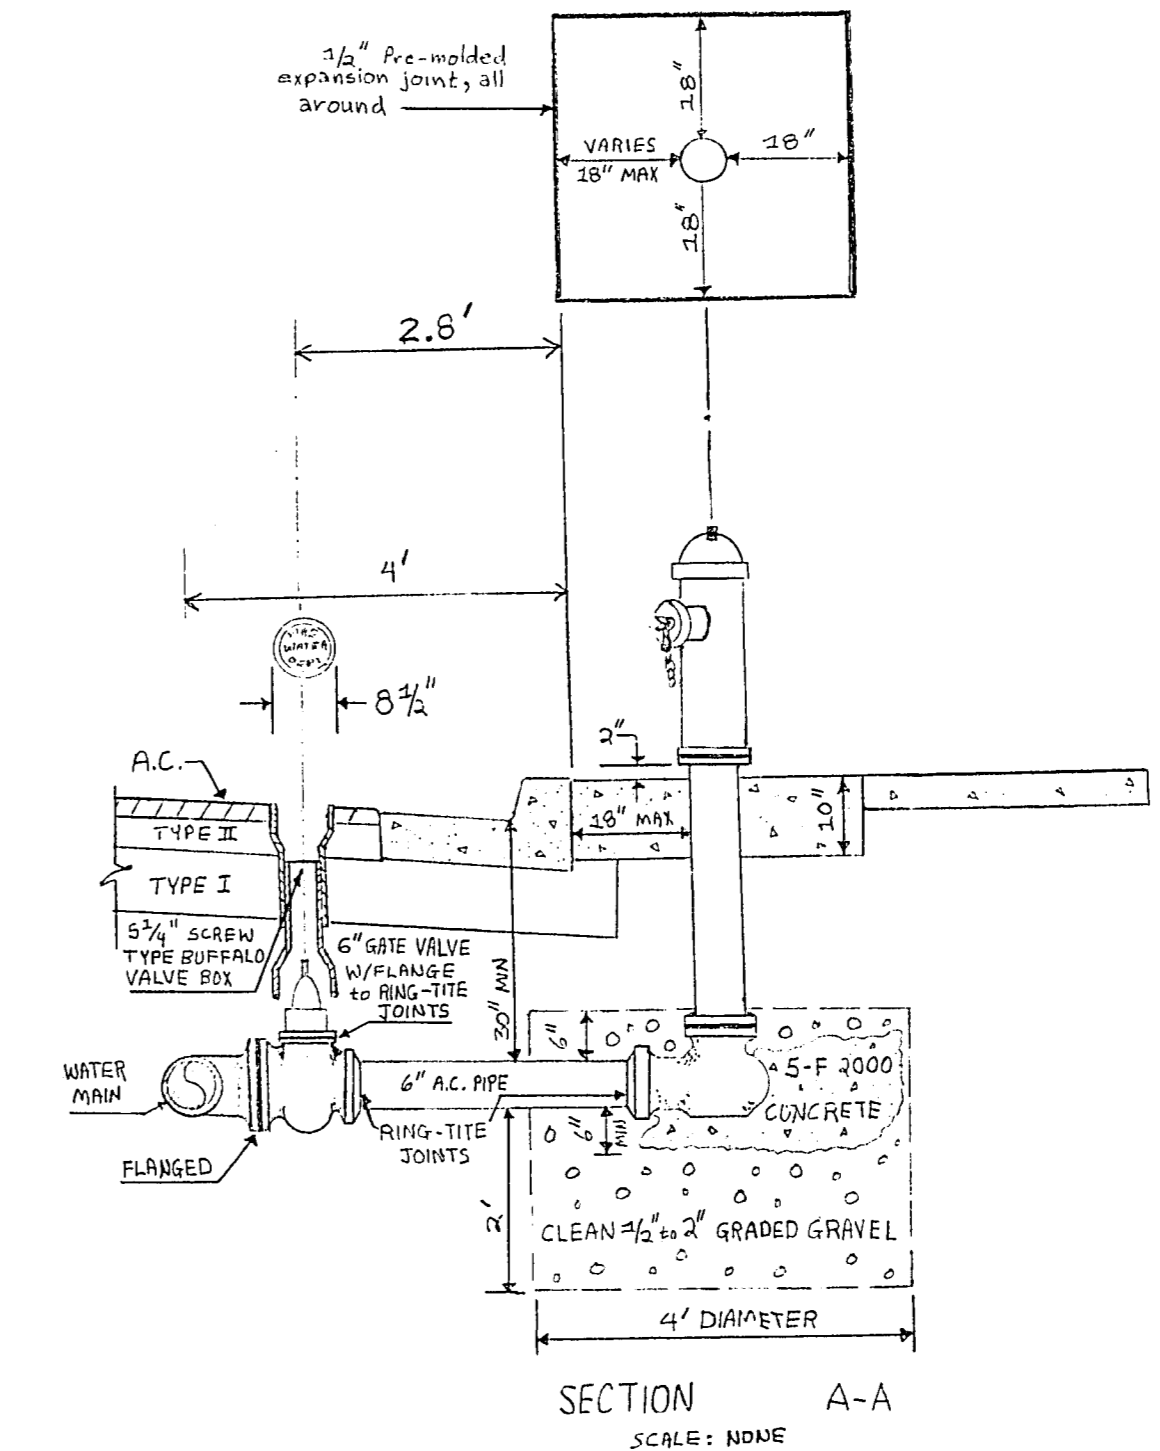


Scale (h)	1"=20'	Scale (v)	NONE	W.O. no.	4221
Fid. bk. no.	75-5X	Date		Drawn by	
Design by	C. Kuzonski	Approved by the Director of Public Services		Date	3/17/78

Department of Public Services Engineering Design Division
 ALTA DRIVE & VALLEY VIEW BOULEVARD
 FIRE HYDRANT & WATER LINE
 INSTALLATION

[Signature]
 LAS VEGAS VALLEY WATER DISTRICT
[Signature]

3/16/78
 DATE
 3-17-78

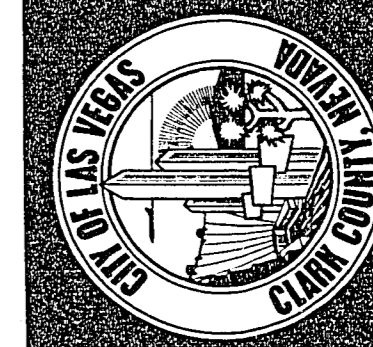

REVISION
 Drawing no.
 107 V-367

23-4-93