


GENERAL PLAN NOTES

1. PROVIDE A 3/4"C HOMERUN FROM EACH TELEPHONE, DATA AND TELEVISION OUTLET TO TELEPHONE TERMINAL BOARD (TTB).
2. ALL CONDUITS SHALL BE 3/4"C UNLESS NOTED OTHERWISE.
3. SPEAKER VOLUME CONTROLS SHALL INSTALLED IN 4" X 4" RECESSED J-BOXES WITH SINGLE GANG RINGS AT 48" AFF TO CENTER OF DEVICE, UNLESS NOTED OTHERWISE.
4. ELECTRICAL CONTRACTOR SHALL PROVIDE ALL SPEAKERS, WIRING, CONDUITS, ENCLOSURES, MOUNTING HARDWARE, GRILLES, TRANSFORMERS, VOLUME CONTROLS AND J-BOXES. PROVIDE ALL ITEMS NEEDED TO MAKE ALL SYSTEMS COMPLETE AND OPERABLE.
5. ELECTRICAL CONTRACTOR SHALL PROVIDE 2-CONDUCTOR 18 AWG STRANDED SPEAKER WIRE WITH FOIL SHIELD. USE WEST PENN 293 ONLY AT LANDLINE VOCAL SYSTEM SPEAKERS AND CARROLL C2534-4110 AT RADIO VOCAL SYSTEM SPEAKERS. WEST PENN AND CARROLL CONDUCTORS SHALL BE COLOR CODED SEPARATELY.
6. TERMINATE SPEAKER WIRING AT TRANSFORMER (ON 2.5 WATT TERMINAL FOR INSIDE SPEAKERS, 3.7 -WATT TERMINAL FOR OUTSIDE SPEAKERS, 70V SIDE), WALL VOLUME CONTROLS AND AT 24" X 24" X 6" J-BOX. SEE CONTROL DIAGRAM ON SHEET E6.2.
7. COORDINATE SPEAKER GRILLES WITH LIGHT FIXTURES AND CENTER GRILLES IN CEILING TILES.
8. PROVIDE WALL PLATES FOR ALL WALL MOUNTED PHONE JACKS.

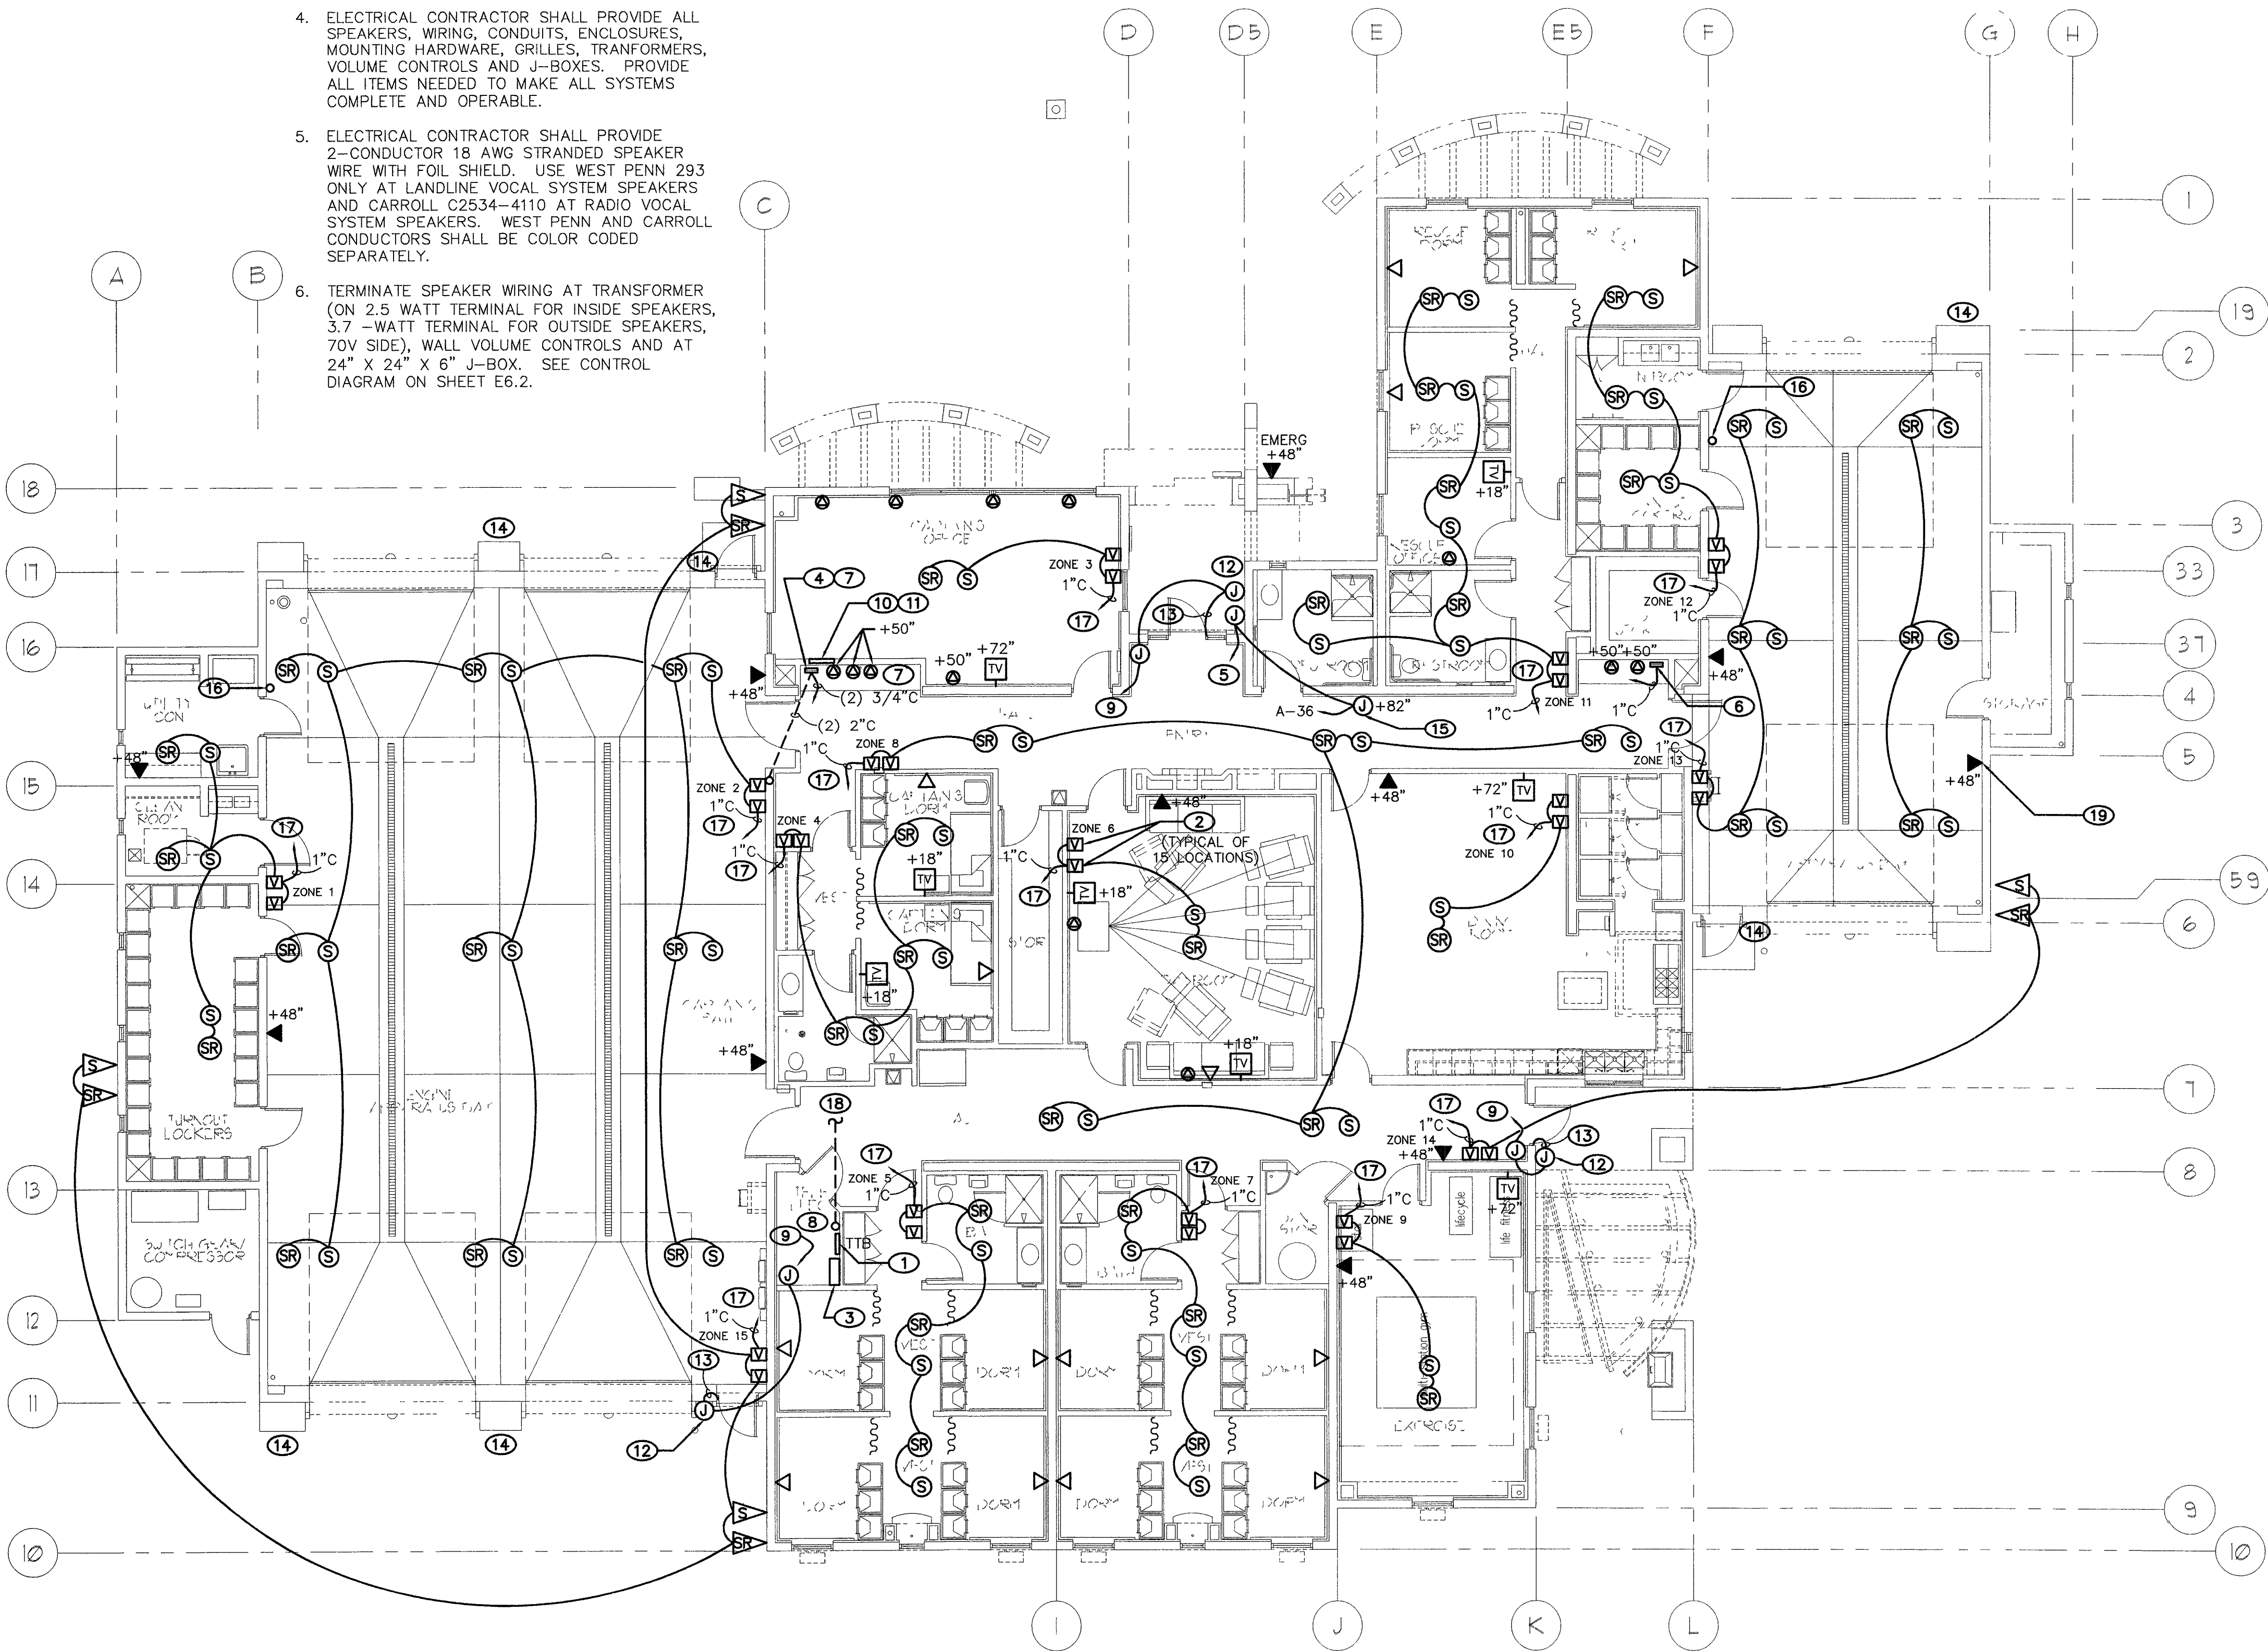

ELECTRICAL COMMUNICATION PLAN

Scale: 1/8"=1'-0"


Project North

KEYED PLAN NOTES


- 1 REFER TO CIVIL DRAWINGS, SHEET C-ES.1 FOR LOCATION OF TELEPHONE SERVICE POINT.
- 2 PROVIDE (2) 2-GANG FLUSH MOUNTED BOXES FOR SPEAKER VOLUME CONTROLS AT THE LOCATIONS INDICATED.
- 3 PROVIDE HUBBELL RE4X WALL MOUNTED CABINET (24"W X 42"H X 10"D) AT TTB AS DIRECTED BY OWNER. NO SUBSTITUTIONS.
- 4 PROVIDE 12"W X 12"H X 4"D FLUSH MOUNTED PULLBOX BELOW ALARM COUNTER WITH (2) 2"C FROM PULLBOX TO PARAPET WALL AS INDICATED. ROUTE CONDUIT ABOVE ROOF LINE FOR ANTENNA CONNECTIONS. PROVIDE COPPER CONDUCTOR ROUTED WITH CONDUIT AND CONNECTED TO BUILDING GROUNDING ELECTRODE.
- 5 PROVIDE J-BOX AT DOOR AT 48" AFF AND PERPENDICULAR TO ENTRY DOOR. ROUTE 3/4"C TO J-BOX ABOVE CEILING FOR 120V POWER. DOORBELL SHALL BE MODEL 504-20-1 BY FEDERAL SIGNAL, NO SUBSTITUTIONS.
- 6 PROVIDE 12" X 12" X 4" J-BOX BELOW SOUTH ALARM COUNTER AND ROUTE 1"C TO NORTH ALARM COUNTER (ADJACENT TO ENGINE BAY).
- 7 ROUTE (2) 3/4"C TO TTB IN ELECTRICAL ROOM FOR VOCAL SYSTEMS. TERMINATE UNDER ALARM COUNTER IN 12" X 12" X 4" J-BOX, APPROXIMATELY 12" AFF.
- 8 TERMINATE ALL DATA WIRING TO HUBBELL RE4X CABINET AT (2) HUBBELL 16-PORT UNLOADED JACK PANELS (MODEL NO MCCF1619) WITH HUBBELL DATA JACKS (MODEL NO. HD670BB) INSIDE WALL MOUNTED CABINET.
- 9 PROVIDE 12" X 12" X 4" J-BOX ABOVE CEILING. ROUTE 3/4"C WITH PULLSTRING TO TTB FOR FUTURE CARD ACCESS SYSTEM.
- 10 PROVIDE 24"W X 24"H X 6"D ALARM J-BOX FLUSH MOUNTED AT 48" AFF TO BOTTOM OF J-BOX FOR SPEAKER SYSTEMS, WITH HINGED LOCKABLE COVER. ACCESS TO J-BOX SHALL BE FROM THE CAPTAIN'S OFFICE. SEE CONTROL WIRING DIAGRAM ON SHEET E6.2.
- 11 ROUTE (2) 1"C FROM 24" X 24" X 6" ALARM J-BOX TO 12" X 12" X 4" ALARM J-BOX UNDER SOUTH ALARM COUNTER (ADJACENT TO RESCUE BAY). COORDINATE EXACT LOCATION WITH OWNER.
- 12 PROVIDE 4S J-BOX WITH SINGLE-GANG RING AND BLANK COVER MOUNTED AT 48" AFF FOR FUTURE CARD ACCESS SYSTEM.
- 13 PROVIDE 3/4"C TO ELECTRIC STRIKE.
- 14 COORDINATE EXACT LOCATION OF ANTENNAS WITH OWNER AND WITH INSTALLATION CONTRACTOR PRIOR TO ROUGH-IN.
- 15 PROVIDE 3/4"C FROM DOORBELL J-BOX TO DOORBELL BUTTON J-BOX AT MAIN ENTRY DOOR.
- 16 ROUTE 3/4"C FROM 84" AFF NEAR BATTERY CHARGER UP THE INSIDE SURFACE OF THE WALL TO THE PARAPET WALL ABOVE THE ROOF FOR FIRE DEPT. GPS SYSTEM.
- 17 ROUTE CONDUIT TO 24" X 24" X 6" ALARM J-BOX IN CAPTAIN'S OFFICE.
- 18 1" CONDUITS FOR FUTURE CAMERAS. SEE SHEET C-ES.1 FOR CONTINUATION. SEE NOTE 1 ON SHEET C-ES.1.
- 19 RJ-11 PHONE JACK FOR VEEDER-ROOT TANK MONITOR. SEE SHEET E6.2.



REVISIONS
3 8/31/04 CHANGES

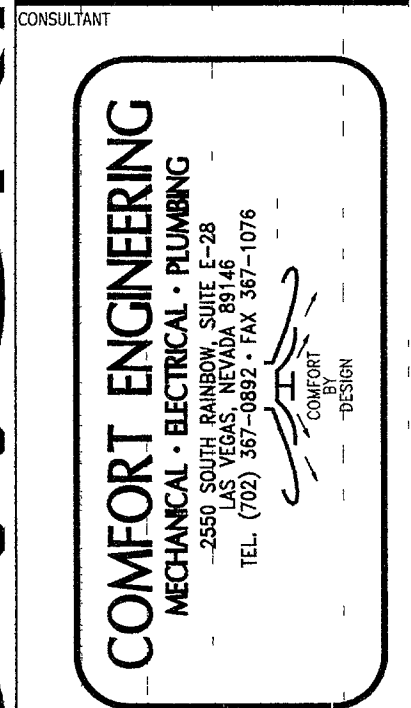

CITY OF LAS VEGAS, NEVADA
FIRE STATION #8
ELECTRICAL COMMUNICATION PLAN

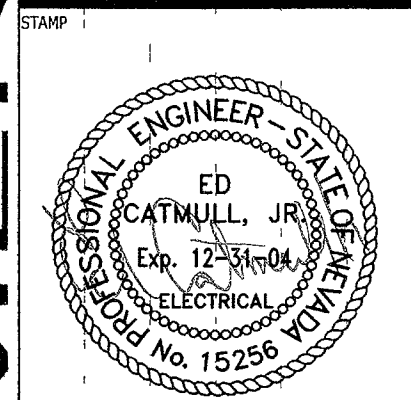

OWNER: CITY OF LAS VEGAS
DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL SERVICES

400 EAST STEWART AVENUE
LAS VEGAS, NEVADA 89101
PHONE: (702) 229-6535
FAX: (702) 382-3232
TDD: (702) 386-9108

DRAWN: DSN
FILE:
DATE: 4/9/04
SCALE: 1/8" = 1'-0"
BID NO: 04.1534104
CLV DWG NO: 630-101

E4.1