


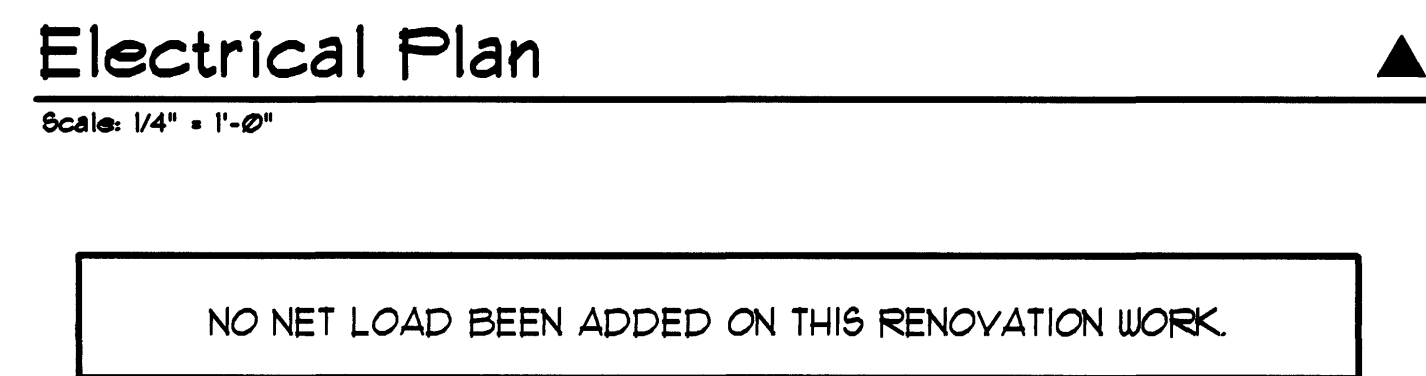

1. EXISTING WALL LIGHTING FIXTURE TO REMAIN. RETROFIT LAMP AND BALLASTS TO F03278/141 AND ELECTRONIC BALLASTS.
2. EXISTING WALL LIGHTING SWITCH TO REMAIN.
3. INSTALL NEW WALL SWITCHES • 48" AFF FOR SEPARATE NEW CEILING LIGHTING CONTROL AS SHOWN.
4. EXISTING WALL LIGHTING FIXTURE TO BE REMOVED.
5. INSTALL CABLE TV OUTLET • 18" AFF.
6. EXISTING POWER RECEPTACLE TO REMAIN.
7. INSTALL DATA/VOICE OUTLET • 18" AFF AND PROVIDE ¾" C HOME RUN WITH FULL STRING TO TERMINAL TELEPHONE BOARD. VERIFY WITH I.T. FOR REQUIREMENTS.
8. INSTALL NEW 2X4 CEILING TROFFER LITHONIA 25P-G-3-32-A1215-120-GE8 CONNECT TO EXISTING LIGHTING CIRCUIT THROUGH EXISTING WALL LIGHT AS SHOWN.
9. REPLACE EXISTING 2X4 FIXTURE WITH NEW 2X4 CEILING TROFFER LITHONIA 25P-F-3-32-A1215-211-GE8.
10. INSTALL NEW CONVENIENT DUPLEX RECEPTACLE • 18" AFF. CONNECT TO THE EXISTING CIRCUIT THROUGH EXISTING OUTLET AS SHOWN. SELECT AN EXISTING CIRCUIT WITH LOWEST LOAD FOR THE CONNECTION OF NEW OUTLET.

1. FIELD VERIFY EXISTING EQUIPMENT, CIRCUITS AND SERVICE VOLTAGE THAT ARE REMAINING TO BE RECONNECTED TO EXISTING PANELBOARD. PROVIDE SWITCHES, RECEPTACLES, CONDUIT, WIRE, ETC. AS REQUIRED TO RESTORE CONTINUITY OF CIRCUITS.
2. REFER TO ARCHITECTURAL DUGS FOR LOCATION AND EXTENT OF DEMOLITION REQUIRED. RESTORE P.A. SPEAKERS EST. AS REQUIRED.
3. COORDINATE WITH OTHER TRADES FOR ELECTRICAL RELATED WORK
4. ALL WORK SHALL BE IN ACCORDANCE WITH THE NEC AND LOCAL GOVERNING CODES AND ORDINANCES.
5. ALL LAMP SHALL HAS COLOR CODE 741.