

NOTE: REFER SHEET 4 FOR LOCATION OF 2 INCH PVC SERVICE TO COMFORT STATION NO. 15

REVISIONS

NO.	DATE	DESCRIPTION
1	11/20	ISSUED FOR PERMIT
2	11/20	ISSUED FOR PERMIT

DATE: 11/20

waterresource
CONSULTING ENGINEERS

PHASE 1-B & 2

CHARLES SALADINO-LANDSCAPE ARCHITECT-ASLA-LTD
LAS VEGAS, NEVADA

FLOYD LAMB STATE PARK
DIVISION OF STATE PARKS


1395 HASKELL ST. - SUITE C - RENO, NEVADA - 89509 - 702.786.2560

NEW AND EXISTING WATER SERVICE PLAN


SHEET
U-1

ITEM #	DESCRIPTION
1	Retire existing 3/4-inch service to residence, depth of pipe and material type unknown. Tap 6-inch ACP and install new 1-inch service with CURB VALVE. See Detail U-1.
2	Cut existing 6-inch ACP and cap. Extend 6-inch ACP as shown to lake. Retire existing service, size and depth unknown. Refer to Detail U-1 for description of work.
3	CUT existing 6-inch ACP and install 1/2-inch TEE AND GATE VALVE FOR Irrigation. Extend irrigation line 350', provide 6" ACP CI. 150, 18" cover.
4	Retire existing service to restroom and concession station (No. 15), size and depth unknown.
5	Retire existing 2-inch irrigation service, depth unknown.
6	Remove fire hydrant and isolation valve, plug tap from 6-inch ACP.
6A	Relocate fire hydrant and isolation valve from #6 above to location shown, install as per Detail U-4.
7	Retire existing 1 1/2-inch service, depth unknown.
8	Remove section of existing 6-inch ACP and install new 6-inch cast iron piping and fittings as shown in Detail on sheet U-2.
9	Retire existing service, size and depth unknown.
10	Retire existing 3/4-inch copper service, depth unknown.
11	Retire existing 2-inch service, depth unknown.
12	Retire existing service, size and depth unknown.
13	Retire existing service, size and depth unknown.
14	Retire existing 2-inch irrigation service, depth unknown.
15	Remove existing fire hydrant and isolation valve, plug tap from 6-inch ACP.
15A	Relocate fire hydrant and isolation valve from #15 above to location shown, install as per Detail U-4.
16	Retire existing 2-inch irrigation service, depth unknown.
17	Retire existing comfort station service, size and depth unknown.
18	3/4" Service to drinking fountain - field locate.
19	3/4" Service to hose bib (tap 2" PVC to comfort station) field locate hose bib.
20	3/4" Service to hose bib (tap 1" PVC) field locate hose bib.
21	3/4" Service to hose bib (tap 1" PVC) field locate hose bib.
22	3/4" Service to hose bib (tap 6" PVC) field locate hose bib.

*Changed
Detailed by Rev. 1/18
Drawing of location.*

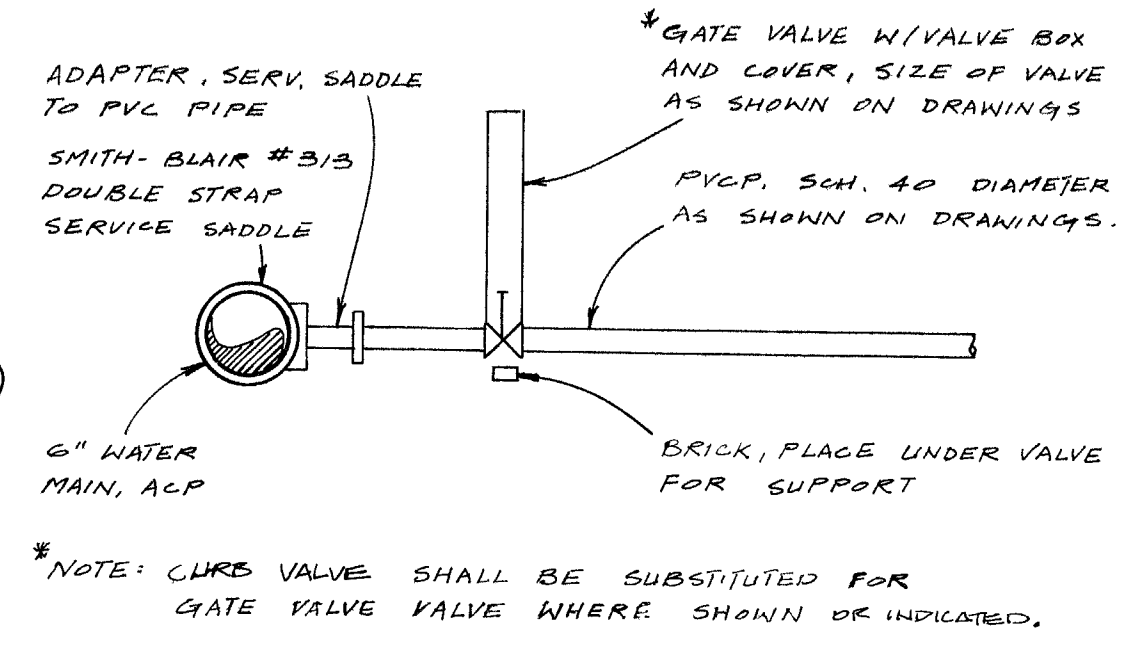

B WATER SERVICE CONNECTION DETAIL
U-1
NTS

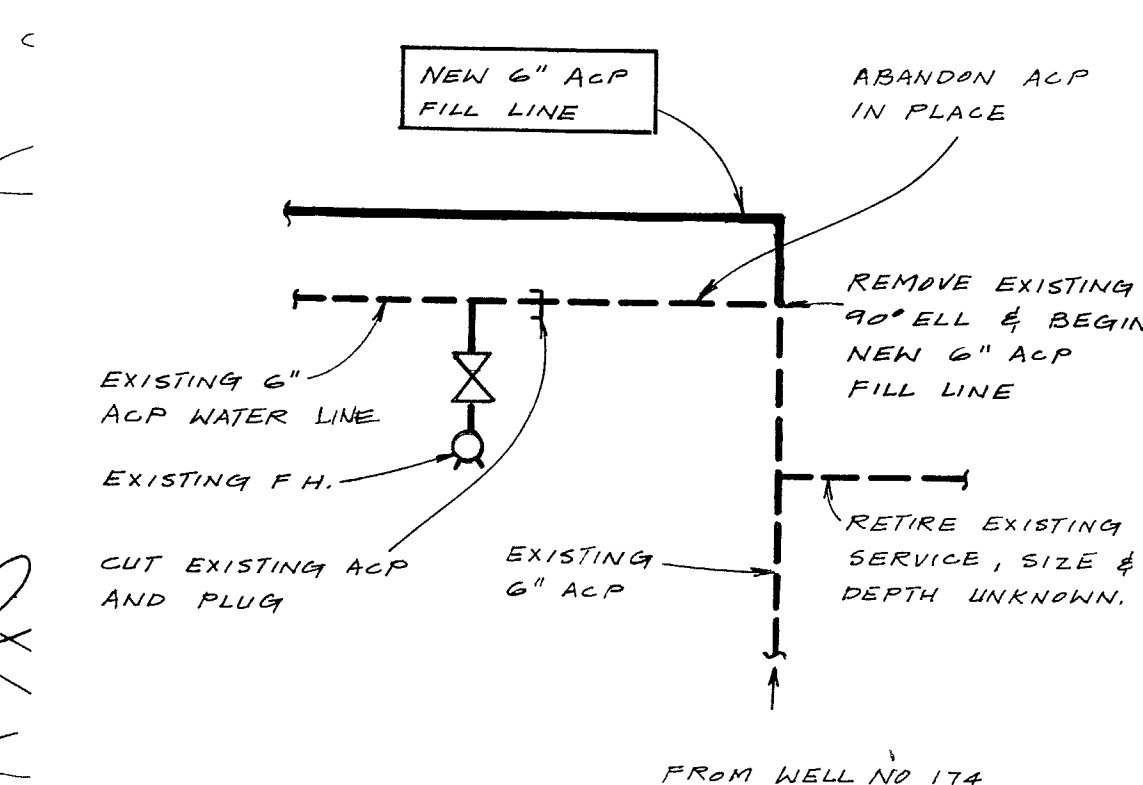

A DETAIL
U-1
NTS

NEW AND EXISTING WATER SERVICE PLAN
1"=100'



101355