

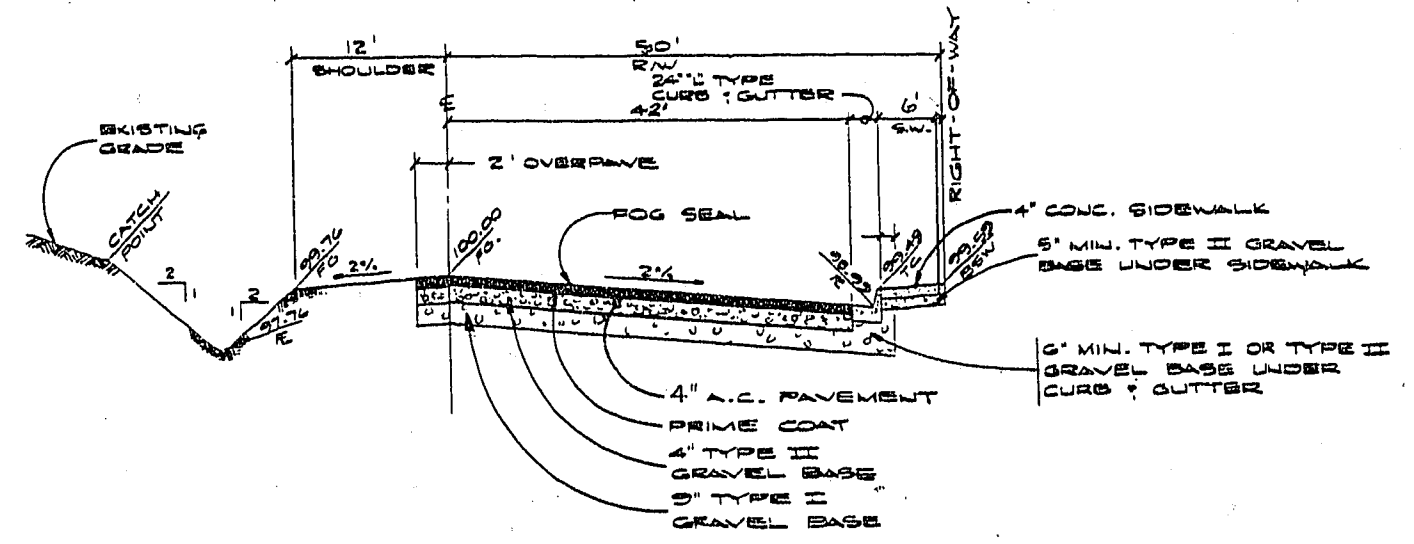



11-7-89

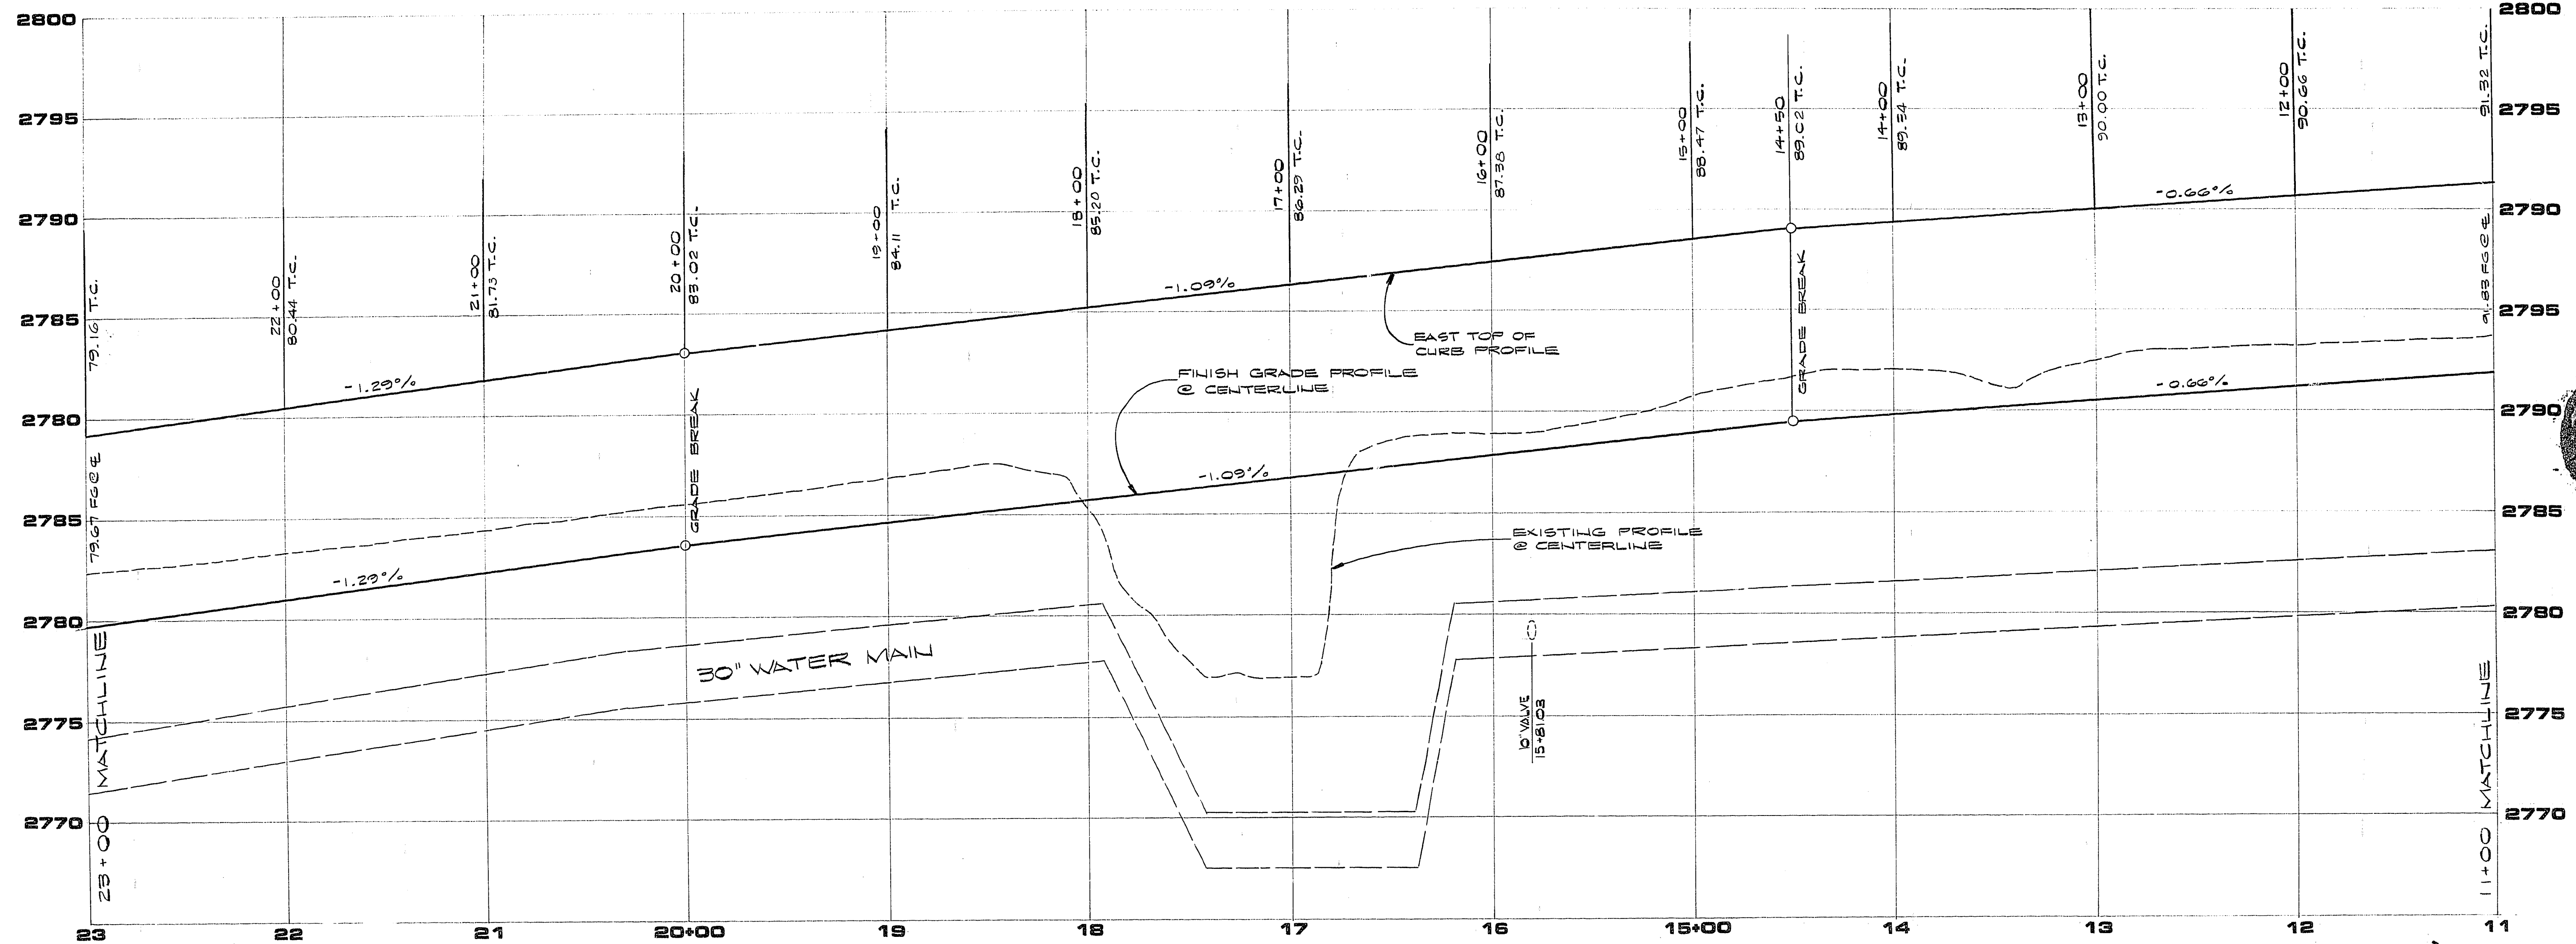

- NOTES:**
- STRUCTURAL SECTION OF STREET TO CONFORM TO C.L.V. STANDARD DRAWING.
 - OWNER AGREES THAT IF EXISTING NATIVE MATERIAL DOES NOT CONFORM TO SPECIFICATIONS FOR TYPE I BASE, OWNER WILL IMPORT TYPE I BASE FOR A.C. PAVEMENT.
 - C.L.V. WILL BE CONTACTED PRIOR TO CONSTRUCTION TO DETERMINE SUITABILITY OF NATIVE MATERIAL.

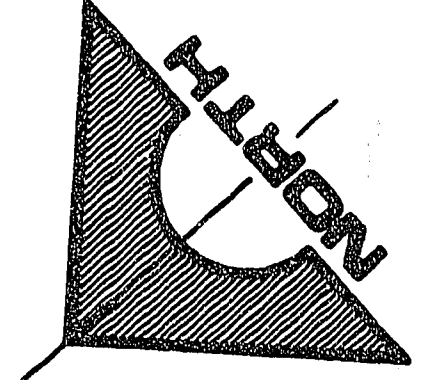


PROFILE
SCALE 1" = 40' HOR.
1" = 4' VERT.

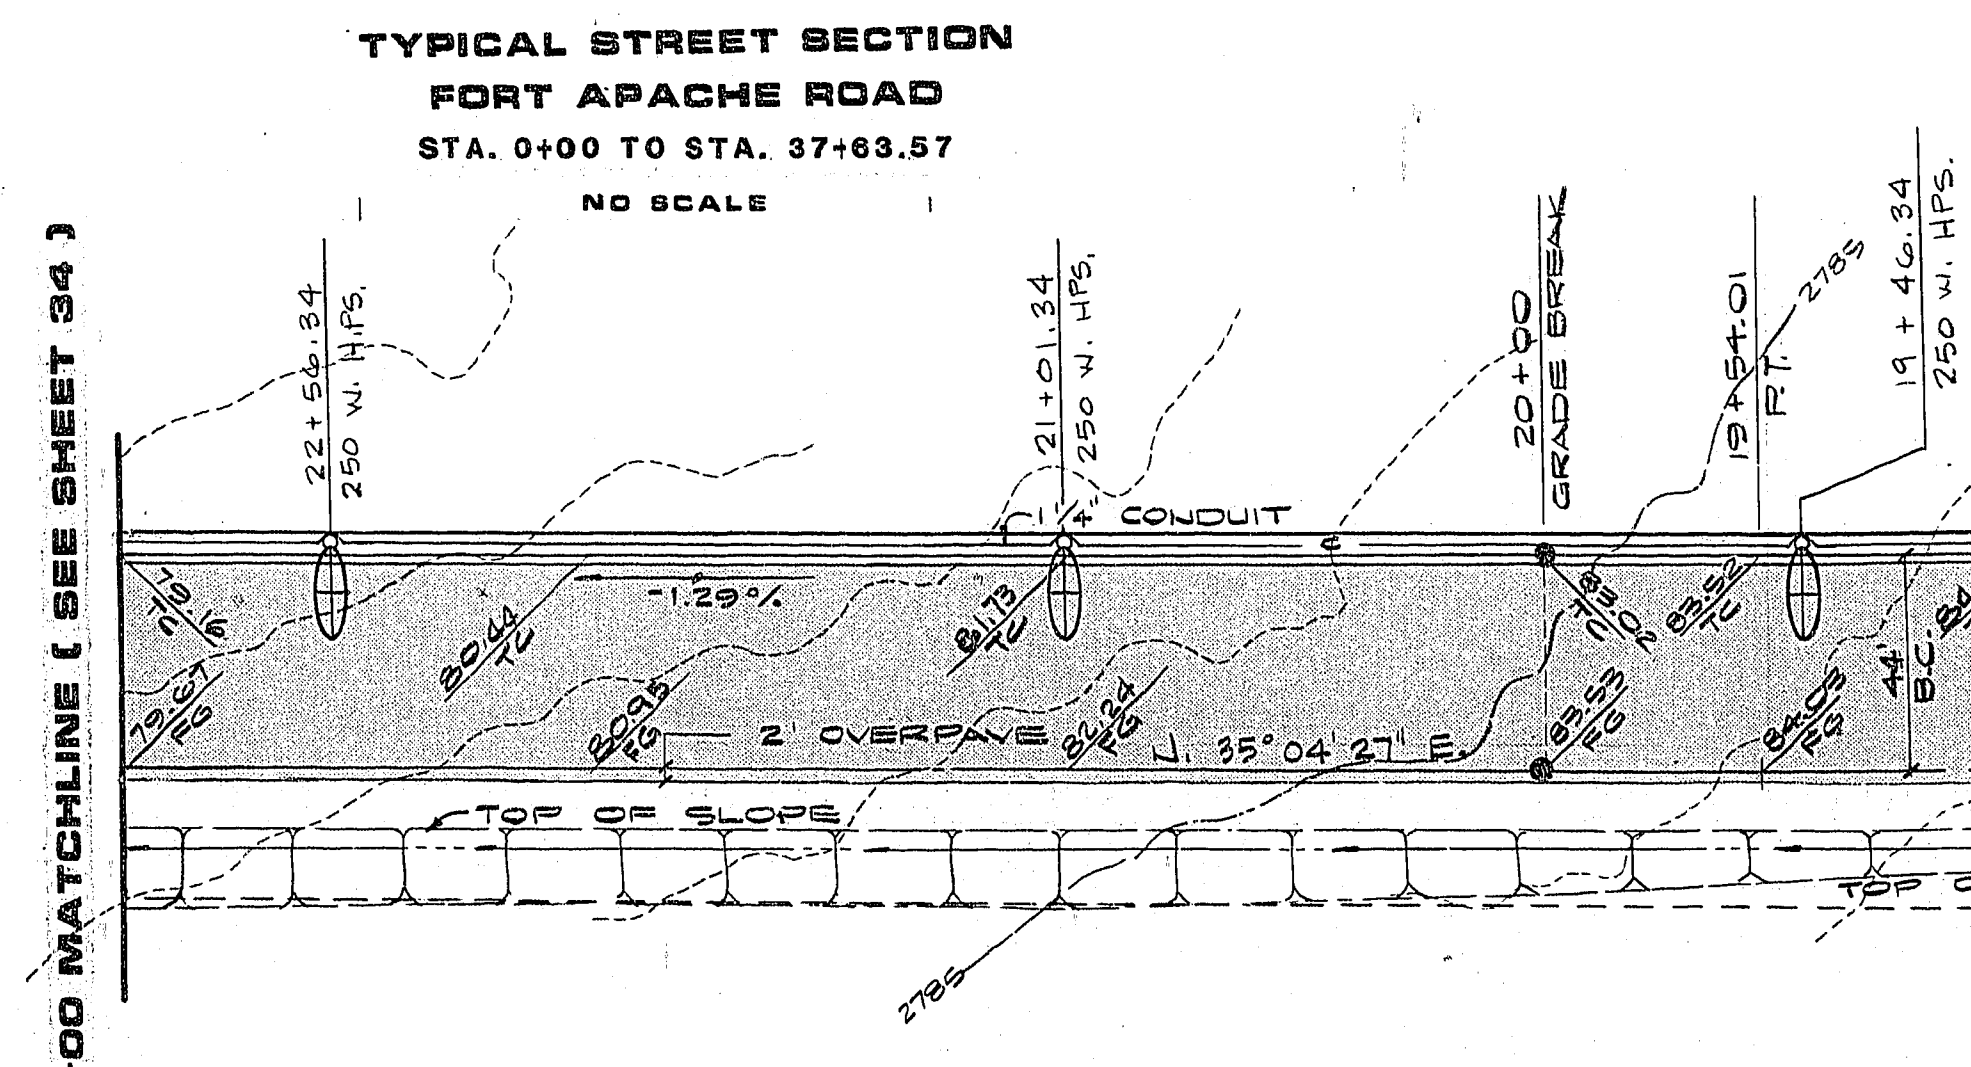

BCR CURVE DATA


NO.	R	Δ	L	T
1	37°06'04"	1998.37'	1294.02'	670.61'
2	37°06'04"	1954.37'	1265.53'	655.84'

FORT APACHE ROAD
SCALE 1" = 40'

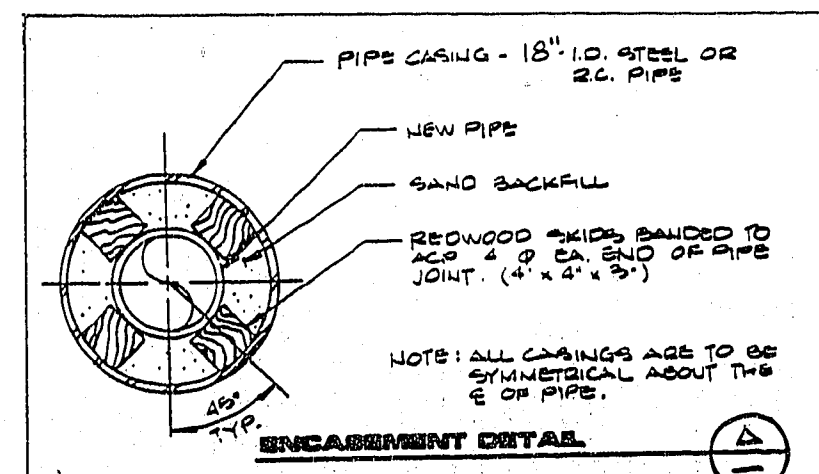

- NOTE:**
- Steel pipe casing shall be fabricated from a minimum of 1/4" thick steel plates, conforming to the requirements of ASTM A572, Grade 50, or 55. All joints shall be welded. Interior joints shall be ground to a smooth finish. All welding shall be performed in accordance with AWS D1.1, "Welding Standard for Fabricated Electrically Welded Steel Water Pipe." Coatings for steel casing are not required.
 - Pipe casing shall be laid true to line and grade with no bends or changes in grade for the full length of the casing.
 - The pipe shall be supported at each end and at each joint with sills. The annular space between the pipe and the casing shall be backfilled with sand. After installation of the pipe, the casing shall be sealed at both ends with neoprene brick or cement brick.

NOTE:
THESE PLANS HAVE BEEN PREPARED ASSUMING THAT THE 30" WATER LINE TO BE CONSTRUCTED IN FORT APACHE RD. R.O.W. BY OTHERS IS EXISTING.

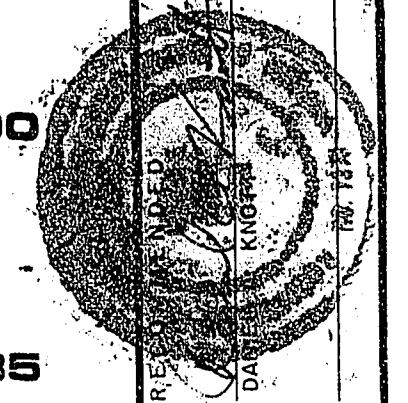

G.C. WALLACE, INC.
Engineering/Architecture

FOOTHILLS COUNTRY CLUB UNIT NO. 3
AT PECOCLE RANCH
FORT APACHE ROAD
STA. 11+00 TO STA. 23+00

SHEET 33