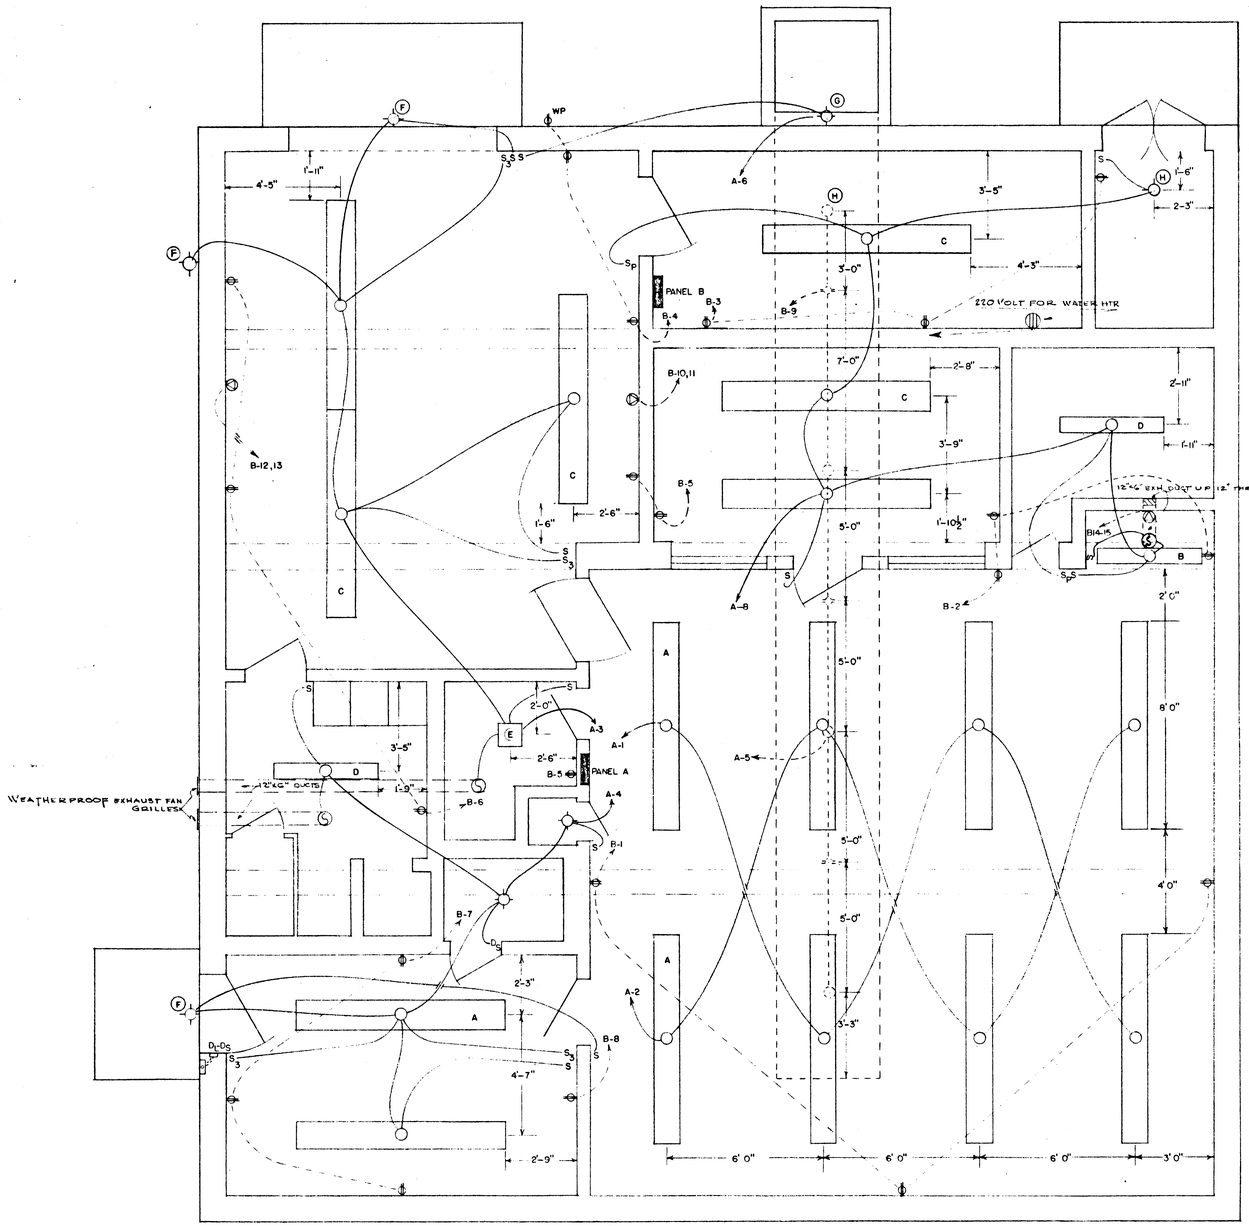


LIGHTING SYSTEM

SCALE – 3/8" = 1'0"

## PANEL A SCHEDULE

| CIRC. NO. | NO. OUTLETS | LOCATION – LIGHT FIXTURES | WATTS FXTR. | A Ø | B Ø |
|---|---|---|---|---|---|
| 1 | 4 | EQUIPMENT ROOM – ALTERNATE LIGHTS | 290 | 1160 | — |
| 2 | 4 | " " " " | 290 | — | 1160 |
| 3 | 6 | REAR DOOR – OUTSIDE BKT. – 1 | 200 | | |
| | | SHOP – 3 | 250 | | |
| | | OPERATOR'S ROOM – 1 | 58 | | |
| | | " " – 1 FAN | 58 | 1086 | |
| 4 | 7 | OFFICE – 2 | 290 | | |
| | | CLOSET – 1 | 100 | | |
| | | OUTSIDE BKT., FRONT – 1 | 200 | | |
| | | MEN'S ROOM – 1 | 104 | | |
| | | " " – 1 FAN | 58 | | |
| | | JANITOR CLOSET – 1 | 75 | | 1117 |
| 5 | 4 | WIREWAY TUNNEL | 200 | 800 | |
| 6 | 1 | OUTSIDE REAR, FLOOD LTS. | 1000 | | 1000 |
| 7 | – | CIRCUIT TO EXISTING STATION | 1650 | 1650 | |
| 8 | 7 | AIR CONDITIONING RM. – 1 | 200 | | |
| | | GENERATOR " – 1 | 250 | | |
| | | TERMINAL " – 2 | 250 | | |
| | | STORAGE " – 1 | 104 | | |
| | | KITCHENETTE – 1 | 58 | | |
| | | " – FAN | – | | 1112 |
| 9 | – | BATTERY CHARGER | | 200 | |
| 10 | – | ALARM POWER SUPPLY | | | 200 |
| 11 | – | " " " | | 200 | |
| 12–24 | – | SPARES – | | | |
| | | | | 5076 | 4589 |

## PANEL B SCHEDULE

| CIRC. NO. | NO. RECPT. | LOCATION – 115/230 V. RECEPTACLES | WATTS – A Ø | B Ø |
|---|---|---|---|---|
| 1 | 3 | EQUIPMENT ROOM | 600 | |
| 2 | 3 | " " , TERM. RM., KITCHENETTE | | 600 |
| 3 | 3 | A. C. RM., GENERATOR RM. | 600 | |
| 4 | 3 | REAR W. P., SHOP | | 600 |
| 5 | 3 | SHOP, TERM. ROOM, OPERATOR'S RM. | 600 | |
| 6 | 3 | " , MEN'S ROOM | | 600 |
| 7 | 3 | OFFICE | 600 | |
| 8 | 1 | " | | 600 |
| 9 | 3 | TUNNEL WIREWAY | | |
| 10–11 | 1 | SHOP, SO. WALL – 230 V. | 5000 | |
| 12–13 | 1 | " , NO. " – " | 5000 | |
| 14–15 | 1 | KITCHENETTE COMB. UNIT | 6250 | |
| 16–24 | – | SPARES | | |
| | | | 18,650 | 18,650 |

| REVISIONS | | | | |
|---|---|---|---|---|
| NO. | DATE | DESCRIPTION | CH'K'D | APP. |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

ELECTRICAL

**JOHN REPLOGLE**
ARCHITECT—STRUCTURAL ENGINEER
1503 SO. FIFTH ST. LAS VEGAS, NEVADA

FIRE ALARM BLDG
CITY OF LAS VEGAS

| DATE | DRAWN: F. E. HAM | APPROVED: | DWG. NO. 475 |
|---|---|---|---|
| JOB NO. | CHECKED: | | SHEET NO. 9 of 11 |

630-V9? (FP)