


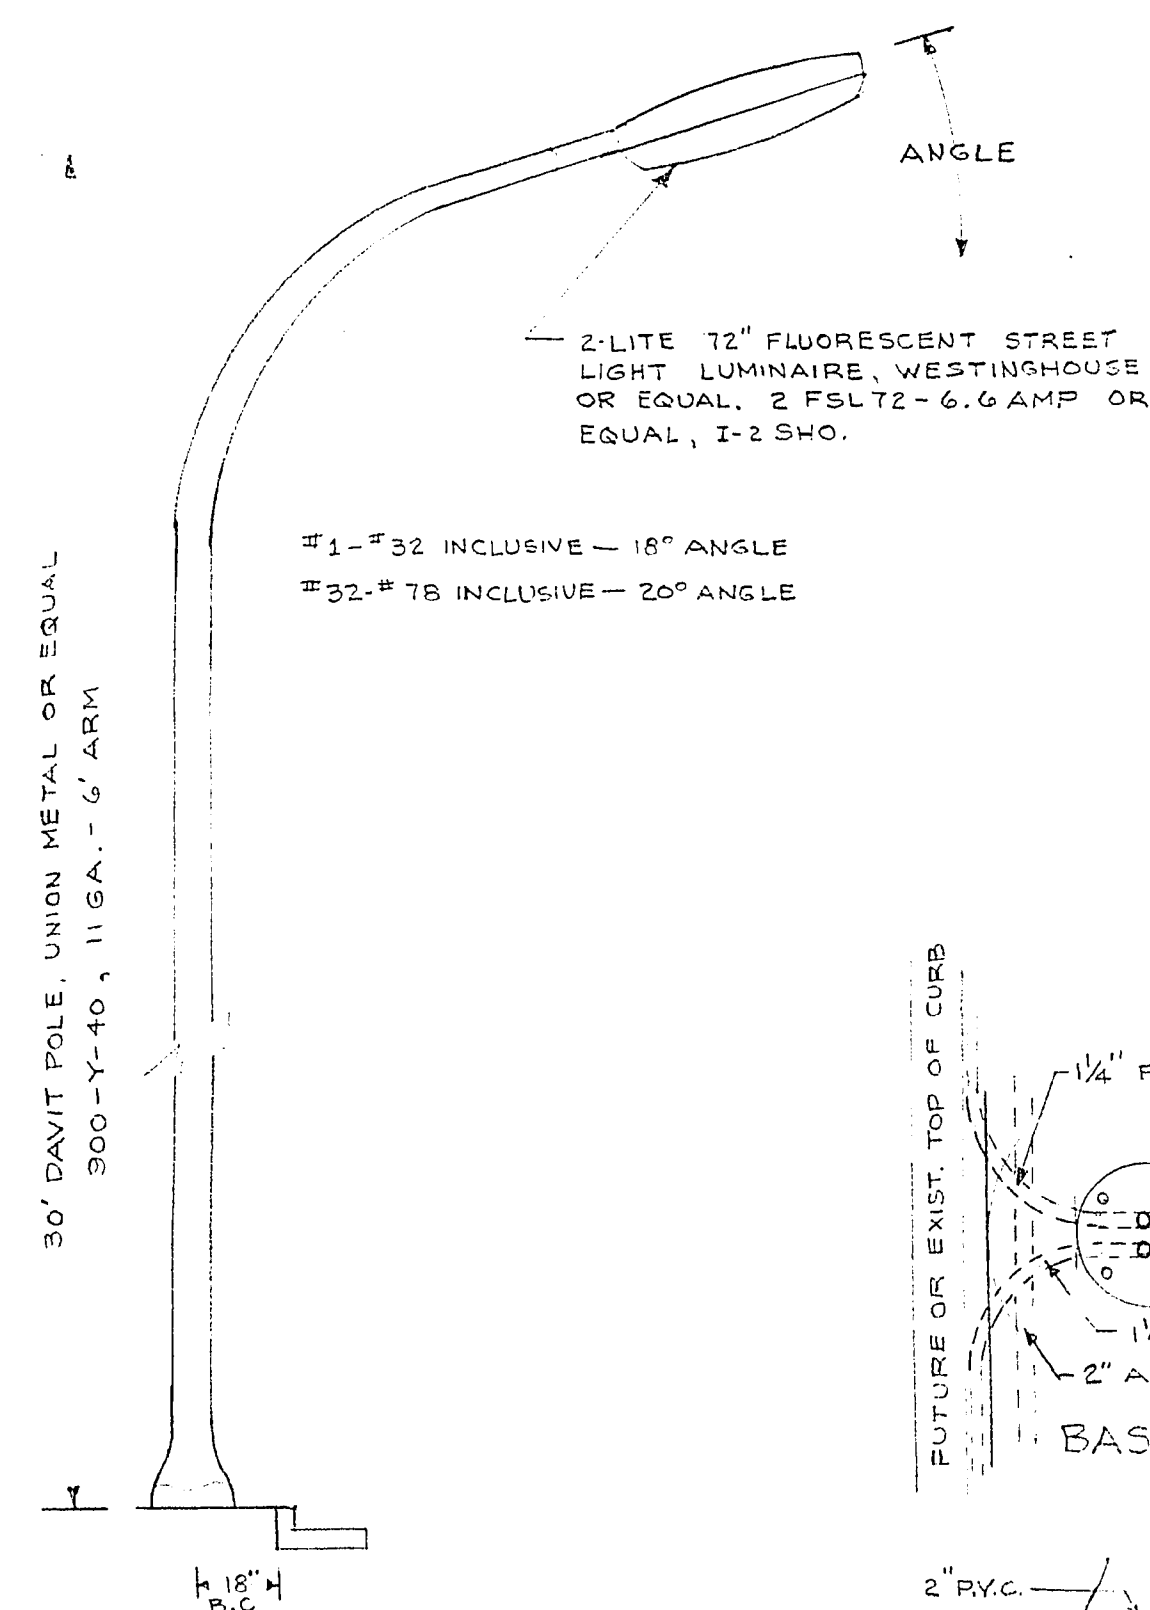
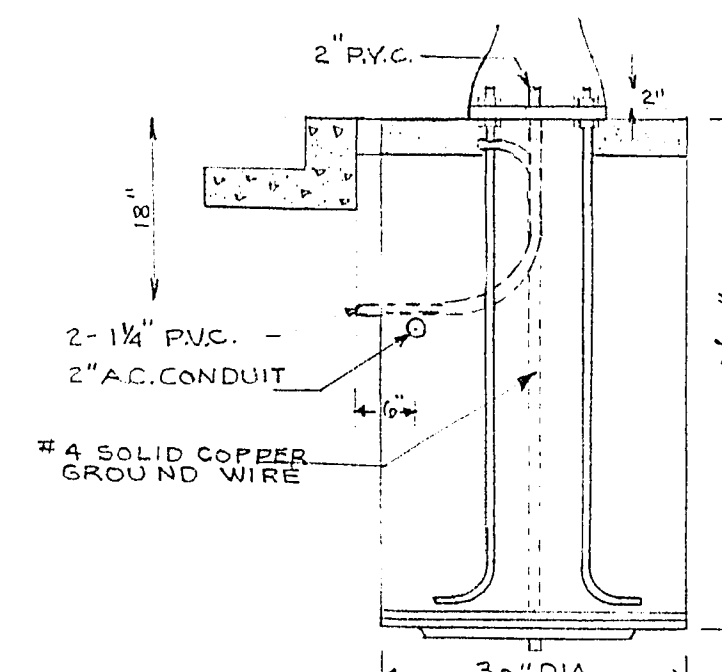


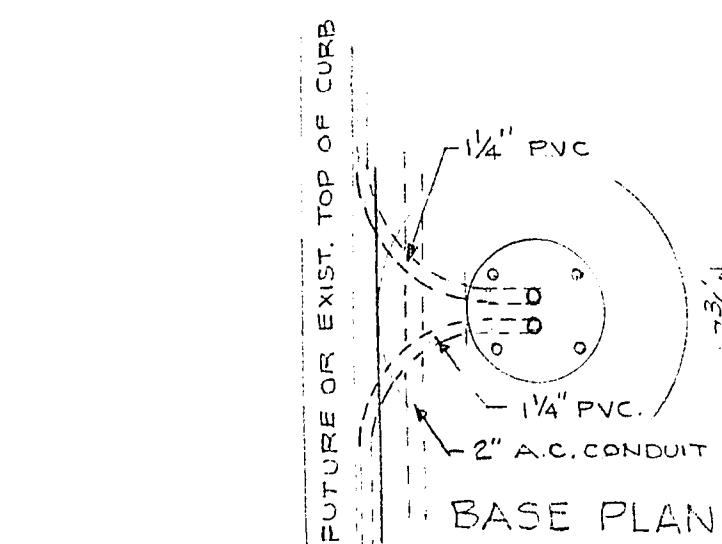

LIGHT POLE

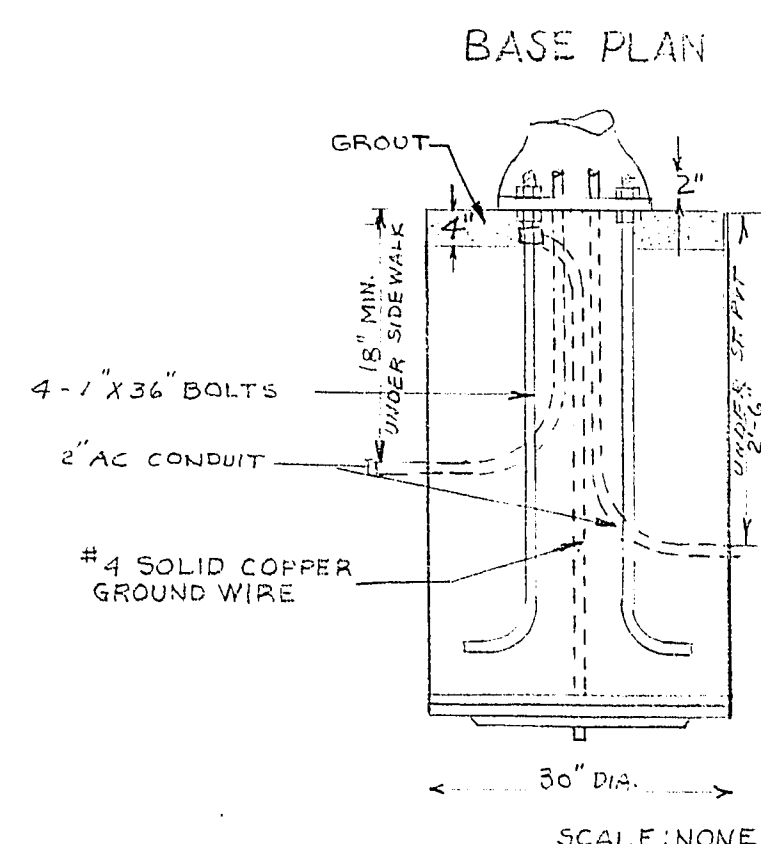


SECTION A-A
POLE BASES NO'S 2, 4, 6, 8, 10, 12, 14, 16, 18,
20, 22, 24, 26, 28, 30, 32, 34,
SCALE: NONE


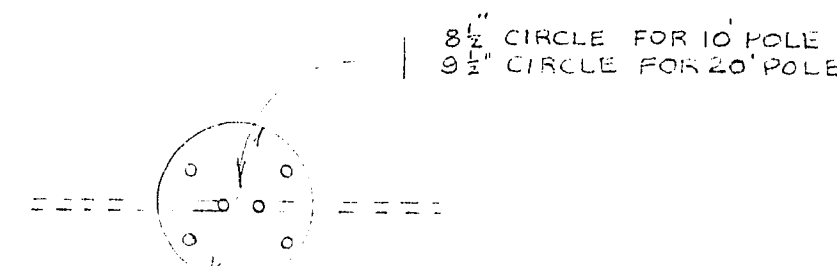


X SECTION - SIGNAL STANDARD BASE



4 EA. 20' POLES	4 EA. 10' POLES
STA. 18+69 1/2	STA. 18+03 1/2
" 19+51 1/2	" 19+37 1/2
" 30+10 1/2	" 30+39 1/2
" 30+92 1/2	" 30+78 1/2

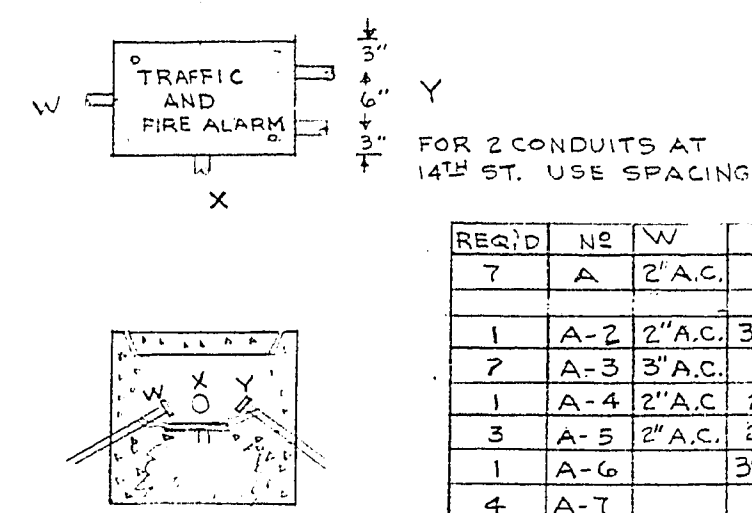

SCHEDULE OF TRAFFIC & FIRE ALARM PULL BOXES

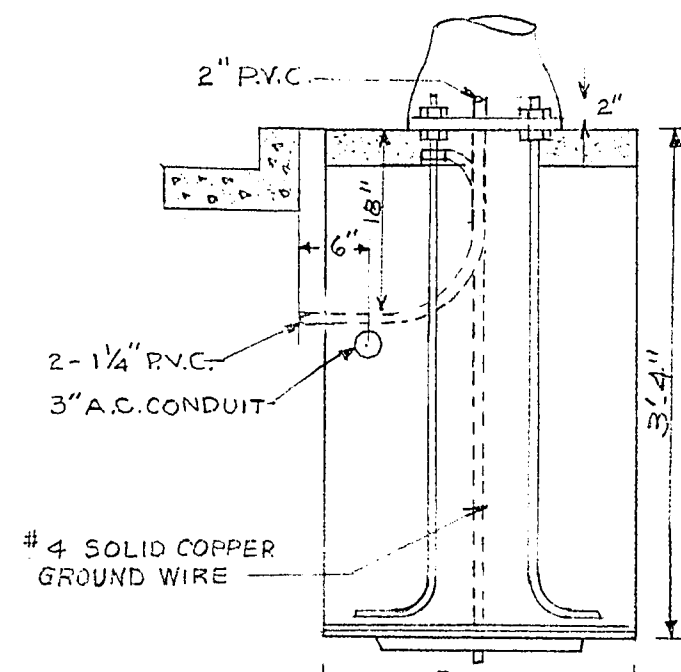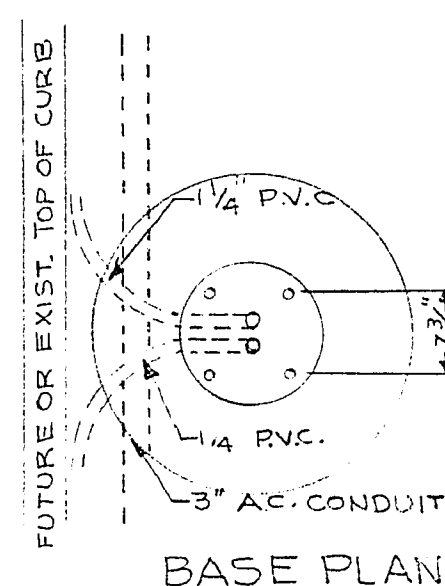


SECTION A-1-A1
POLE BASES NO'S 52, 53, 55, 57, 59,
61, 63, 65, 67, 69, 71, 73, 75, 77, 79
SCALE: NONE

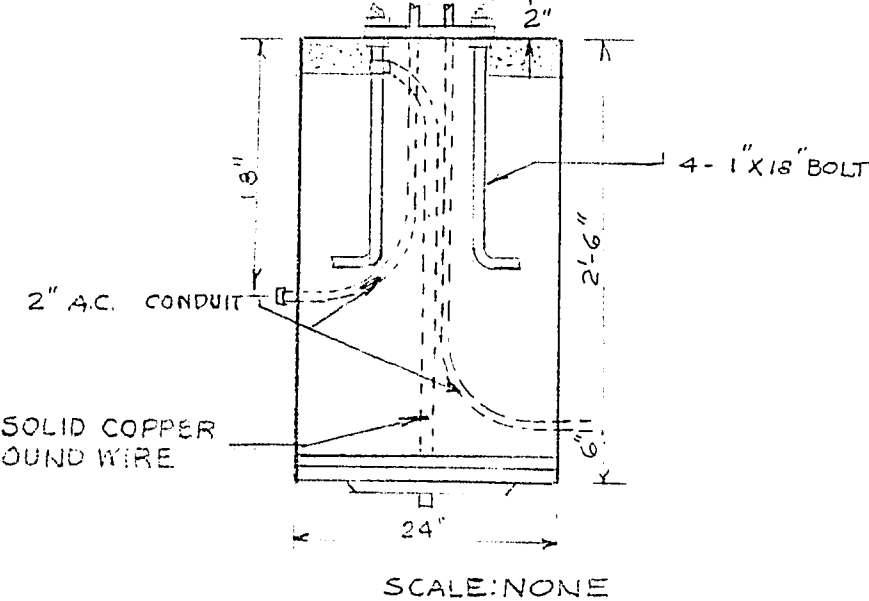
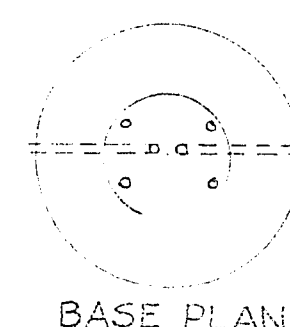


X-SECTION - CONTROLLER BASE



2 EA. (TYPE G)
STA. 3+53 1/2 13+33 1/2
30+15 3/2

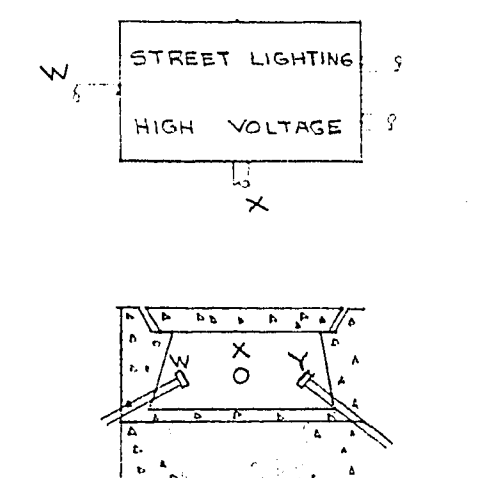



REQ'D.	NO.	W.	X.	Y.	STATIONS
1	B-1	1 1/2\" P.V.C.	1 1/2\" P.V.C.	14\"	WEST SIDE
2	B-2	1 1/2\" P.V.C.	1 1/2\" P.V.C.	14\"	WEST SIDE
1	B-3	1 1/2\" P.V.C.	1 1/2\" P.V.C.	14\"	WEST SIDE

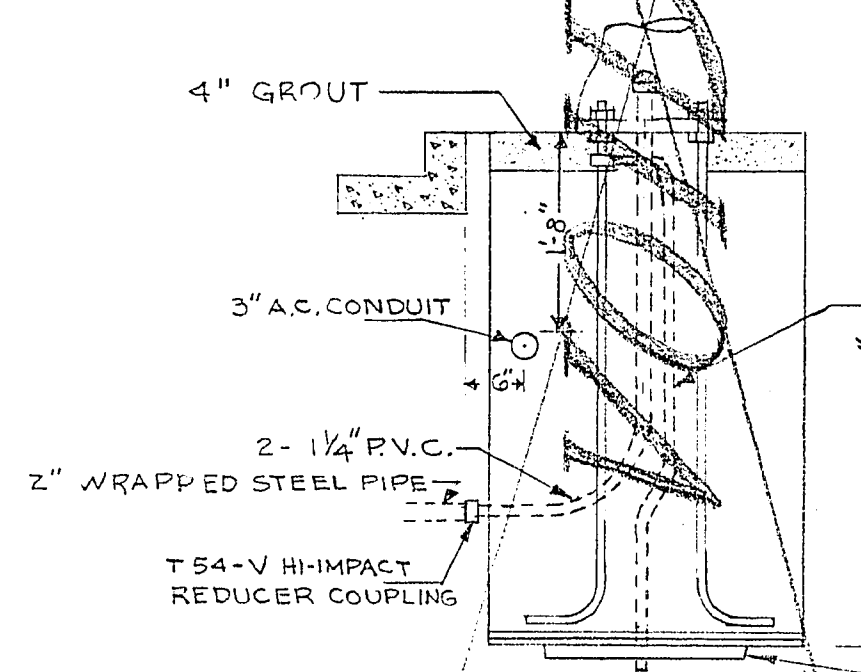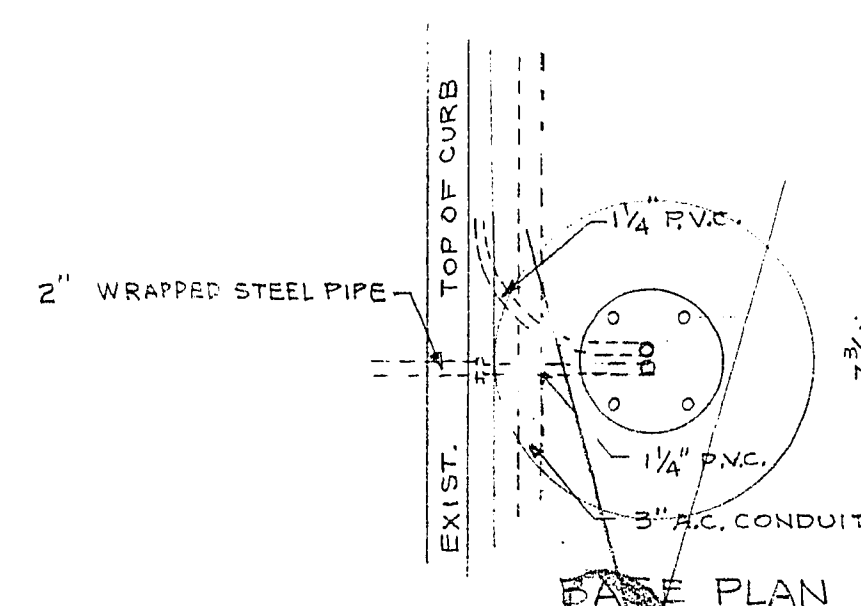

SECTION B-B
POLE BASE NO. 18

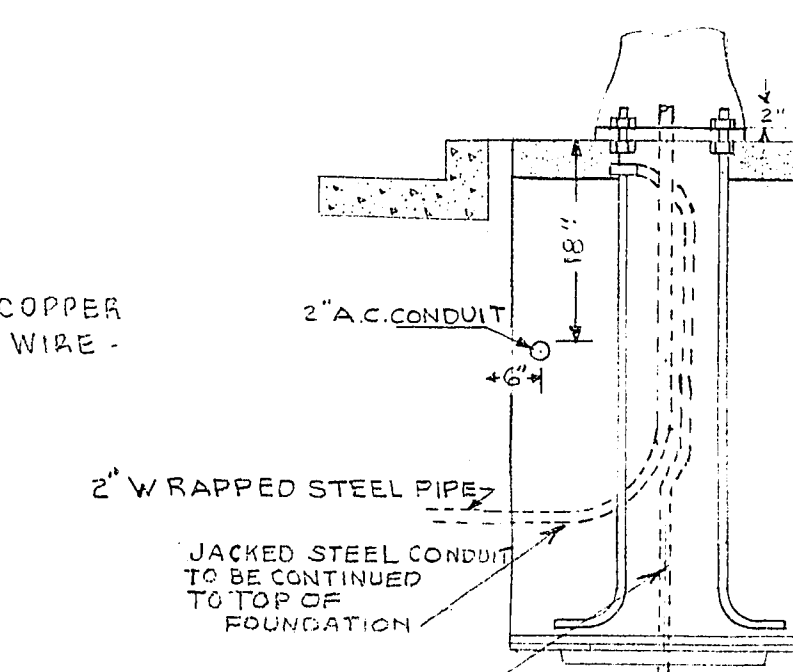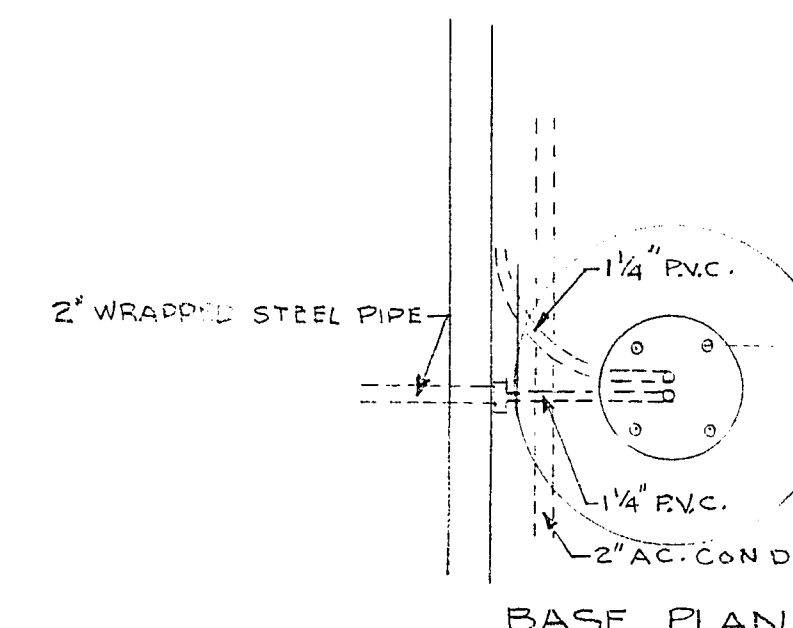

SECTION C-C
POLE BASE NO. 1
SCALE: NONE

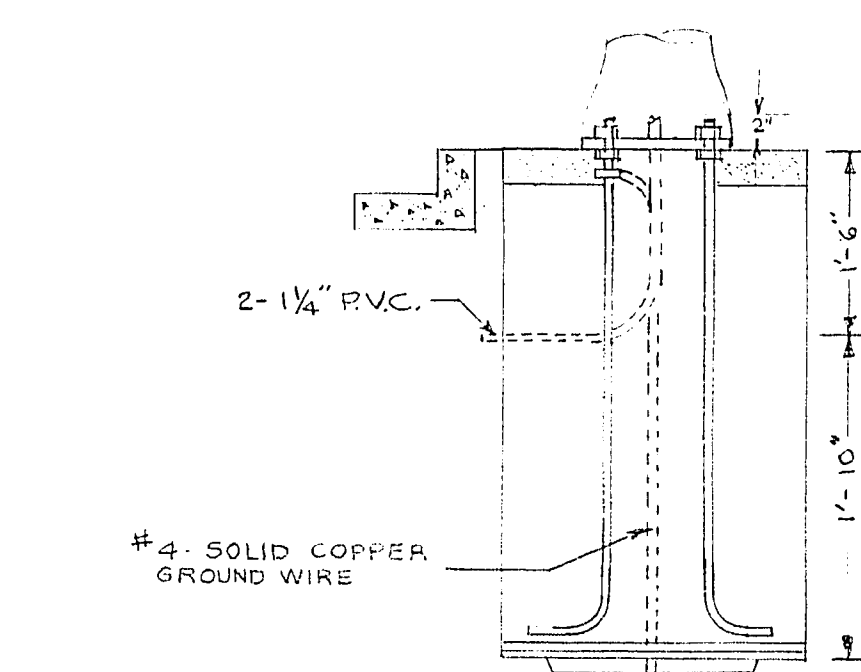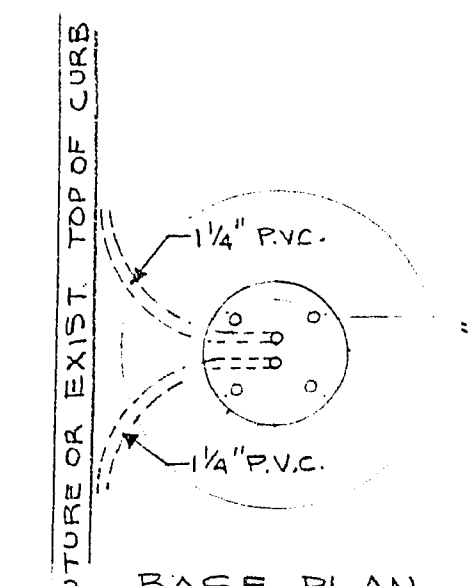

TYPICAL SECTION D-D
POLE BASES NO'S 34, 36, 38, 60, 62, 64, 66, 68, 70, 72, 74, 76, 78

NOTES

- GROUNDING CONNECTIONS ARE TO BE INSPECTED BEFORE BASES ARE GROUTED.
- P.V.C. CONDUIT TO BE TERMINATED 2\" ABOVE TOP OF FOUNDATION.
- JACKED STEEL CONDUIT WHEN TERMINATED 2\" ABOVE TOP OF FOUNDATION TO HAVE SMOOTH FITTING.

SAD. 100-28

CITY OF LAS VEGAS NEVADA
ENGINEERING DEPT.

STREET LIGHTING DETAILS
FOR FREMONT STREET

DESIGNED BY	DATE	SCALE	NONE
DRAWN BY		FIELD BOOK NO.	
CHECKED BY		WORK ORDER NO.	W 35
APPROVED		DRAWING NO.	
CITY ENGR.			207-V6