



ISO 358
VALVE#1104948
INISP#1741430
TILE -x582y536
TAX CODE 02-0200
T20S R60E S7

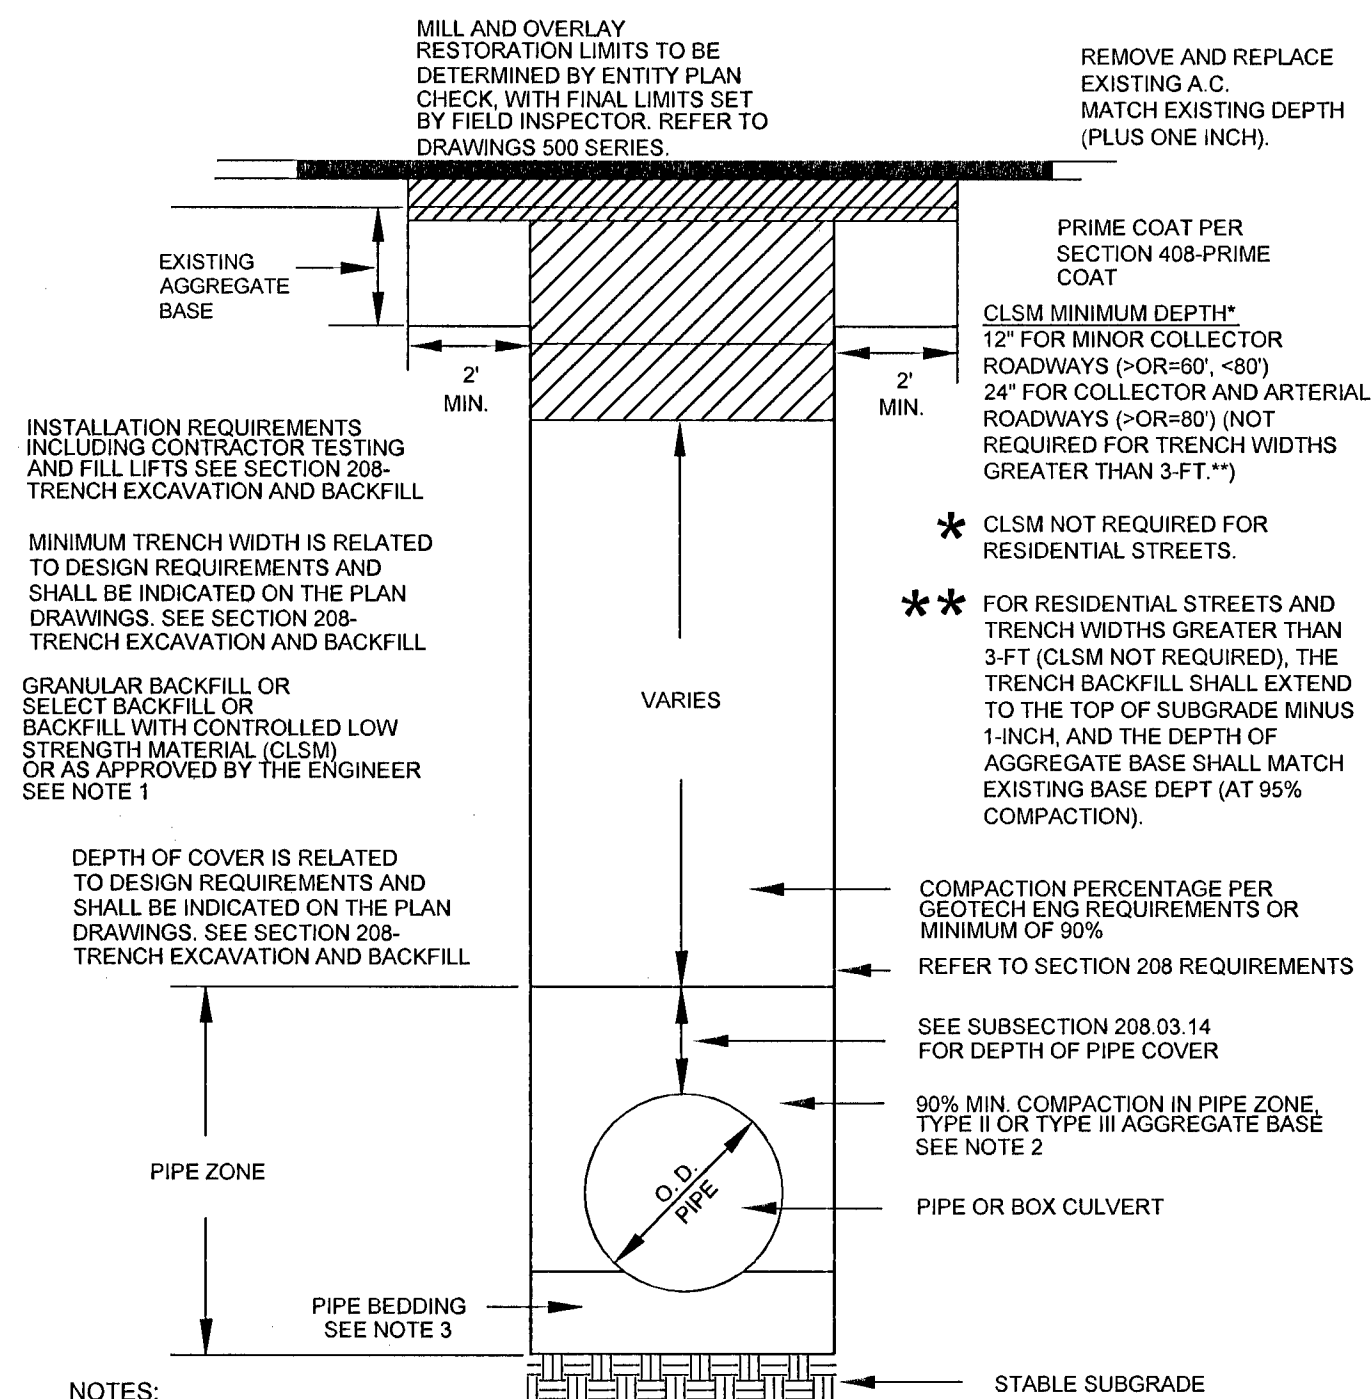

- NOTES:
- NO STONES OR LUMPS GREATER THAN 3" PERMITTED IN TRENCH 2' OR LESS IN WIDTH.
 - TRENCH WIDTH, BEDDING, SUBGRADE AND PIPE ZONE REQUIREMENTS FOR UTILITY INSTALLATIONS SHALL CONFORM TO THE RESPECTIVE ENTITY REQUIREMENTS.
 - CRUSHED ROCK MAY BE USED FOR PIPE BEDDING ONLY IF MATERIAL USE HAS BEEN SPECIFICALLY APPROVED BY THE GOVERNING AGENCY. SEE STANDARD DRAWING NO. 505 FOR PIPE BEDDING METHODS.
 - LAS VEGAS VALLEY WATER DISTRICT REQUIRES PIPE BEDDING AND BACKFILL WITHIN THE PIPE ZONE TO BE OF THE SAME MATERIAL.

RTC STD DWG 503

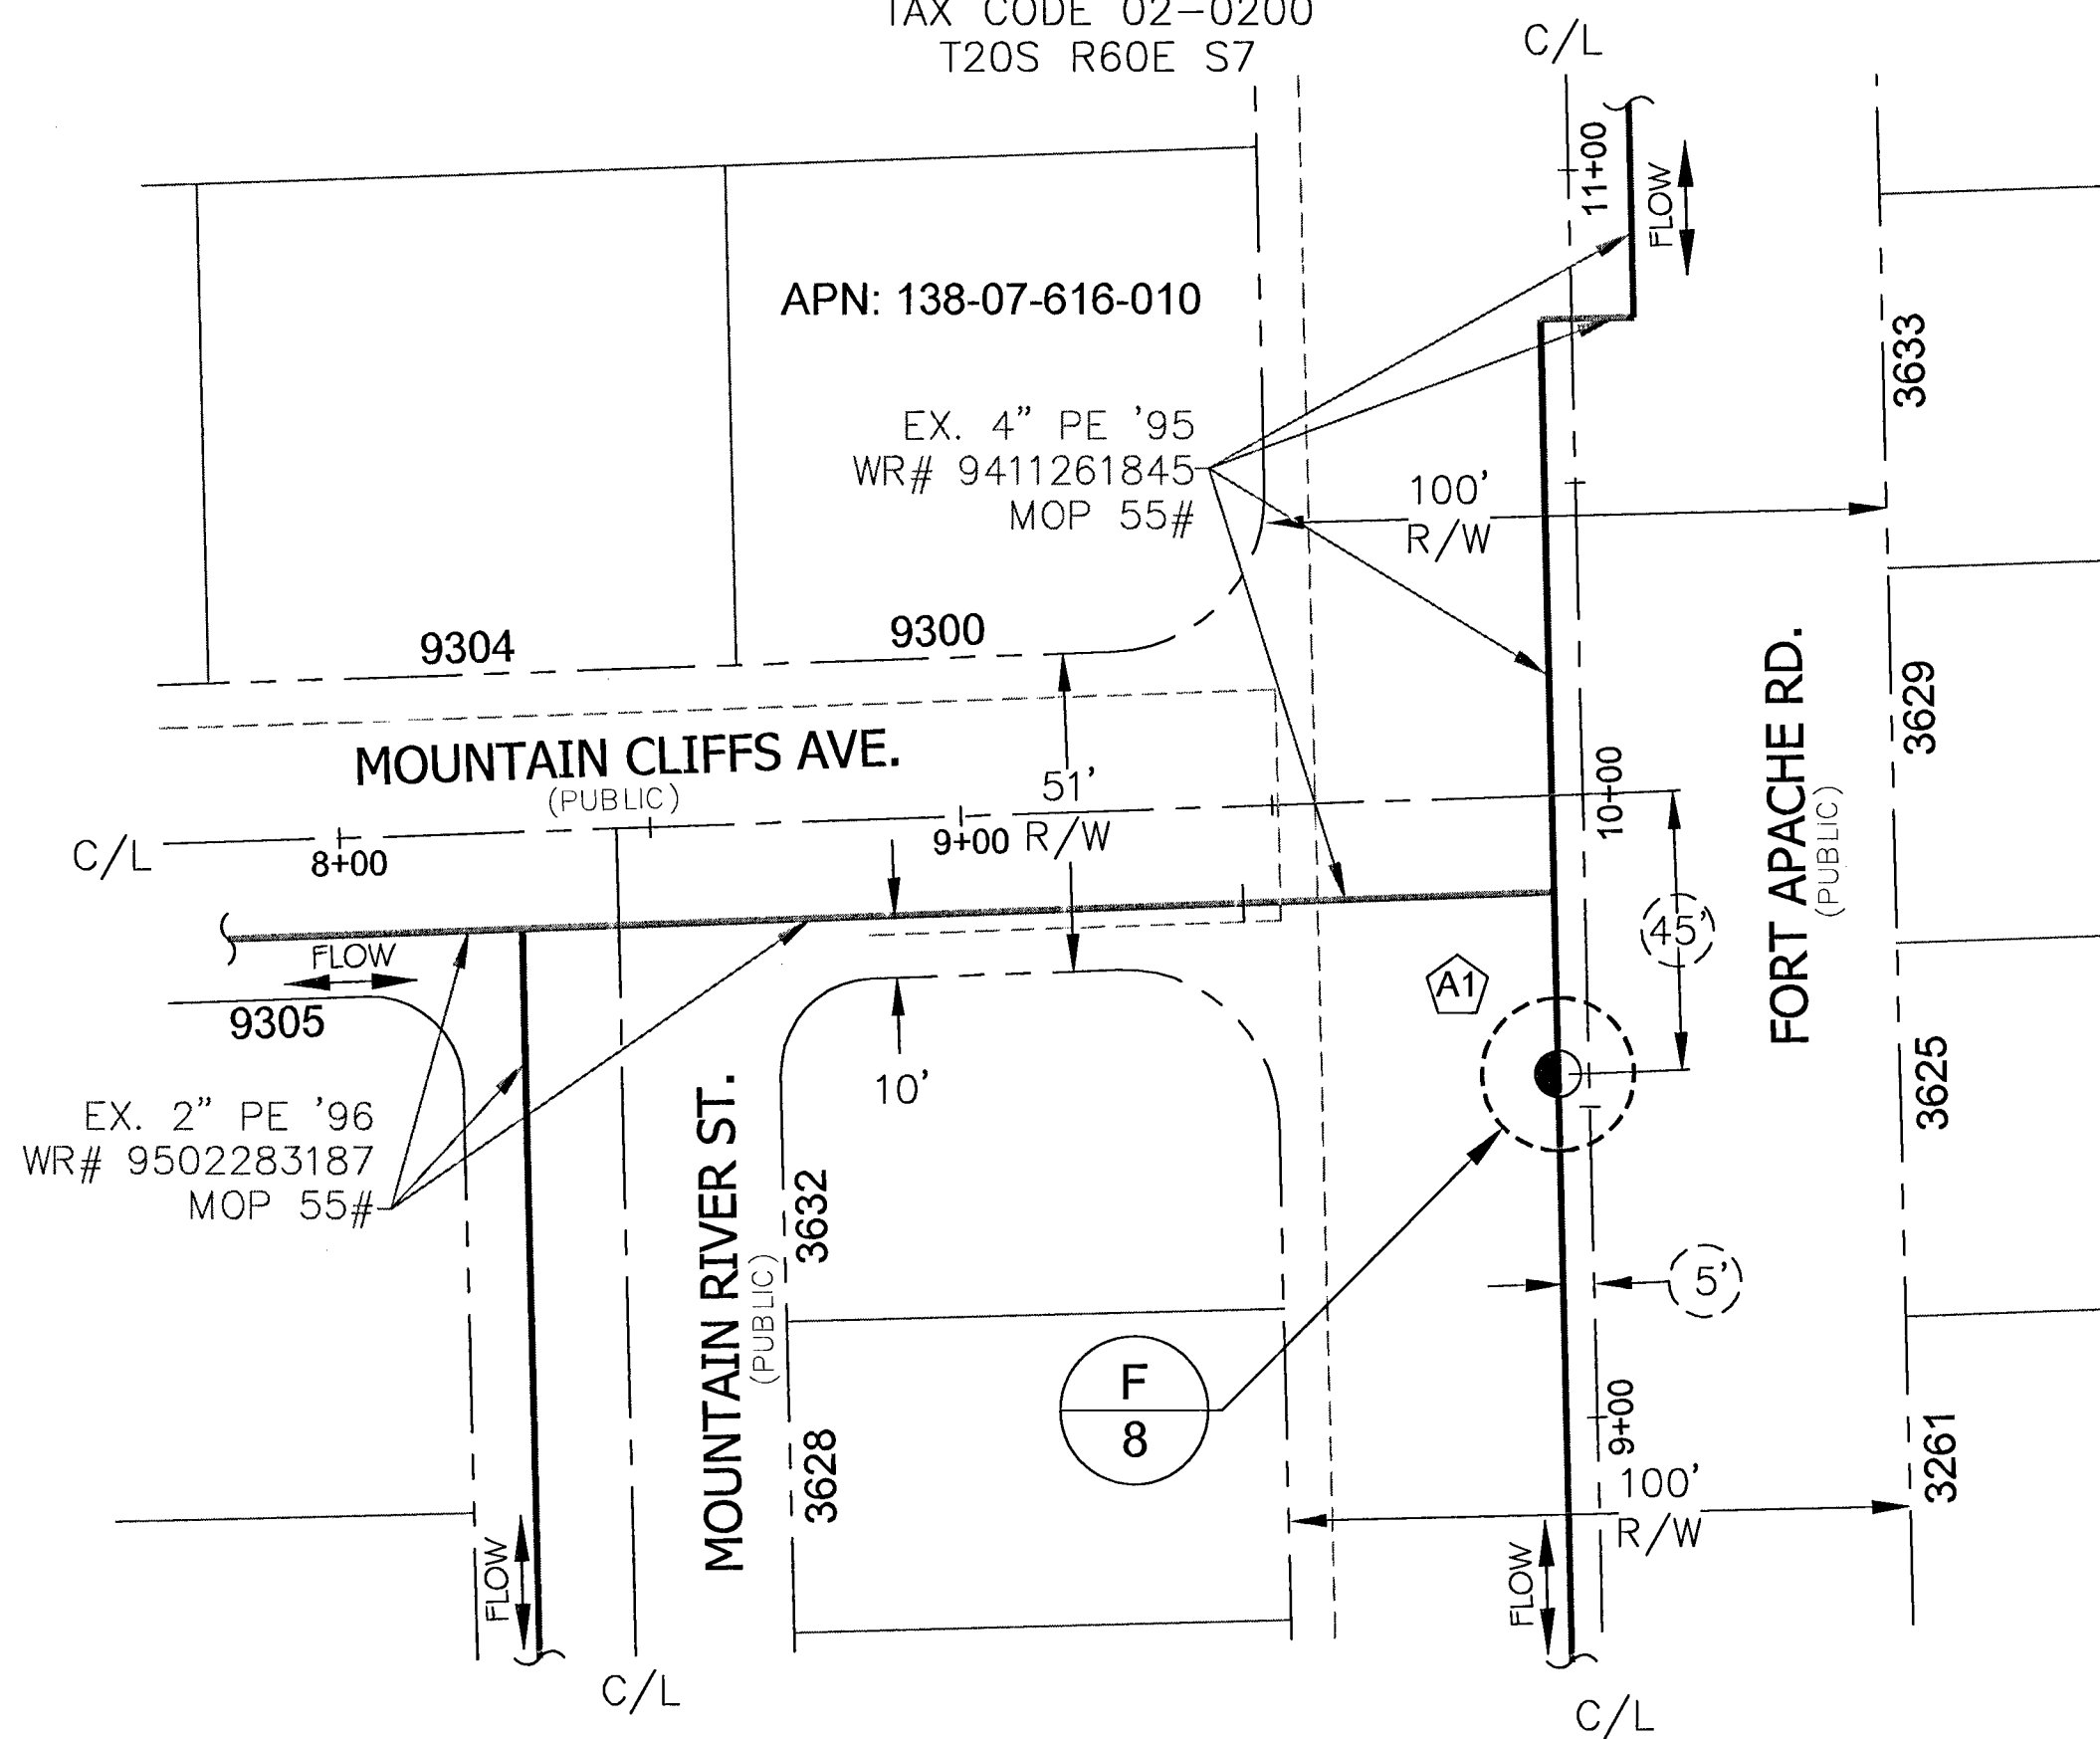

PROPOSED FACILITIES:

- 2 PROP. 4" PE
- 6 PROP. 4" PE VALVE (120-8604)
- 7 PROP. 4" PE COUPLING (140-3530)
- 8 PROP. 4"x1/2" SVC TEE (160-8334)

ABANDONED FACILITIES:

- 6 ABANDON EX. 4" PE '95 MOP 55#

RTC NOTES:

- BACKFILL SHALL CONFORM TO RTC STD. 503.
PAVEMENT REPAIR SHALL CONFORM TO RTC:
- A1 500.3

APPROVED FOR CONSTRUCTION


THIS APPROVAL IS FOR WORK IN CLV R/W OR CLV EASEMENTS ONLY. OBTAINING PERMISSIONS OR EASEMENTS FOR WORK SHOWN ON PRIVATE PROPERTY IS THE RESPONSIBILITY OF THE UTILITY.

APPROVAL _____ DATE _____

SYSTEM	D_W_Valley
DR. NO.	21DR10002585
SEGMENT M.A.O.P.	N/A
SYSTEM M.A.O.P.	60
SYSTEM M.O.P.	55

AS-BUILT DRAWING-PRESSURE TEST DATA

PIPE DIA.	TEST MEDIUM		TEST METHOD	
	☐ AIR	☐ NITROGEN	☐ GAUGE	☐ CHART
PIPE LENGTH			☐ WATER	☐ GAUGE/ PRESS REC SN#
PIPE TYPE				
MIN. DURATION			START	END
TEST PRES. (PSIG)				
TIME				
DATE				
PERFORMED BY				

1.				2.				3.				4.							
NO.				DESCRIPTION				BY				DATE				APPVD.			
REVISIONS																			
SOUTHWEST GAS CORPORATION																			
TAX CODES				UNIT NO.				UNIT TYPE				INSTL. RETIRED							
												PROPOSED COMPLETED							
PROPERTY UNITS																			
AS-BUILT DRAWING-PRESSURE TEST DATA																			
TEST MEDIUM TEST METHOD																			
PIPE DIA. AIR GAUGE																			
PIPE LENGTH NITROGEN CHART																			
PIPE TYPE WATER GAUGE/ SOAP PRESS REC SN#																			
MIN. DURATION START END																			
TEST PRES. (PSIG)																			
TIME																			
DATE																			
PERFORMED BY																			
VISUAL INSPECTION CERTIFICATION																			
I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT I HAVE PERFORMED																			
NAME DATE																			
CONSTRUCTION																			
INSPECTOR FOREMAN REVIEWED BY																			
PERMIT INFORMATION																			
CITY OF LAS VEGAS																			
TAX CODE 02-0200																			
ISOLATION AREA				W.R. NO.				ENGINEER/TECH: PATRICK DENISON				PHONE: 702-365-2139							
358				1771644				ACCOUNT REP:				PHONE:							
								PROJECT CONTACT: PATRICK DENISON				PHONE: 702-365-2139							
SHEET NO: 8 OF 10				SCALE: 1"=30'				DATE: 10/08/2013											
DWN. BY: ZONE ENG				CHKD. BY:				APPVD. BY:											
TITLE																			
SI-ISOLATION REDUCTION AREAS																			
207, 227, 298 & 358																			