


ISO 358
VALVE#1104949
INISP#1741431
TILE x579y536
TAX CODE 02-0200
T20S R60E S7

APN: 138-07-617-010

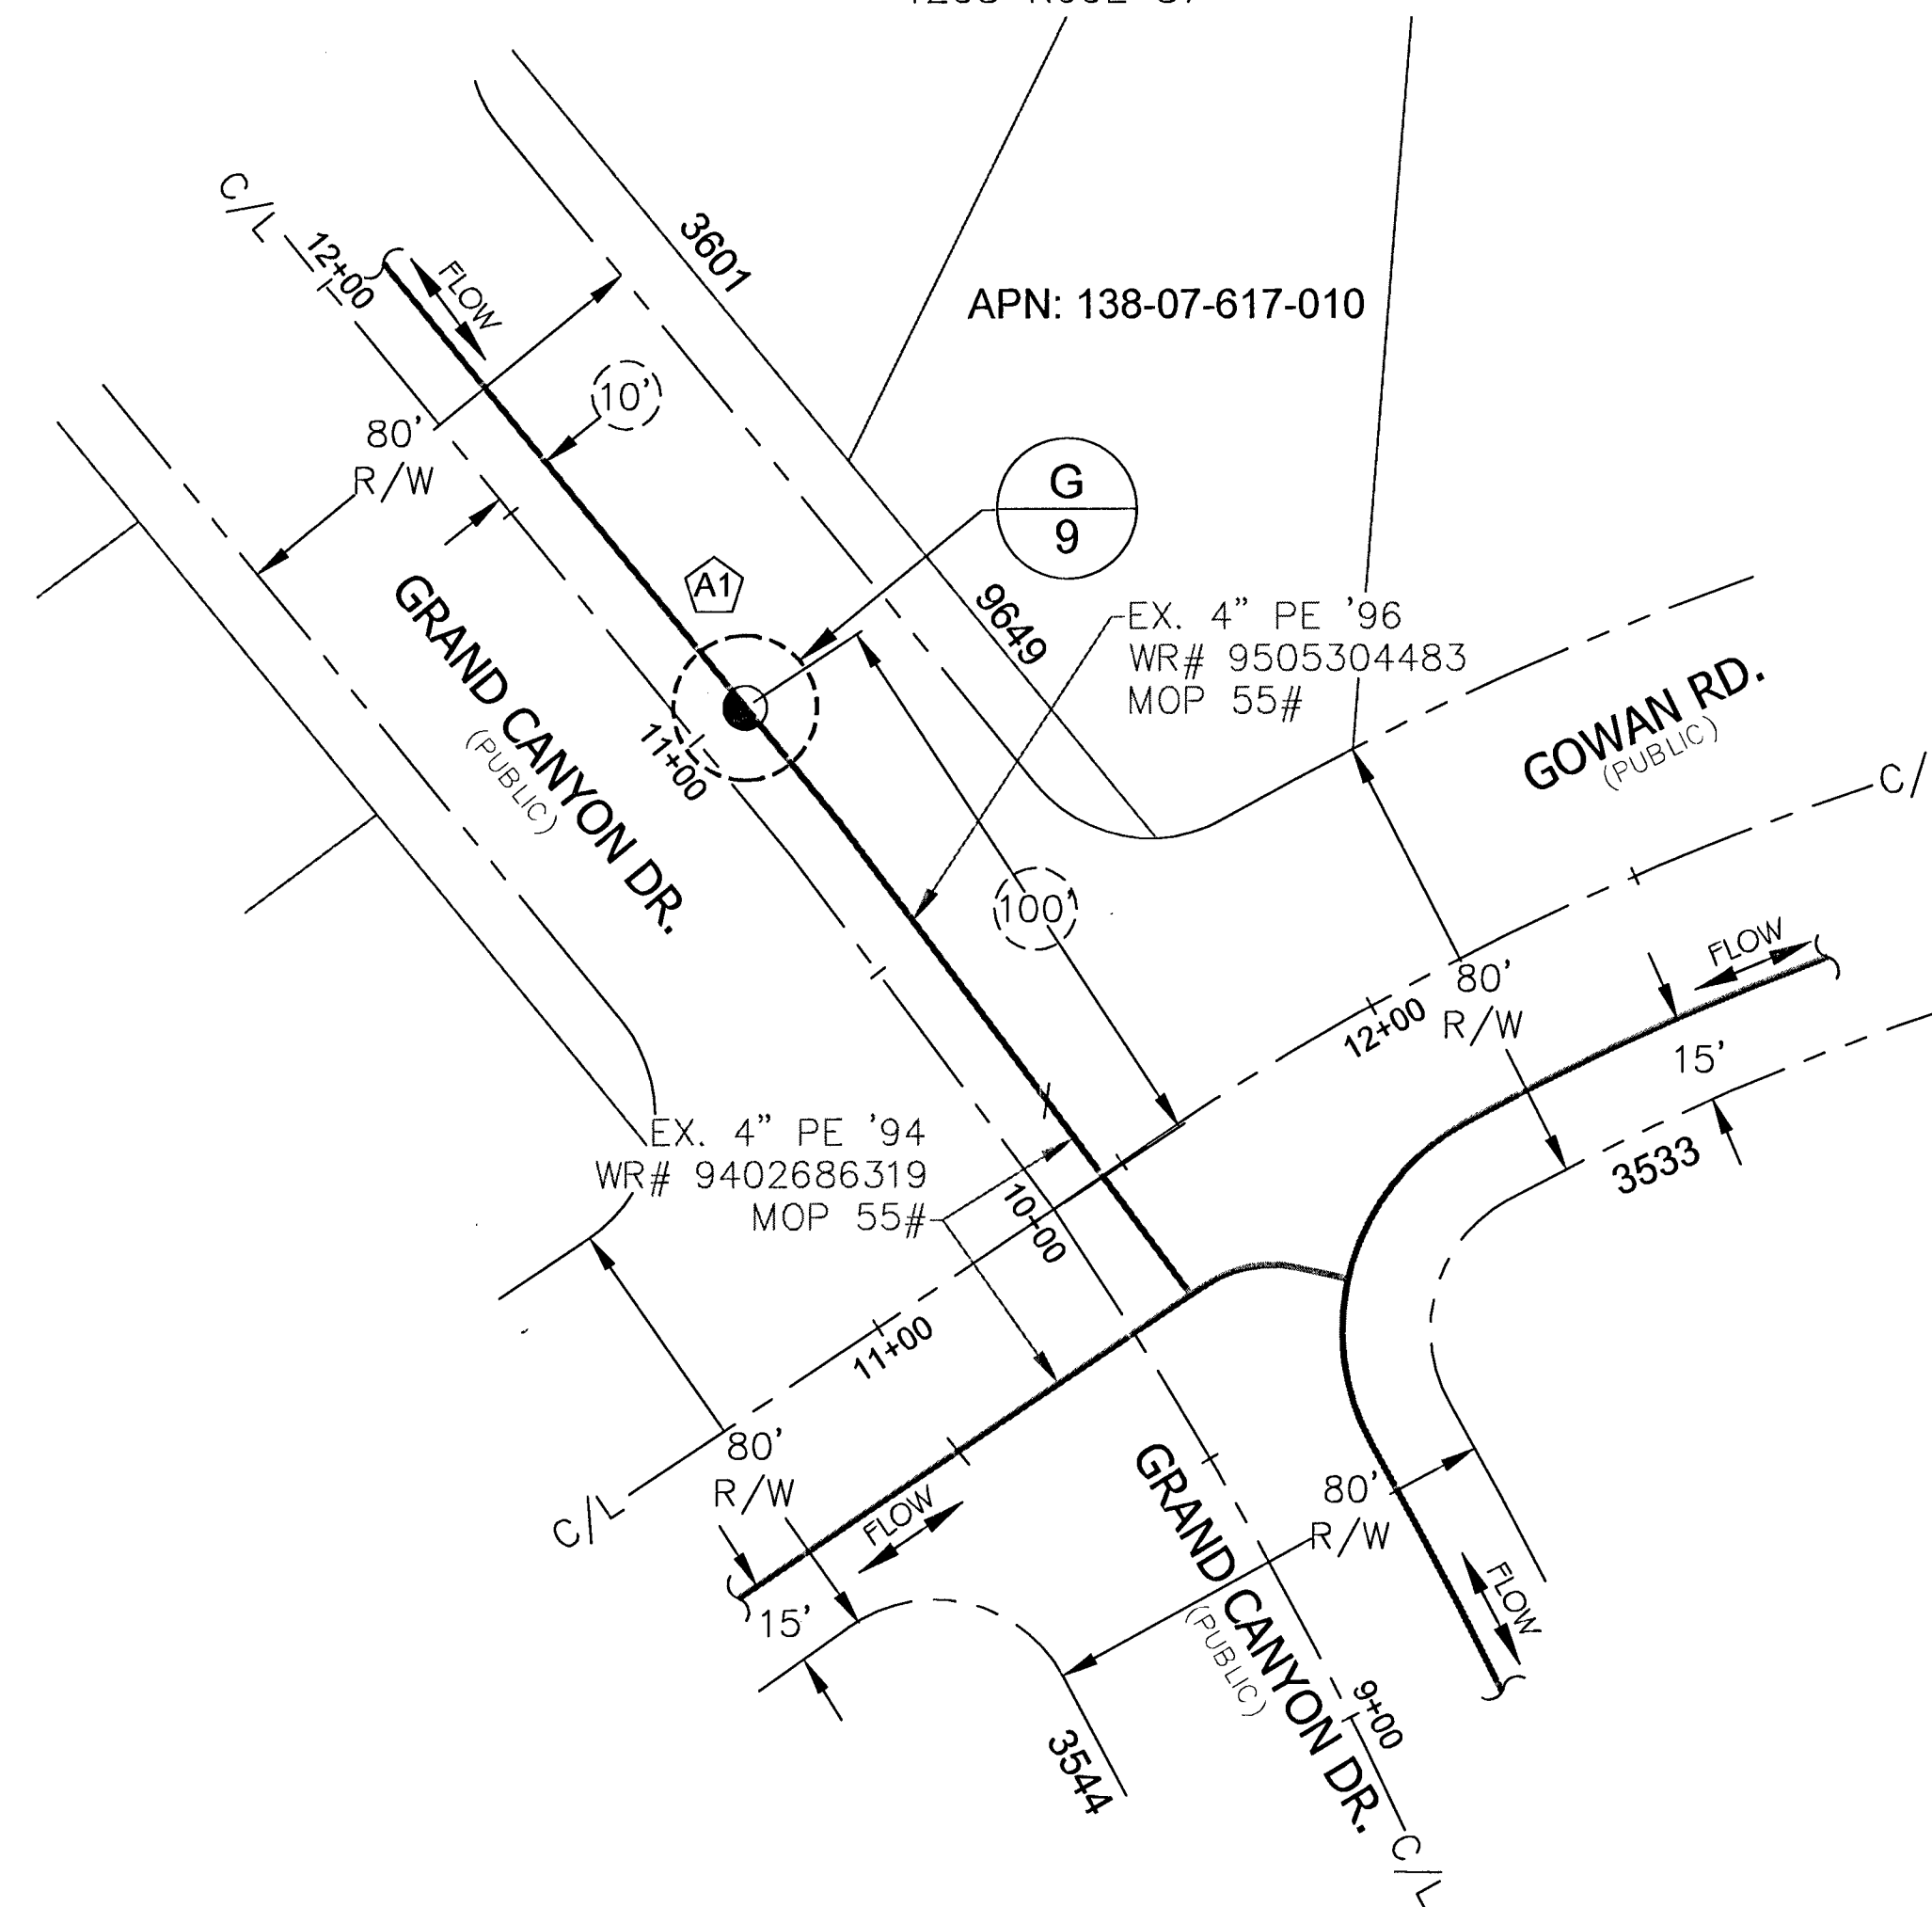

VALVE #1104949
INSP #1741431
CONTACT ENGINEERING
FOR BYPASS INFORMATION

PROPOSED FACILITIES:

- 2 PROP. 4" PE
 6 PROP. 4" PE VALVE (120-8604)
 7 PROP. 4" PE COUPLING (140-3444)
 8 PROP. 4"x1/2" SVC TEE (160-8334)

ABANDONED FACILITIES:

- 7 ABANDON EX. 4" PE '96 MOP 55#

RTC NOTES:

BACKFILL SHALL CONFORM TO RTC STD. 503.
PAVEMENT REPAIR SHALL CONFORM TO RTC:

- A1** 500.3

APPROVED FOR CONSTRUCTION

THIS APPROVAL IS FOR WORK IN CLV R/W
OR CLV EASEMENTS ONLY. OBTAINING PERMISSIONS
OR EASEMENTS FOR WORK SHOWN ON PRIVATE
PROPERTY IS THE RESPONSIBILITY OF THE
UTILITY.

APPROVAL _____ DATE _____

SYSTEM	D_W_Valley
DR. NO.	21DR10002585
SEGMENT M.A.O.P.	N/A
SYSTEM M.A.O.P.	60
SYSTEM M.O.P.	55

AS-BUILT DRAWING-PRESSURE TEST DATA

		TEST MEDIUM	TEST METHOD
PIPE DIA. _____		☐ AIR	☐ GAUGE
PIPE LENGTH _____		☐ NITROGEN	☐ CHART
PIPE TYPE _____		☐ WATER	GAUGE/
		☐ SOAP	PRESS REC SN#
MIN. DURATION _____	START _____	END _____	
TEST PRES. (PSIG) _____			
TIME _____			
DATE _____			
PERFORMED BY _____			

RTC STD DWG 503



Know what's **below**.
Call before you dig.

VALVE DETAIL - ABANDONMENT
N.T.S.

VALVE DETAIL - INSTALLATION
N.T.S.

[illegible]