


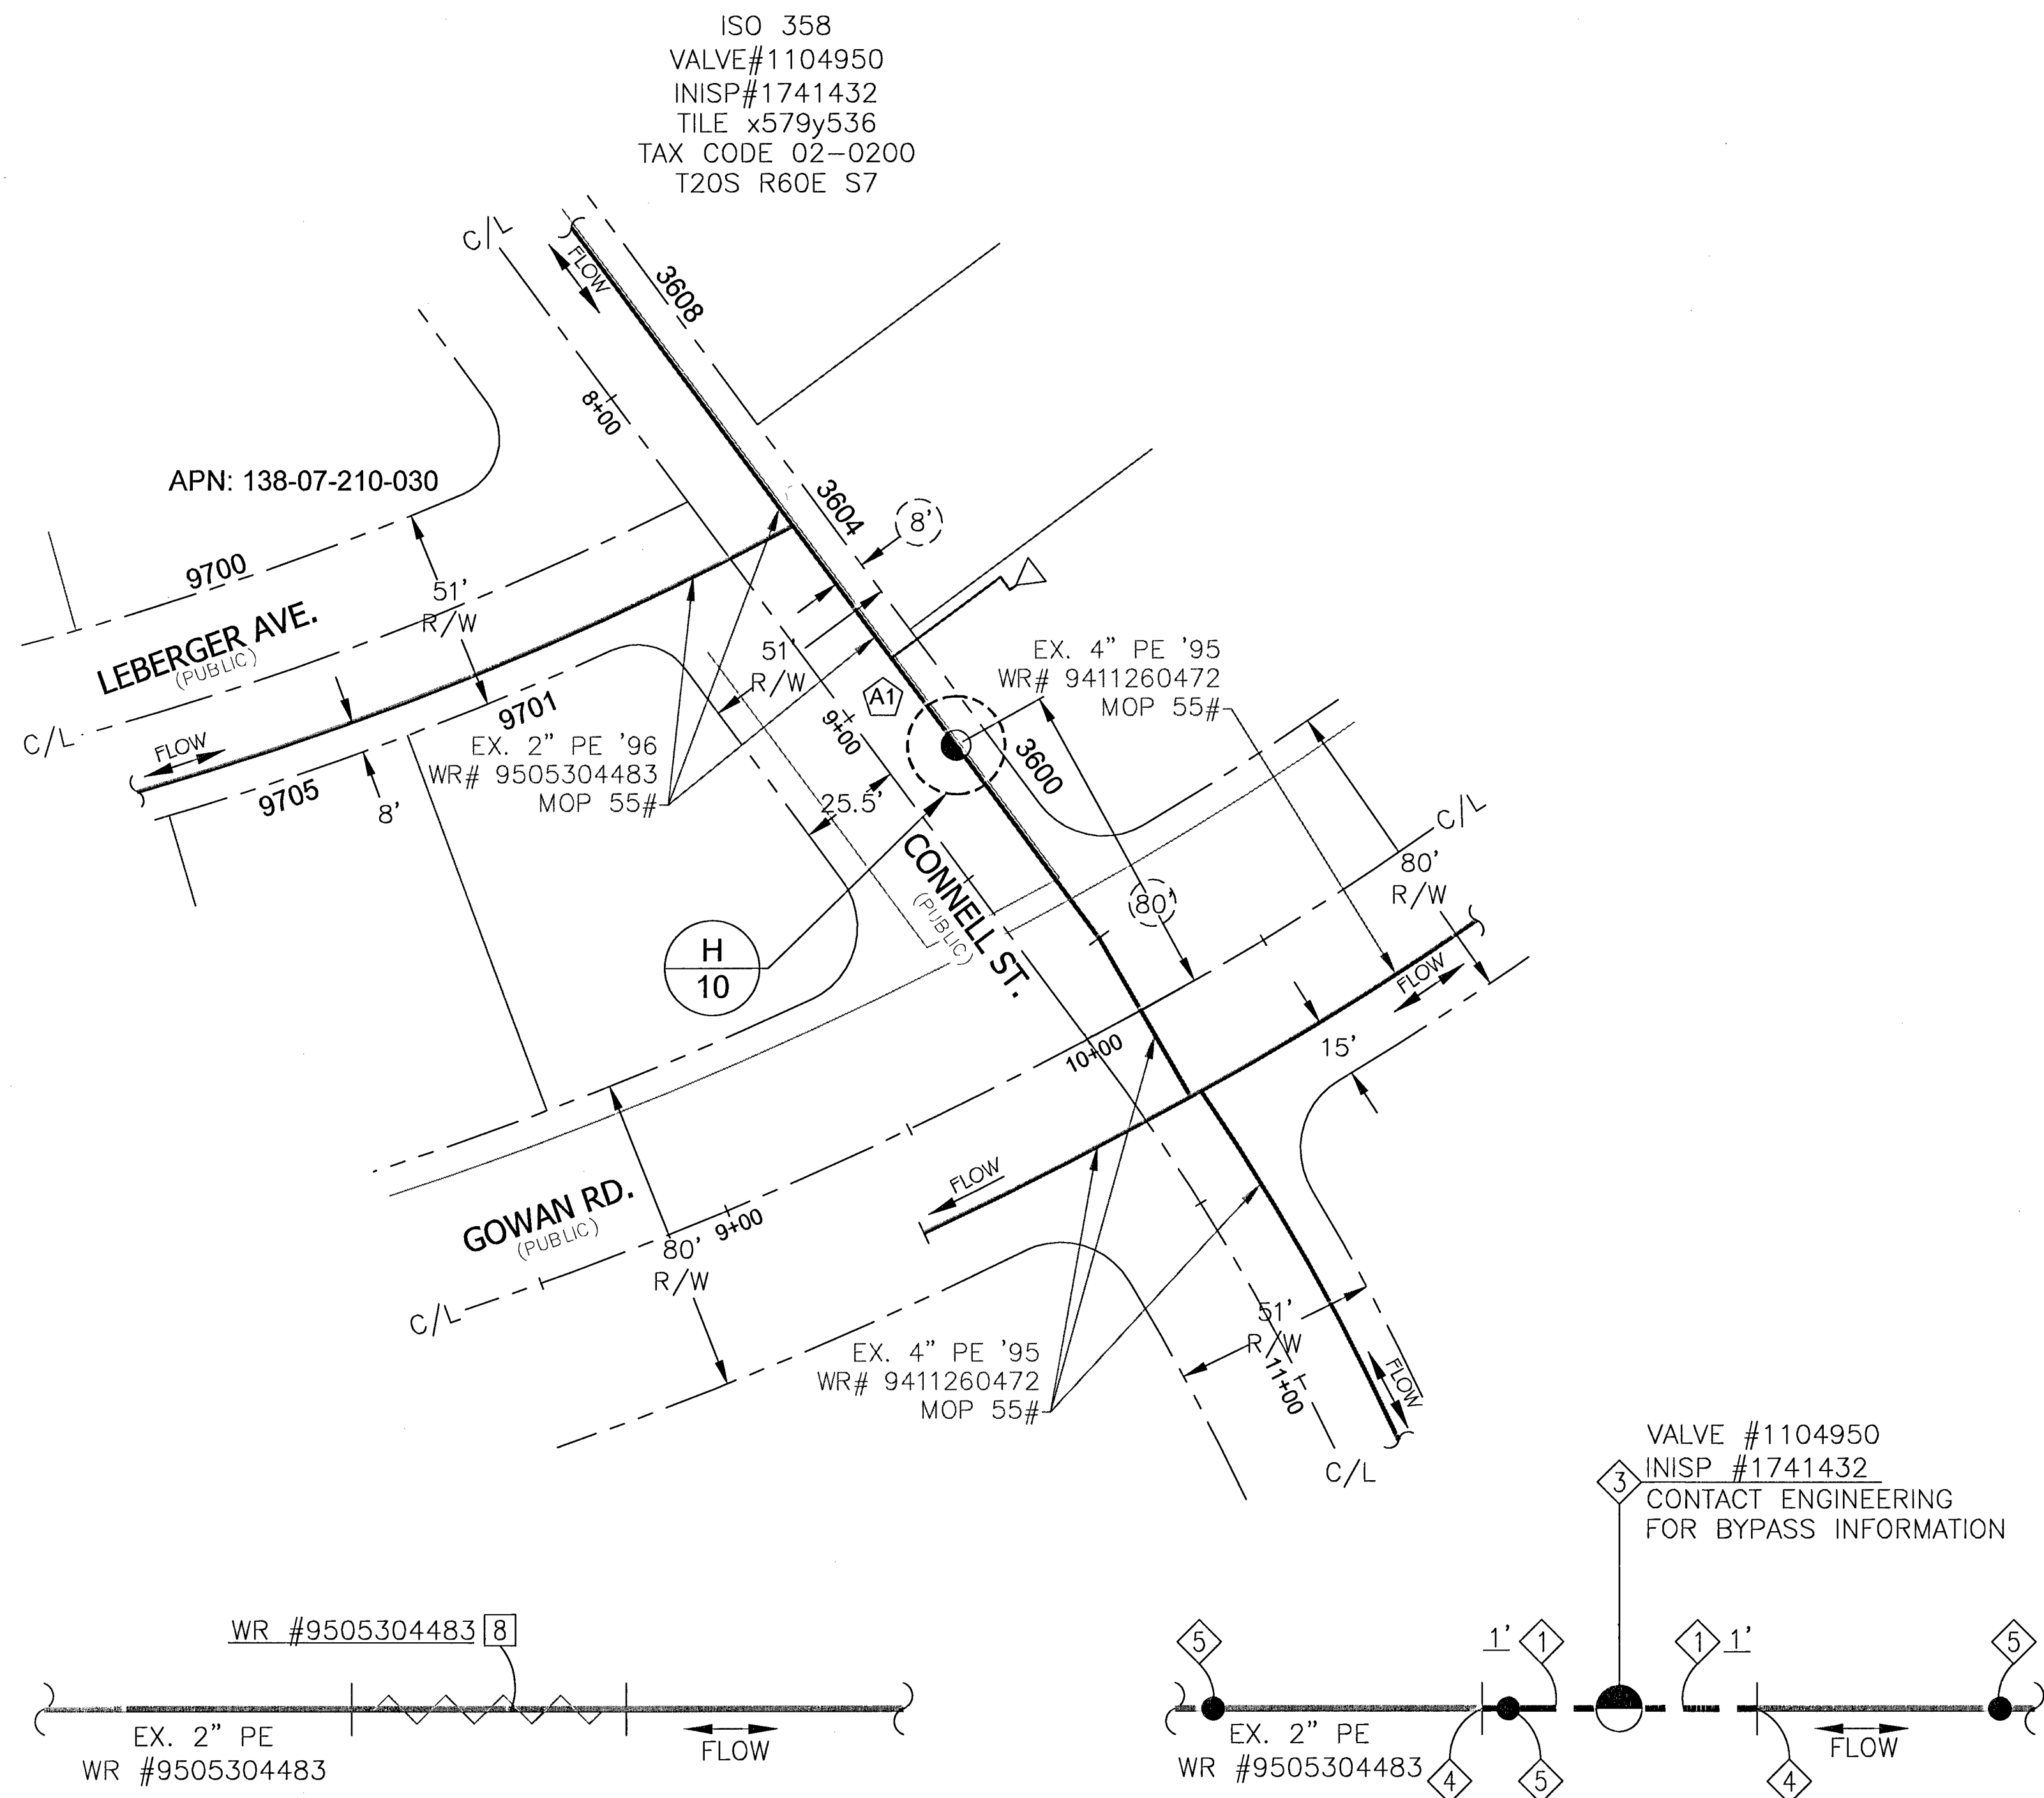

1	PROP. 2" PE
3	PROP. 2" PE VALVE (120-8605)
4	PROP. 2" PE COUPLING (140-3504)
5	PROP. 2"x1/2" SVC TEE (160-8549)

8 ABANDON EX. 2" PE '96 MOP 55#

BACKFILL SHALL CONFORM TO RTC STD. 503.
PAVEMENT REPAIR SHALL CONFORM TO RTC:
A1 500.3

THIS APPROVAL IS FOR WORK IN CLV R/W
OR CLV EASEMENTS ONLY. OBTAINING PERMISSIONS
OR EASEMENTS FOR WORK SHOWN ON PRIVATE
PROPERTY IS THE RESPONSIBILITY OF THE
UTILITY.

APPROVAL _____ DATE _____

SYSTEM	D_W_Valley
DR. NO.	21DR10002585
SEGMENT M.A.O.P.	N/A
SYSTEM M.A.O.P.	60
SYSTEM M.O.P.	55

		TEST MEDIUM	TEST METHOD
PIPE DIA. _____		☐ AIR	☐ GAUGE
PIPE LENGTH _____		☐ NITROGEN	☐ CHART
PIPE TYPE _____		☐ WATER	☐ GAUGE/
		☐ SOAP	PRESS REC SN#
MIN. DURATION _____			
	START		END
TEST PRES. (PSIG) _____			
TIME _____			
DATE _____			
PERFORMED BY _____			



RTC STD DWG 503

[illegible]