


- NOTES:
- (A) SEE STANDARD DRAWING NO. R-1.1.6 "CULVERT BEDDING"
  - (B) SEE "REINFORCED CONCRETE PIPE COLLAR" DETAIL, SHT. 16.
  - (C) SEE "LATERAL JUNCTION STRUCTURE" DETAIL, SHT. 16.
  - (D) UTILITY TO BE ADJUSTED BY OTHERS.
  - (E) ADJUST UTILITY PER THE SPECIAL PROVISIONS OF THE SPECIFICATIONS
  - (F) DELETED
  - (G) FOR STORM DRAIN BEDDING DETAILS, SEE SHT. 26.
  - (H) THE LOCATIONS OF THE UNDERGROUND FACILITIES SHOWN IN PROFILE ARE APPROXIMATE AND ARE BASED UPON RECORD DRAWINGS FROM THE FACILITY OWNERS. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO LOCATE ALL EXISTING UNDERGROUND FACILITIES WHETHER SHOWN OR NOT, AND TO NOTIFY ALL FACILITY OWNERS TO VERIFY IN THE FIELD THE LOCATION OF THEIR INSTALLATIONS PRIOR TO CONSTRUCTION.
  - (I) FOR WATER LINE ADJUSTMENTS SEE SHEETS W-1 THRU W-8.
  - (J) CONSTRUCT CONCRETE ENCASEMENT AROUND STORM DRAIN MIN. 10' EACH SIDE OF WATER LINE WHERE VERTICAL CLEARANCE IS LESS THAN 18". SEE SHEET 25 FOR DETAIL.

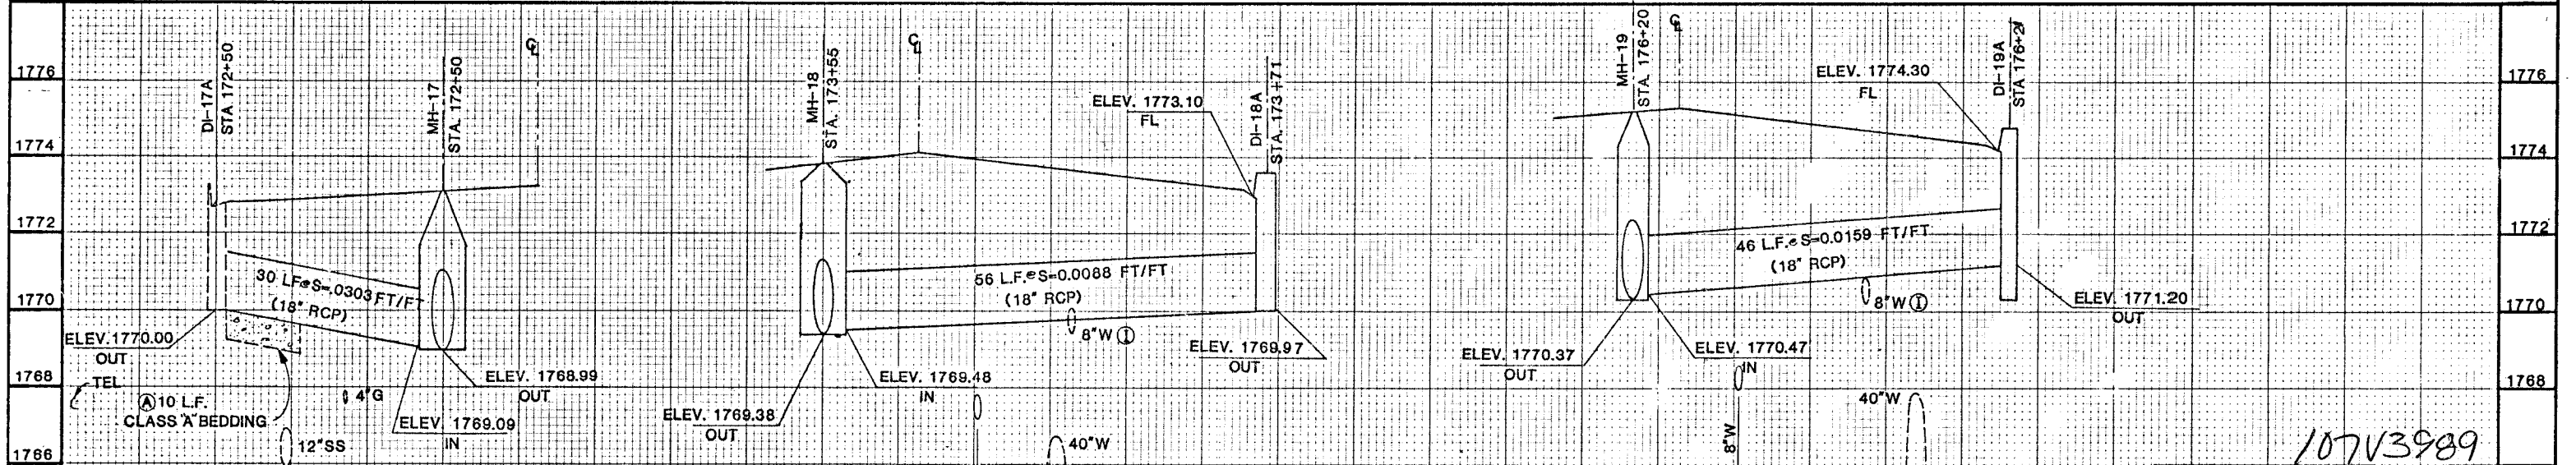

66954

107V3989

	RENO-SPIRKS, NEVADA LAS VEGAS, NEVADA PHOENIX, ARIZONA
	JOB NO. 990-02-2
	DESIGNED G.S.
	DRAWN C.H.W.
	CHECKED AKF
DATE 3-30-90	