
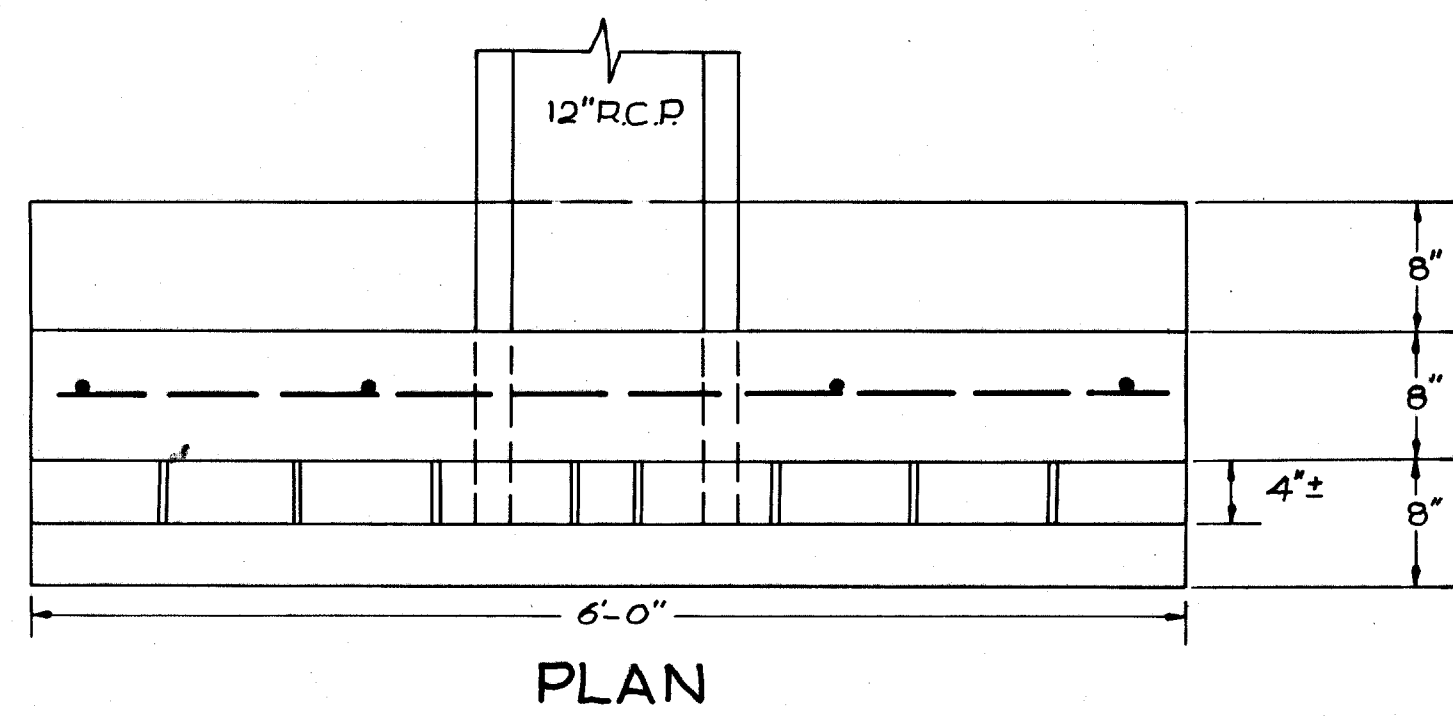
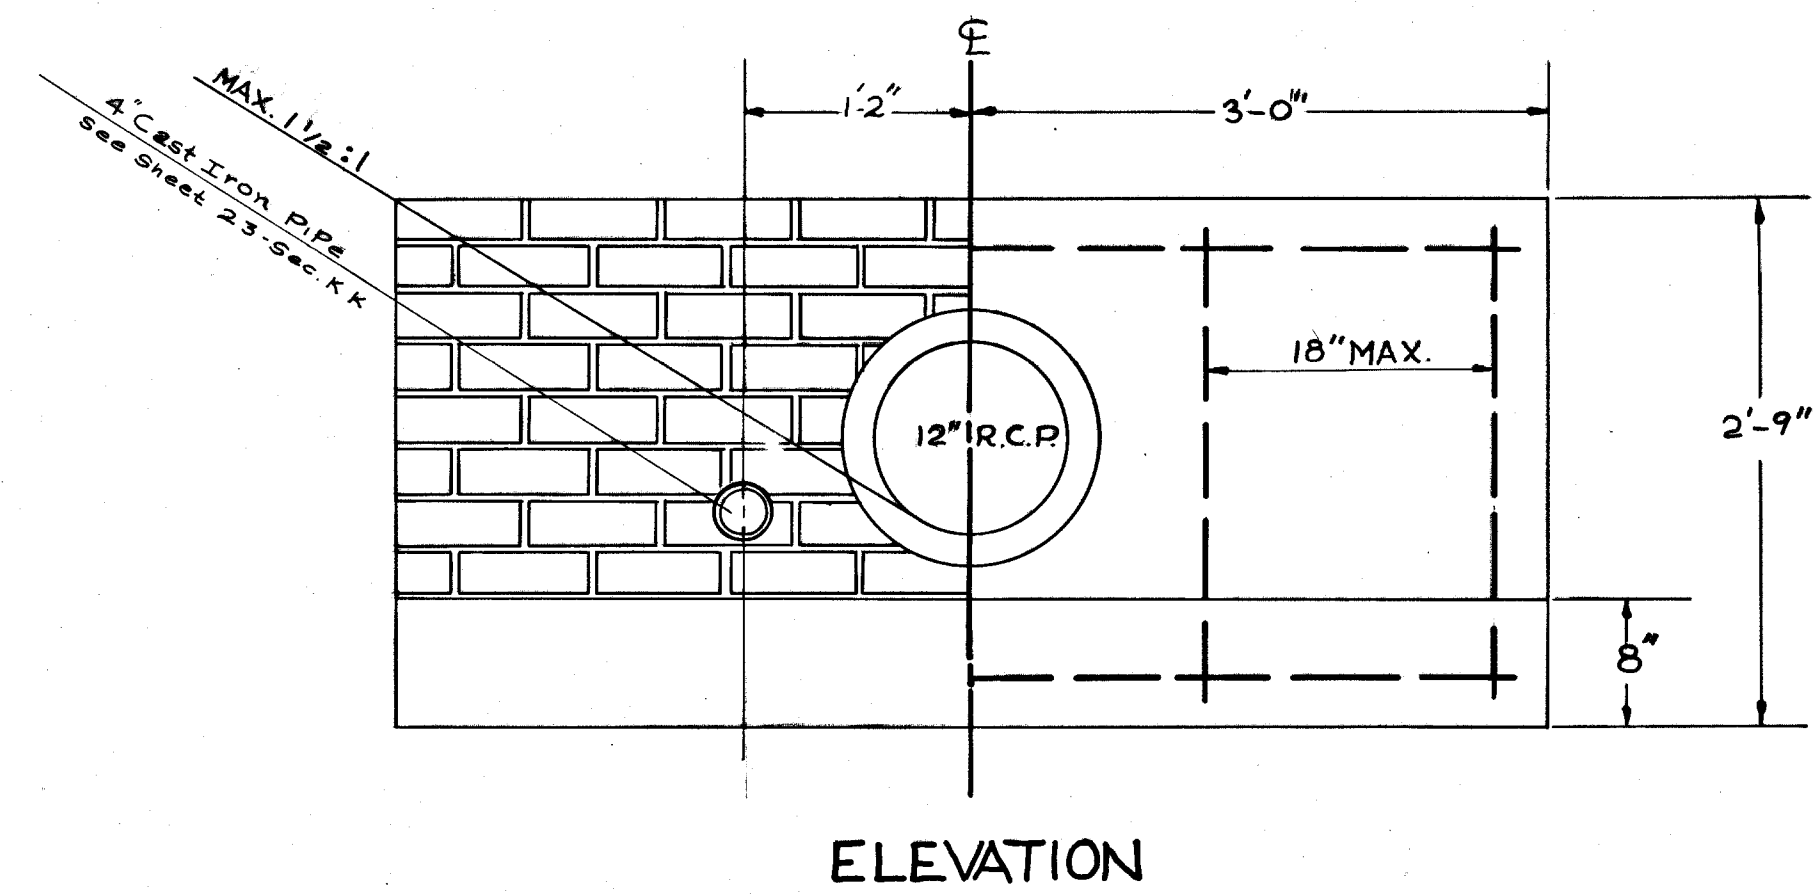


DETAIL OF HEADWALL
LAKE OUTLET PIPE

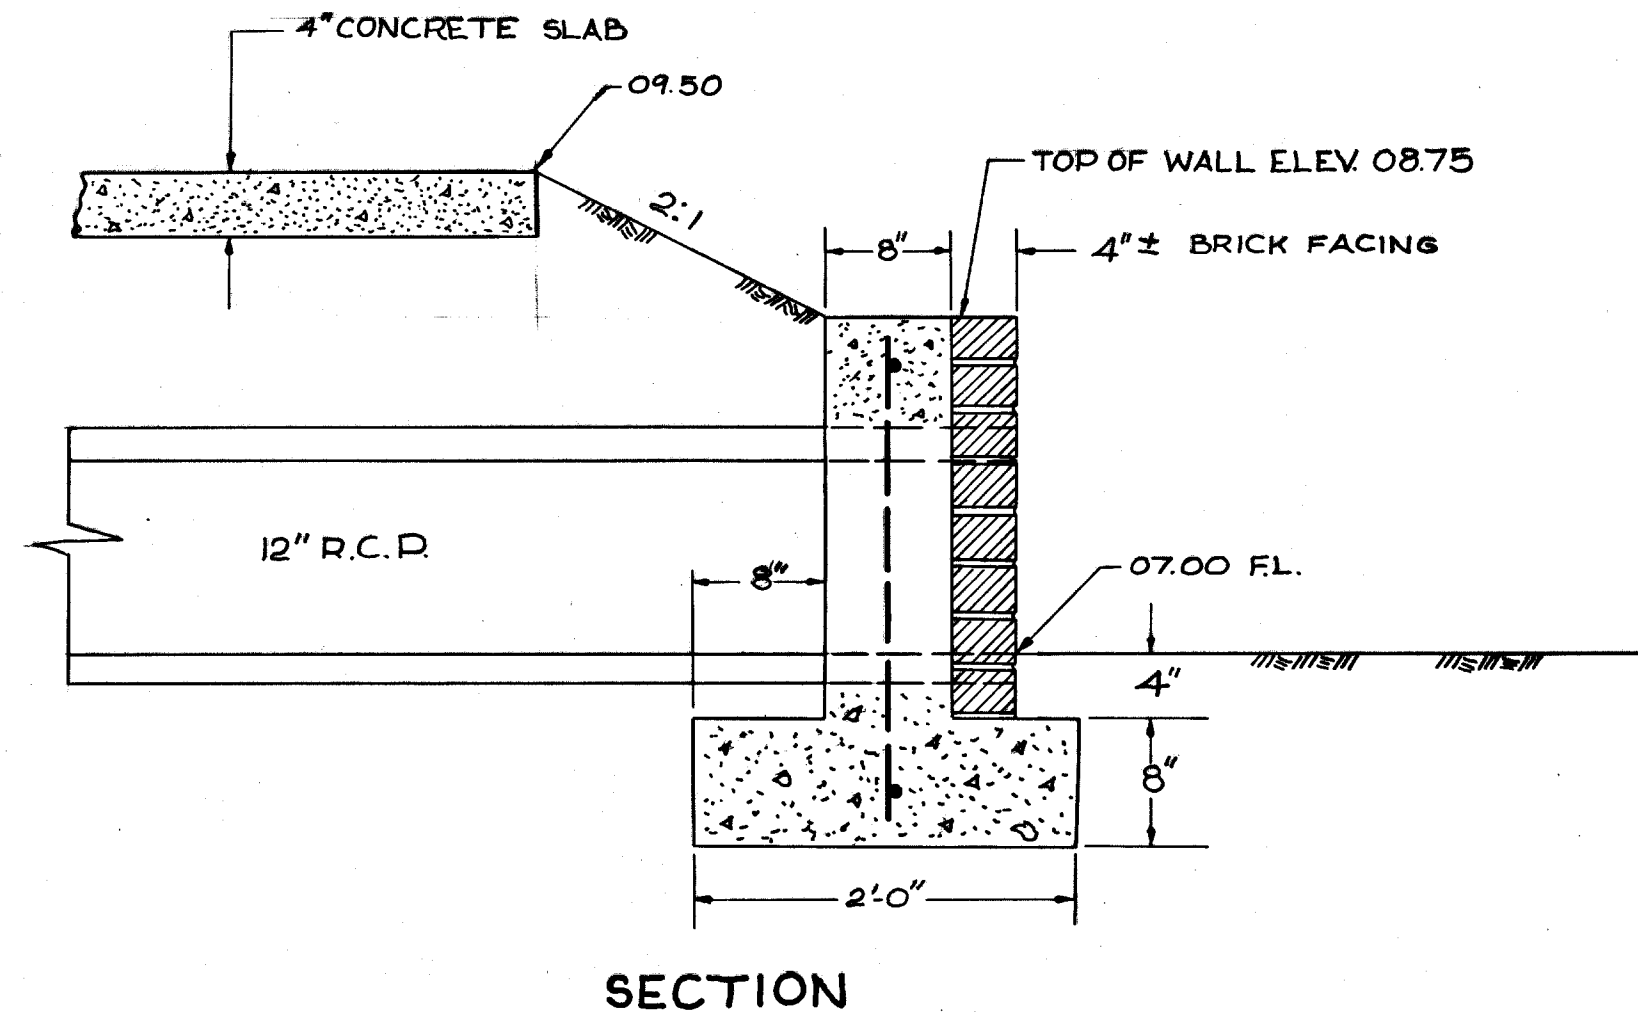


NOTES:

1. All concrete shall be Class 55B 3000.
2. All reinforcing steel shall be No. 4 deformed bars. Intersections shall be tightly wired and embedded at least one and one-half inches clear of concrete surface.
3. Bricks in facing shall be Standard U.S. size (2 1/4" x 3 3/4" x 8") and shall be red in color. The texture shall be as approved by the engineer. Mortar shall be class "B".

PHASE 2 27-00014
PHASE 1 NEV-OSD-7

CITY OF LAS VEGAS NEVADA
DEPARTMENT OF PUBLIC WORKS
SERVICES DIVISION

LAKE OUTLET PIPE HEADWALL

W.O. NO. 3111	F.BK. NO. FB	DATE	DRAWING NO.
SC. (H)	SC. (V)	06-1-70	650-19-15
DES. Billingsley			FILE NO.
DR. U. McDowell			
APPROVED BY DIRECTOR OF PUBLIC WORKS			
			SHEET 21 OF 23

CONTRACT
DRAWING
SEP 8 1970