


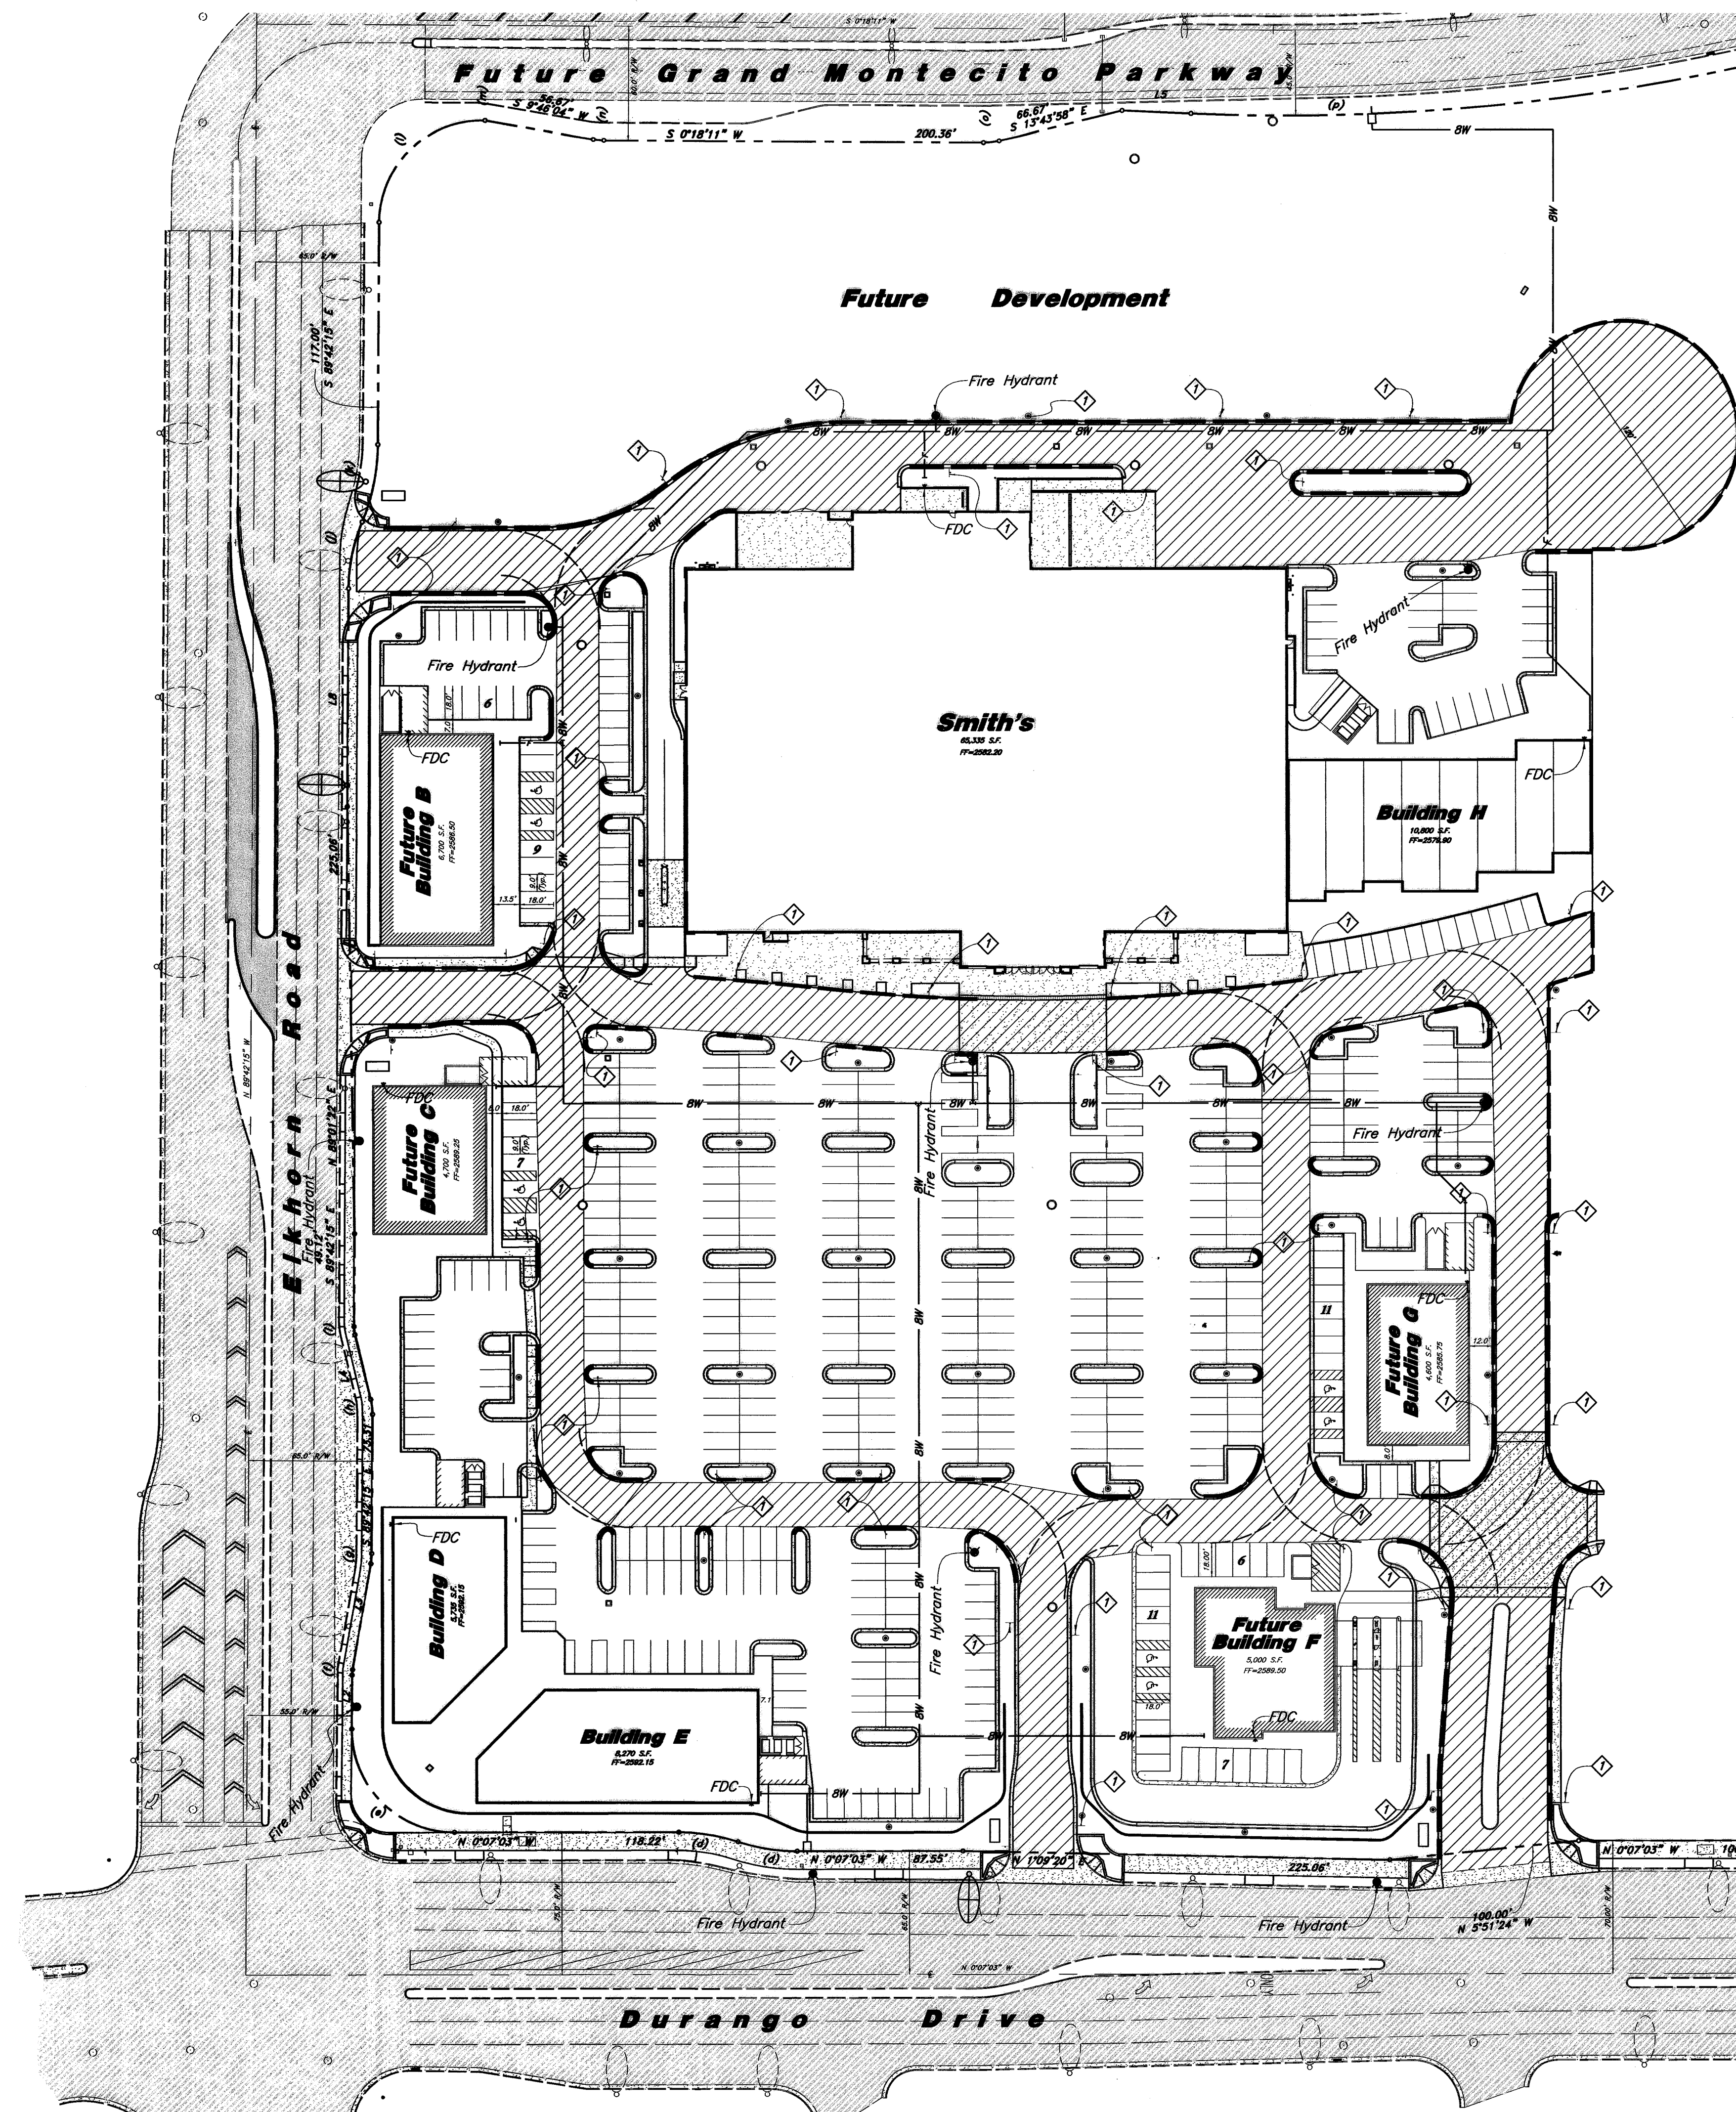


Curve


d	31.76'	100.00'	31.62'	N 8°58'48" E	18°11'42" E
e	85.21'	54.00'	76.64'	N 45°05'21" E	90°24'48" E
f	2.89'	17.50'	2.89'	S 84°58'23" E	9°27'44" E
g	5.37'	32.50'	5.36'	S 84°58'23" E	9°27'44" E
h	7.96'	32.50'	7.94'	N 83°16'40" E	14°02'10" E
i	4.29'	17.50'	4.28'	N 83°16'40" E	14°02'10" E
j	36.05'	92.50'	35.83'	S 78°32'18" E	22°19'54" E
k	41.90'	107.50'	41.63'	S 78°32'18" E	22°19'54" E
l	84.83'	54.00'	76.37'	S 44°41'58" E	90°00'35" E
m	2.64'	16.00'	2.64'	S 5°02'12" W	9°27'44" E
n	5.62'	34.00'	5.61'	S 5°02'08" W	9°27'53" E
o	8.33'	34.00'	8.31'	S 6°42'54" E	14°02'09" E
p	917.08'	1145.00'	892.76'	S 20°28'53" E	45°53'26" E

Line

L3	56.69'	S 80°14'30" E
L4	35.08'	N 76°15'35" E
L5	36.35'	S 2°27'50" W

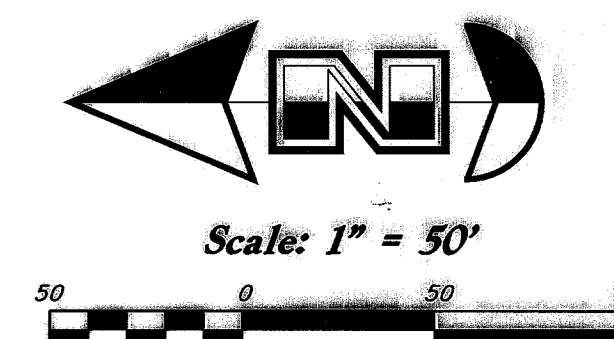


Phase I Site Data:
 Zone = GC-TC
 Building Area = 100,360 s.f.
 Parking Provided = 496 stalls (4.94/1000)

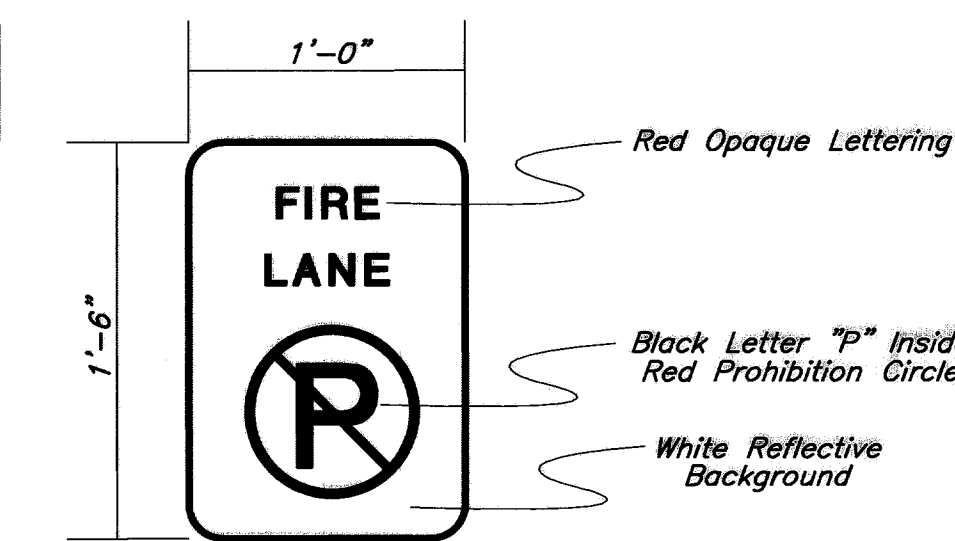

Sign Specifications
 Minimum Specifications of "No Parking Fire Lane" Signs
 Size: 1' Wide x 1'-6" Long as Required
 Lettering: Block Letters 2 1/2" in Height with a Stroke of 1"
 Color: Red and Black on White Luminous Background
 (See above Example)
 Verbage: Fire Lane
 Symbol: International No Parking Symbol
 Height: To be Installed not less than Six Feet nor more than Ten Feet from Ground Level

Fire Lane Sign Detail
 No Scale

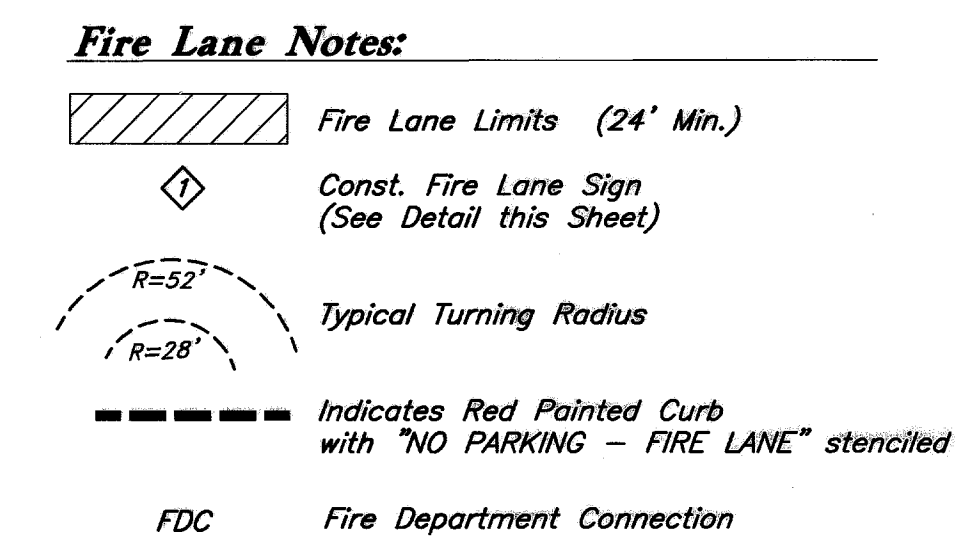

Fire Flow Calculations:
 Fire Flow Requirement is 2,750 gallons per minute @ 20 PSI residual pressure

	Smith's	Bldg A	Bldg B	Bldg C	Bldg D	Bldg E	Bldg F	Bldg G	Bldg H
Required Fire Flow (GPM)	2,750	1,500	1,500	1,500	1,500	1,500	1,500	1,500	1,500
Square Footage	85,335 SF	6,700 SF	4,700 SF	5,735 SF	8,270 SF	5,000 SF	4,600 SF	10,800 SF	1,500 SF
Height	22-35	22-35	22-35	22-35	22-35	22-35	22-35	22-35	22-35
Type of Construction	III-B	V-B	V-B	V-B	V-B	V-B	V-B	V-B	V-B
Sprinkler System	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes
Occupancy	M	M	M	M	M	M	M	M	M


Benchmark
 Rivet with Washer at the Northwest Corner of Deer Springs Way and Riley Street
 Elevation = 2543.29 (775.1977 meters)
 Published by Las Vegas City as Benchmark No. 8LV90 2066 (NAVD 88 Datum)

Basis of Bearings
 North 00°32'07" East, being the bearing of the east line of Section 17, T20S, R60E, M.D.M. as shown by map thereof on file in File 54, Page 09 of Parcel Maps, in the Clark County Recorder's Office, Clark County, Nevada.

Approvals
 [Signature] 1/12/05 Date
 Las Vegas Fire Department

Smith's
 FOOD & DRUG STORES
#332
 Las Vegas, Nevada

Overall Site/Fire Plan
Montecito Marketplace - Phase 1
 SE Corner of Durango Drive & Elkhorn Road
 Las Vegas, Nevada

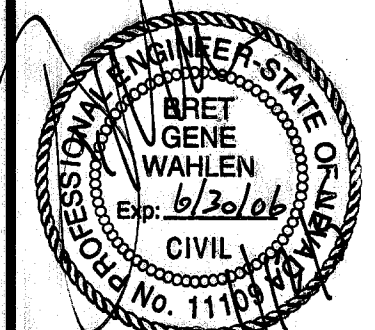

11 Jan, 2005
 SHEET NO. **3**
 3 of 24
 SMC332F
 107V4300