


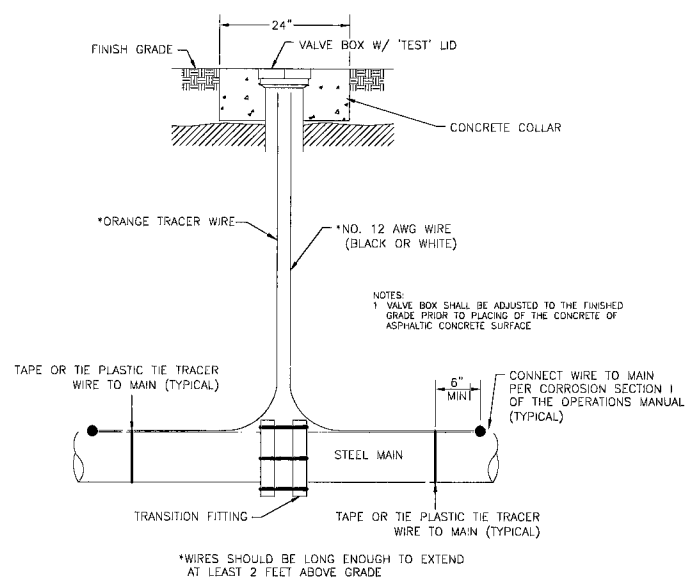


CP DETAIL


1. CP ID: R-6 1-A
FACILITY ID: 21DCP0021136

2. INSTALL TEST STATION (DETAIL 252)
ON SHEET 3 OF 6.

NOTHING ON THESE DRAWINGS SHALL BE REUSED ON
OR CONSTRUED BY CONTRACTOR TO ESTABLISH THE
METHOD OF INSTALLATION (i.e INSERTION, SPLITTING
OF SERVICE, OPEN CUT, OR BORING).

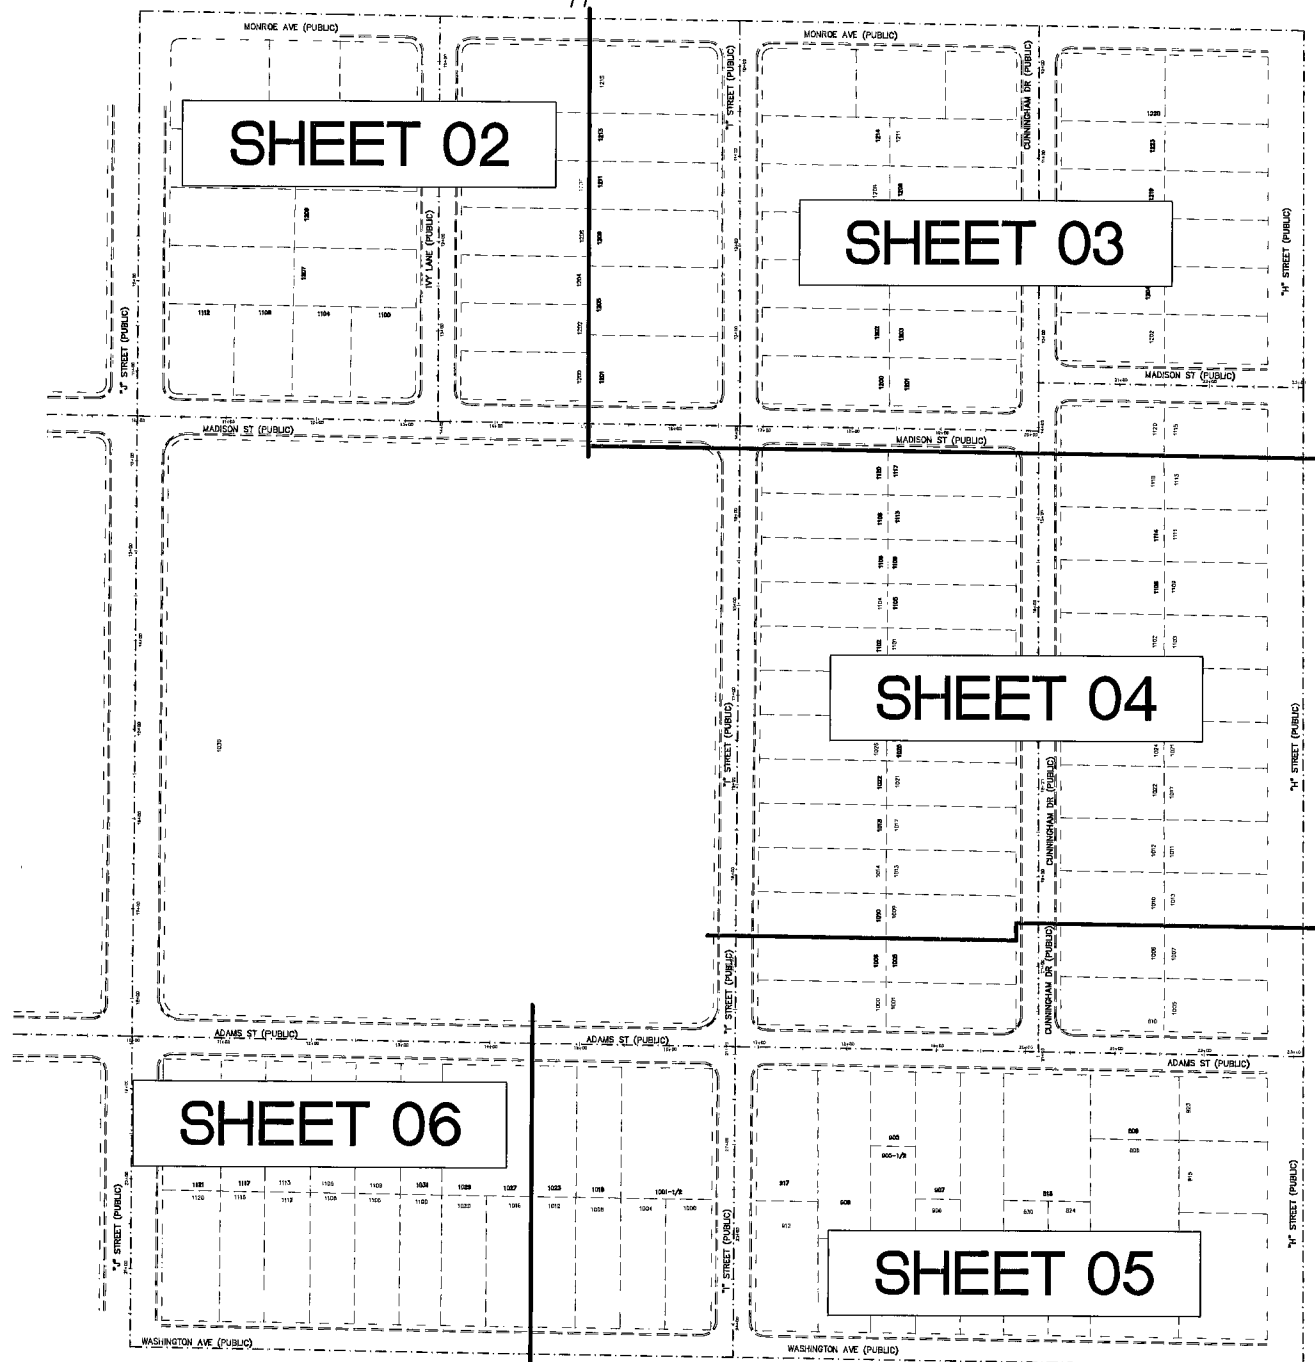

4948' OF 2" PE IN THE
PUBLIC ROW/EASEMENT

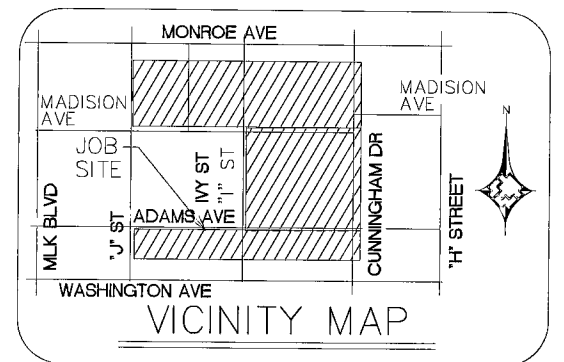

EXISTING GAS LINE
PROPOSED MAIN GAS LINE
PROPOSED SERVICE GAS LINE
BOUNDARY LINE
RIGHT OF WAY LINE
ST (PUBLIC) CENTERLINE
BACK OF CURB / LOT LINE
EX. BACK OF CURB / LOT LINE
SEWER LINE
WATER LINE
FIRE HYDRANT
MATCHLINE

1. SUGGESTED GAS LOCATIONS ARE TO CLEAR SUBSTRUCTURES LOCATE IN FIELD.
2. ALL PIPELINE CONSTRUCTION SHALL CONFORM TO APPLICABLE JURISDICTION SPECIFICATIONS.
3. DO NOT SCALE THIS DRAWING.
4. SEE AC'S FOR SERVICE REPLACEMENT.
5. CHANGE IN PROPOSED MAIN LOCATION MUST BE AUTHORIZED BY SWG INSPECTOR AND MUST BE APPROVED BY CLV INSPECTOR PRIOR TO INSTALLATION.
6. GAS MAINS SHALL BE PURGED PER OPERATIONS MANUAL.
7. ABANDONED SERVICE NO ACTION REQUIRED.
8. REPLACE ALL ACTIVE SERVICES EXCEPT WHERE EXISTING PE SERVICES ARE VERIFIED, INSPECTED, AND APPROVED FOR TIE-OVER BY SWG INSPECTOR.
9. CITY OF LAS VEGAS PERMIT REQUIRED.
10. EXISTING PE SERVICE, PE VERIFICATION, AND INSPECTION REQUIRED FROM MAIN TO RISER. TIE INTO NEW MAIN IF APPROVED BY SWG INSPECTOR, OTHERWISE REPLACE SERVICE.
11. EXISTING SERVICE, UNKNOWN TYPE, SIZE, AND LOCATION TO BE VERIFIED.
12. EXISTING ANODE RISER.
13. EXISTING ANODELESS RISER.
14. REPLACEMENT SVCS TO BE SINGLE OR BRANCHED. NO CROSS-LOT REPLACEMENT SVCS PERMITTED.
15. REPLACE ALL STEEL RISERS WITH ANODELESS RISERS.
16. TRENCHING AND PAVEMENT REPLACEMENT ARE TO CONFORM WITH THE CURRENT RTC STANDARDS.

THIS APPROVAL IS FOR WORK IN CLV R/W
OR CLV EASEMENTS ONLY. OBTAINING PERMISSIONS
OR EASEMENTS FOR WORK SHOWN ON PRIVATE
PROPERTY IS THE RESPONSIBILITY OF THE
UTILITY.

APPROVAL 12/21/2009 DATE

CUSTOMERS63	CYCLE	ROUTE	AREA	3S	LV 16
-------------	-------	-------	------	----	-------

</									
---	--	--	--	--	--	--	--	--	--