


NOT TO SCALE




NOT TO SCALE




NOT TO SCALE

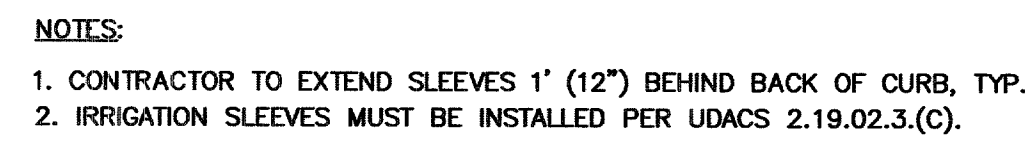


NOT TO SCALE

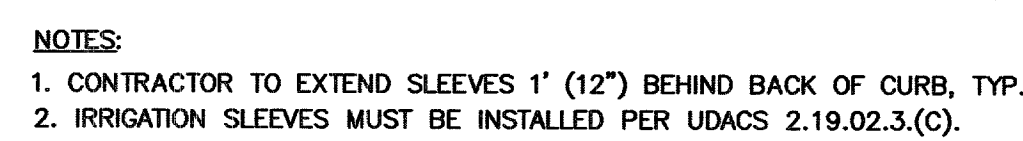

NOT TO SCALE



PER L.V.V.W.D. UNIFORM DESIGN
AND CONSTRUCTION STANDARDS 2.19

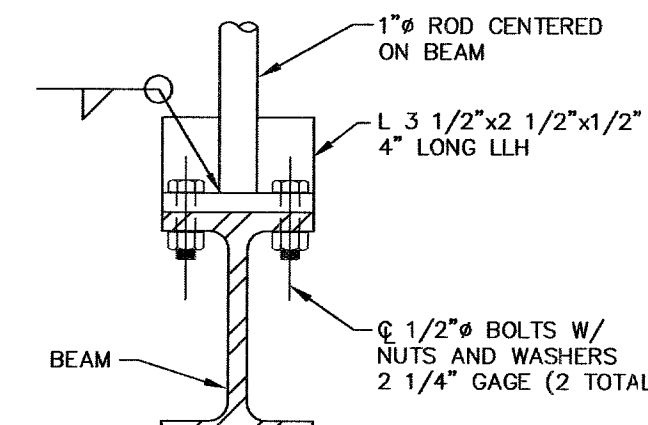


SCALE 3"=1'



SCALE 3/4"=1'

- NOTES:**
1. ALL EXPOSED METALLICS SHALL BE HOT DIP GALVANIZED AFTER FABRICATION.
 2. PROVIDE 1/2" (MIN.) CLEARANCE ALL AROUND THE STEEL BEAM, DRY PACK AFTER INSTALLATION.
 3. WHEN REQUIRED BY LENGTH OF OPENING, PLATE ANGLE MAYBE DELIVERED IN SECTIONS AND BUTT WELDED IN PLACE.
 4. ALL GALVANIZING DAMAGED BY WELDING SHALL RECEIVE TWO COATS OF GALVALLOY OR EQUAL.
 5. CONCRETE SHALL BE MODIFIED CLASS DA, SEE SPECIAL PROVISIONS SECTION 501.
 6. SEE GENERAL NOTES FOR STRUCTURES ON DWG. DB.
 7. ALL ANCHORS SHALL BE EMBEDDED MIDPOINT IN EACH ENDWALL AND EVENLY SPACED. (MAXIMUM SPACING OF 2')

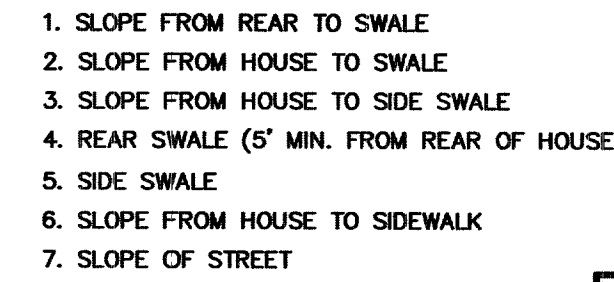

TYPICAL GRADING



SCALE 3/8"=1'



SCALE 3/8"=1'



SCALE 3"=1'




LAS VEGAS VALLEY WATER DISTRICT
PROJ. NO. 111501

3-02-0
DATE

CLV DRAWING NO. 10744891-1