

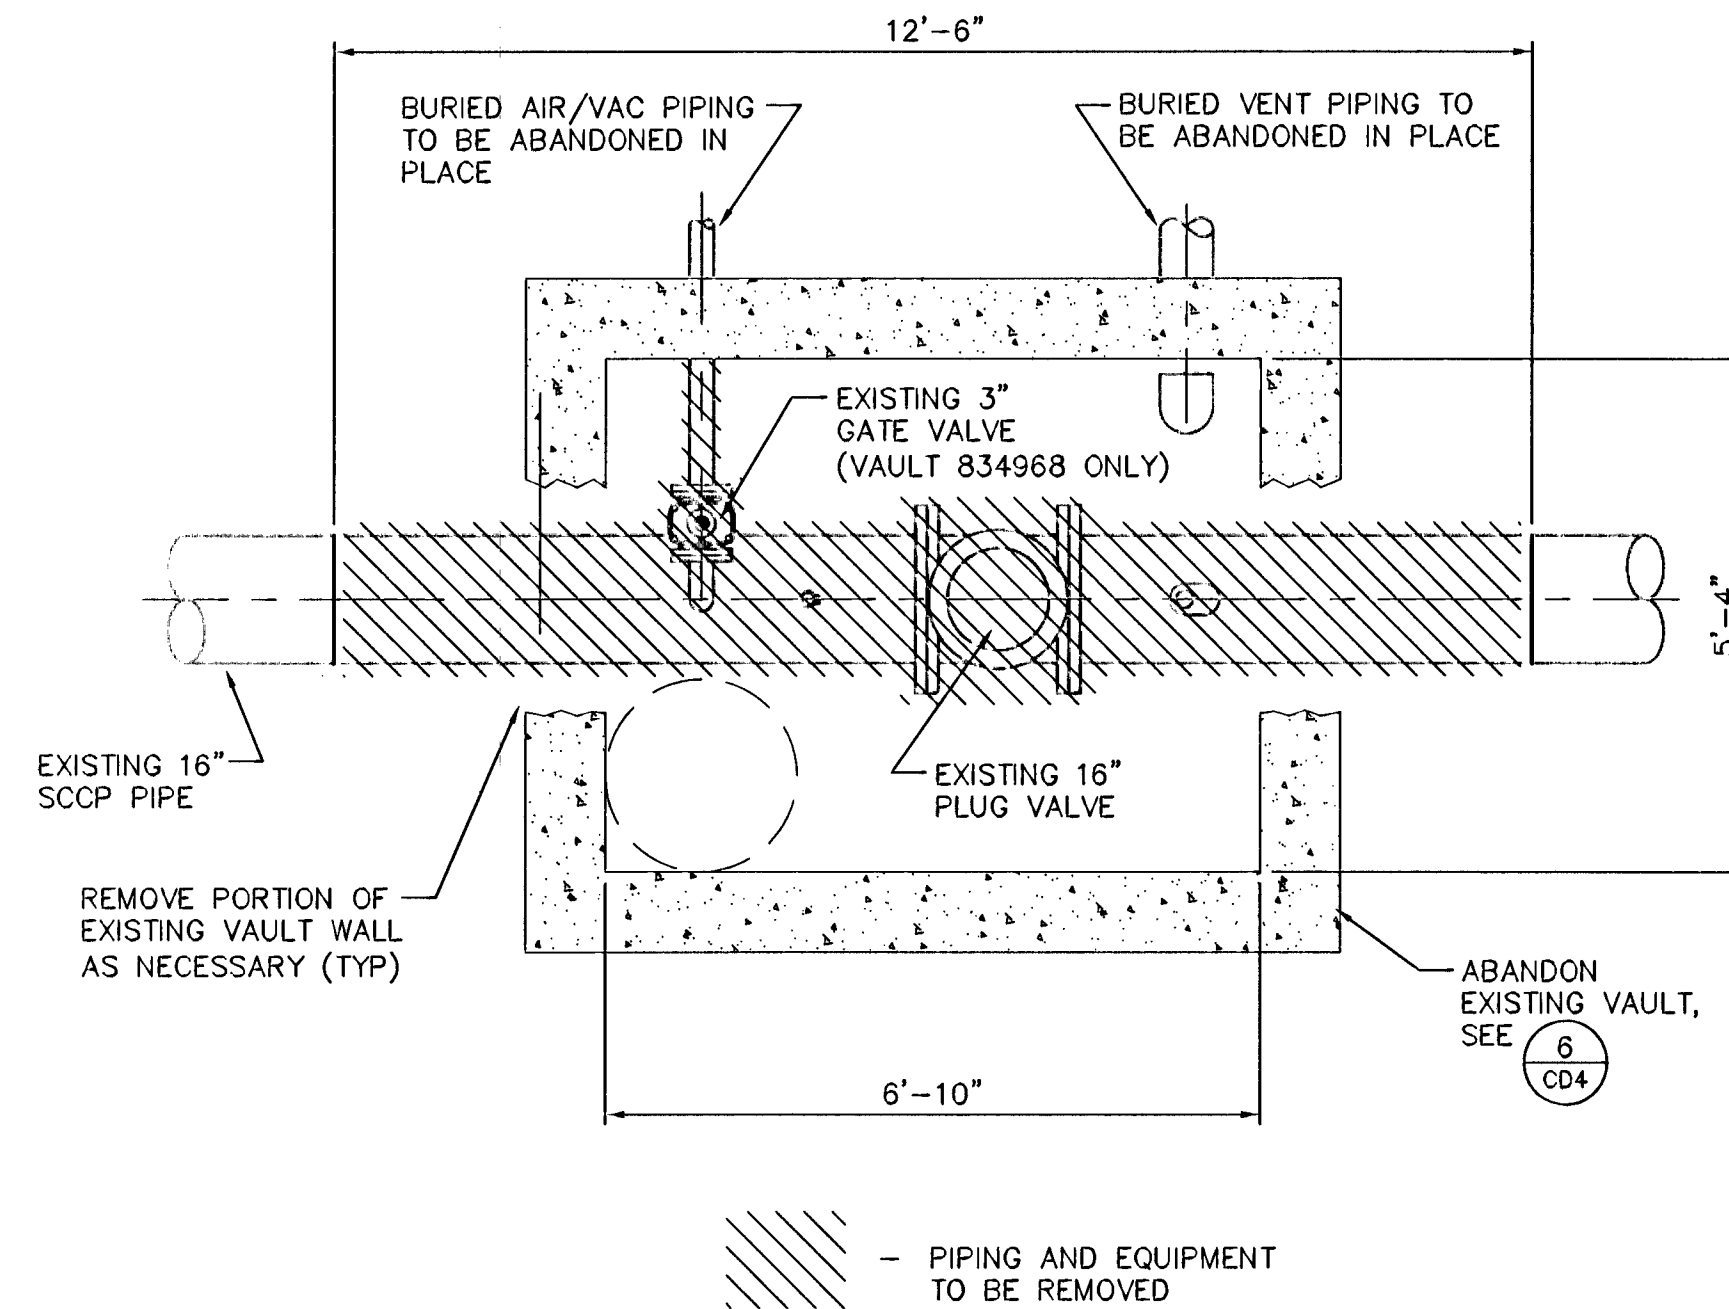


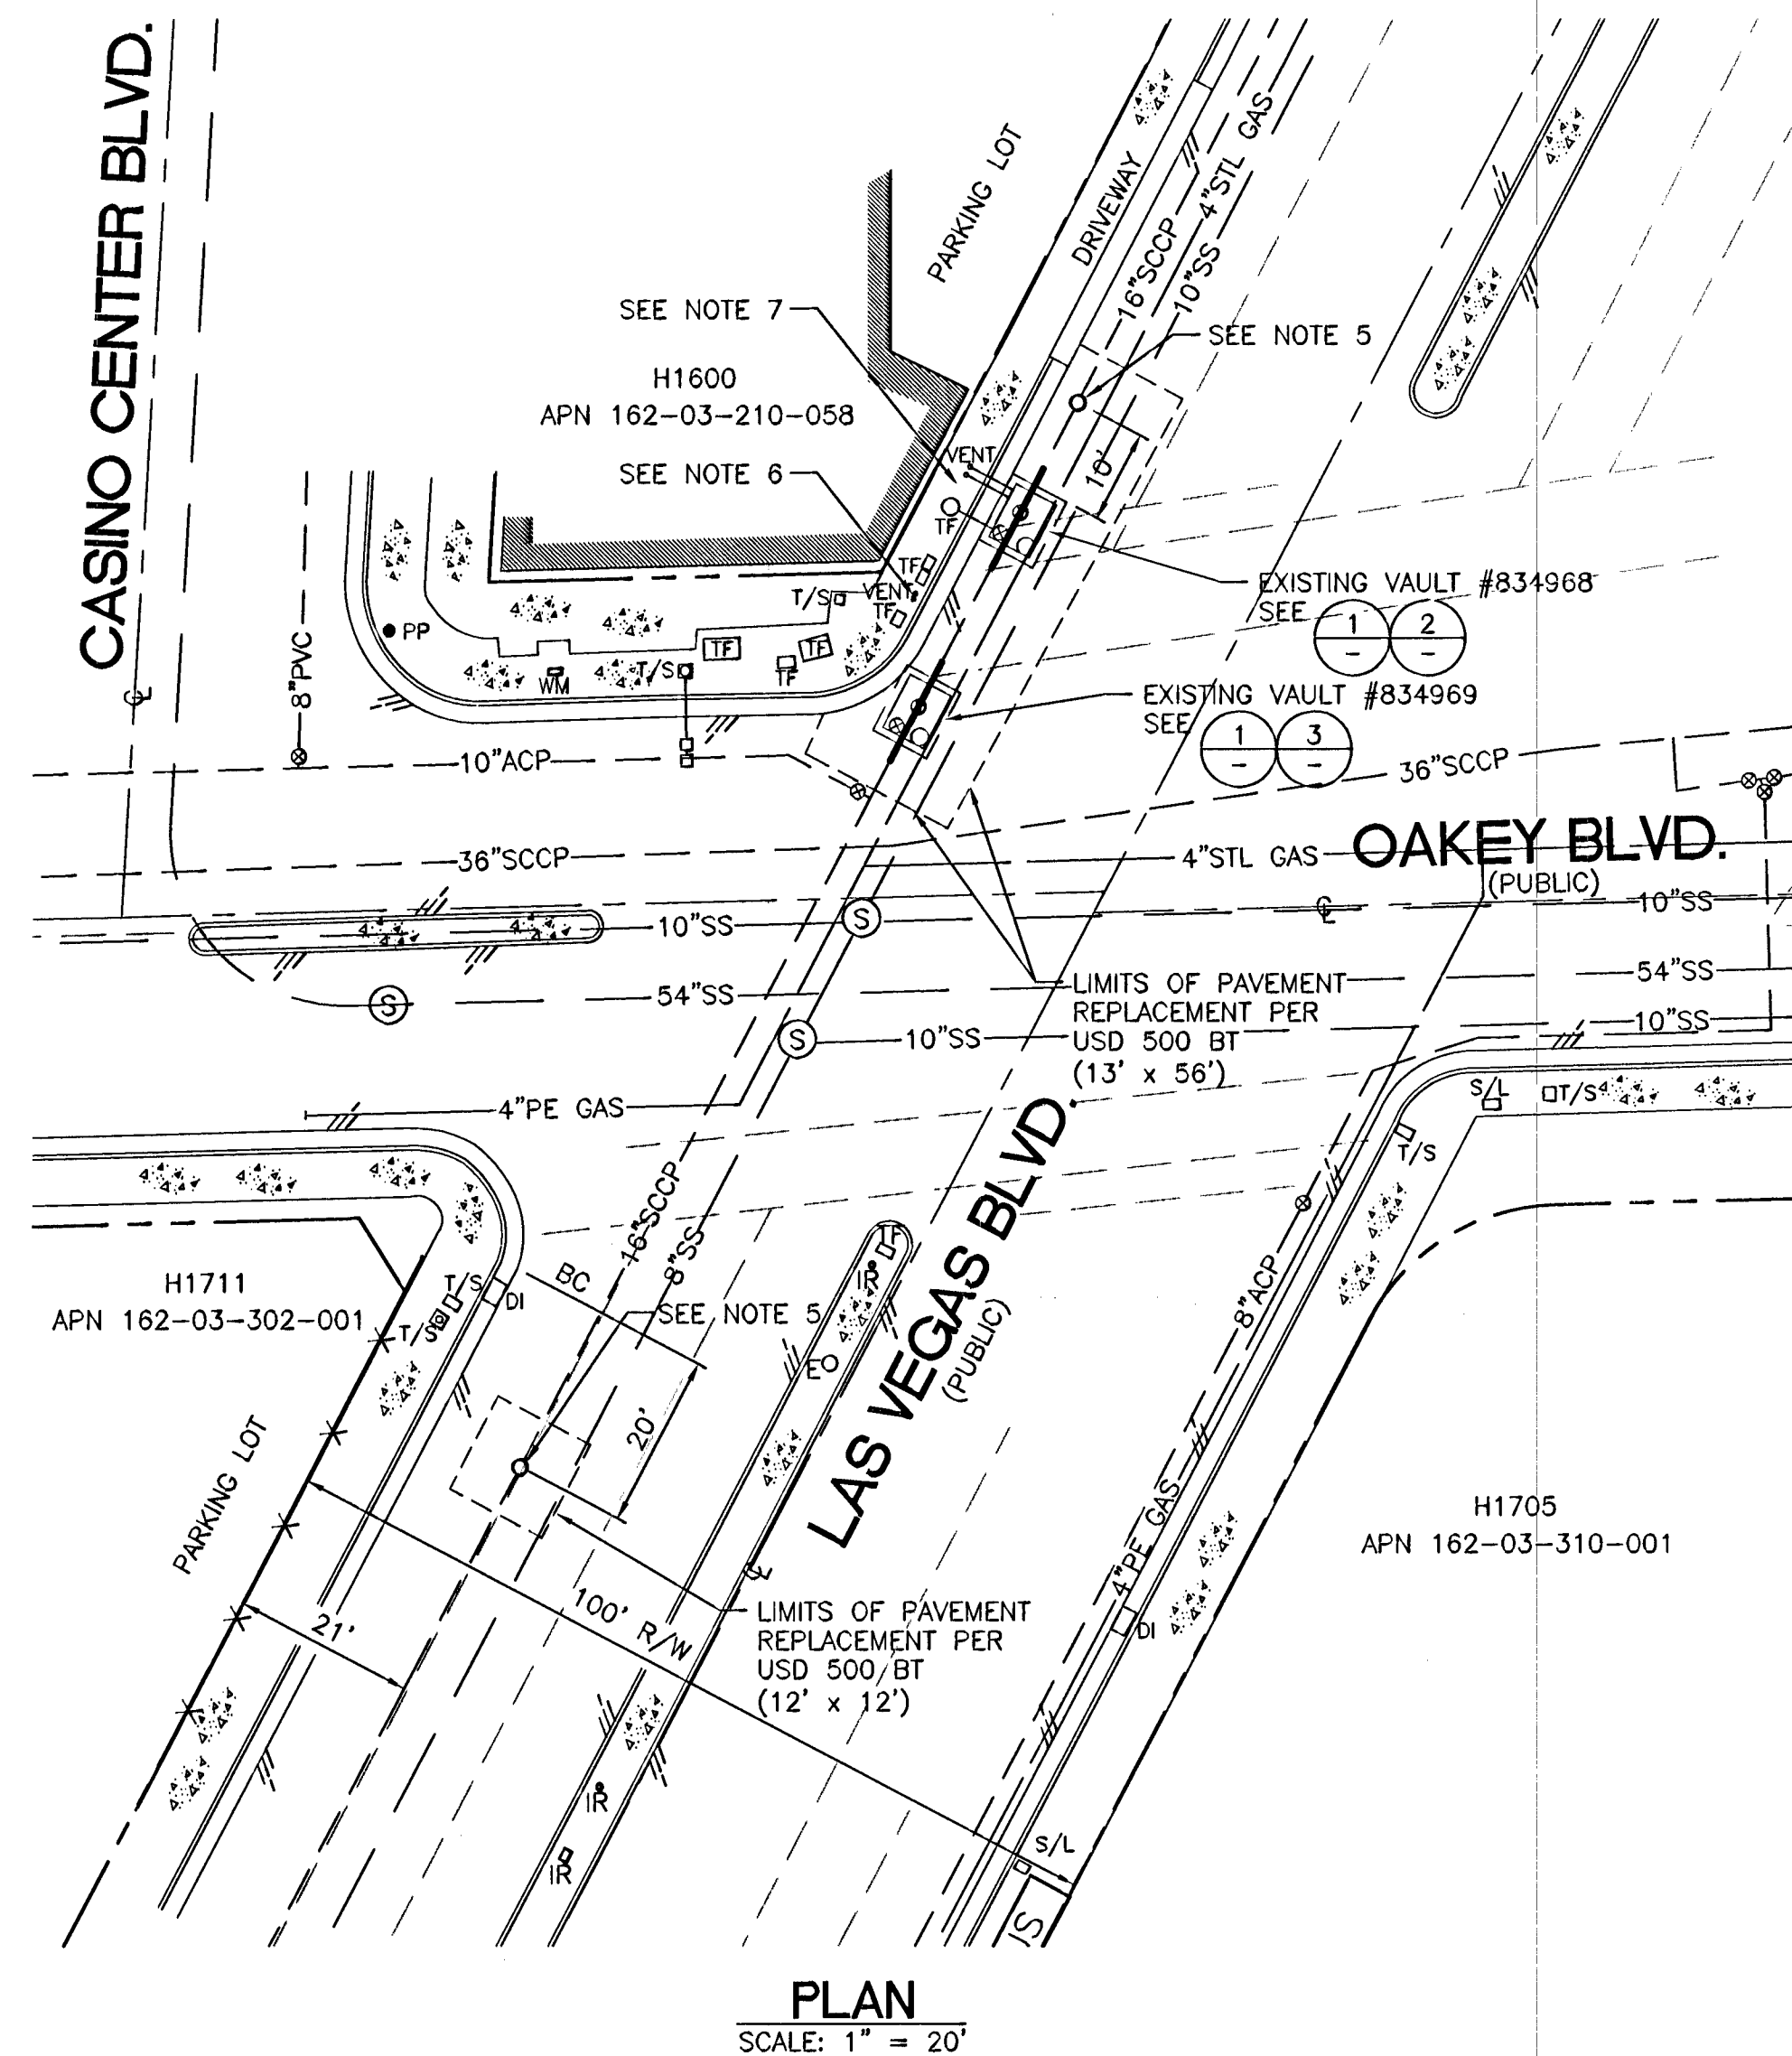

VAULT #834968/#834969 DEMOLITION PLAN

SCALE: 1/2" = 1'-0"

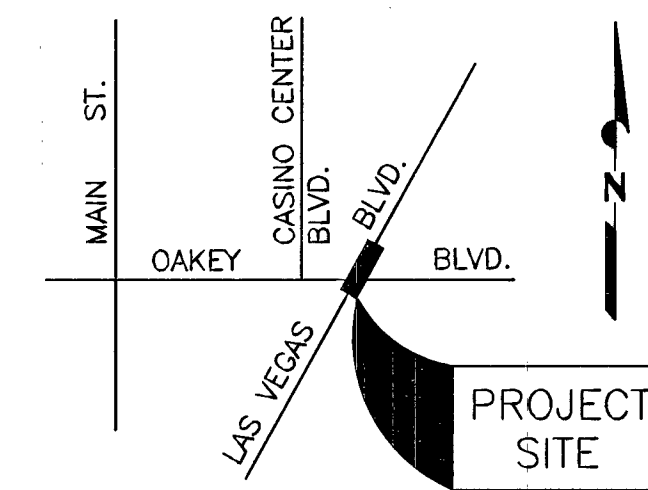


CAUTION TO CONTRACTOR:

THE CONTRACTOR SHALL BE RESPONSIBLE TO INVESTIGATE AND VERIFY THE ACTUAL LOCATION AND DEPTH OF ALL EXISTING UNDERGROUND FACILITIES AT LEAST 48 HOURS IN ADVANCE OF THE PERFORMANCE OF ANY WORK.

EXISTING 16" SSCP PIPE DATA: (LVWWD SPEC 6)
STEEL CYLINDER ID - 17"
STEEL CYLINDER THICKNESS - NO. 12 GA.
MORTAR LINING - 1/2"
MORTAR COATING - 3/4"
ROD WRAP - NO. 11 GA.


INSTALLATION NOTES:

1. REMOVE AND DISPOSE OF EXISTING PIPING/EQUIPMENT AS INDICATED.
2. REMOVE AND REPLACE EXISTING SIDEWALK, CURB AND GUTTER TO NEAREST WEAKENED PLANE JOINT AS REQUIRED.
3. FILL EXISTING VAULT WITH CLSM TYPE II TO SPRING LINE OF 16" PIPE. SEE DETAIL 1 CD4.
4. ALL DIP TO BE WRAPPED IN TWO LAYERS OF 10 MIL POLYETHYLENE PRIOR TO BACKFILL WITH CLSM AND TYPE II.
5. INSTALL 16" INSTA-VALVE SEE DETAIL 1 CD1.
6. REMOVE EXISTING VENT PIPING, GRIND FLUSH WITH EXISTING SIDEWALK AND FILL VENT PIPING WITH CLSM.
7. REMOVE AND DISPOSE OF EXISTING VENT PIPING AND AIR VAC. INSTALL NEW AIR VAC SEE DETAILS 1 C2 AND 2 C2.

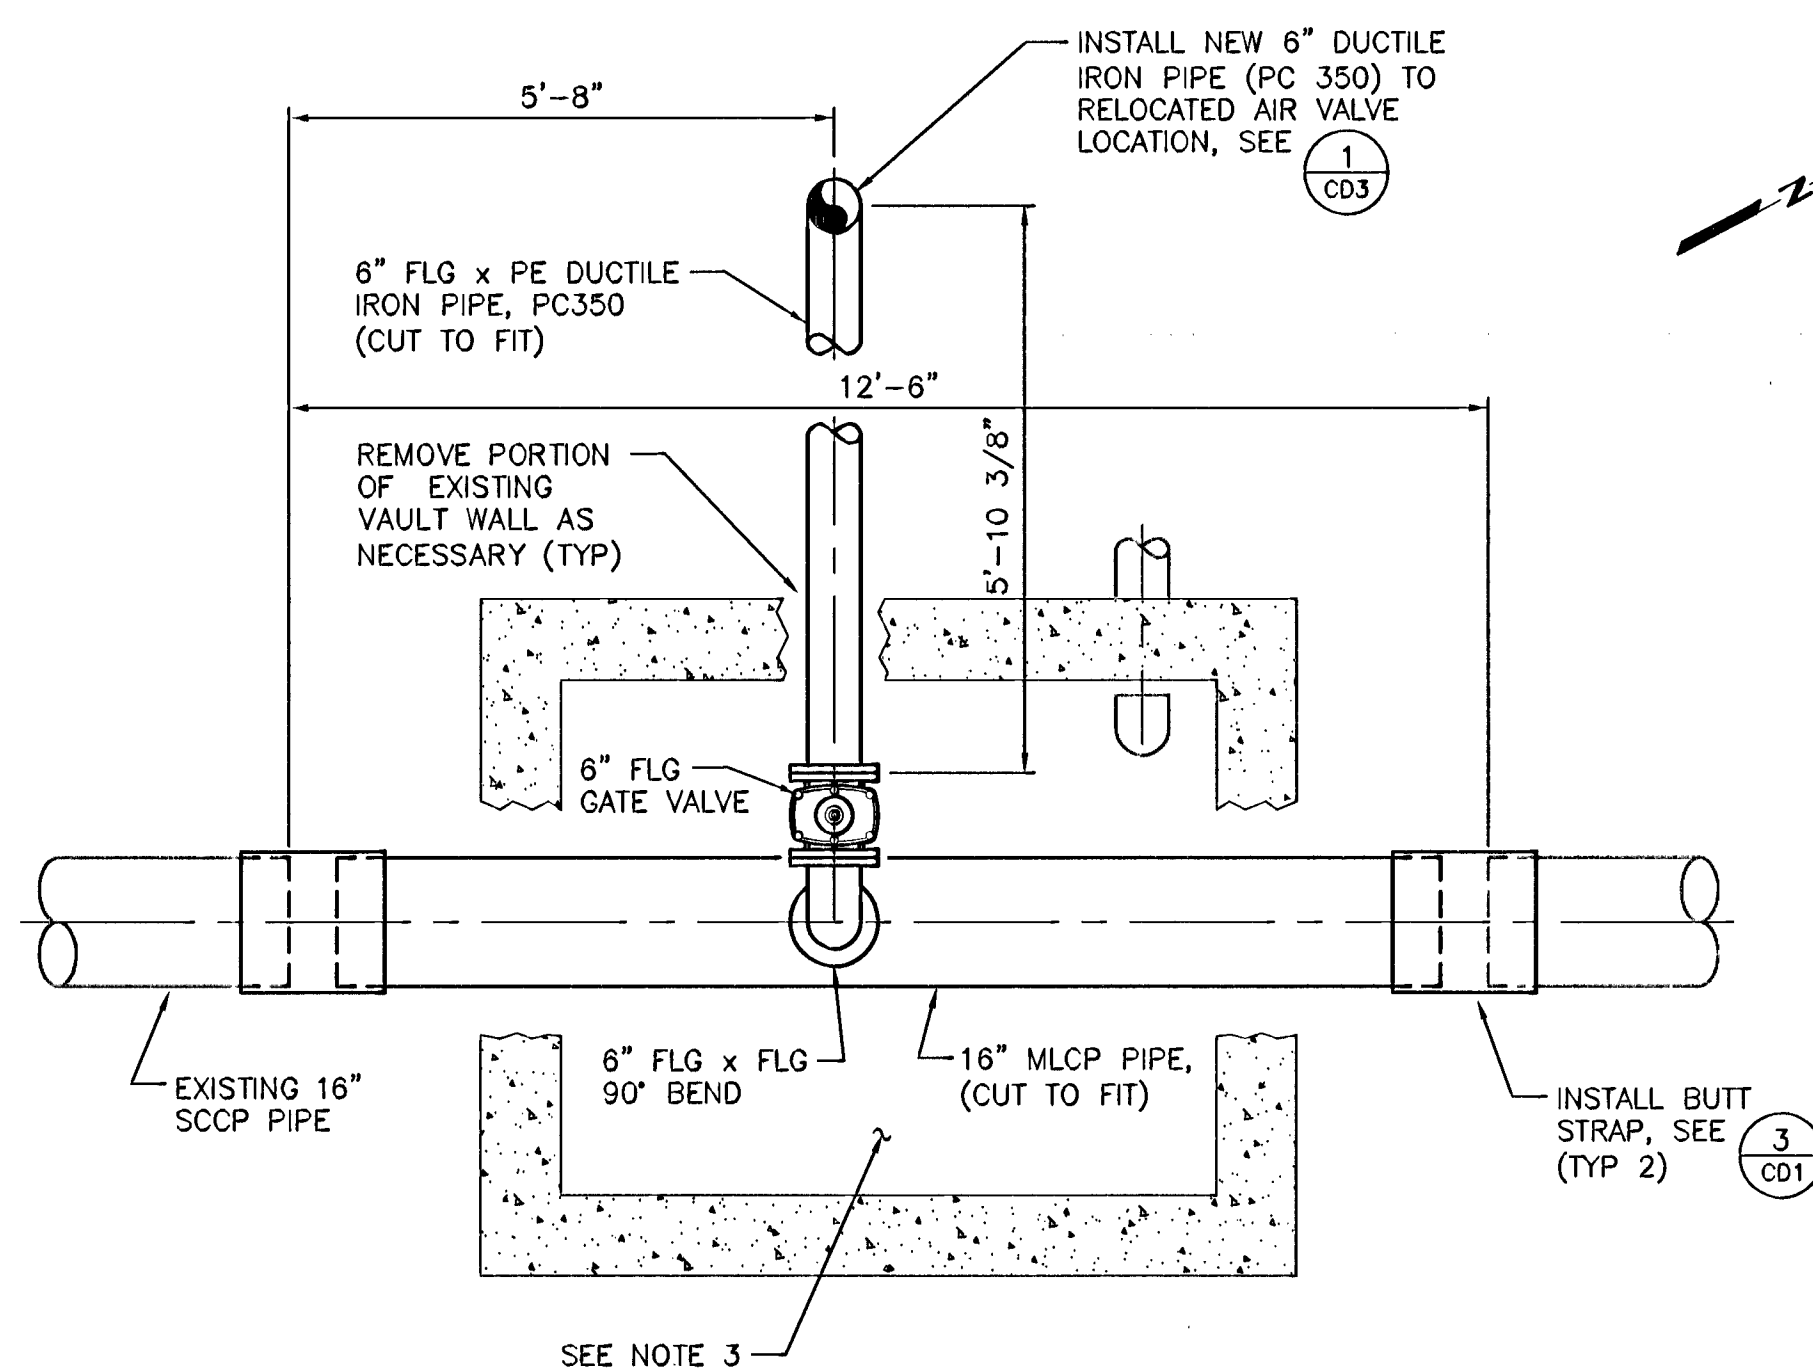

VAULT #834968 PIPE INSTALLATION PLAN

SCALE: 1/2" = 1'-0"

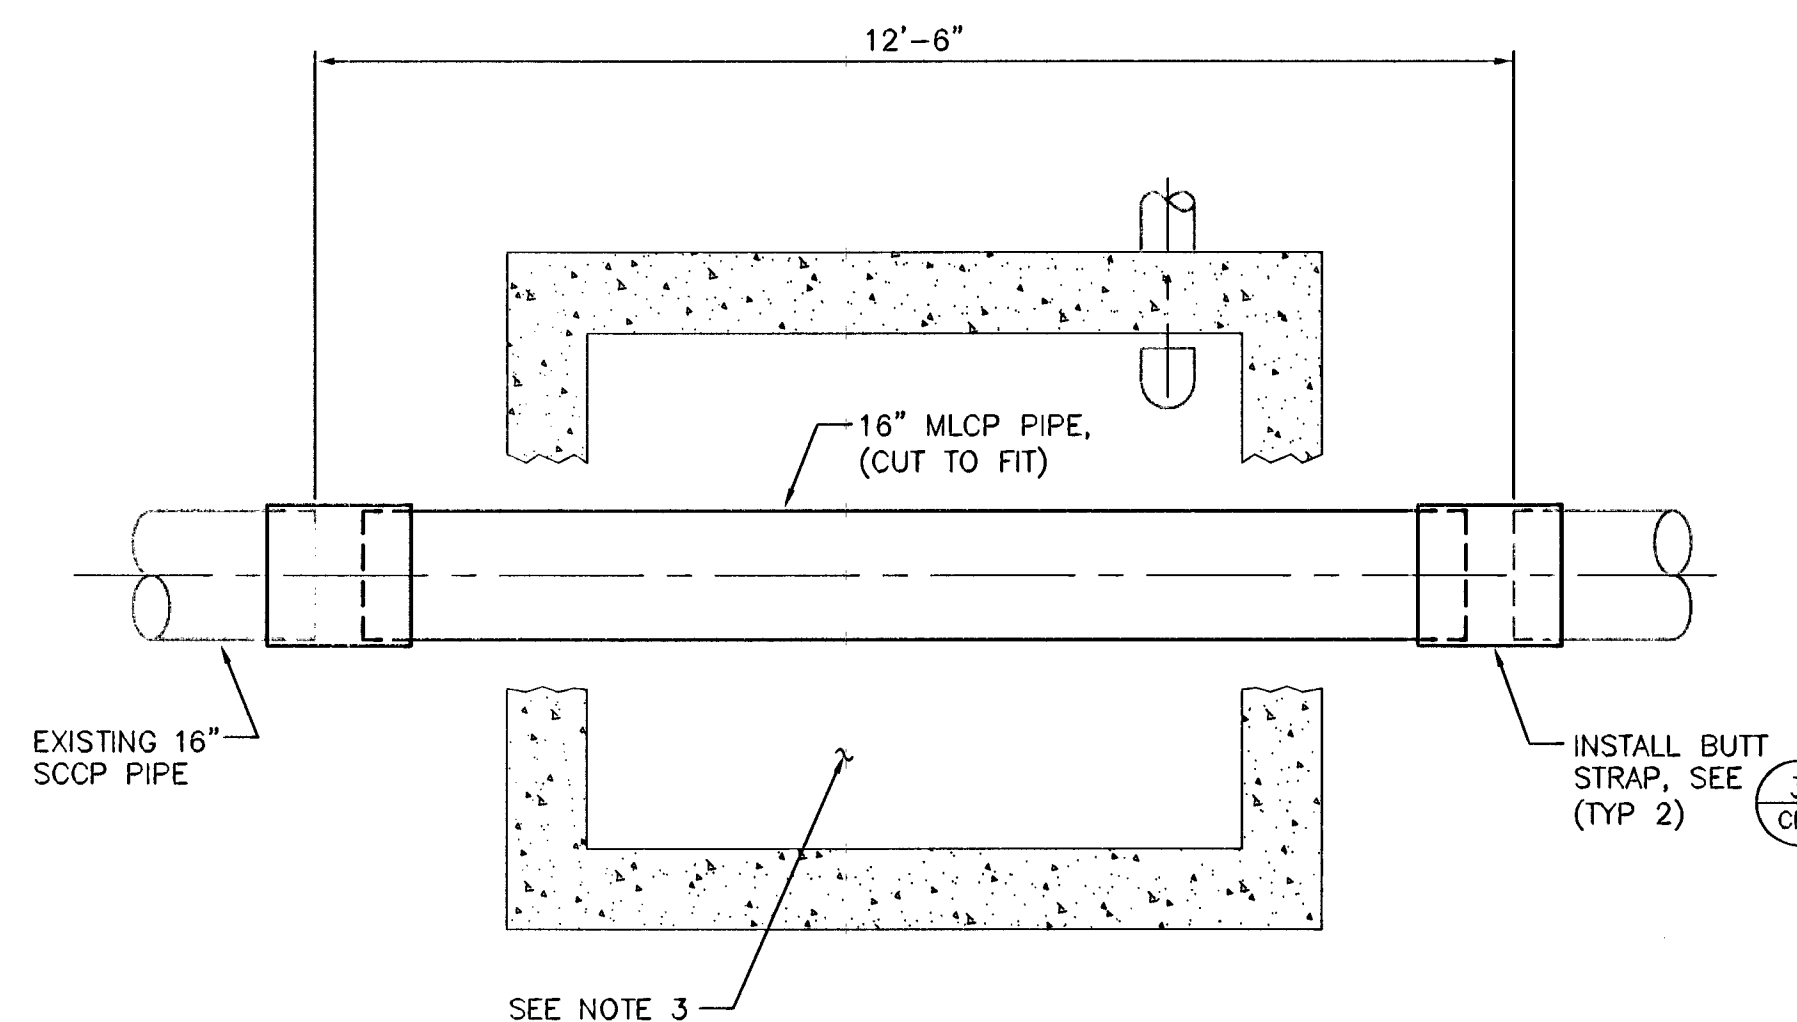

VAULT #834969 PIPE INSTALLATION PLAN

SCALE: 1/2" = 1'-0"


**LAS VEGAS VALLEY
WATER DISTRICT**
1001 S. VALLEY VIEW BOULEVARD
LAS VEGAS, NEVADA 89153
(702) 875-2011

VERIFY SCALE
1/2" = 0' 1/2"
BAS. REPRESENTS
ONE AND ONE-HALF
INCHES ON ORIGINAL

MISCELLANEOUS VAULT REHABILITATION,
FY 2014/2015

1690 S. LAS VEGAS BLVD. & 437 E. OAKLEY BLVD.
VAULT DEMOLITION I

DRAWN BY: JANK
CHECKED BY: RYAN CADE PEARSON
RECOMMENDED BY: RYAN CADE PEARSON
ACCEPTED BY: PETER J. JAUCH
DATE: 2/20/2014
DATE: 2/21/2014
DATE: _____
DATE: _____

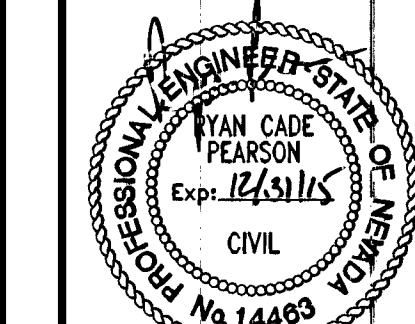

CONTRACT NUMBER
C1408
DRAWING NUMBER C1
SHEET 6 OF 13

Call before you Dig
1-800-4-A-DIG
1-702-227-2929

CLV DWG # 565-493