


935 21st Avenue South, NASHVILLE, TENNESSEE 37212

LAS VEGAS, NEVADA

3100 N TENAYA WAY
LAS VEGAS, NV 89128
(702)225-5065

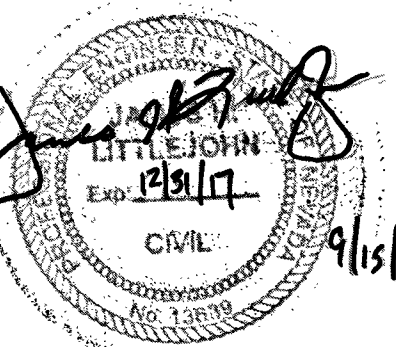


5/19/16	REV 1
DATE	REVISIONS
02/25/2016	201511

SHEET 2 OF 20

C1.0

EXISTING
CONDITIONS

107V6732 H#64607

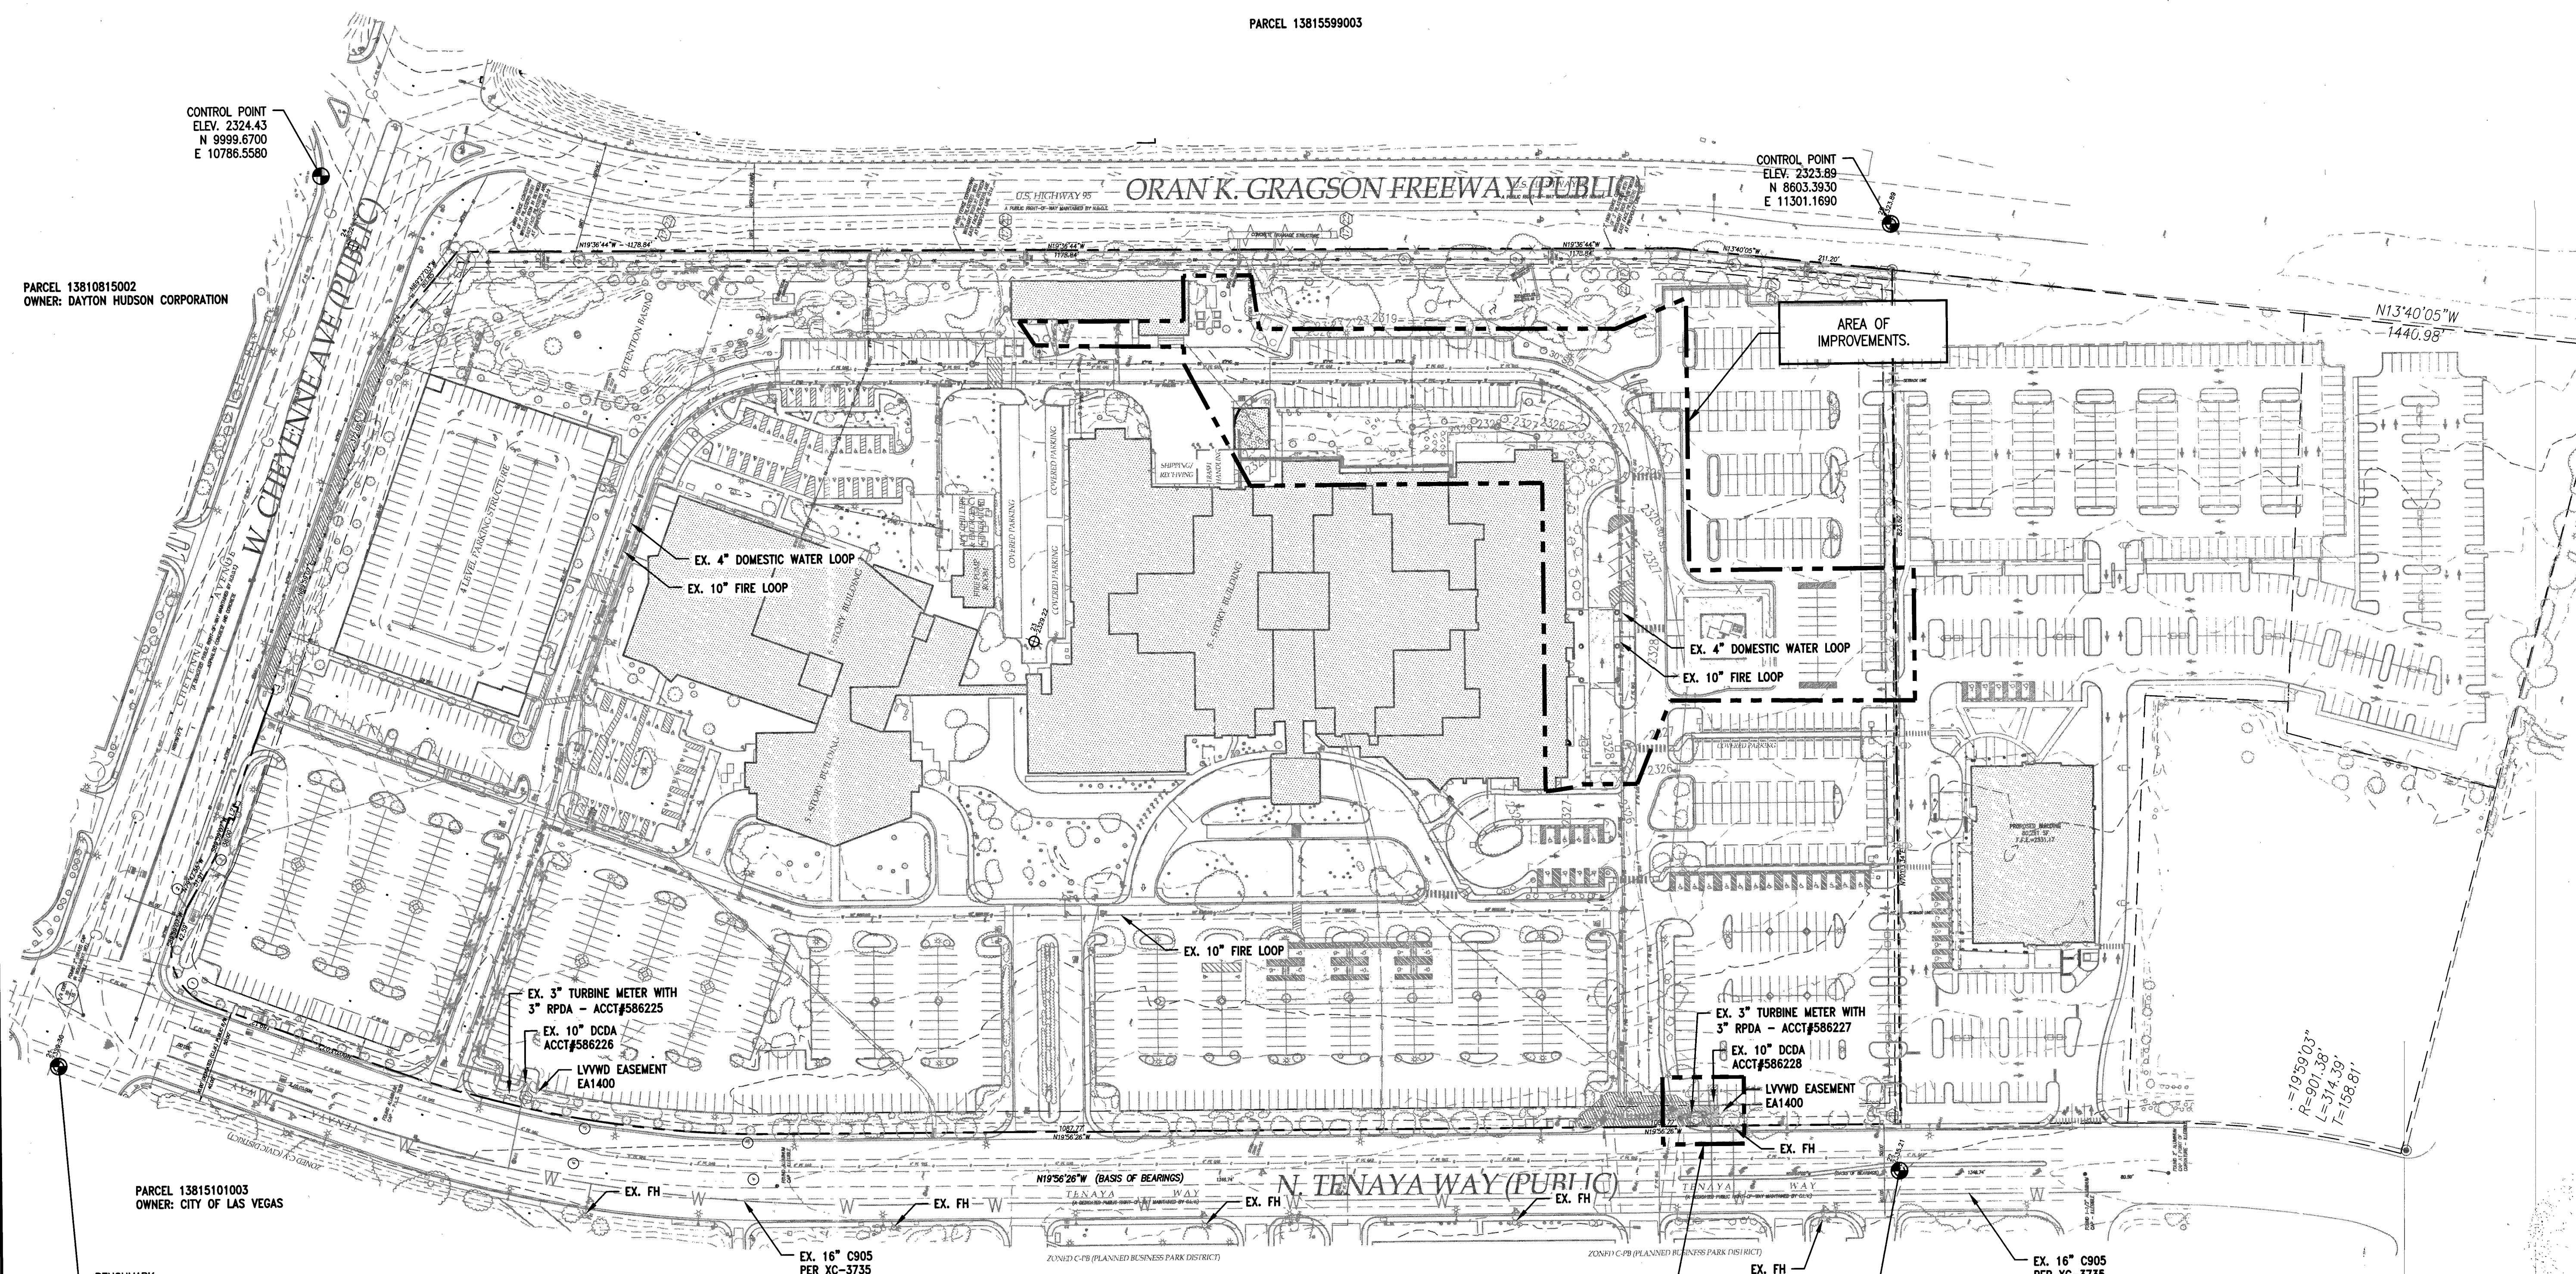

AREA OF
IMPROVEMENTS.

**WARNING FIRE LINE (NON-POTABLE WATER)
ALL EXISTING, RELOCATED, OR PROPOSED DCDA/RPDA
INSTALLATIONS:**

"To comply with the Federal Safe Drinking Water Act, the Fire Line or any of its components shall **NOT** be used for potable drinking water at any time.

APPROVED FOR CONSTRUCTION

[Signature] 12/6

CITY OF LAS VEGAS FIRE & RESCUE DATE

APPROVED FOR CONSTRUCTION

4 / DISHAR ER

Las Vegas Valley Water District Engineering Services Manager

DATE 10/12/16 PROJECT NO. 124549

LVVWD Approved Fire Flow 4500 GPM at 20 PSI Residual

