


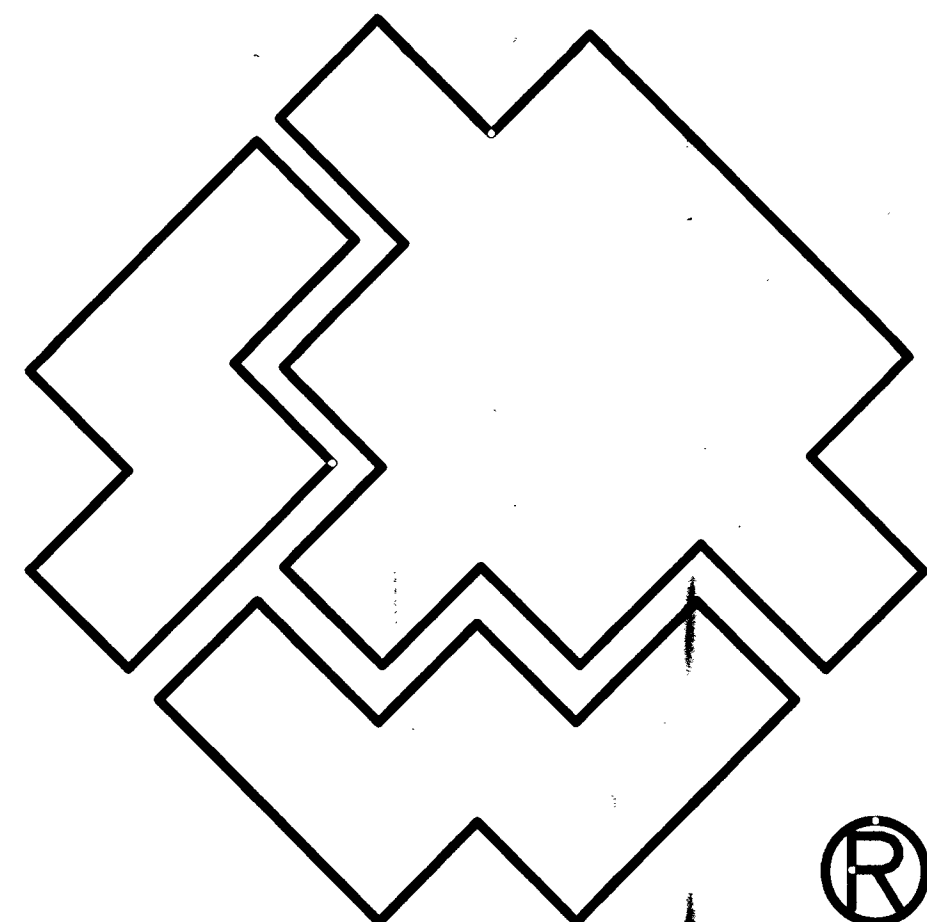

SOUTHWEST GAS CORPORATION



MLK MEDICAL
CITY OF LAS VEGAS, NV
WR #3261890

City of
Las Vegas


Total footage located in Public ROW 15'

APPROVED FOR CONSTRUCTION
THIS APPROVAL IS FOR WORK IN CLV R/W OR CLV
EASEMENTS ONLY. OBTAINING PERMISSION OR
EASEMENTS FOR WORK SHOWN ON PRIVATE PROPERTY
IS THE RESPONSIBILITY OF THE UTILITY.

Approval _____ Date _____

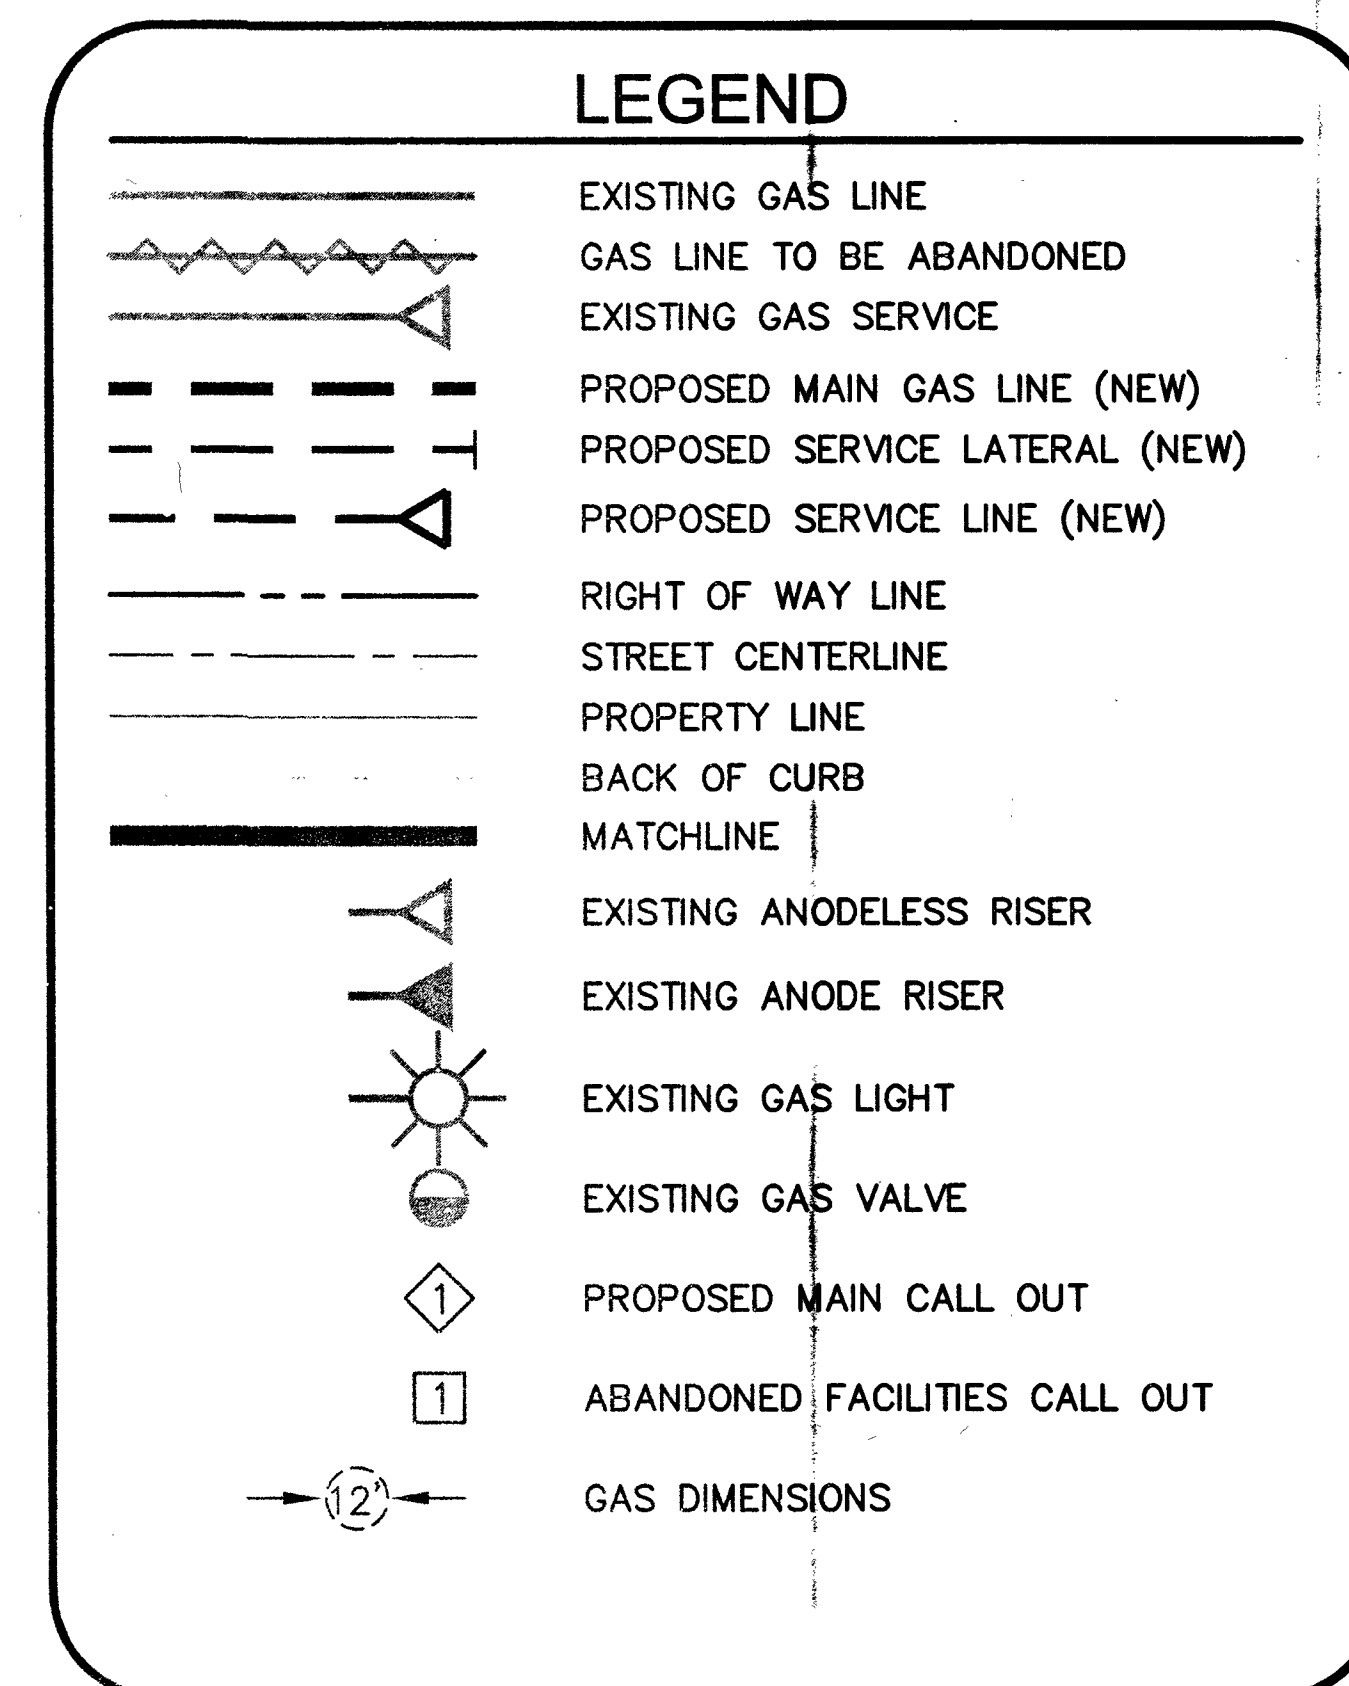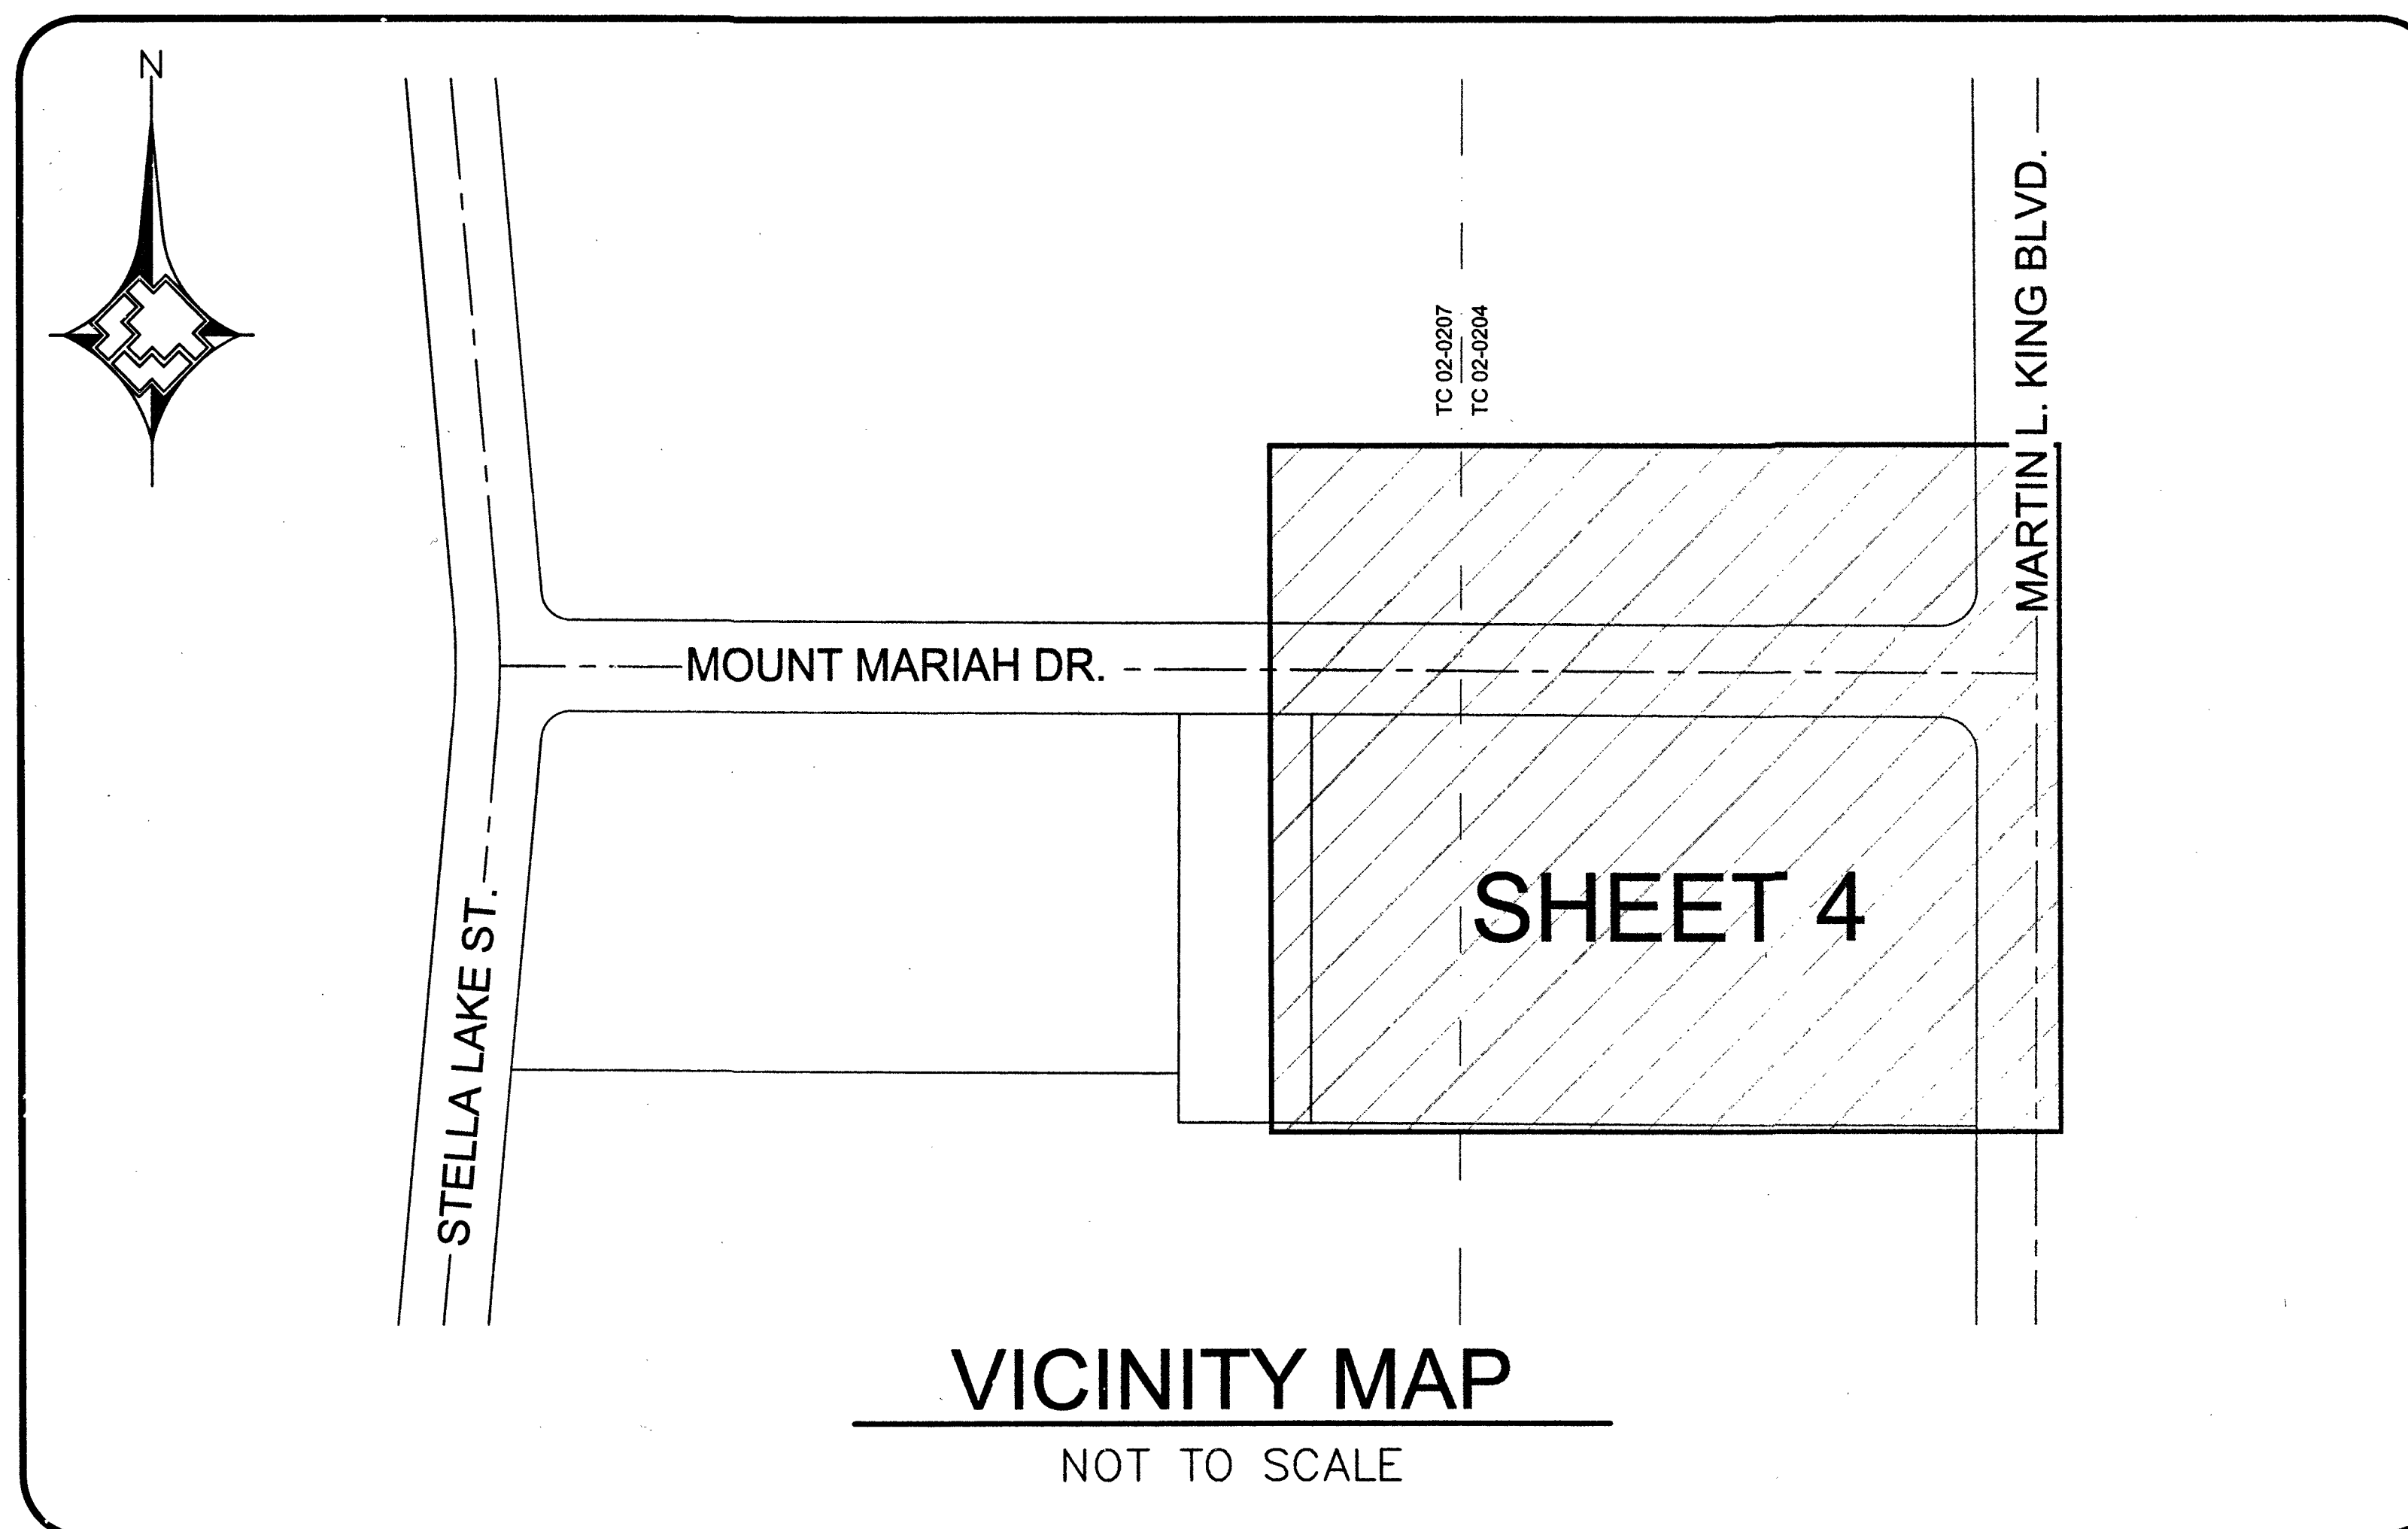

SHEET INDEX	
1. COVER SHEET	
2. CONSTRUCTION NOTES	
3. MATERIALS & NOTES	
4. DESIGN PLAN	

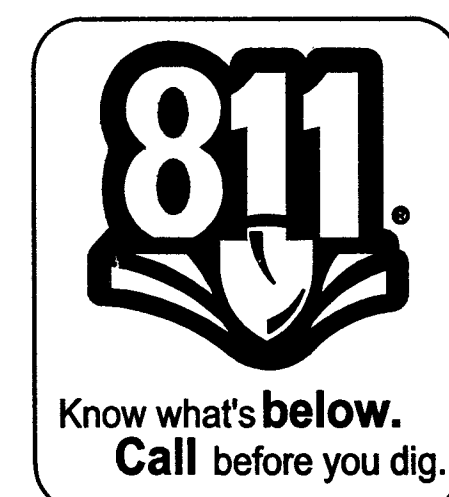


1. _____		2. _____		3. _____		4. _____		CUSTOMERS 0		AS-BUILT DRAWING-PRESSURE TEST DATA		INDIVIDUAL PERFORMING VISUAL INSPECTION VISUAL INSPECTION CERTIFICATION I HAVE VISUALLY INSPECTED ALL HEATED FLUIDS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT I HAVE PERFORMED DATE _____		CONSTRUCTION INSPECTOR _____ FOREMAN _____ REVIEWED BY _____		ISOLATION AREA ISO_21_DIST_092		W.R. NO. 3261890		ENGINEER/TECH: JACOB SAKAGUCHI ACCOUNT REP: FADI AZAR PROJECT CONTACT: MARTEL CLAYTON SHEET NO: 1 OF 4 DWN. BY: SEI SCALE: NTS DATE: 10/03/2016 DATE: 10/03/2016 APPVD. BY: _____ TITLE: _____ H#66665 107V6760					
NO.		DESCRIPTION		BY		DATE		APPROVAL		PROPERTY UNITS		TEST MEDIUM TEST METHOD PIPE DIA. _____ PIPE LENGTH _____ PIPE TYPE _____ MIN. DURATION _____ TEST PRES. (PSIG) (MAX) _____ (MIN) _____ TIME (HOURS) (STOP) _____ (STOP) _____ DATE (START) _____ (STOP) _____ PERFORMED BY: _____ SNG VERIFIED BY: _____		TEST METHOD ☐ AIR ☐ GAUGE ☐ NITROGEN ☐ CHART ☐ WATER ☐ GAUGE/ SOAP PRESS REC SNG		AS-BUILTS ACCEPTED BY _____ DATE _____ POSTED BY _____ DATE _____ POSTING QC'D BY _____ DATE _____		PERMIT INFORMATION CITY OF LAS VEGAS TAX CODE 02-0204 & 02-0207		LOCATION SEC 21 T20S R61E M.D.M.		ATLAS #/TILE # x624y524		MLK MEDICAL COVER SHEET	
REVISIONS		TAX CODES		UNIT NO.		UNIT TYPE		INSTL. RETIRED		INSTL. RETIRED		COMPLETED													



MATERIAL LIST FOR PROPOSED DISTRIBUTION FACILITIES				
ITEM#	QTY. (DESIGN)	QTY. (AS-BUILT)	STOCK ID#	DESCRIPTION
1	346'		100-5101	PROPOSED 2" PE MAIN
2	1		160-8171	PROPOSED 2"x2" PE TAPPING TEE
3	2		140-3067	PROPOSED 2" PE 90 DEGREE ELBOW
4	1		140-3074	PROPOSED 2" PE FULL FLOW TEE
5	2		140-3060	PROPOSED 2" PE CAP
6	60'		101-8526	PROPOSED 1" PE SERVICE

VISUAL INSPECTION (OQ/PJQ)	
_____	_____
_____	_____
_____	_____
_____	_____
SIGNATURE _____	
DATE _____	

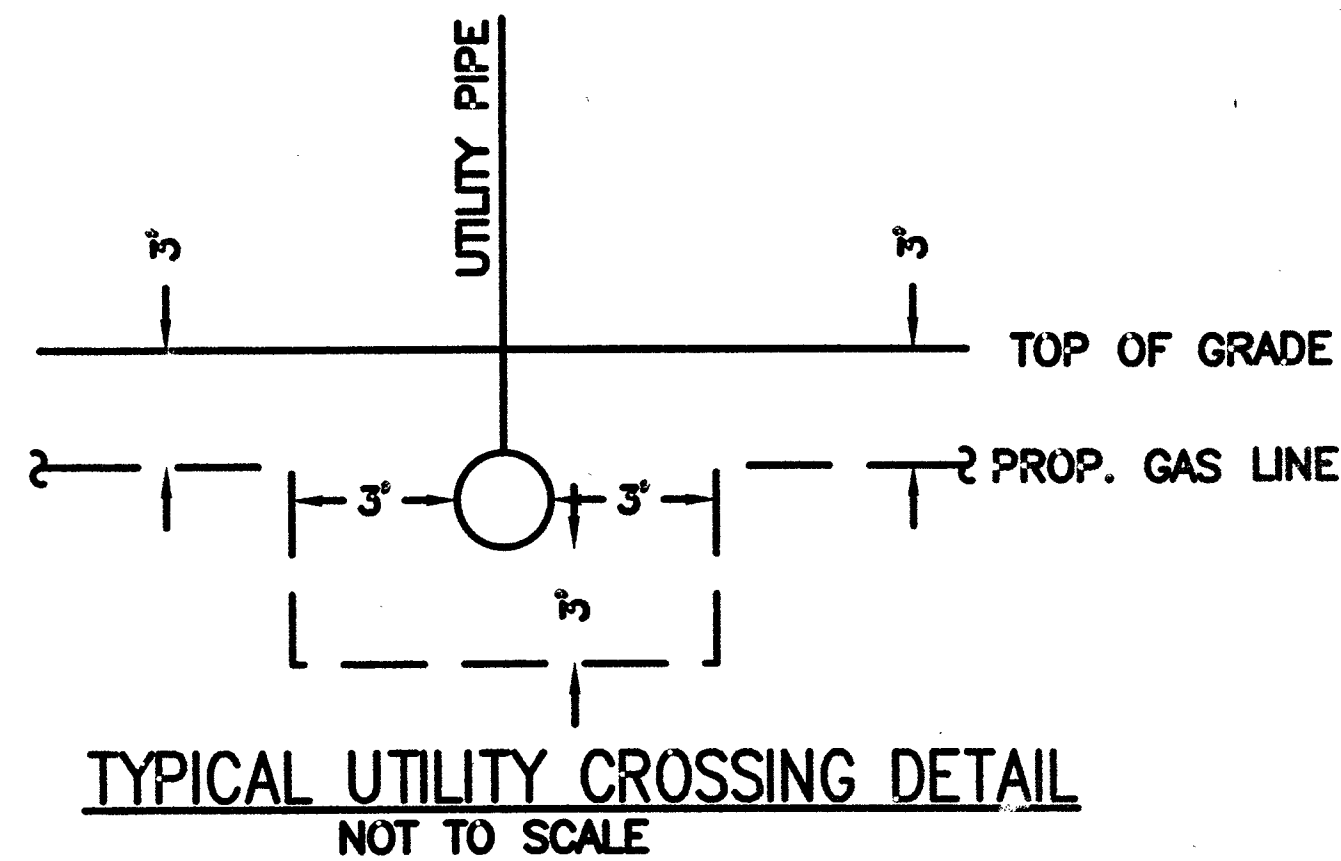


SYSTEM	D_VALLEY_WIDE
DR. NO.	21DR10002365
SEGMENT M.A.O.P.	N/A
SYSTEM M.A.O.P.	43 PSIG
SYSTEM M.O.P.	43 PSIG




PURGE PLAN WAS COMPLETED IN ACCORDANCE
WITH THE OPERATIONS MANUAL GUIDELINES BY:

PRINT: _____ DATE: _____

SIGNATURE: _____

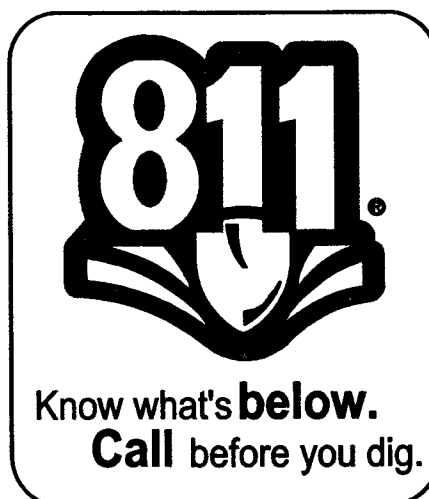[illegible]

0601070_0007

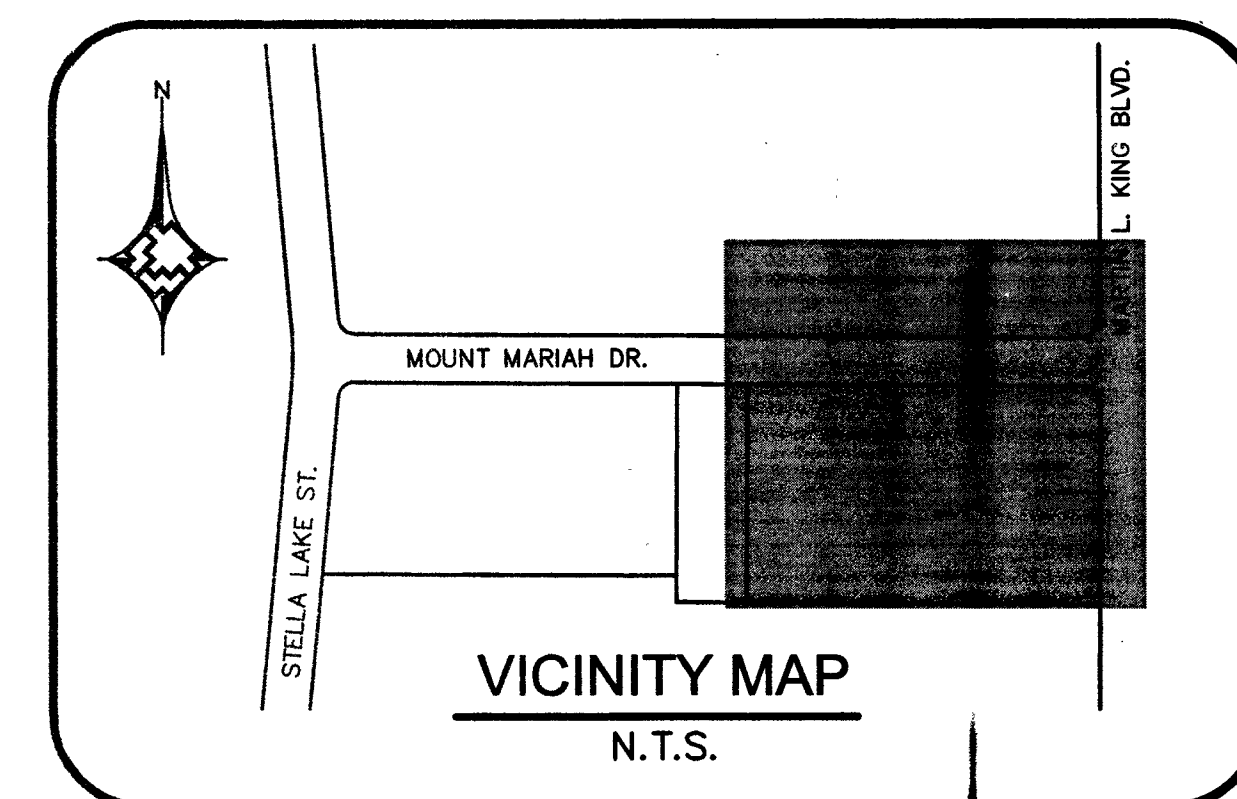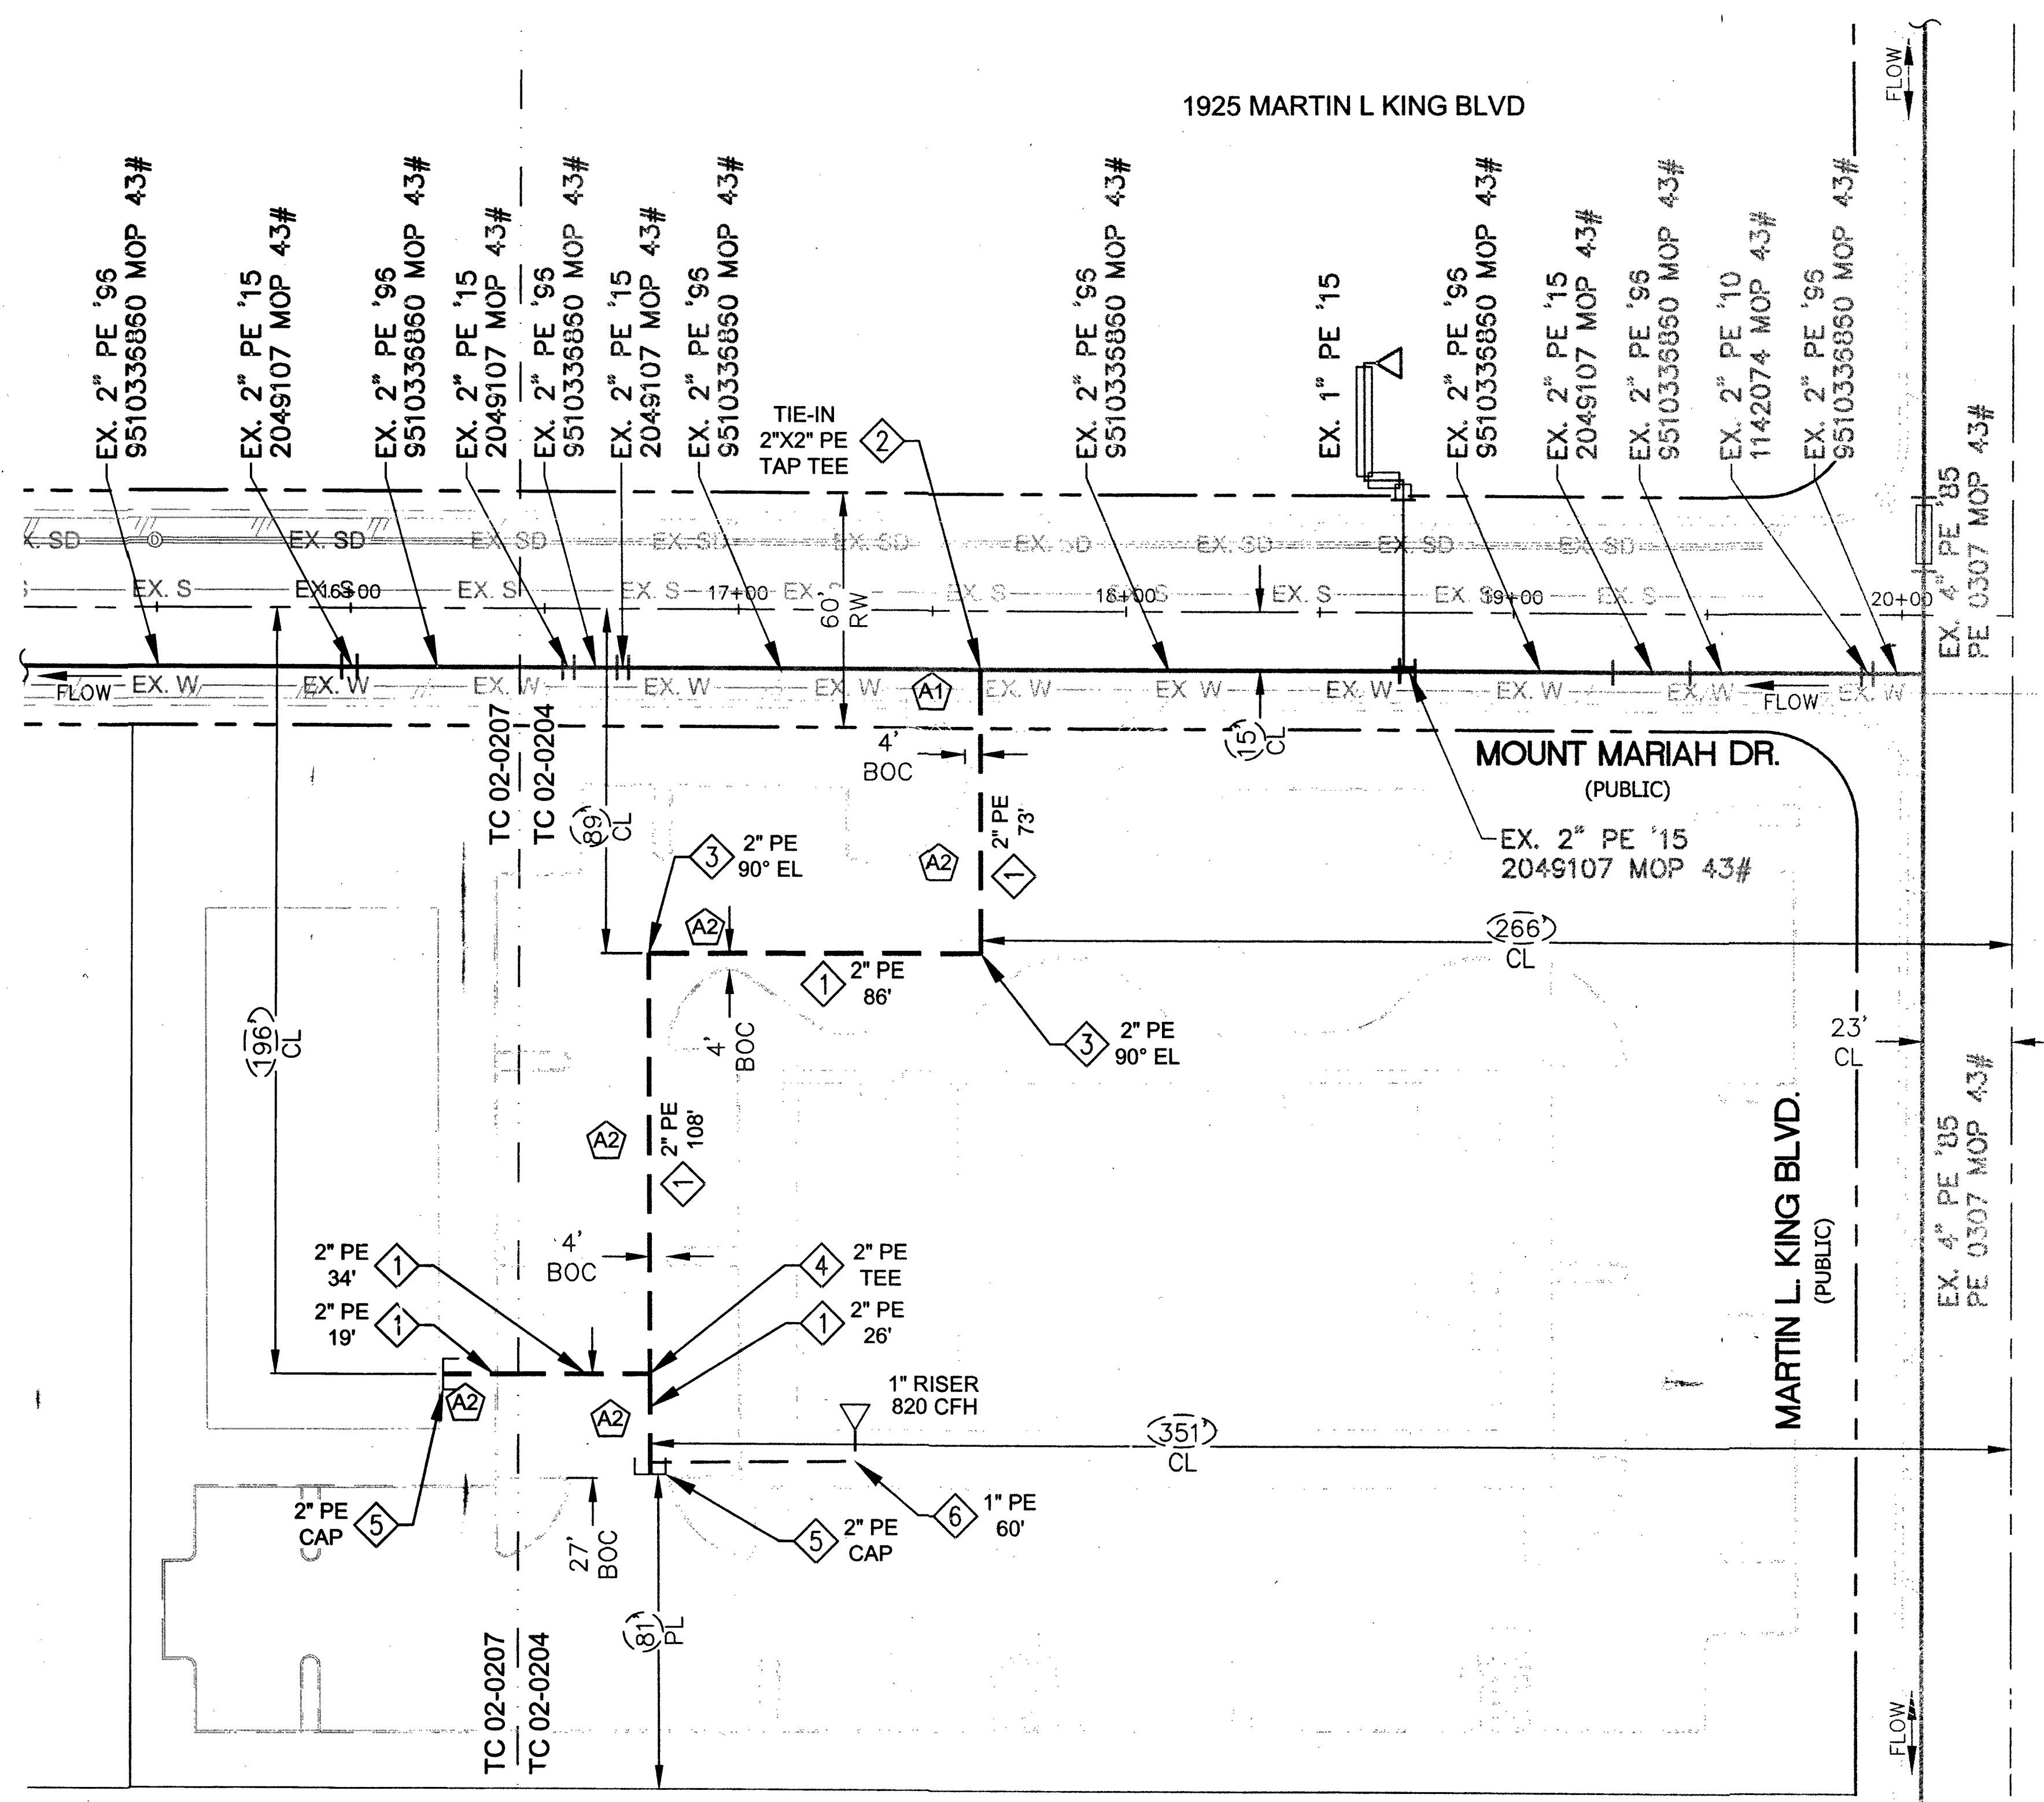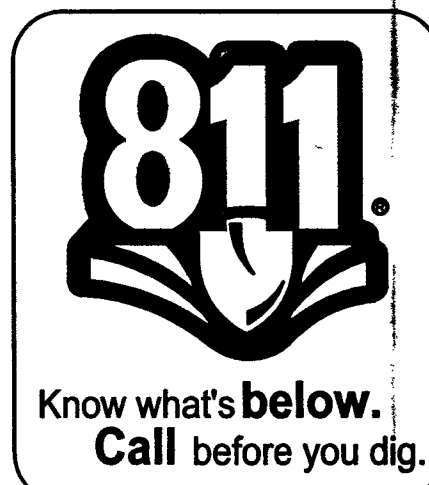

MATERIAL LIST FOR PROPOSED DISTRIBUTION FACILITIES		
ITEM#	STOCK ID#	DESCRIPTION
1	100-5101	PROPOSED 2" PE MAIN
2	160-8171	PROPOSED 2"x2" PE TAPPING TEE
3	140-3067	PROPOSED 2" PE 90 DEGREE ELBOW
4	140-3074	PROPOSED 2" PE FULL FLOW TEE
5	140-3060	PROPOSED 2" PE CAP
6	101-8526	PROPOSED 1" PE SERVICE

PAVEMENT REPAIR SHALL CONFORM TO RTC:

A2 503

[illegible]

000 0001000