503 PASSENGER LOADING ZONES

503.2 VEHICLE PULL-UP SPACE. PASSENGER LOADING ZONES SHALL PROVIDE A VEHICULAR PULL-UP SPACE 96 INCHES MINIMUM IN WIDTH, 20 FEET MINIMUM IN LENGTH AND AN ADJACENT ACCESS AISLE COMPLYING WITH 503.3.

503.3 ACCESS AISLE. ACCESS AISLES SERVING PASSENGER LOADING ZONES SHALL COMPLY WITH 503.3.

ACCESS AISLES SHALL ADJOIN AN ACCESSIBLE ROUTE.

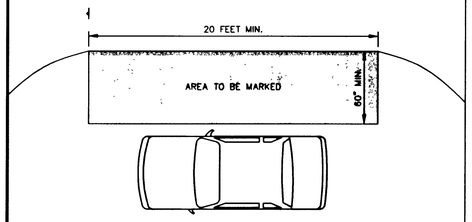

503.3.1 WIDTH. ACCESS AISLES SERVING VEHICLE PULL-UP SPACES SHALL BE 60 INCHES WIDE MINIMUM.

503.3.2 LENGTH. ACCESS AISLES SHALL BE 20 FEET MINIMUM IN LENGTH AND SHALL EXTEND THE FULL LENGTH OF THE VEHICLE PULL-UP SPACES THEY SERVE.

503.3.3 MARKING. ACCESS AISLES SHALL BE MARKED SO AS TO DISCOURAGE PARKING IN THEM.

503.4 FLOOR AND GROUND SURFACES. CHANGES IN LEVEL ARE NOT PERMITTED.

ACCESS AISLES SHALL BE AT THE SAME LEVEL AS THE VEHICLE PULL-UP SPACE THEY SERVE.

SLOPES NOT STEEPER THAN 1:48 (2%) SHALL BE PERMITTED.

503.5 VERTICAL CLEARANCE. VEHICLE PULL-UP SPACES, ACCESS AISLES SERVING THEM AND A VEHICULAR ROUTE FROM AN ENTRANCE TO THE PASSENGER LOADING ZONE, AND FROM THE PASSENGER LOADING ZONE TO AN EXIT, SHALL PROVIDE A VERTICAL CLEARANCE OF 114 INCHES MINIMUM.

216.3 DIRECTIONAL AND INFORMATIONAL SIGNS. SIGNS THAT PROVIDE DIRECTION TO OR INFORMATION ABOUT PERMANENT INTERIOR SPACES AND FACILITIES OF THE SITE SHALL COMPLY WITH 703.4.

INFORMATION ABOUT A PERMANENT ROOM OR SPACE INCLUDES RULES OF CONDUCT, OCCUPANT LOAD, AND SIMILAR SIGNS.

SIGNS PROVIDING DIRECTION TO PERMANENT ROOMS OR SPACES INCLUDE THOSE THAT IDENTIFY EGRESS.

EXCEPTIONS: BUILDING DIRECTORIES, MENUS, AND TEMPORARY SIGNS ARE NOT REQUIRED TO COMPLY WITH.

18" x 24" SPECIAL HANDICAP SIGN (WHITE LETTERS ON HANDICAP BLUE BACKGROUND) WITH 1.5" LETTERS AND INTERNATIONAL HANDICAP SYMBOL.

LOADING ZONE — SPECIAL 18" x 6" HANDICAP SIGN ADVISORY PLATE WITH 2" LETTERS.

505 HANDRAILS

505.2 WHERE REQUIRED. HANDRAILS SHALL BE PROVIDED ON BOTH SIDES OF STAIRS AND RAMPS.

HANDRAILS ARE NOT REQUIRED ON RAMPS WITH A RISE OF 6 INCHES MAXIMUM.

505.3 CONTINUITY. HANDRAILS SHALL BE CONTINUOUS WITHIN THE FULL LENGTH OF EACH STAIR FLIGHT OR RAMP RUN.

505.4 HEIGHT. TOP OF GRIPPING SURFACES OF HANDRAILS SHALL BE 34 INCHES MINIMUM AND 38 INCHES MAXIMUM VERTICALLY ABOVE STAIR NOSINGS AND RAMP SURFACES.

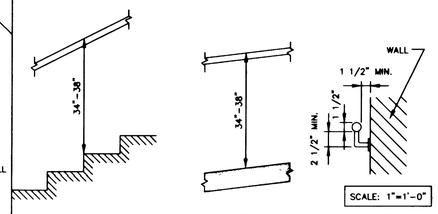

(A) STAIRS (B) RAMPS (C) HANDRAILS

505.5 CLEARANCE. CLEARANCE BETWEEN HANDRAIL AND WALL SHALL BE 1 1/2 INCHES MINIMUM.

505.6 GRIPPING SURFACES. GRIPPING SURFACES SHALL BE CONTINUOUS, WITHOUT INTERRUPTION BY NEWEL POSTS, OTHER CONSTRUCTION ELEMENTS, OR OBSTRUCTIONS.

505.7 CROSS SECTION. HANDRAILS SHALL HAVE A CIRCULAR CROSS SECTION WITH AN OUTSIDE DIAMETER OF 1-1/4 INCHES MINIMUM AND 2 INCHES MAXIMUM, OR SHALL PROVIDE EQUIVALENT GRASPABILITY IN ACCORDANCE WITH 505.7.1.

505.8 SURFACES. HANDRAILS AND ANY WALL OR OTHER SURFACES ADJACENT TO THEM SHALL BE FREE OF ANY SHARP OR ABRASIVE ELEMENTS.

505.9 FITTINGS. HANDRAILS SHALL NOT ROTATE WITHIN THEIR FITTINGS.

505.10 HANDRAIL EXTENSIONS. HANDRAILS SHALL EXTEND BEYOND STAIR RUNS AND RAMP RUNS IN ACCORDANCE WITH 505.10.

505.10.1 TOP AND BOTTOM EXTENSION AT RAMPS. RAMP HANDRAILS SHALL EXTEND HORIZONTALLY ABOVE THE LANDING FOR 12 INCHES MINIMUM BEYOND THE TOP AND BOTTOM OF RAMP RUNS.



505.10.2 TOP EXTENSION AT STAIRS. AT THE TOP OF A STAIR FLIGHT, HANDRAILS SHALL EXTEND HORIZONTALLY ABOVE THE LANDING FOR 12 INCHES MINIMUM BEGINNING DIRECTLY ABOVE THE FIRST RISER NOSING.

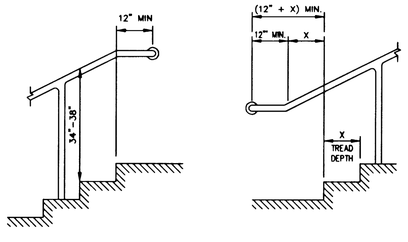

505.10.3 BOTTOM EXTENSION AT STAIRS. AT THE BOTTOM OF A STAIR FLIGHT, HANDRAILS SHALL EXTEND AT THE SLOPE OF THE STAIR FLIGHT FOR A HORIZONTAL DISTANCE EQUAL TO ONE TREAD DEPTH BEYOND THE LAST RISER NOSING AND AN ADDITIONAL 12 INCHES MINIMUM HORIZONTALLY AT A HEIGHT EQUAL TO THAT OF THE SLOPING PORTION OF THE HANDRAIL AS MEASURED ABOVE THE STAIR NOSING.

703 SIGNS

703.2.1 FINISH AND CONTRAST. CHARACTERS AND THEIR BACKGROUND SHALL HAVE A NON-GLARE FINISH.

CHARACTERS SHALL CONTRAST WITH THEIR BACKGROUND WITH EITHER LIGHT CHARACTERS ON A DARK BACKGROUND OR DARK CHARACTERS ON A LIGHT BACKGROUND.

703.2.3 CHARACTER FORMS. FONTS SHALL HAVE CHARACTERS COMPLYING WITH 703.2.3.

703.2.3.1 CASE. CHARACTERS SHALL BE UPPERCASE.

703.2.3.2 STYLE. CHARACTERS SHALL BE SANS SERIF.

703.2.3.3 WIDTH. CHARACTER WIDTH SHALL BE 55 PERCENT MINIMUM AND 110 PERCENT MAXIMUM THE HEIGHT OF THE CHARACTER WITH THE WIDTH BASED ON THE UPPERCASE LETTER "O" AND THE HEIGHT BASED ON THE UPPERCASE LETTER "I".

703.2.3.4 HEIGHT. CHARACTER HEIGHT MEASURED VERTICALLY FROM THE BASELINE OF THE CHARACTER SHALL BE 5/8 INCH MINIMUM AND 2 INCHES MAXIMUM BASED ON THE UPPERCASE LETTER "I".

703.7 SYMBOLS OF ACCESSIBILITY. WHERE SYMBOLS OF ACCESSIBILITY ARE REQUIRED, THEY SHALL COMPLY WITH 703.7.

703.7.2 SYMBOLS.

703.7.2.1 INTERNATIONAL SYMBOL OF ACCESSIBILITY. WHERE THE INTERNATIONAL SYMBOL OF ACCESSIBILITY IS REQUIRED, IT SHALL COMPLY WITH 703.7.2.1.

18" x 24" SPECIAL HANDICAP SIGN (WHITE LETTERS ON HANDICAP BLUE BACKGROUND) WITH 1.5" LETTERS AND INTERNATIONAL SYMBOL OF ACCESSIBILITY.

VAN ACCESSIBLE — 18"x 6" ADVISORY PLATE WITH 2" LETTERS.

LOADING ZONE — SPECIAL 18" x 6" HANDICAP SIGN ADVISORY PLATE WITH 2" LETTERS.

VALET — SPECIAL 18" x 6" HANDICAP SIGN ADVISORY PLATE WITH 2" LETTERS.

SPECIAL 18" x 6" HANDICAP SIGN DIRECTIONAL ARROW(S) 2"

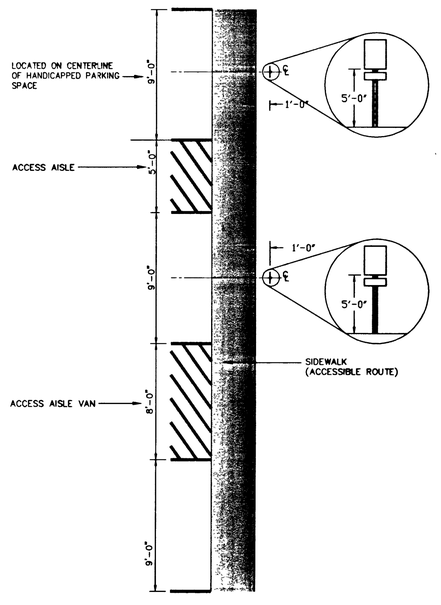

SECTION 14: PUBLIC RIGHT-OF-WAY

SEC. 14.1* GENERAL. ALL AREAS, ELEMENTS AND FACILITIES INTENDED FOR PEDESTRIAN ACCESS, CIRCULATION, AND USE THAT ARE CONSTRUCTED, INSTALLED, OR ALTERED IN THE PUBLIC RIGHT-OF-WAY AND WHICH ARE SUBJECT TO TITLE II OF THE ADA SHALL COMPLY WITH 14 AND WITH PROVISIONS OF 4.1 THROUGH 4.35 THAT ARE NOT OTHERWISE SPECIFIED IN THIS SECTION.

SEC. 14.2* NEW CONSTRUCTION: MINIMUM REQUIREMENTS.

SEC.14.2.1* PUBLIC SIDEWALKS. WHERE PROVIDED, PUBLIC SIDEWALKS SHALL CONTAIN A CONTINUOUS PASSAGE.



(A) SIDEWALK WITHOUT PARKWAY WHERE CONTINUOUS PASSAGE BYPASSES APRON.



(B) SIDEWALK WITH PARKWAY.

SEC. 14.2.4* PUBLIC SIDEWALK CURB RAMPS.

SEC. 14.2.4 (2) TYPES OF PUBLIC SIDEWALK CURB RAMPS. PUBLIC SIDEWALK CURB RAMPS SHALL BE PERPENDICULAR TO THE CURB AT STREET CROSSINGS AND EACH SHALL HAVE A LEVEL LANDING AT THE TOP.



(A) PERPENDICULAR PUBLIC SIDEWALK CURB RAMP.

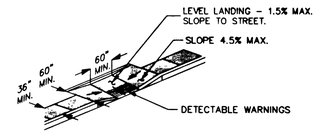

(B) PARALLEL PUBLIC SIDEWALK CURB RAMP

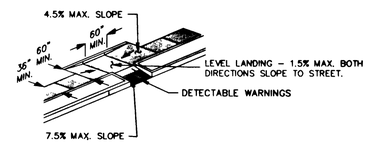

(C) COMBINED (PARALLEL/PERPENDICULAR) PUBLIC SIDEWALK CURB RAMP

9 PASSENGER LOADING SPACE
SCALE: 1"=5'

10 HANDRAILS
SCALE: 1/2"=1'-0"
CHAPTER 5: GENERAL SITE AND BUILDING ELEMENTS

11 SIGNS
SCALE: 1"=5'
CHAPTER 7: COMMUNICATION ELEMENTS AND FEATURES

12 PUBLIC RIGHT-OF-WAY
SCALE: NONE
SECTION 14: PUBLIC RIGHT-OF-WAY

NO.	DESCRIPTION	DATE	APP'D

DATE: 04/11/01
PM: C. HIGH
DRAWN BY: M. GRIMES
DESIGNED BY: M. GRIMES
CHECKED BY: C. HIGH
ADA CHECKED BY: FALTAO
JOB NO.: 0050.0268
SCALE: AS NOTED

PENTACORE
CIVIL ENGINEERING • LAND SURVEYING • PLANNING
CONSTRUCTION MANAGEMENT • ADA CONSULTING
8215 WEST FLAMINGO ROAD
LAS VEGAS, NEVADA 89146 (702)258-0115

OUTBACK STEAKHOUSE, INC.
ODETTE CENTER
A.D.A. DETAILS

PROFESSIONAL ENGINEER STATE OF NEVADA
CARL W. HIGH
CIVIL
No. 10794
4/12/01

SHEET C23
23 OF 23
DRAWING No. 107-V3430

0268ADDT.DWG
3/1/02