NOTES

1. CONNECT MANHOLES USING 8" VCP PIPE. MATCH TOP AT NEW MANHOLE.
2. PRESSURE GROUT ABANDONED 8" SEWER WITH APPROVED SAND OR GROUT MIXTURE.
3. REMOVE AND REPLACE 20 LF OF "L" TYPE C&G, CUT TREE ROOTS IF NECESSARY
4. NEW EAST CURB & GUTTER WITH FLOW LINE SLOPE = 0.0024 STA 16+79.3 TO 21+00
5. INSTALL WHEELCHAIR RAMP
6. INSTALL NEW WATER METERS & BOXES
7. REMOVE TREE ROOTS IN CURB AREA

| BC CURVE DATA | | | | |
|---|---|---|---|---|
| NO | Δ | RADIUS | LENGTH | TANGENT |
| (A) | 90°00'00" | 20.00' | 31.42' | 20.00' |

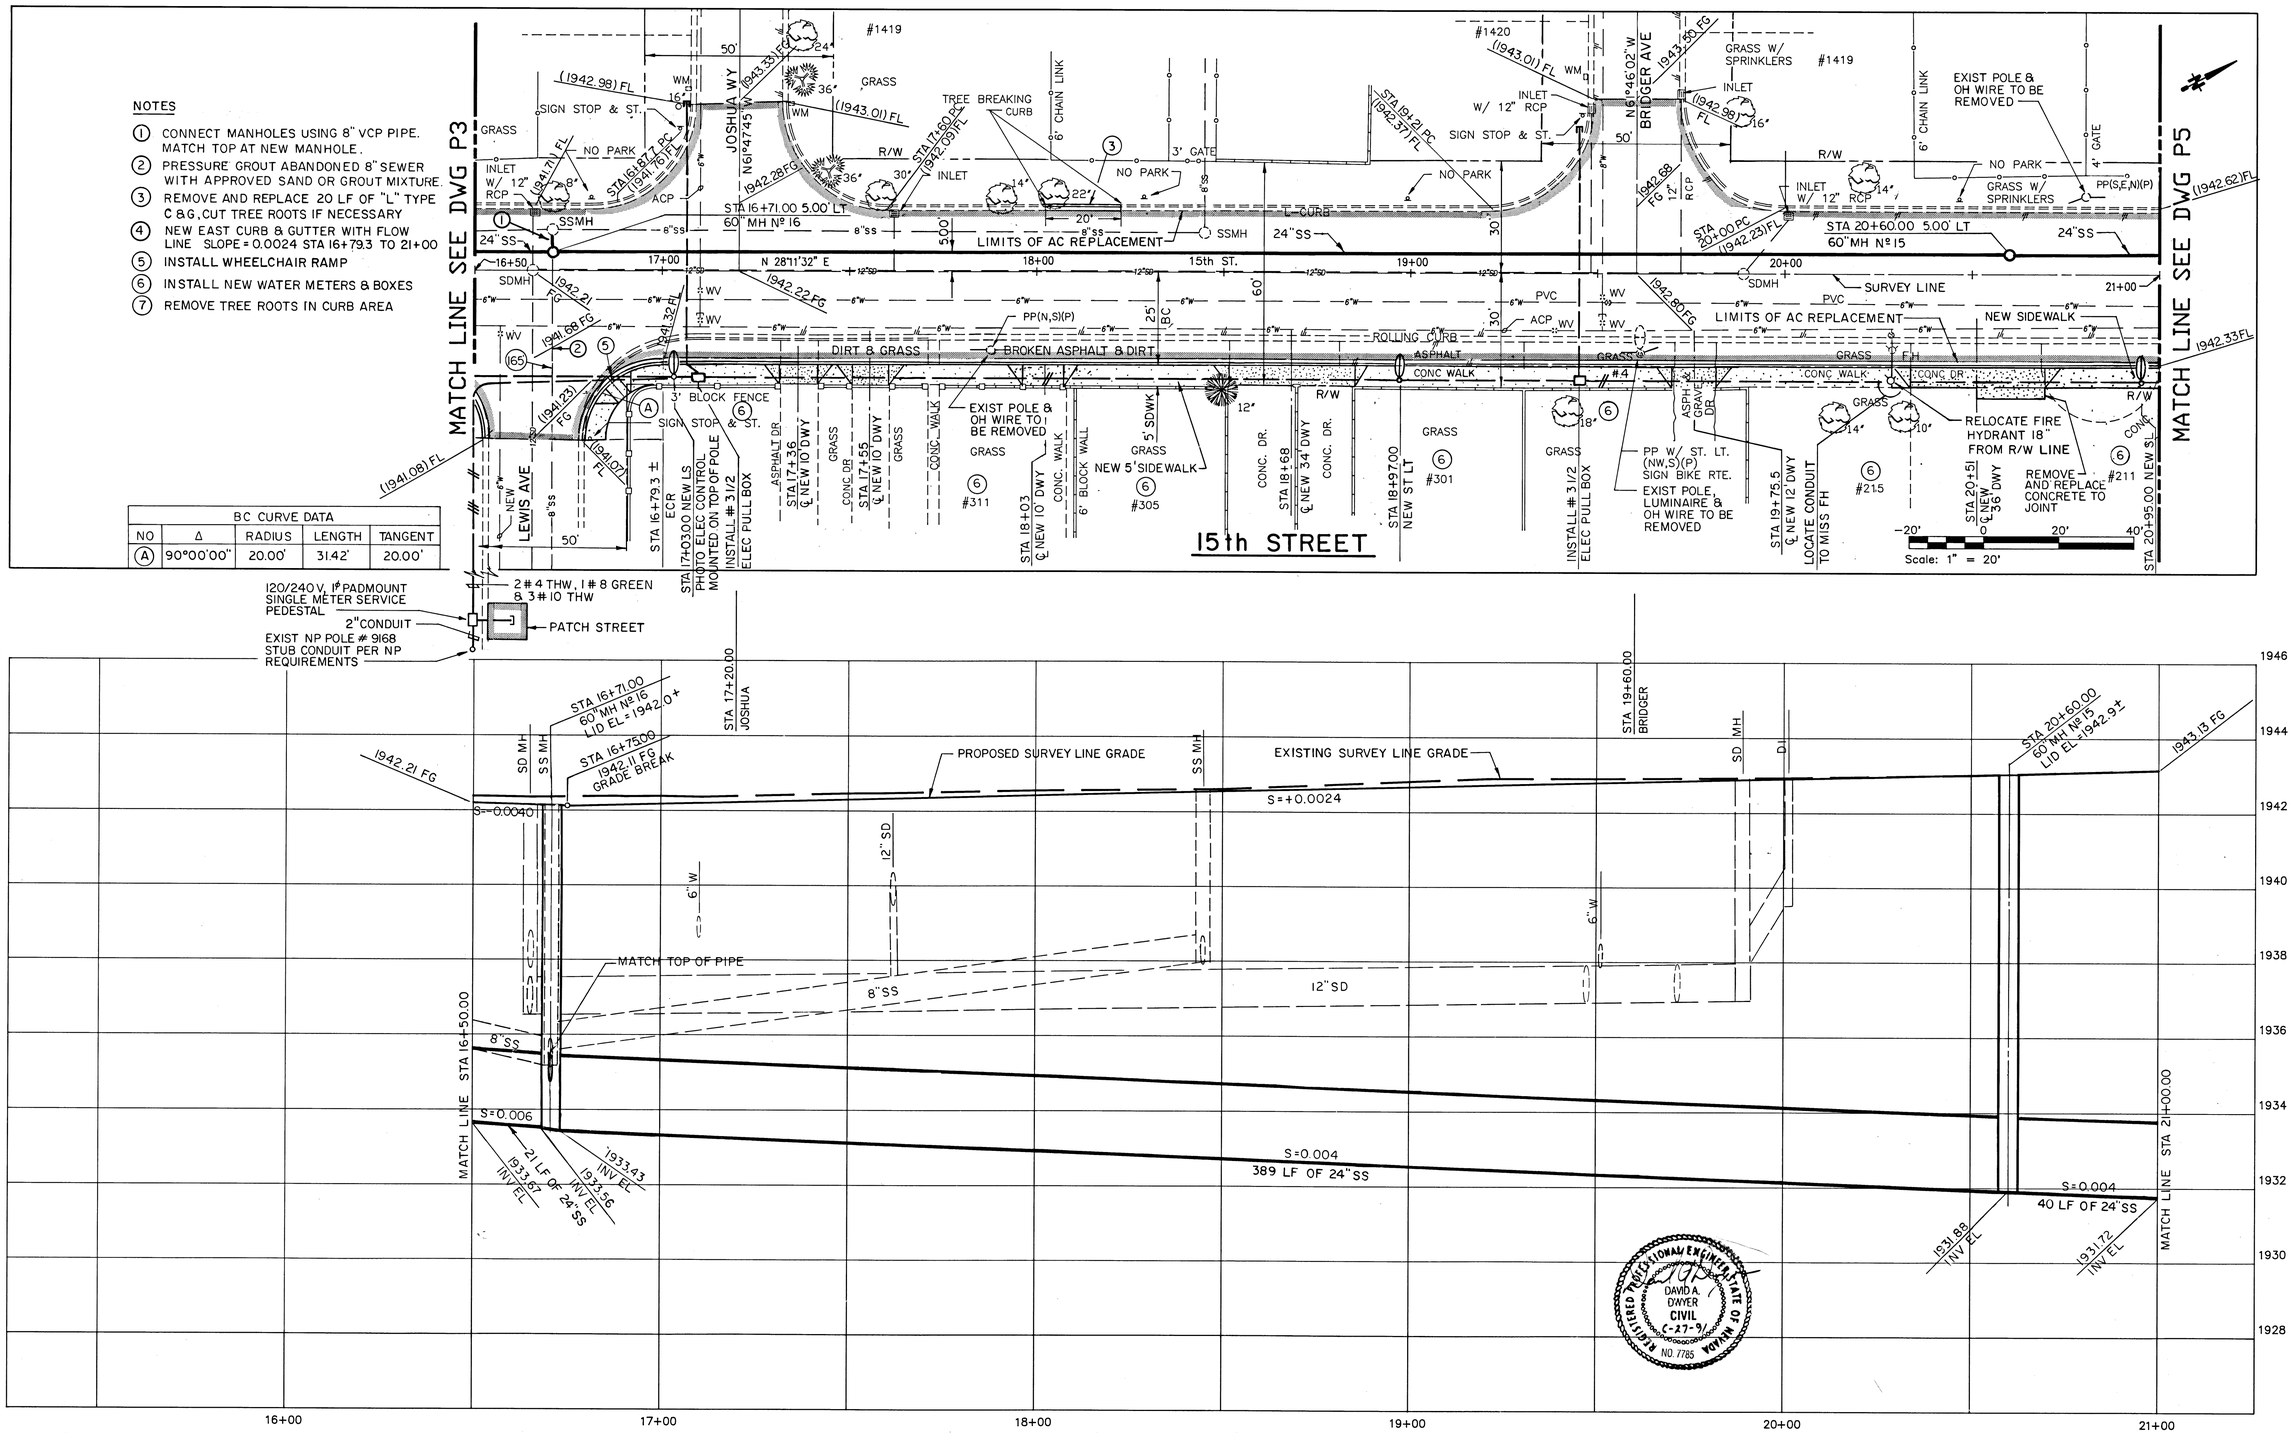


| MARK | DATE | BY | REVISION |
|---|---|---|---|
| | | | |

DESIGNED: MSL
DRAWN: WJH
CHECKED: DAD
DWGNAME: AL-OGP4

Michael S. Lusko — PROJECT ENGINEER — DATE 7/11/91
Don Dwyer — PROJECT MANAGER — DATE 7-11-91

Boyle Engineering Corporation
1785 E. Sahara Ave. 300
Las Vegas, NV 89104
(702) 731-5511

# CITY OF LAS VEGAS

OGDEN/CEDAR SEWER INTERCEPTOR

15th STREET
PLAN & PROFILE STA 16+50 – 21+00

DRAWING P4 OF 29
307-V681

25-1-65