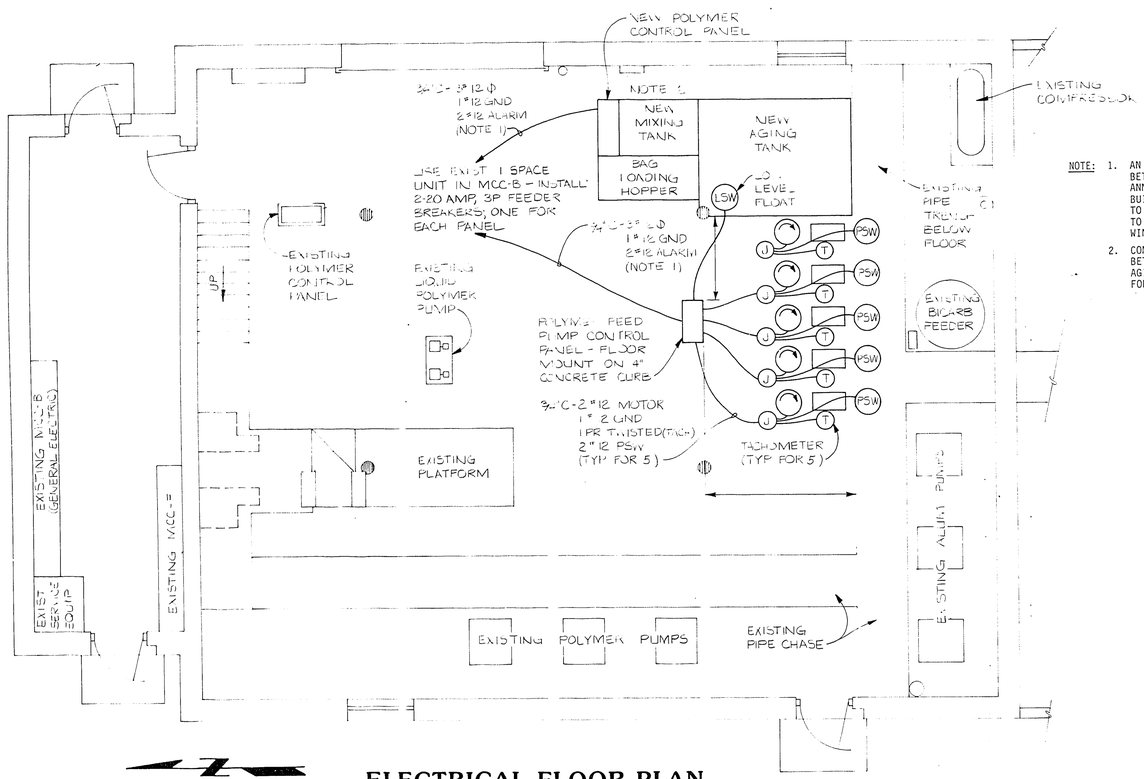

NOTE: 1. AN EXISTING 30 PAIR ALARM CABLE RUNS BETWEEN MCC B AND THE EXISTING PLANT ANNUNCIATOR PANEL IN THE OPERATIONS BUILDING. CONTRACTOR TO CONNECT TO THIS CABLE IN MCC B, MAKE CONNECTION TO ANNUNCIATOR AND PROVIDE ENGRAVED WINDOW FOR ANNUNCIATOR.

2. CONTRACTOR TO INSTALL ALL CONNECTIONS BETWEEN COMPONENTS OF POLYMER EQUIPMENT, AGING TANK AND TRANSFER PUMPS (IF SUPPLIED) FOR COMPLETE INSTALLATION.

ELECTRICAL FLOOR PLAN

1/4" = 1'-0"

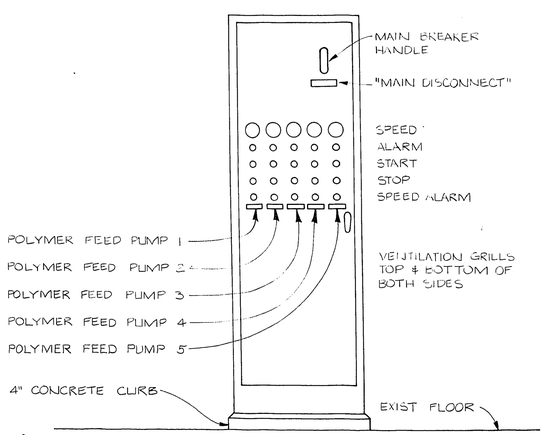

POLYMER SOLUTION METERING PUMP CONTROL PANEL ELEVATION

NTS

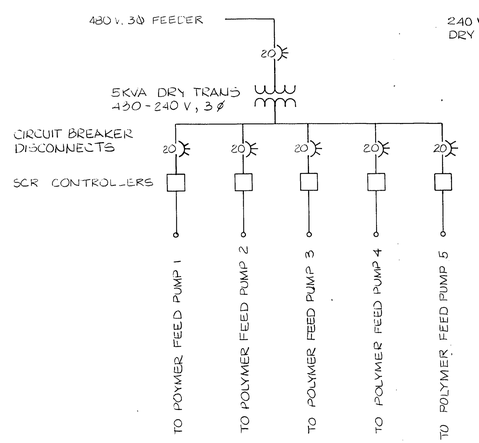

POLYMER SOLUTION METERING PUMP ONE LINE

NTS

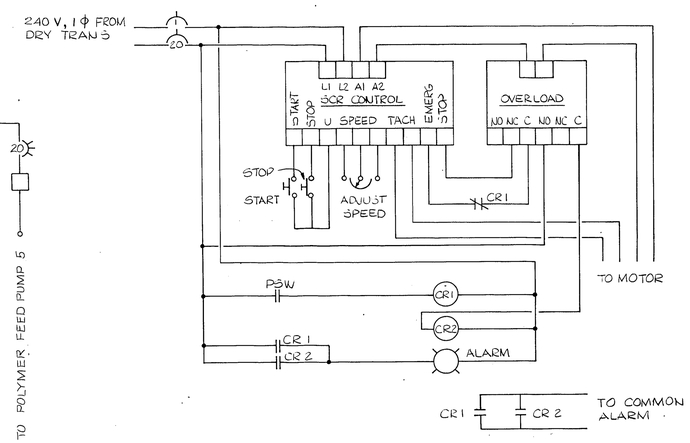

POLYMER FEED PUMP CONTROL SCHEMATIC

NTS

311.5 G

4-1-4

CULP/WESSNER/CULP
CAMERON PARK, CALIFORNIA
SANTA ANA, CALIFORNIA DENVER, COLORADO

PROFESSIONAL ENGINEER STATE OF NEVADA WILLIAM F. EITCHEY EE/P REGISTERED No. 6267

Job No. 740.4
Designed WFE
Drawn GKS
Checked RLC
Approved
Date 11-11-83

No. By	Revision Description	Date

CITY OF LAS VEGAS
Wastewater Treatment Plant Improvement 1984

POLYMER SYSTEM FOR SLUDGE THICKENING
ELECTRICAL

Sheet 4 of 4