
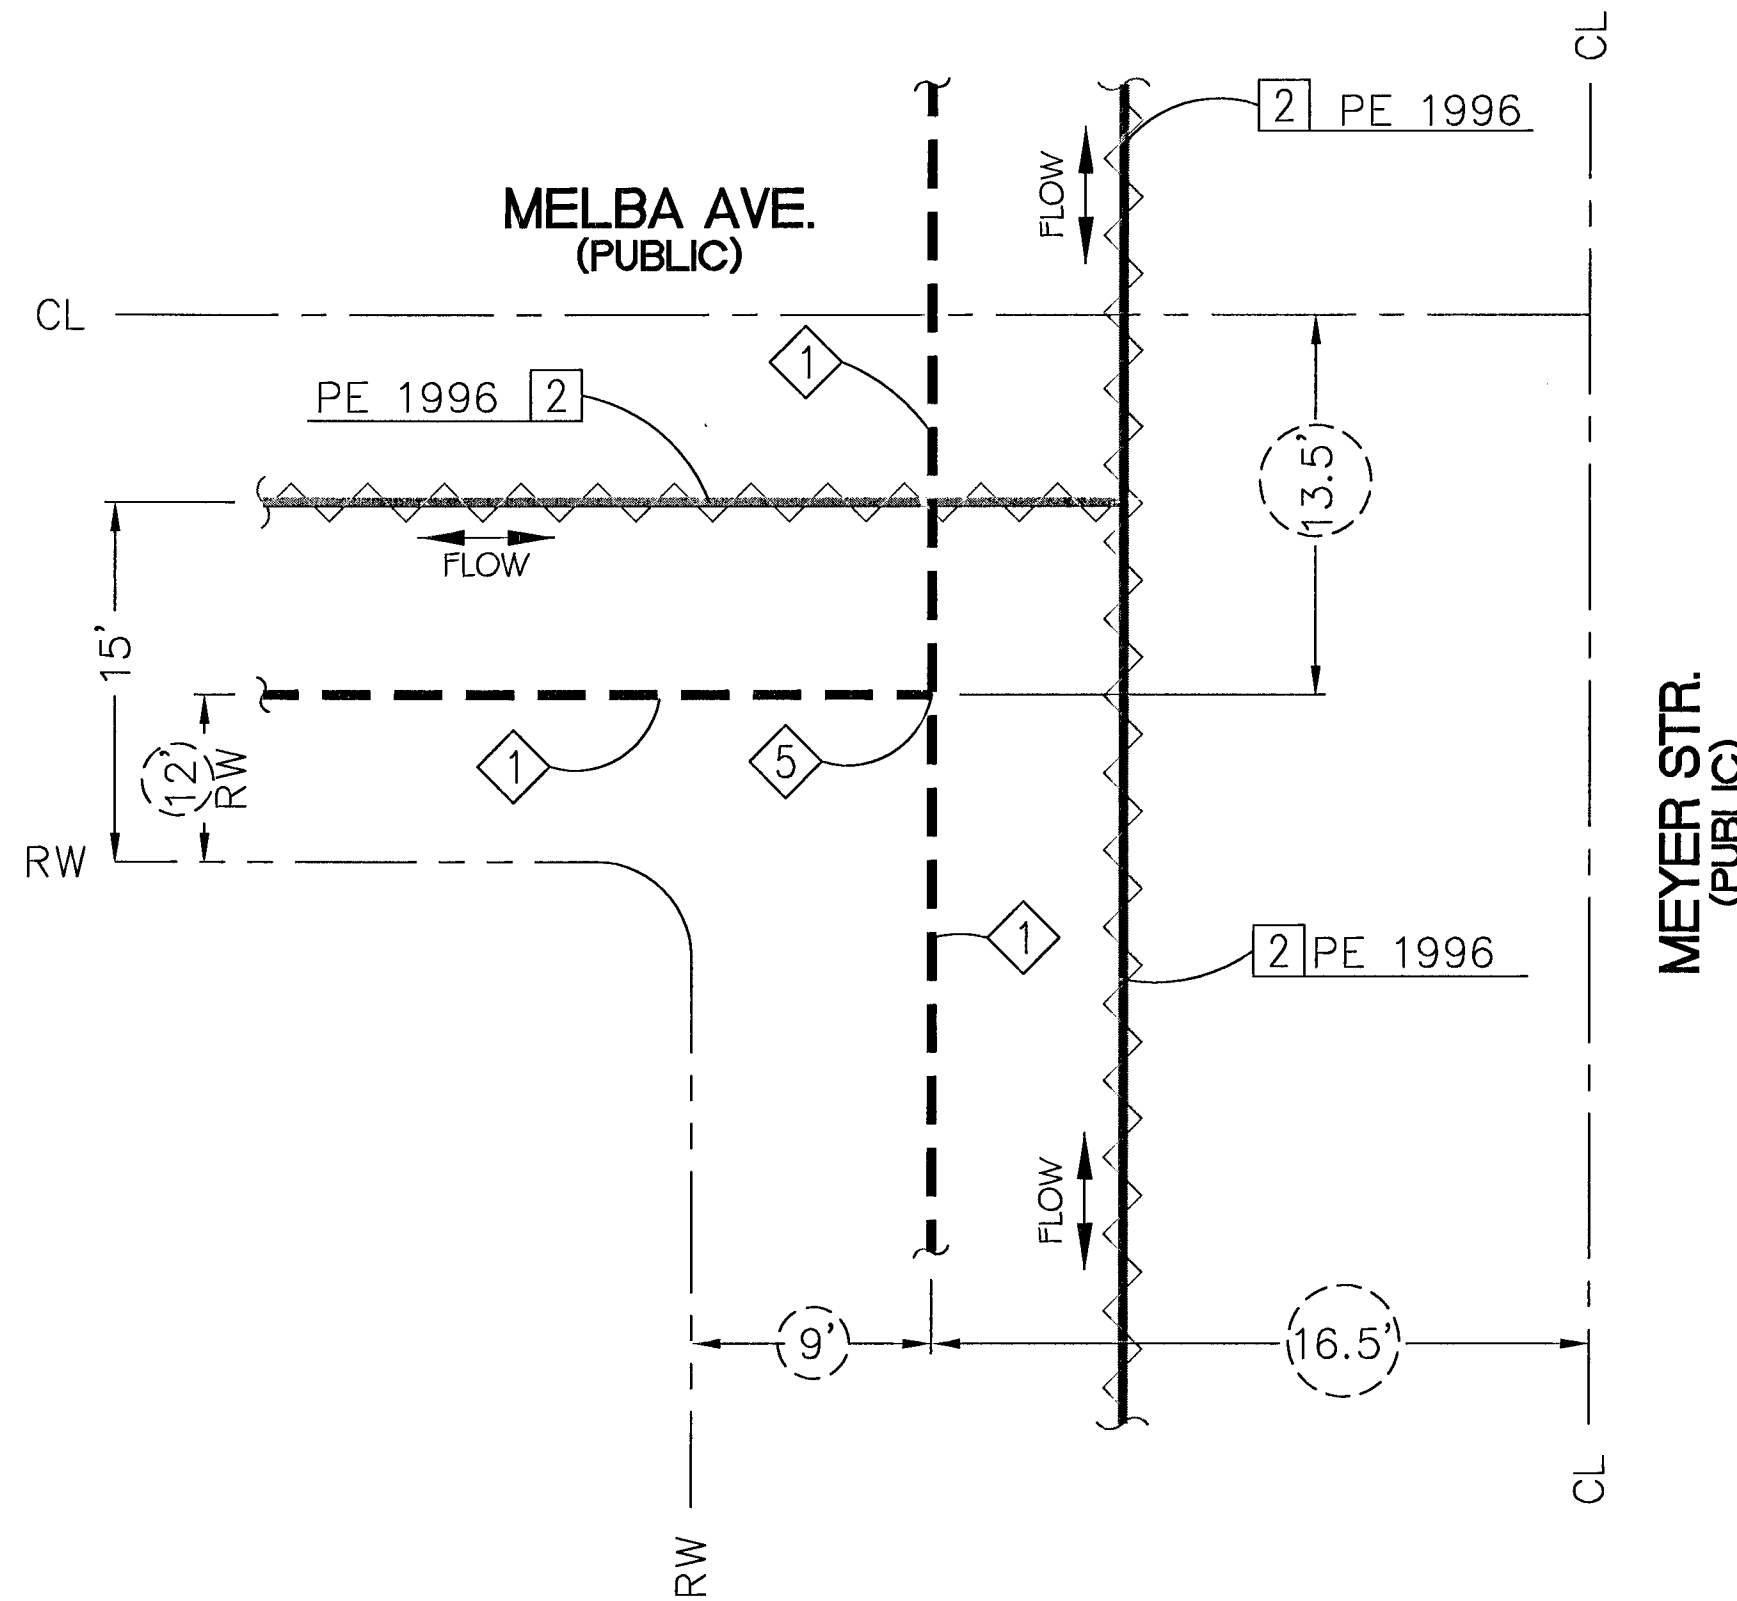
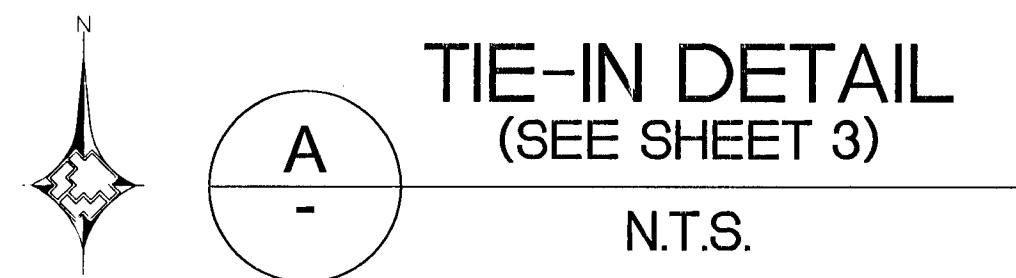
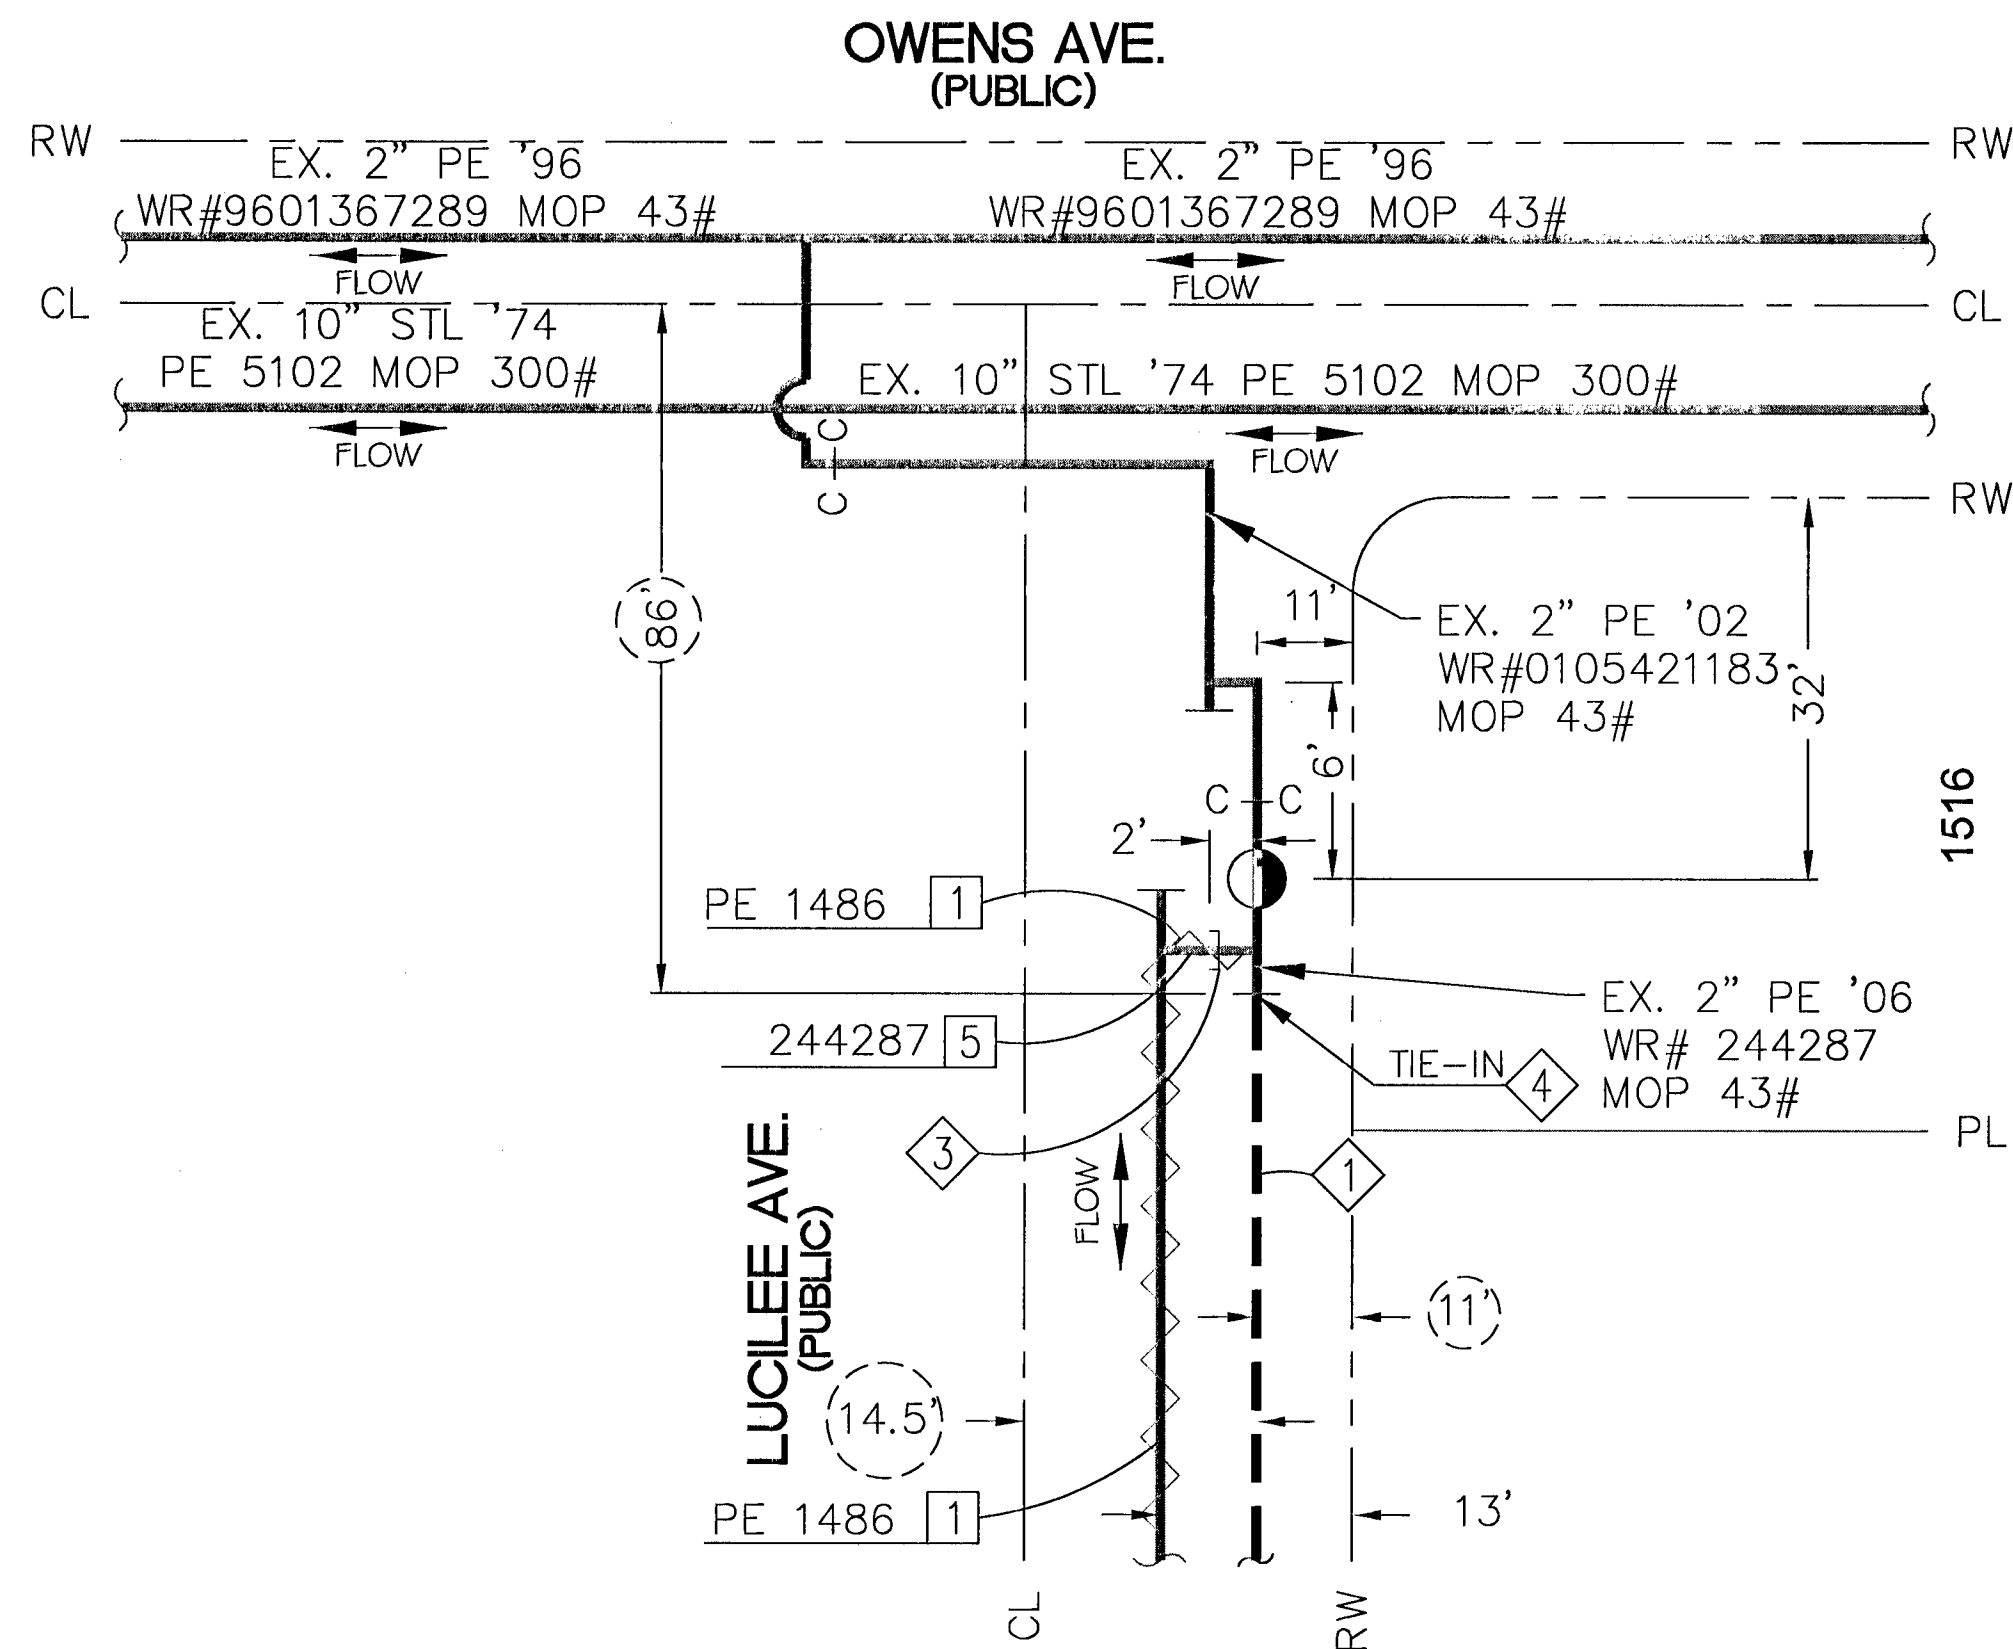



PROPOSED FACILITIES:

- 1 PROPOSED 2" PE MAIN
- 2 INSTALL 2" PE ELBOW #140-3067
- 3 INSTALL 2" PE CAP #140-3060
- 4 INSTALL 2" PE METFIT COUPLING #140-3504
- 5 INSTALL 2" PE TEE #140-3074

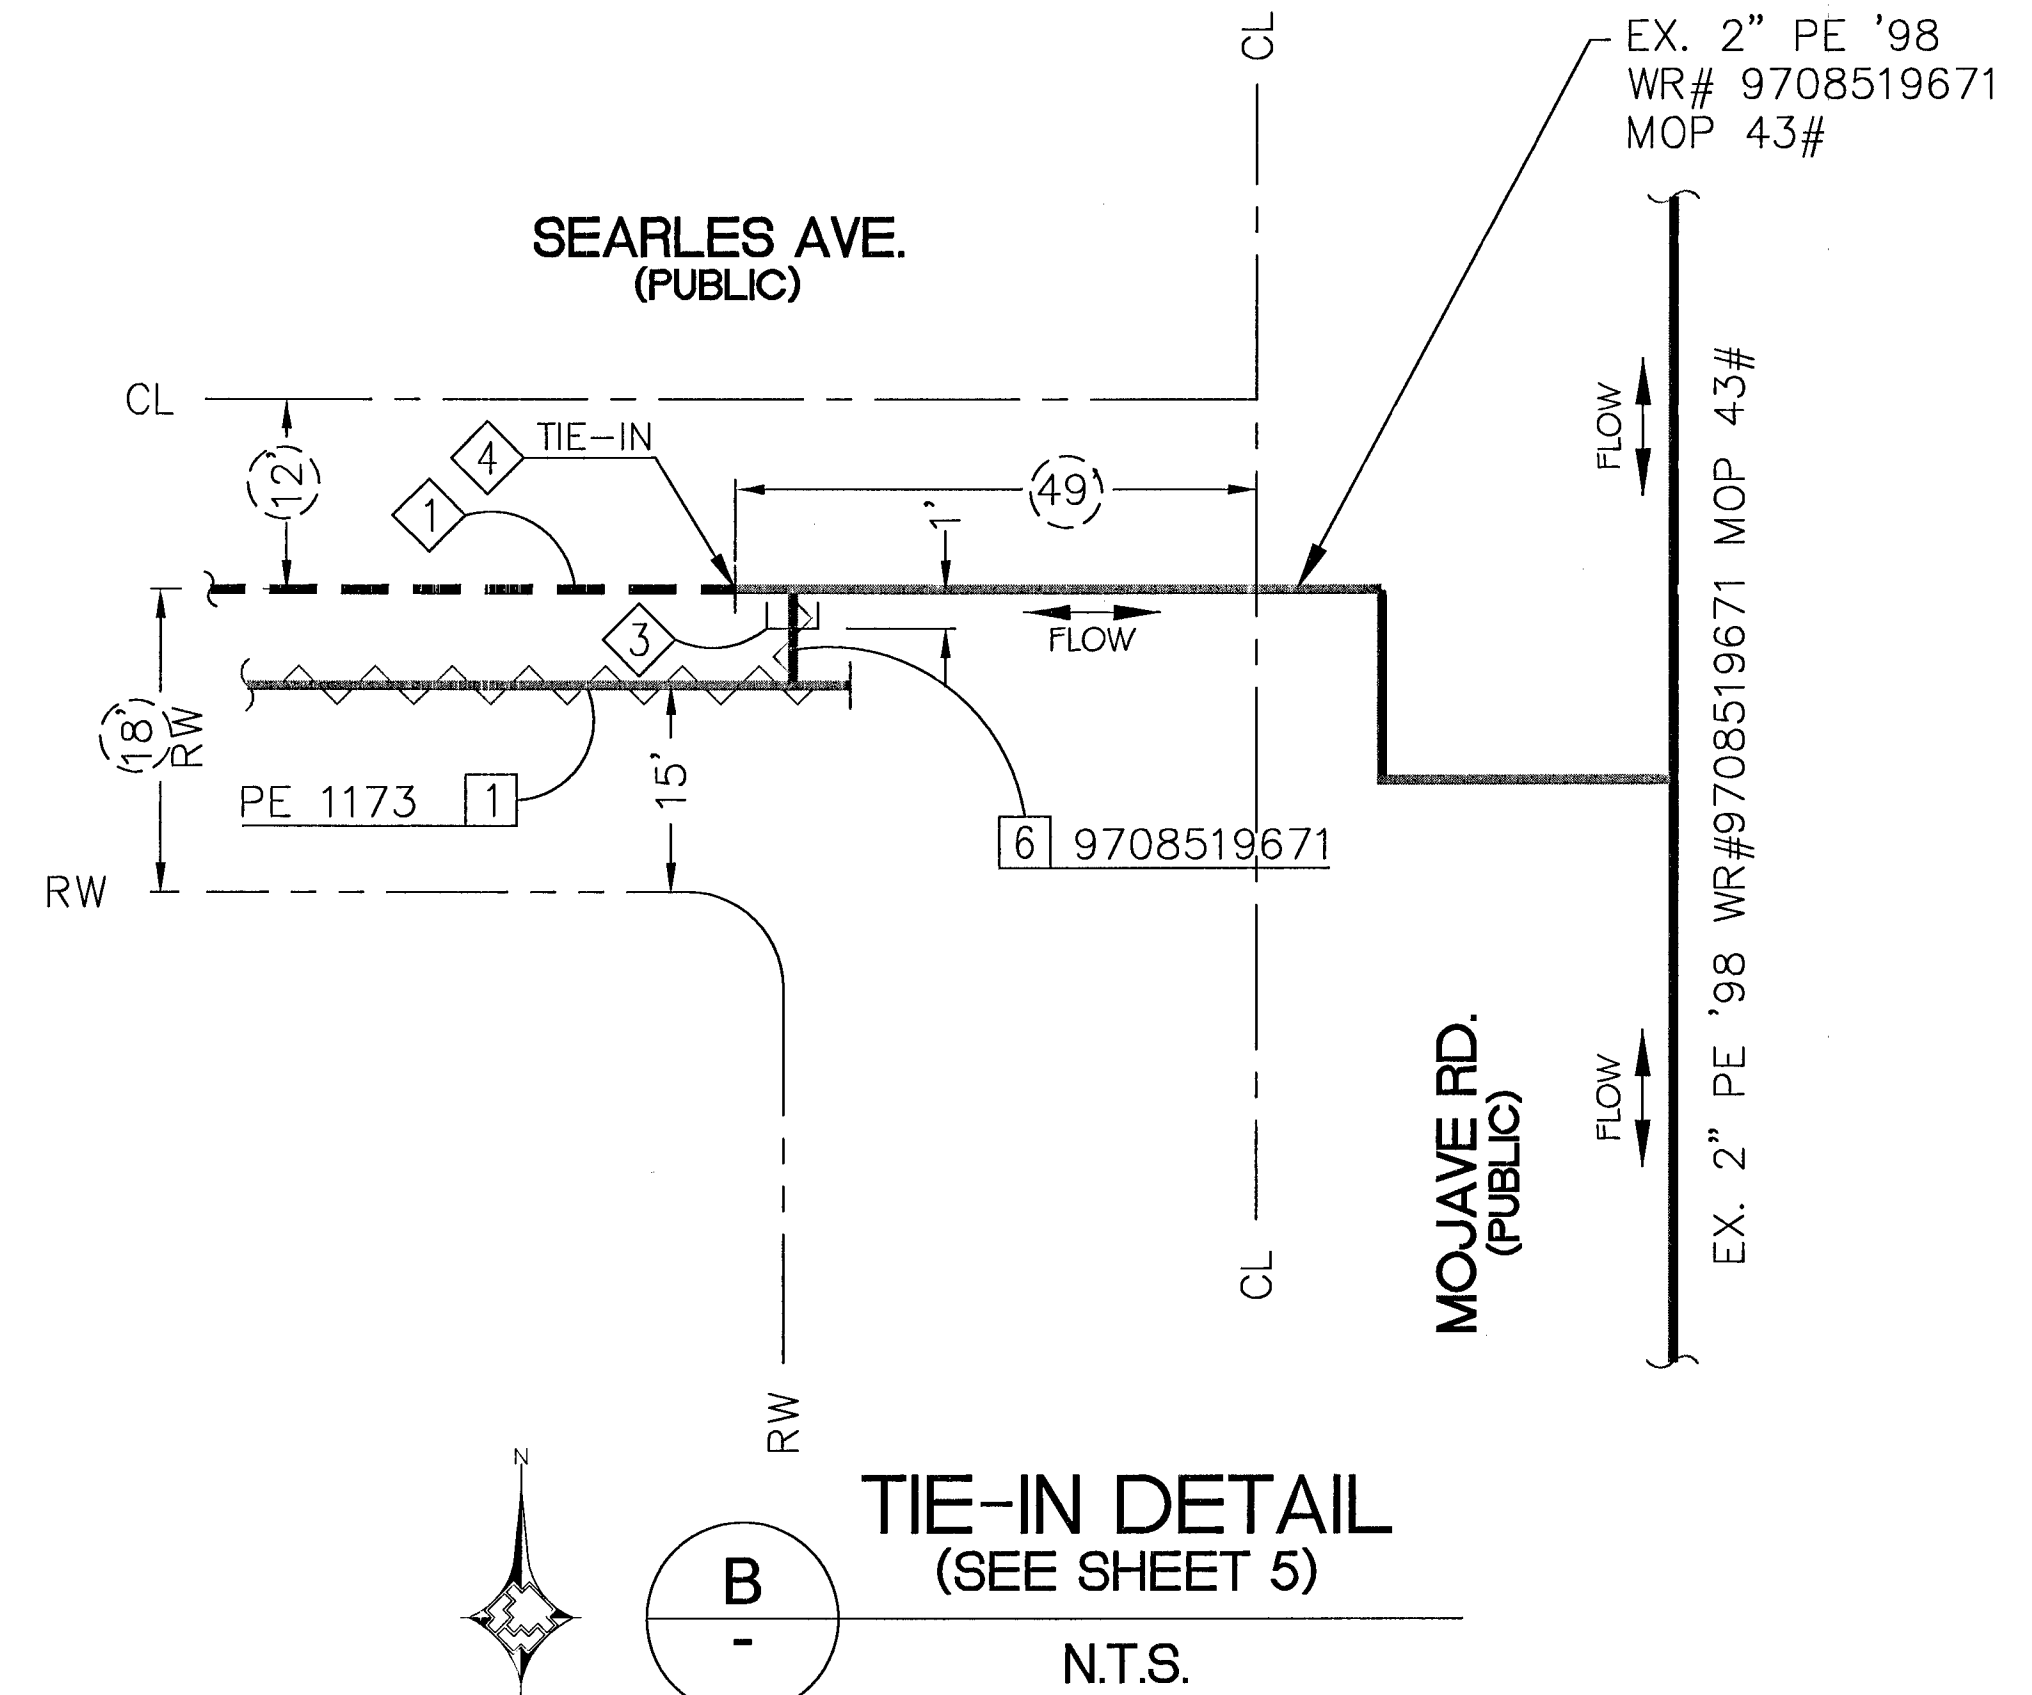

ABANDONED FACILITIES:

- 1 ABANDON 2" PVC '65 MOP 43#
- 2 ABANDON 2" PVC '67 MOP 43#
- 5 ABANDON 2" PE '06 MOP 43#
- 6 ABANDON 2" PE '98 MOP 43#
- 10 ABANDON 2" PE '02 MOP 43#

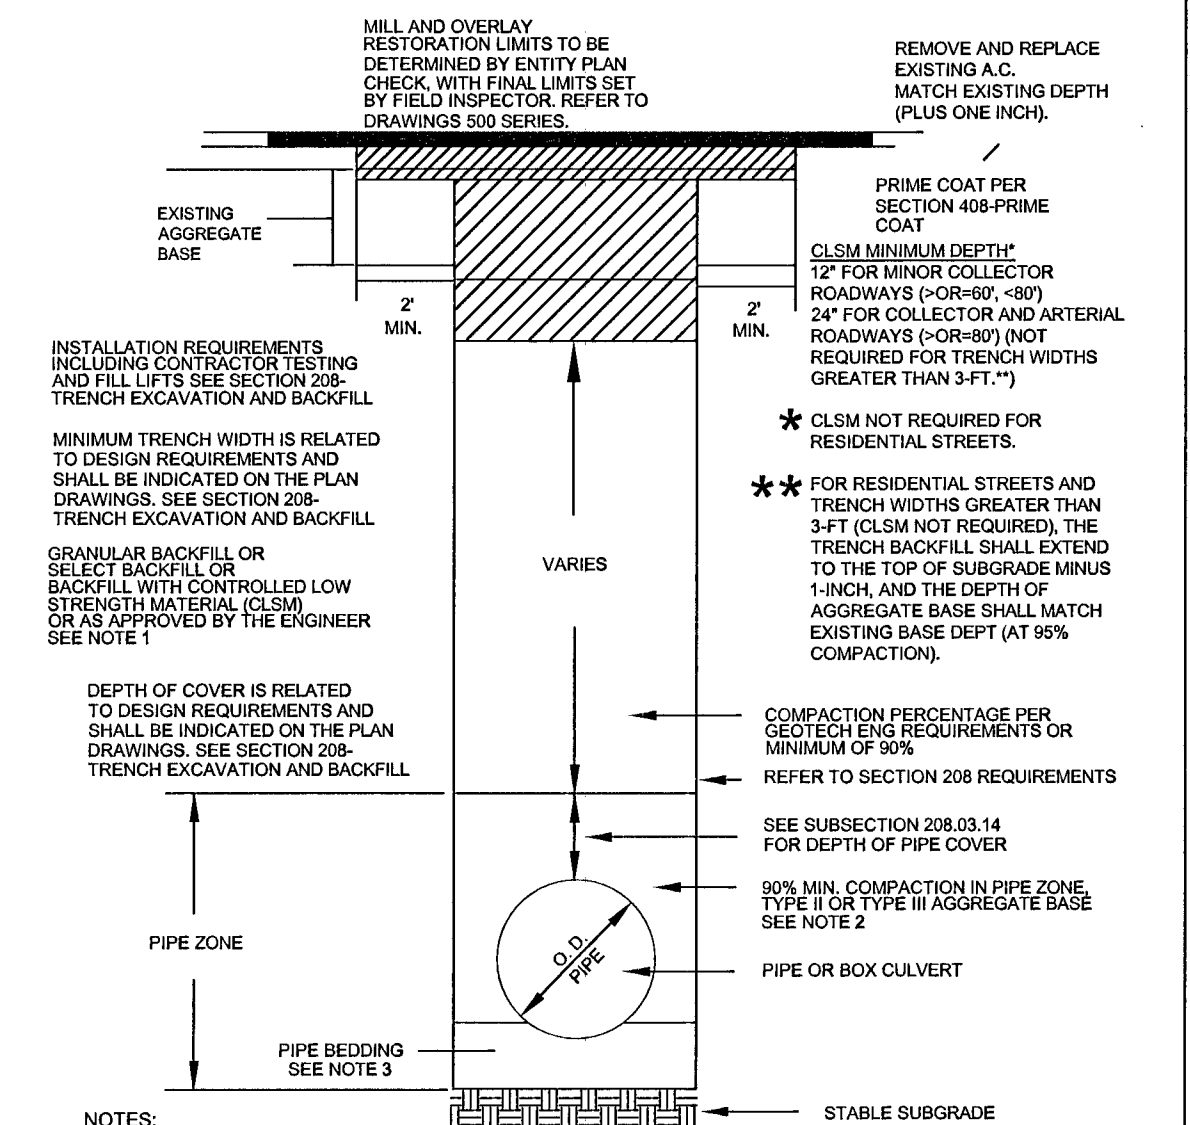

RTC STD DWG 503

811 Know what's below. Call before you dig.				PROPOSED FACILITIES: 1 PROPOSED 2" PE MAIN 2 INSTALL 2" PE ELBOW #140-3067 3 INSTALL 2" PE CAP #140-3060 4 INSTALL 2" PE METFIT COUPLING #140-3504 5 INSTALL 2" PE TEE #140-3074				AS-BUILT DRAWING-PRESSURE TEST DATA <table border="1"> <tr> <th>TEST PRES. (PSI)</th> <th>START</th> <th>END</th> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </table>				TEST PRES. (PSI)	START	END				VISUAL INSPECTION CERTIFICATION I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT HAVE PERFORMED. NAME: _____ DATE: _____ INSPECTOR: _____ FOREMAN: _____ REVIEWED BY: _____				CONSTRUCTION INSPECTOR: _____ FOREMAN: _____ REVIEWED BY: _____				ISOLATION AREA DIST_123				W.R. NO. 1712087				ENGINEER/TECH: RYAN MORGAN ACCOUNT REP: _____ PHONE: (702) 365-2172													
TEST PRES. (PSI)	START	END																																													
REVISIONS <table border="1"> <tr> <th>NO.</th> <th>DESCRIPTION</th> <th>BY</th> <th>DATE</th> <th>APPVD</th> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </table>				NO.	DESCRIPTION	BY	DATE	APPVD						PROPERTY UNITS <table border="1"> <tr> <th>TAX CODES</th> <th>UNIT NO.</th> <th>UNIT TYPE</th> <th>INSTL. PROPOSED</th> <th>RETIRED PROPOSED</th> <th>INSTL. COMPLETED</th> <th>RETIRED COMPLETED</th> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </table>				TAX CODES	UNIT NO.	UNIT TYPE	INSTL. PROPOSED	RETIRED PROPOSED	INSTL. COMPLETED	RETIRED COMPLETED								PERMIT INFORMATION CLV TAX CODE 02-0200				LOCATION T-20S R-61E Sec. 25				ATLAS #/TILE # x639y522				PROJECT CONTACT: MARMAC FIELD SERVICES SHEET NO: 8 OF 9 SCALE: N.T.S. DATE: 07/23/13			
NO.	DESCRIPTION	BY	DATE	APPVD																																											
TAX CODES	UNIT NO.	UNIT TYPE	INSTL. PROPOSED	RETIRED PROPOSED	INSTL. COMPLETED	RETIRED COMPLETED																																									
SOUTHWEST GAS CORPORATION				SI-CLV-OWENS AND MOJAVE PVC REPLACEMENT PHASE 1				PHONE: (714) 434-5300				DATE: 07/23/13																																			