

SI-CLV-OGDEN & 3RD 2" STL REPLACEMENT


CITY OF LAS VEGAS, NV

WR# 1756600



1. NO STONES OR LUMPS GREATER THAN 3" PERMITTED IN TRENCH 2' OR LESS IN WIDTH.
2. TRENCH WIDTH, BEDDING, SUBGRADE AND PIPE ZONE REQUIREMENTS FOR UTILITY INSTALLATIONS SHALL CONFORM TO THE RESPECTIVE ENTITY REQUIREMENTS.
CRUSHED ROCK MAY BE USED FOR PIPE BEDDING ONLY IF MATERIAL USE HAS BEEN SPECIFICALLY APPROVED BY THE GOVERNING AGENCY. SEE STANDARD DRAWING NO. 505 FOR PIPE BEDDING METHODS.
4. LAS VEGAS VALLEY WATER DISTRICT REQUIRES PIPE BEDDING AND BACKFILL WITHIN THE PIPE ZONE TO BE OF THE SAME MATERIAL.

RTC STD DWG 503

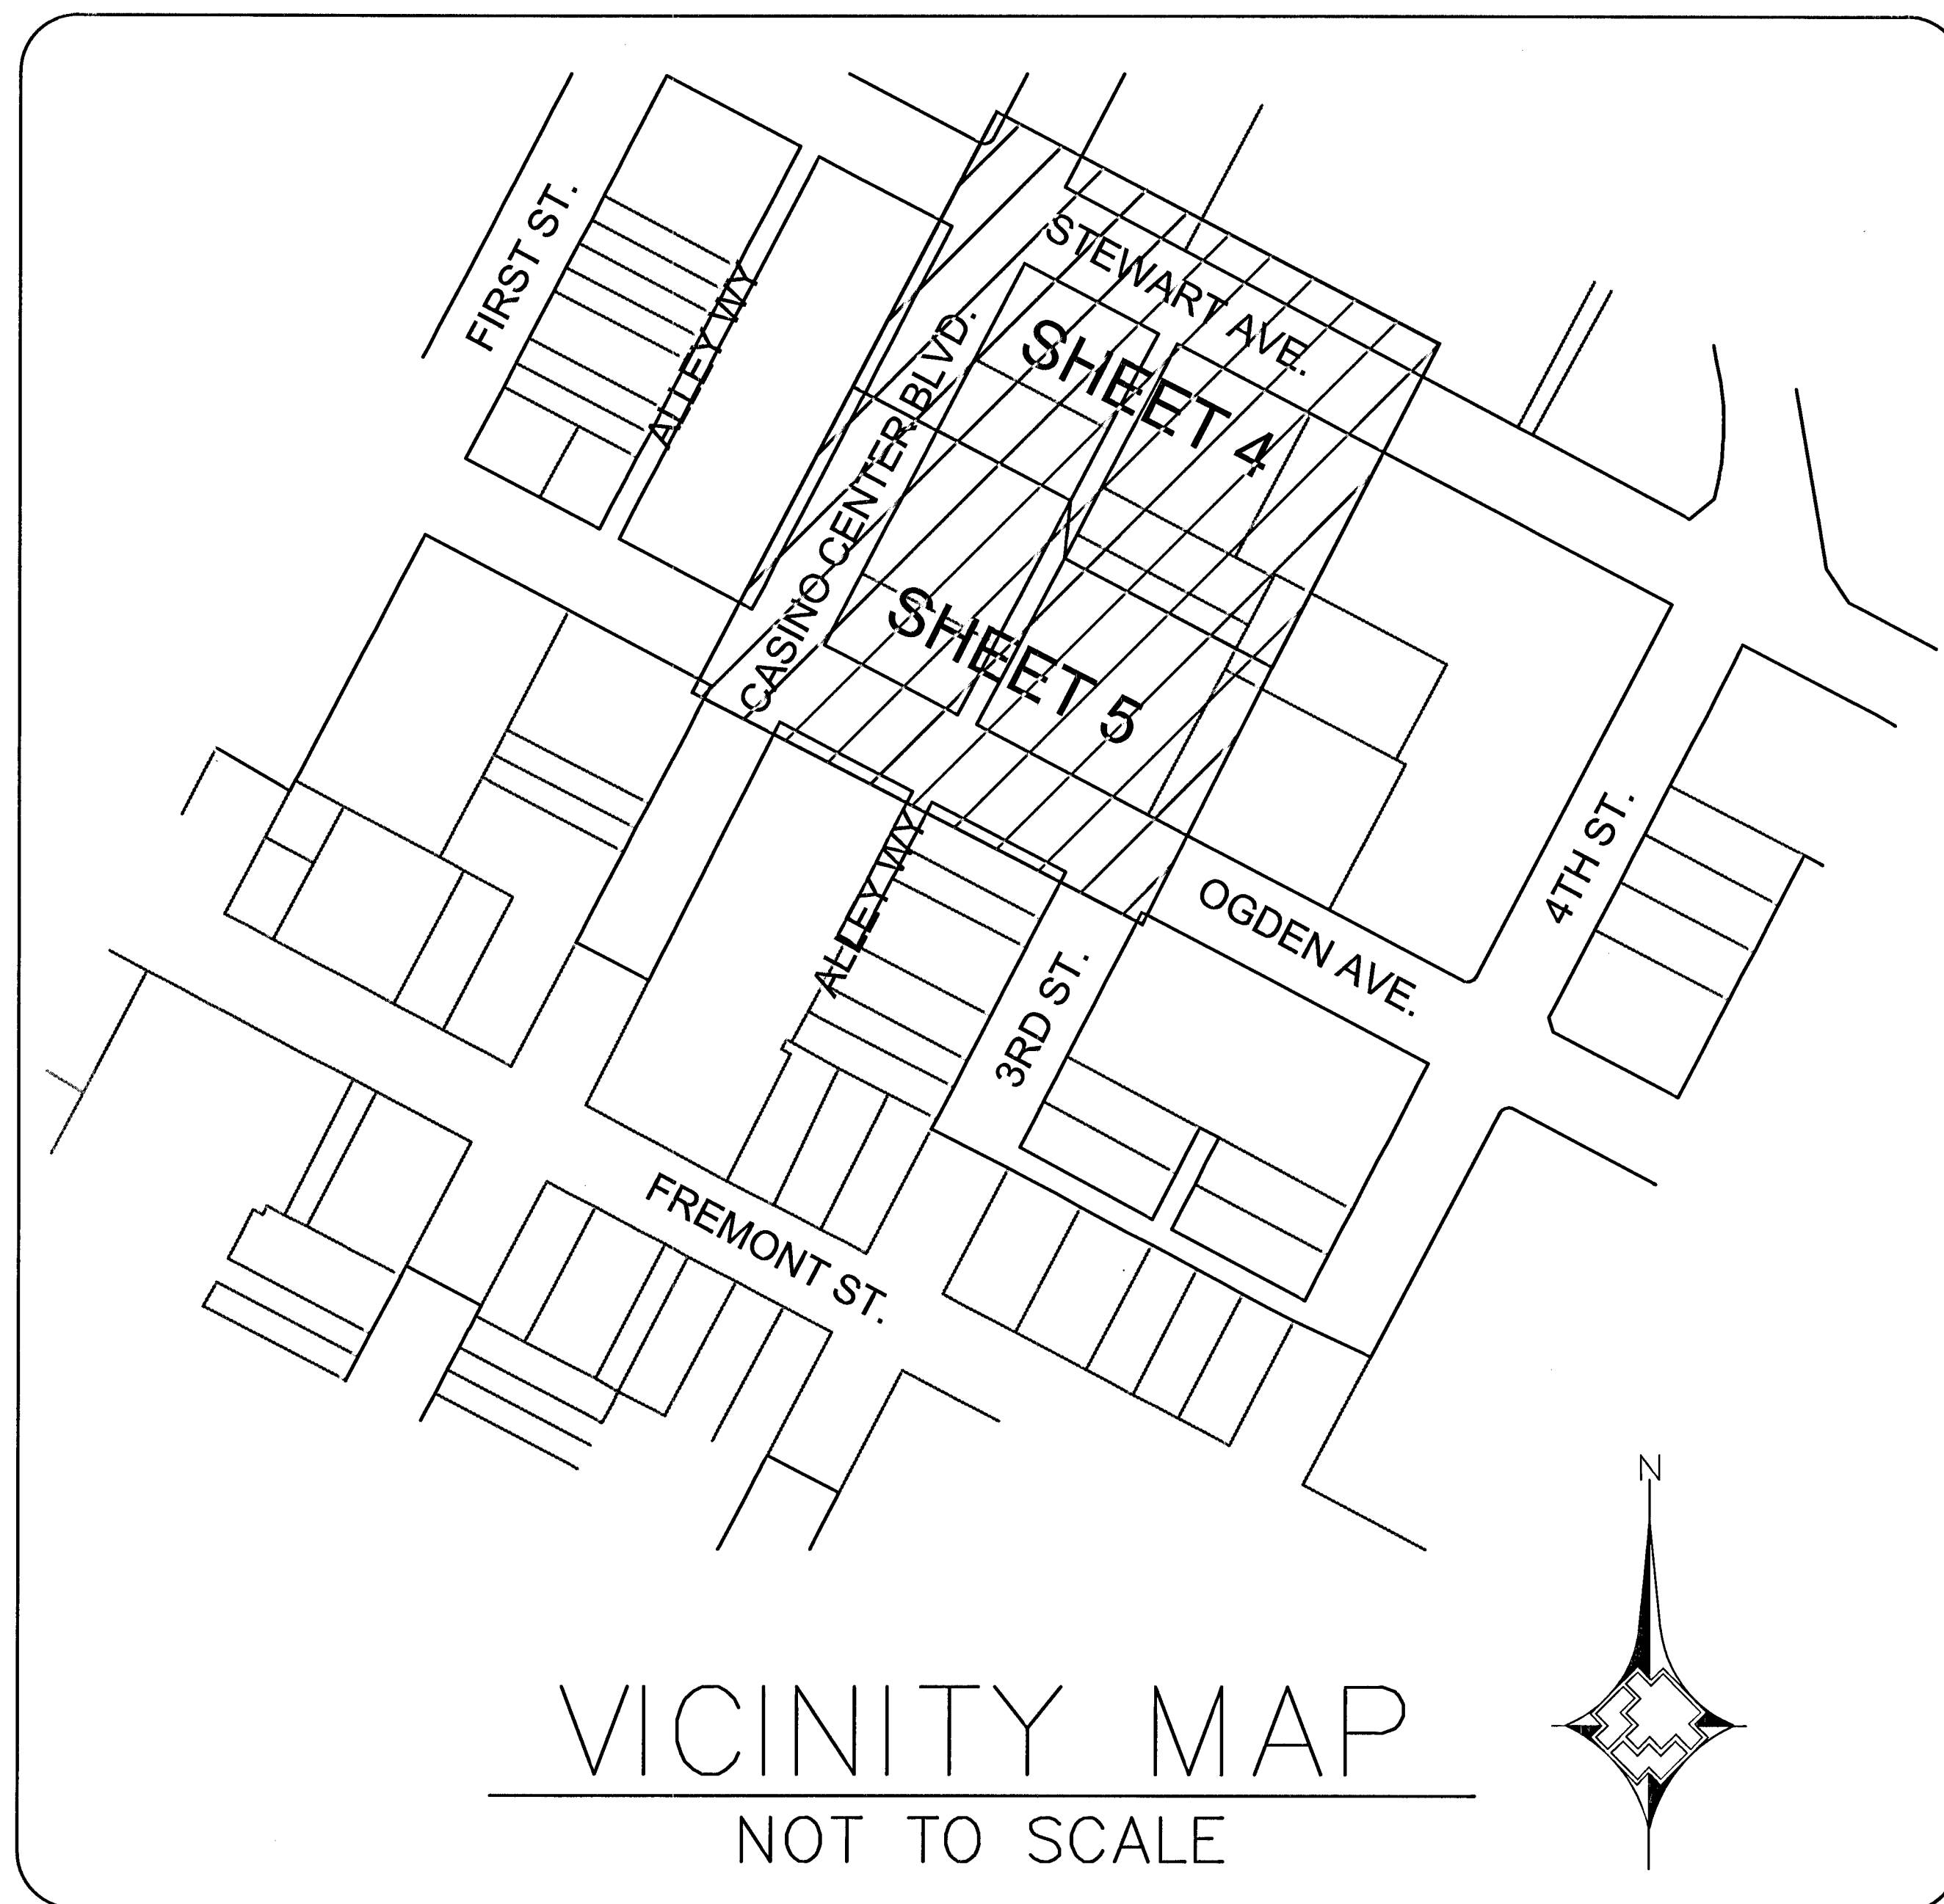

VICINITY MAP

NOT TO SCALE

[illegible]

AS-BUILT DRAWING-PRESSURE TEST DATA			
	TEST MEDIUM	TEST METHOD	
PIPE DIA. _____	☐ AIR	☐ GAUGE	
PIPE LENGTH _____	☐ NITROGEN	☐ CHART	
PIPE TYPE _____	☐ WATER	☐ GAUGE/ PRESS REC SN#	
MIN. DURATION _____	☐ SOAP		
TEST PRES. (PSIG) _____	START _____	END _____	
TIME _____			
DATE _____			
PERFORMED BY _____			

VISUAL INSPECTION CERTIFICATION

I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT,
MECHANICAL JOINTS, AND WELDS THAT I HAVE PERFORMED

NAME _____ DATE _____

SEE SHEET 2

AS-BUILTS ACCEPTED BY _____ DATE _____

POSTED BY _____ DATE _____

POSTING QC'D BY _____ DATE _____

CONSTRUCTION

INSPECTOR _____

FOREMAN _____

REVIEWED BY _____

SEE SHEET 2

PERMIT INFORMATION

CITY OF LAS VEGAS

TAX CODE

02-0203

ISOLATION AREA	W.R. NO.
96	1756600
LOCATION	ATLAS #/TILE #
T20S R61E SEC 34 M D M	x630y516 x630y518

ENGINEER/TECH: ANNIE BOUCK		PHONE: 702-365-2014
ACCOUNT REP:		PHONE:
PROJECT CONTACT: ANNIE BOUCK		PHONE: 702-365-2014
SHEET NO: 1 OF 6	SCALE: N.T.S.	DATE: 5/16/14
DWN. BY: ZONE ENG	CHKD. BY:	APPVD. BY:
TITLE		
SI-CLV-OGDEN & 3RD 2" STL REPLACEMENT		