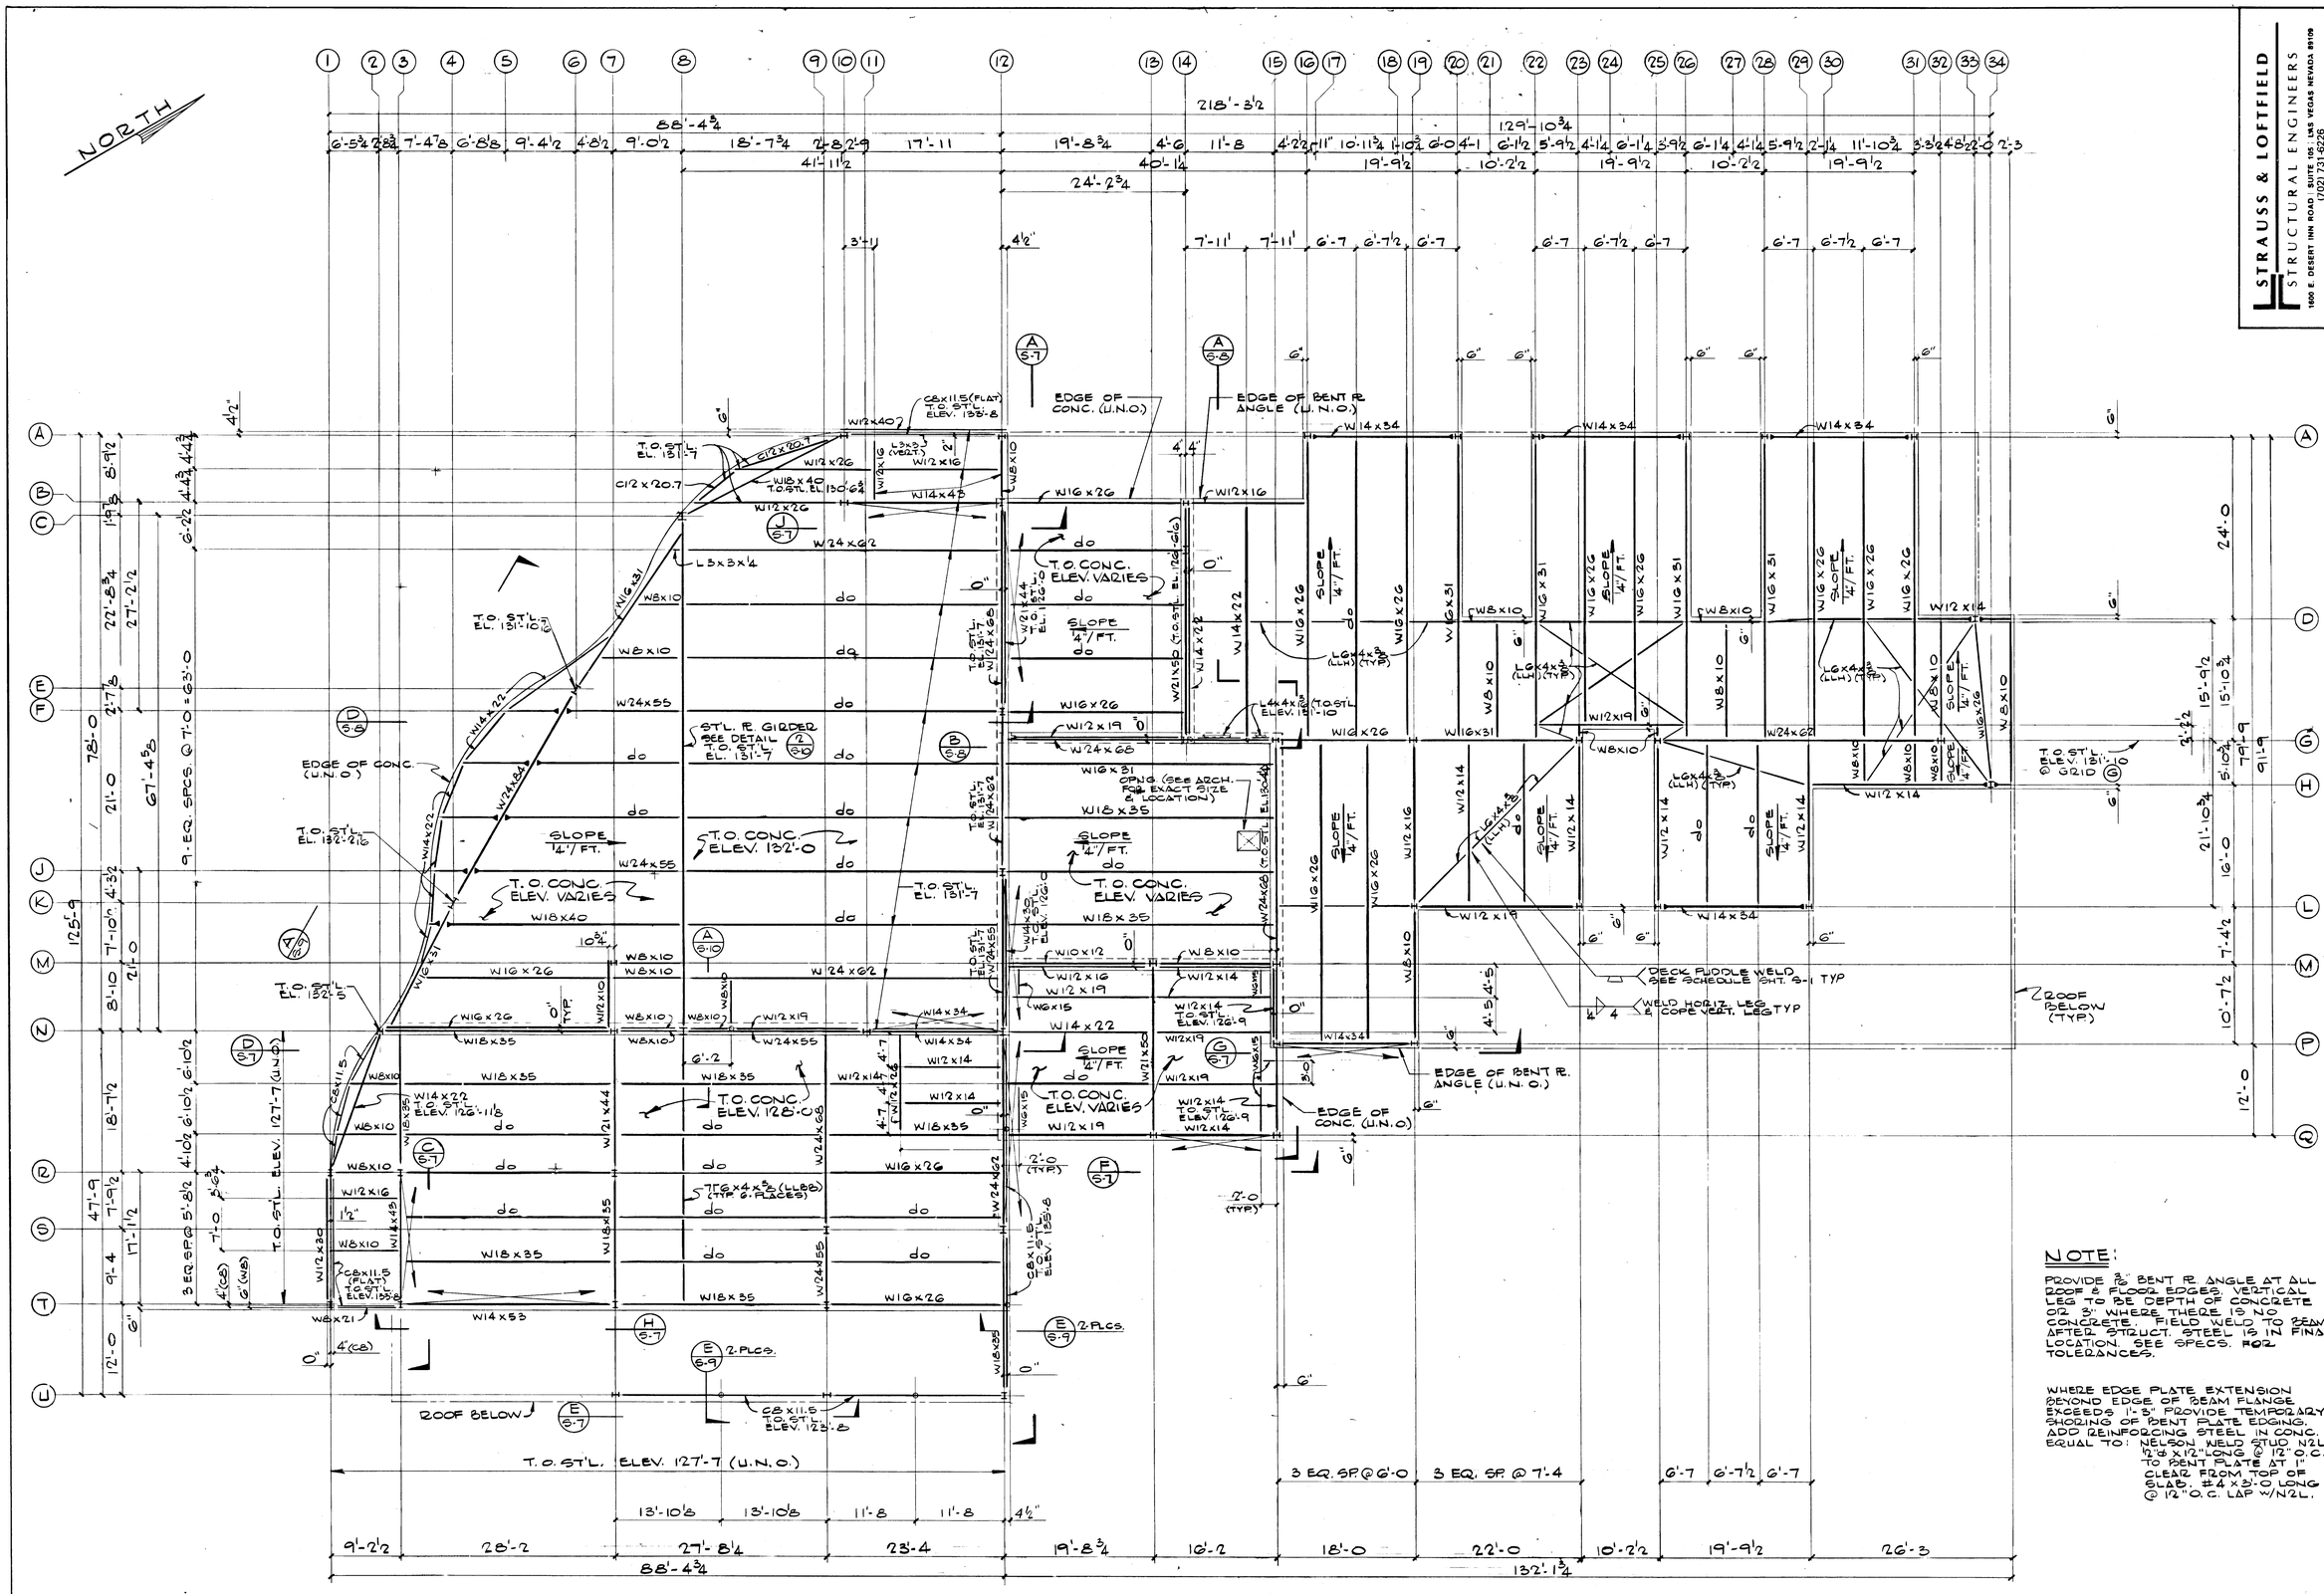


NOTE:

PROVIDE ⅜" BENT PL ANGLE AT ALL ROOF & FLOOR EDGES. VERTICAL LEG TO BE DEPTH OF CONCRETE OR 3" WHERE THERE IS NO CONCRETE. FIELD WELD TO BEAMS AFTER STRUCT. STEEL IS IN FINAL LOCATION. SEE SPECS. FOR TOLERANCES.

WHERE EDGE PLATE EXTENSION BEYOND EDGE OF BEAM FLANGE EXCEEDS 1'-5" PROVIDE TEMPORARY SHORING OF BENT PLATE EDGING. ADD REINFORCING STEEL IN CONC. EQUAL TO: NELSON WELD STUD. N2L-12 x 12" LONG @ 12" O.C. TO BENT PLATE AT 1" CLEAR FROM TOP OF SLAB. #4 x 3'-0 LONG @ 12" O.C. LAP W/N2L.

ROOF FRAMING PLAN

SCALE 1/8" = 1'-0

STRAUSS & LOFTFIELD
STRUCTURAL ENGINEERS
1800 E. DESERT INN ROAD, SUITE 100, LAS VEGAS NEVADA 89109
(702) 731-5226

Sheet No. 01

HARRIS P. SHARP, A.I.A.
GERALD R. STREHLOW, A.I.A.
DAVID A. DALEDA, A.I.A.

hs&a ARCHITECTURE AND PLANNING
HARRIS SHARP & ASSOCIATES, INCORPORATED
2616 STATE STREET LAS VEGAS, NEVADA 89109 (702) 734-1464

Sheet Title: ROOF FRAMING PLAN
Job Title: CENTRAL FIRE STATION
VERIFY ALL DIMENSIONS AND CONDITIONS AT THE SITE

Job: 4882-1
Date: 8 NOV. '82
Drawn By: J. HENDERSON
Checked: HS
Sheet No.: S - 6
Of: 16 of 119

4496

Dwg. # 630-74