



NORTH

NOTE: BASEMENT WALLS MUST BE BRACED IF BACK FILL IS PLACED BEFORE TOP SLAB IS IN PLACE.

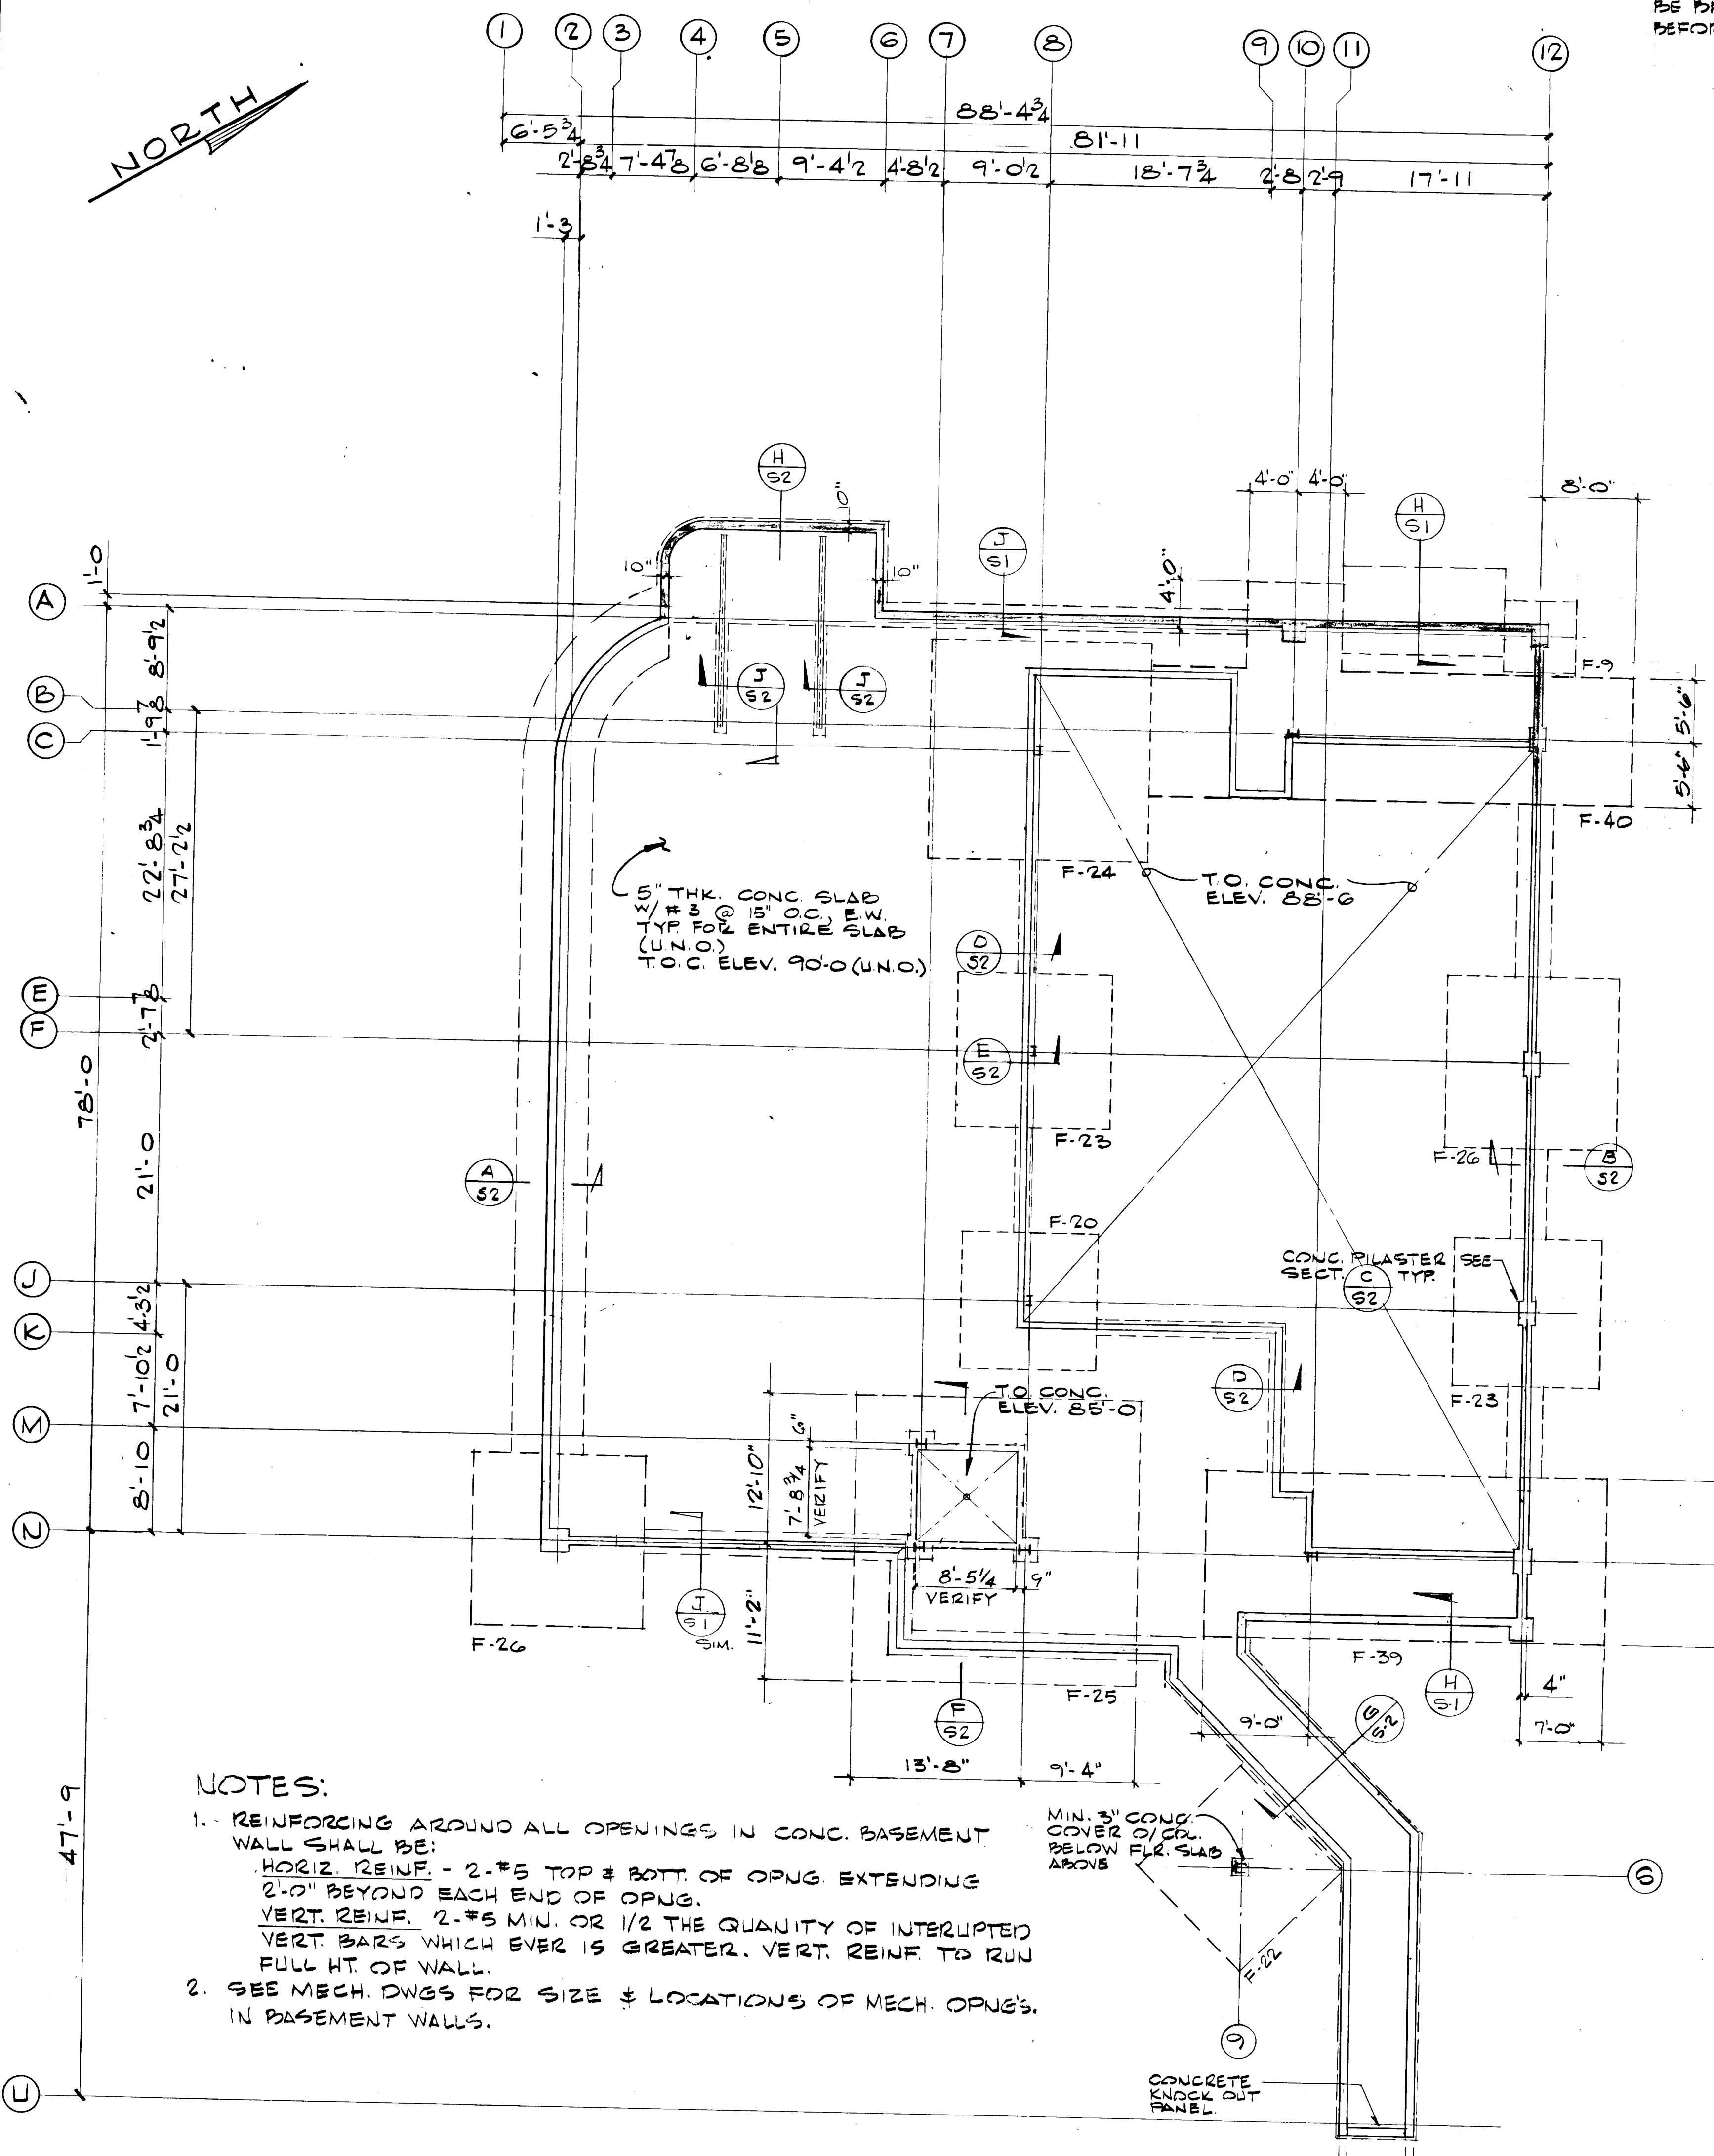

- NOTES:
1. REINFORCING AROUND ALL OPENINGS IN CONC. BASEMENT WALL SHALL BE:
HORIZ. REINF. - 2-#5 TOP & BOTT. OF OPNG. EXTENDING 2'-0" BEYOND EACH END OF OPNG.
VERT. REINF. - 2-#5 MIN. OR 1/2 THE QUANTITY OF INTERRUPTED VERT. BARS WHICH EVER IS GREATER. VERT. REINF. TO RUN FULL HT. OF WALL.
 2. SEE MECH. DWGS FOR SIZE & LOCATIONS OF MECH. OPNG'S. IN BASEMENT WALLS.

COMMUNICATIONS LEVEL & FOUNDATION PLAN
SCALE 1/8" = 1'-0"

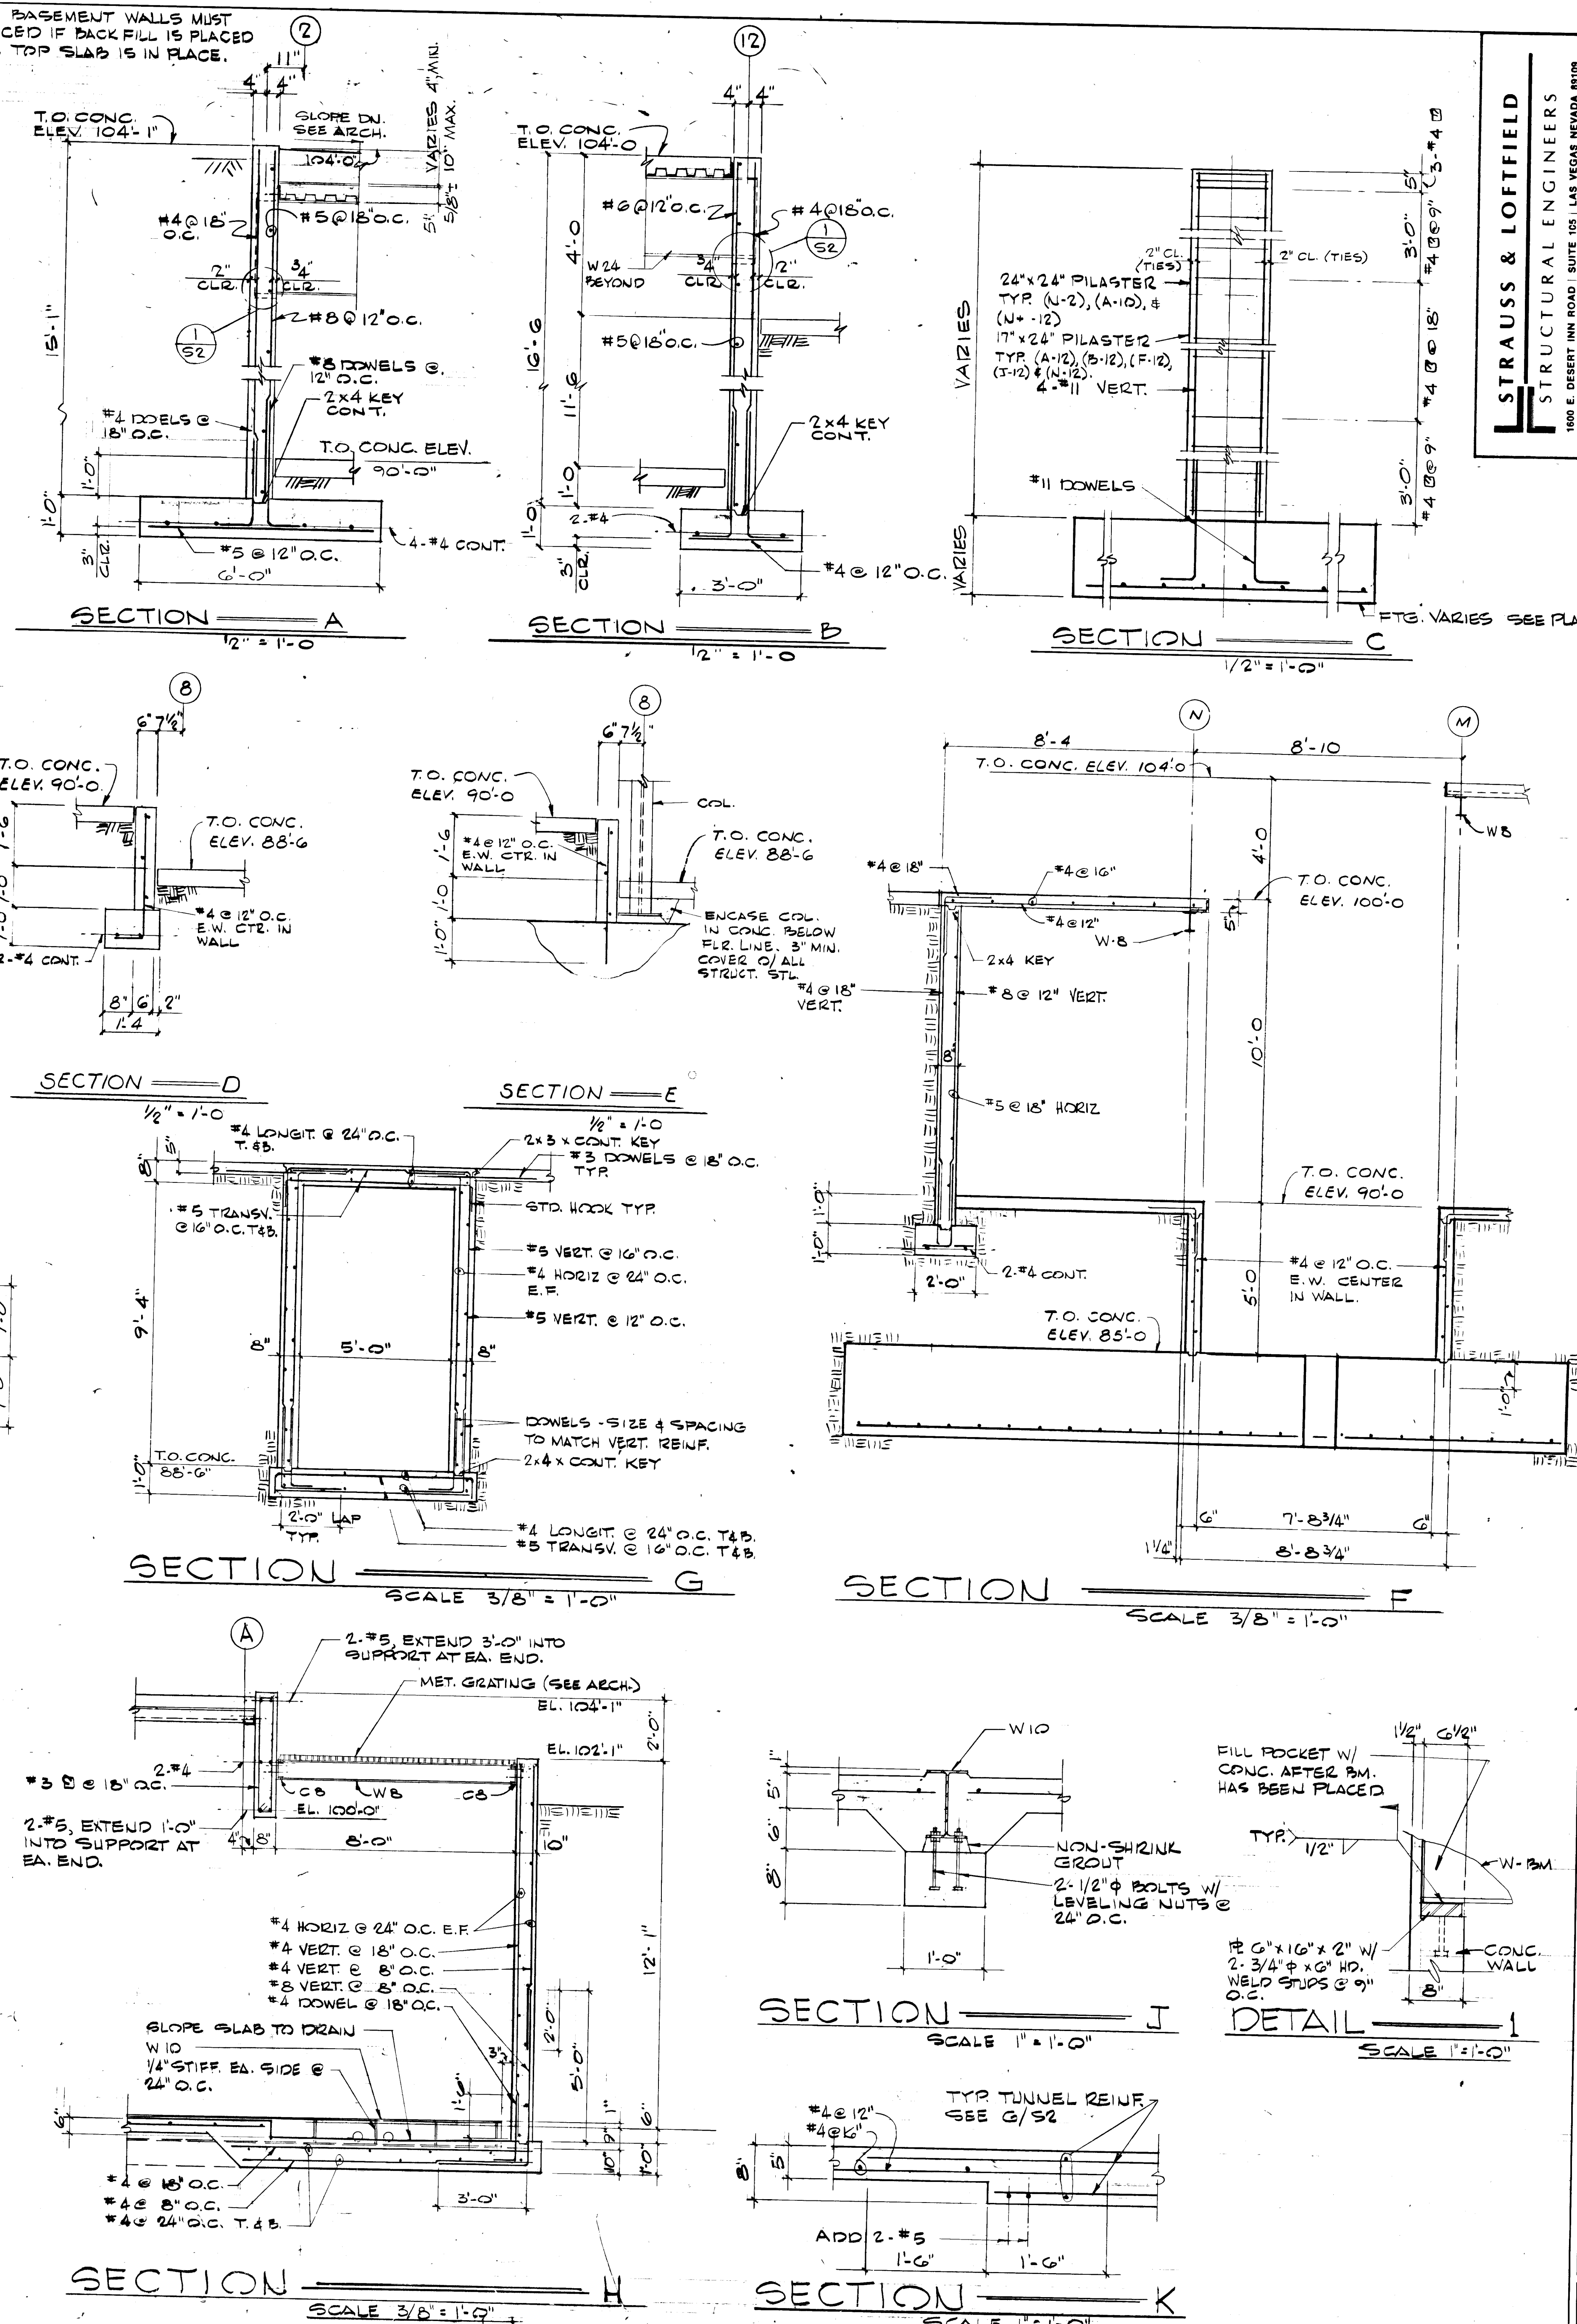

STRAUSS & LOFFIELD
STRUCTURAL ENGINEERS
100 E. DESERT INN ROAD, SUITE 101, LAS VEGAS, NEVADA 89109
(702) 731-8226

Sheet No. 10

HARRIS SHARP & ASSOCIATES, INCORPORATED
2616 STATE STREET LAS VEGAS, NEVADA 89109
(702) 734-1464

CENTRAL FIRE STATION
VERIFY ALL DIMENSIONS AND CONDITIONS AT THE SITE

Job: 4882-1
Date: 8 NOV. '82
Drawn By: J.H. # D.E.
Checked: HS
Sheet No. 3-2
Of: 10

12 of 119

Dwg. # 630-74