



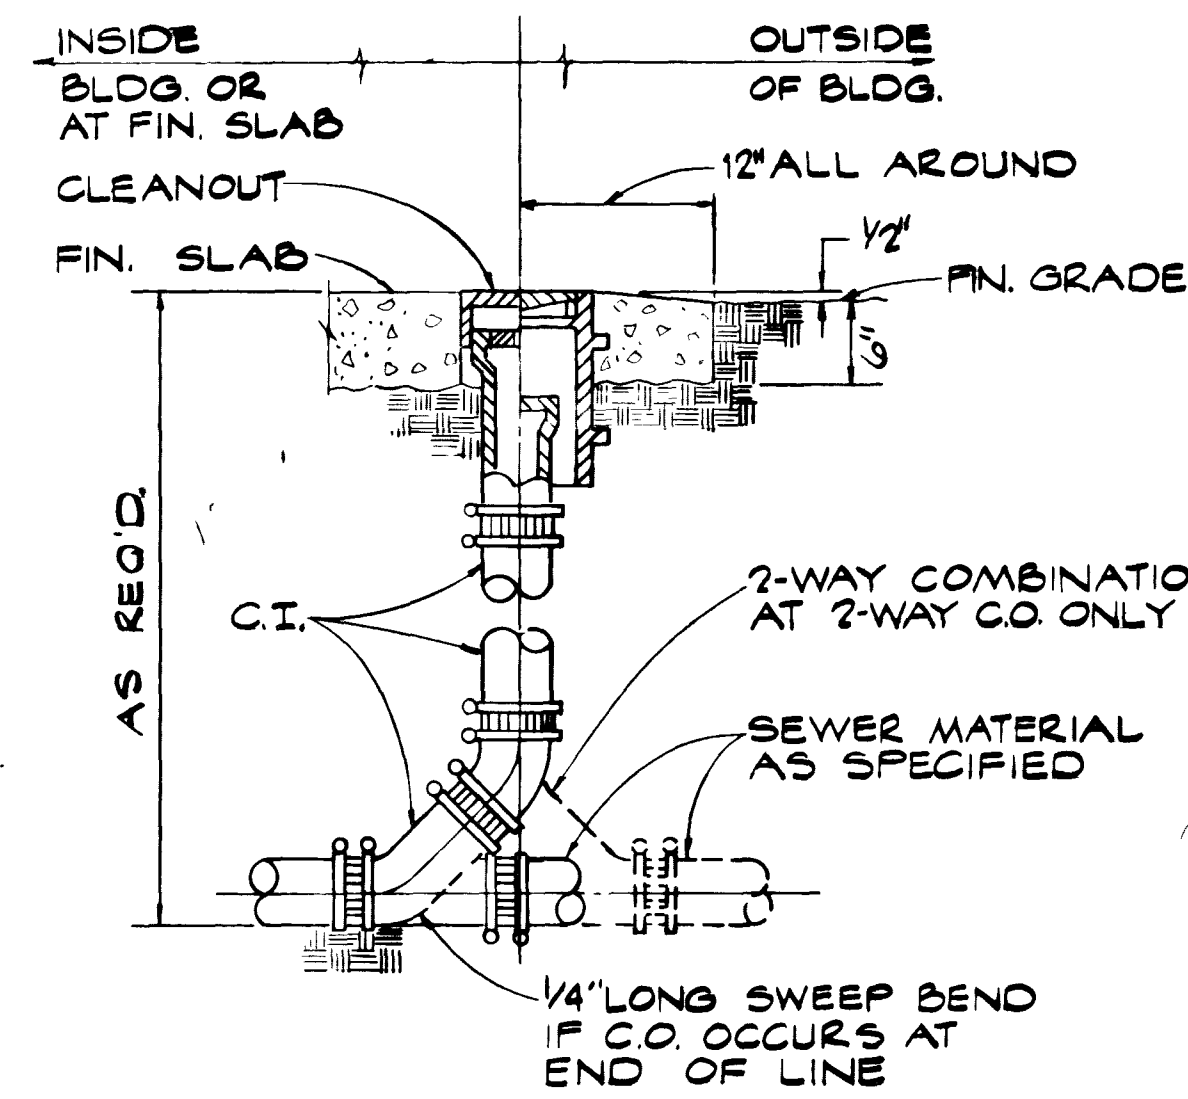


CLEANOUT TO GRADE
NO SCALE

1
P-5

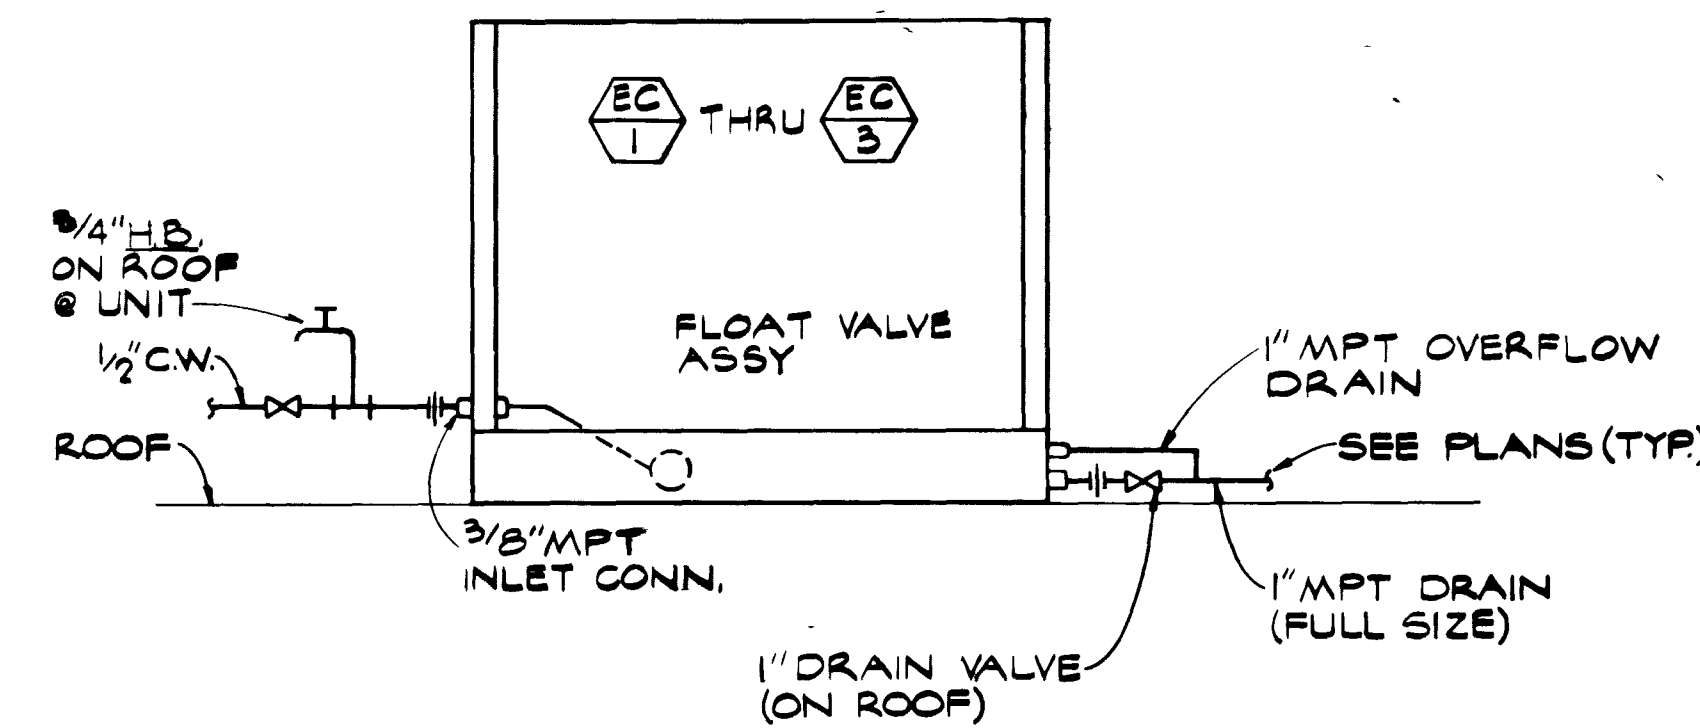


EVAP. COOLER C.W. & DRAIN PIPING
NO SCALE

2
P-5

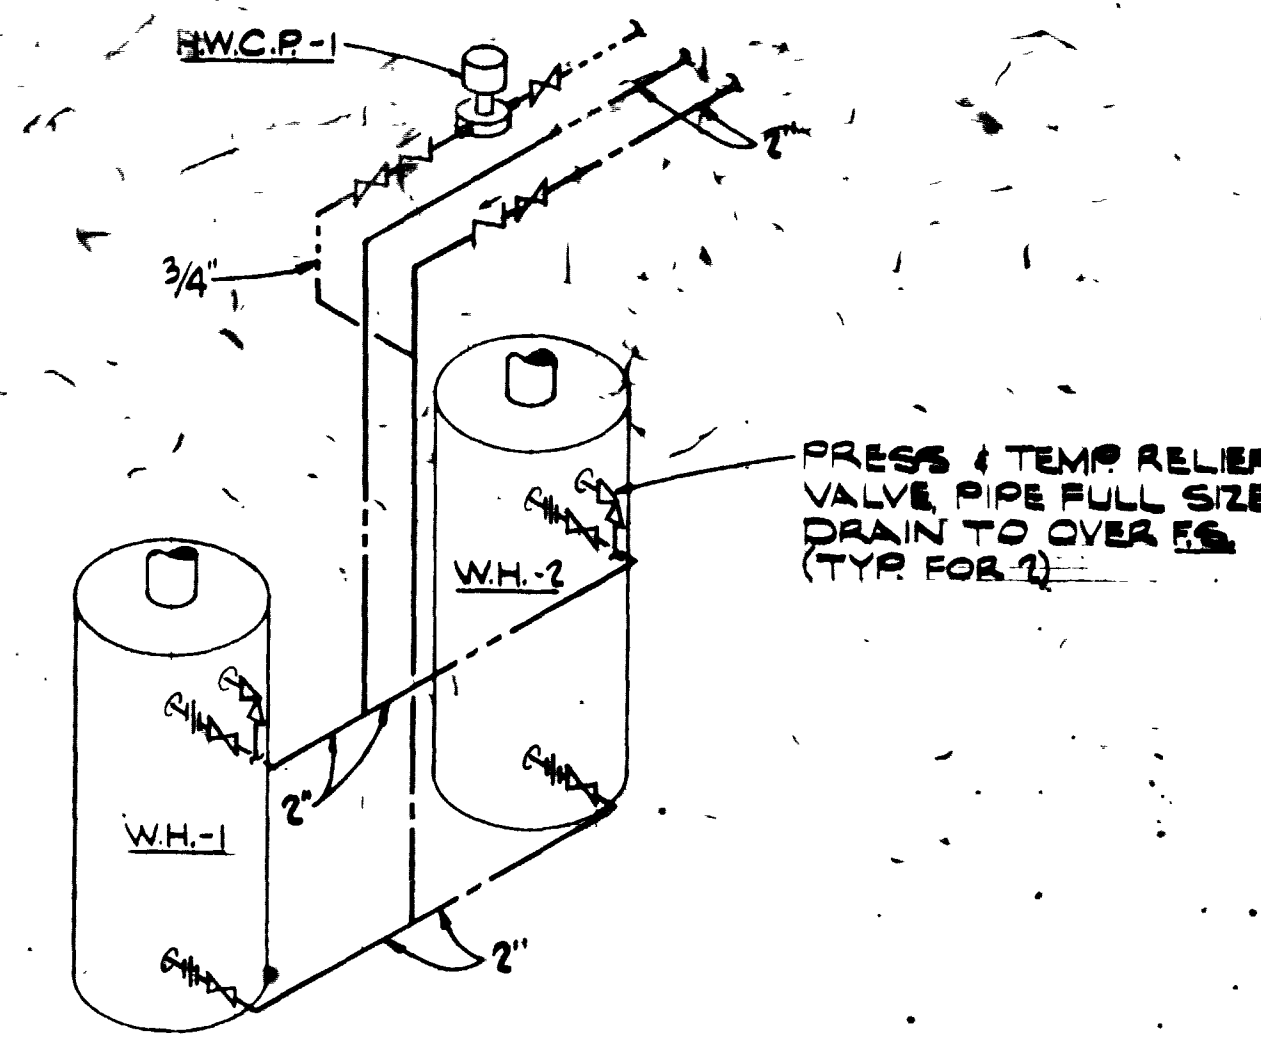


WATER HEATER PIPING DETAIL
NO SCALE

3
P-5

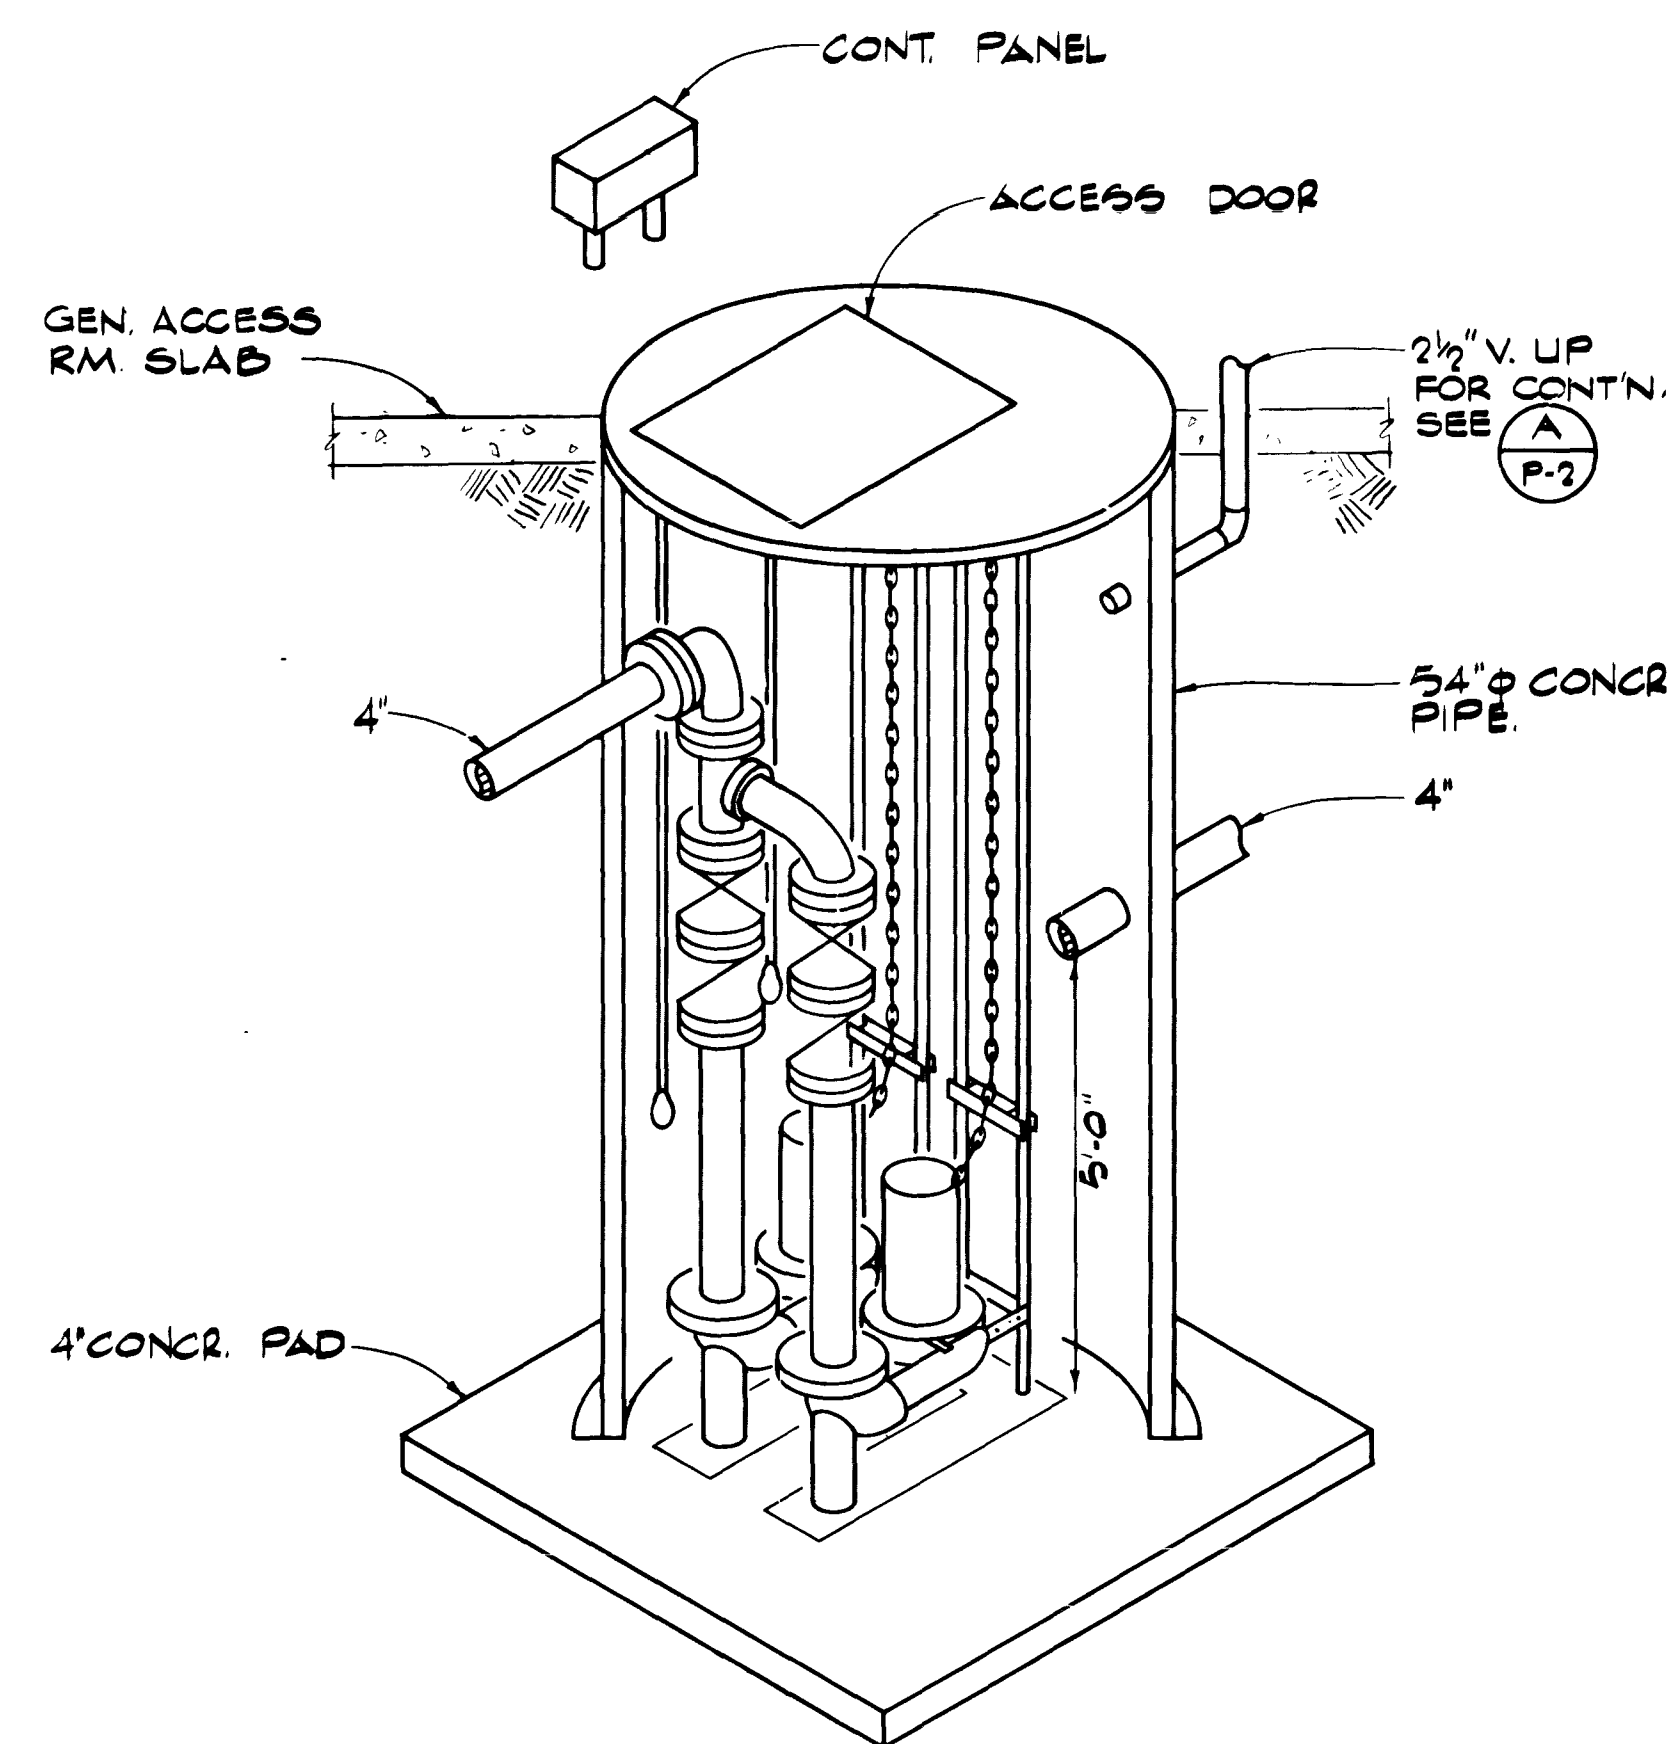

SEWAGE EJECTOR
NO SCALE

4
P-5


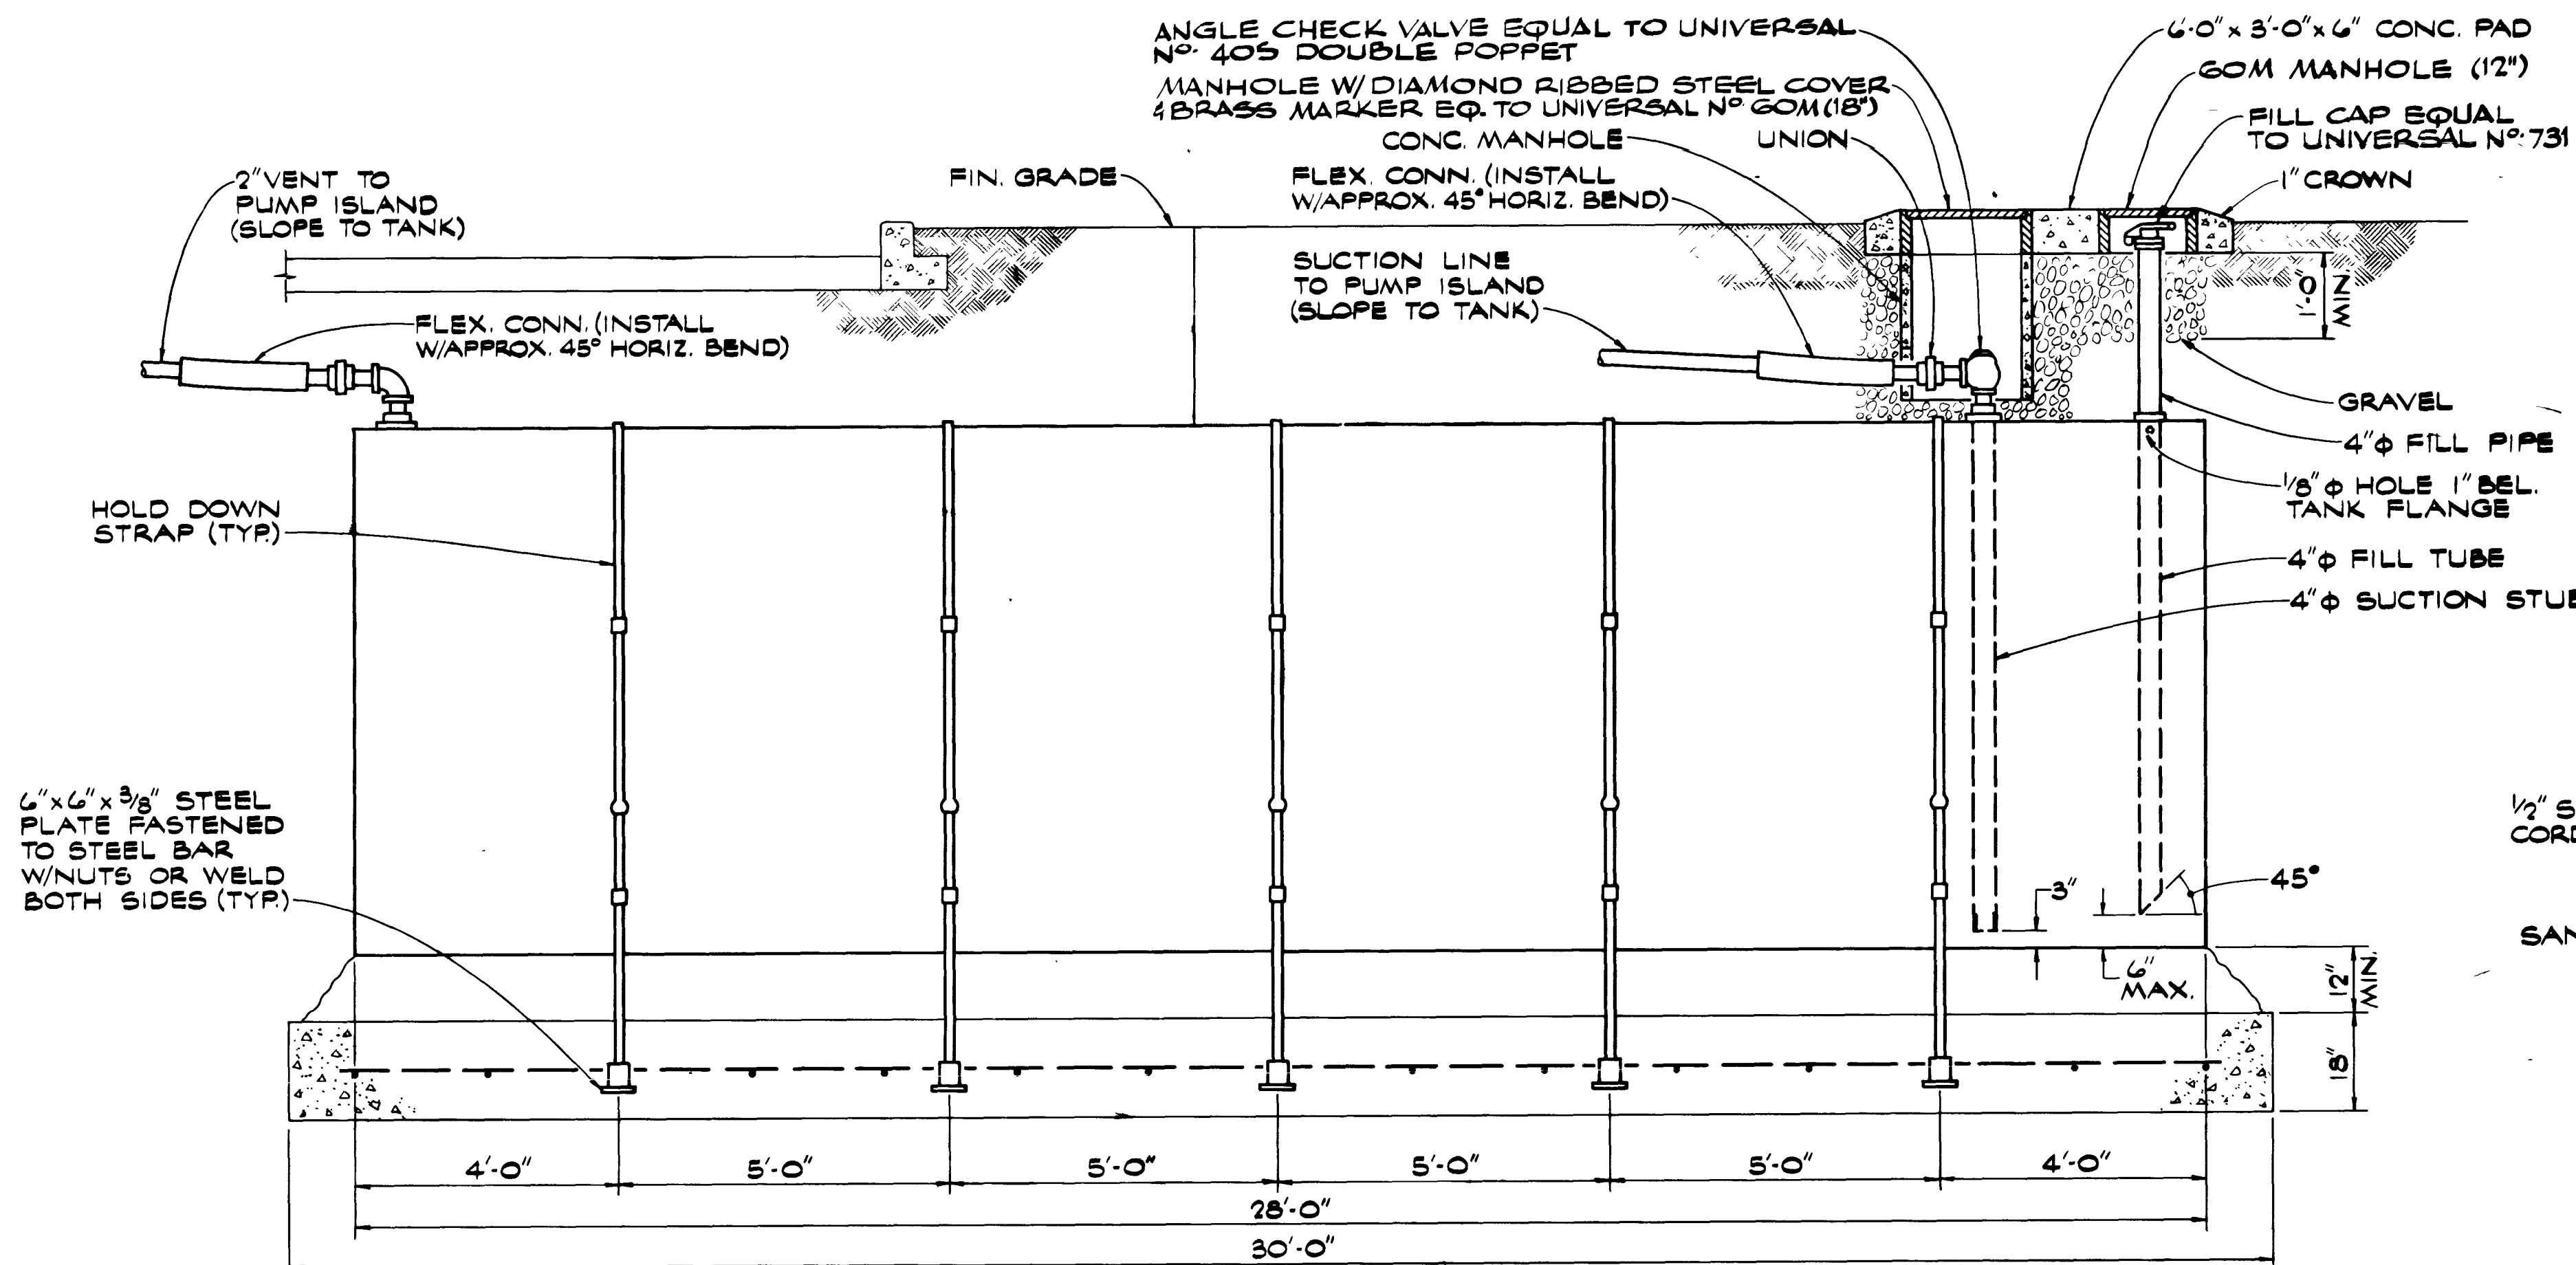


STORAGE TANK DETAIL
NO SCALE

5
P-5

NOTES

- TANKS SHALL BE INSTALLED IN STRICT CONFORMANCE W/ NFPA & THE MANUFACTURERS INSTALLATION CRITERIA.
- CONTRACTOR SHALL VERIFY ANCHOR SPACING REQMT'S W/TANK MFR'S. APPROVED SHOP DWGS. CONCRETE PAD REQMT'S. SHALL BE COORDINATED W/TANK MFR. PRIOR TO BEGINNING WORK.

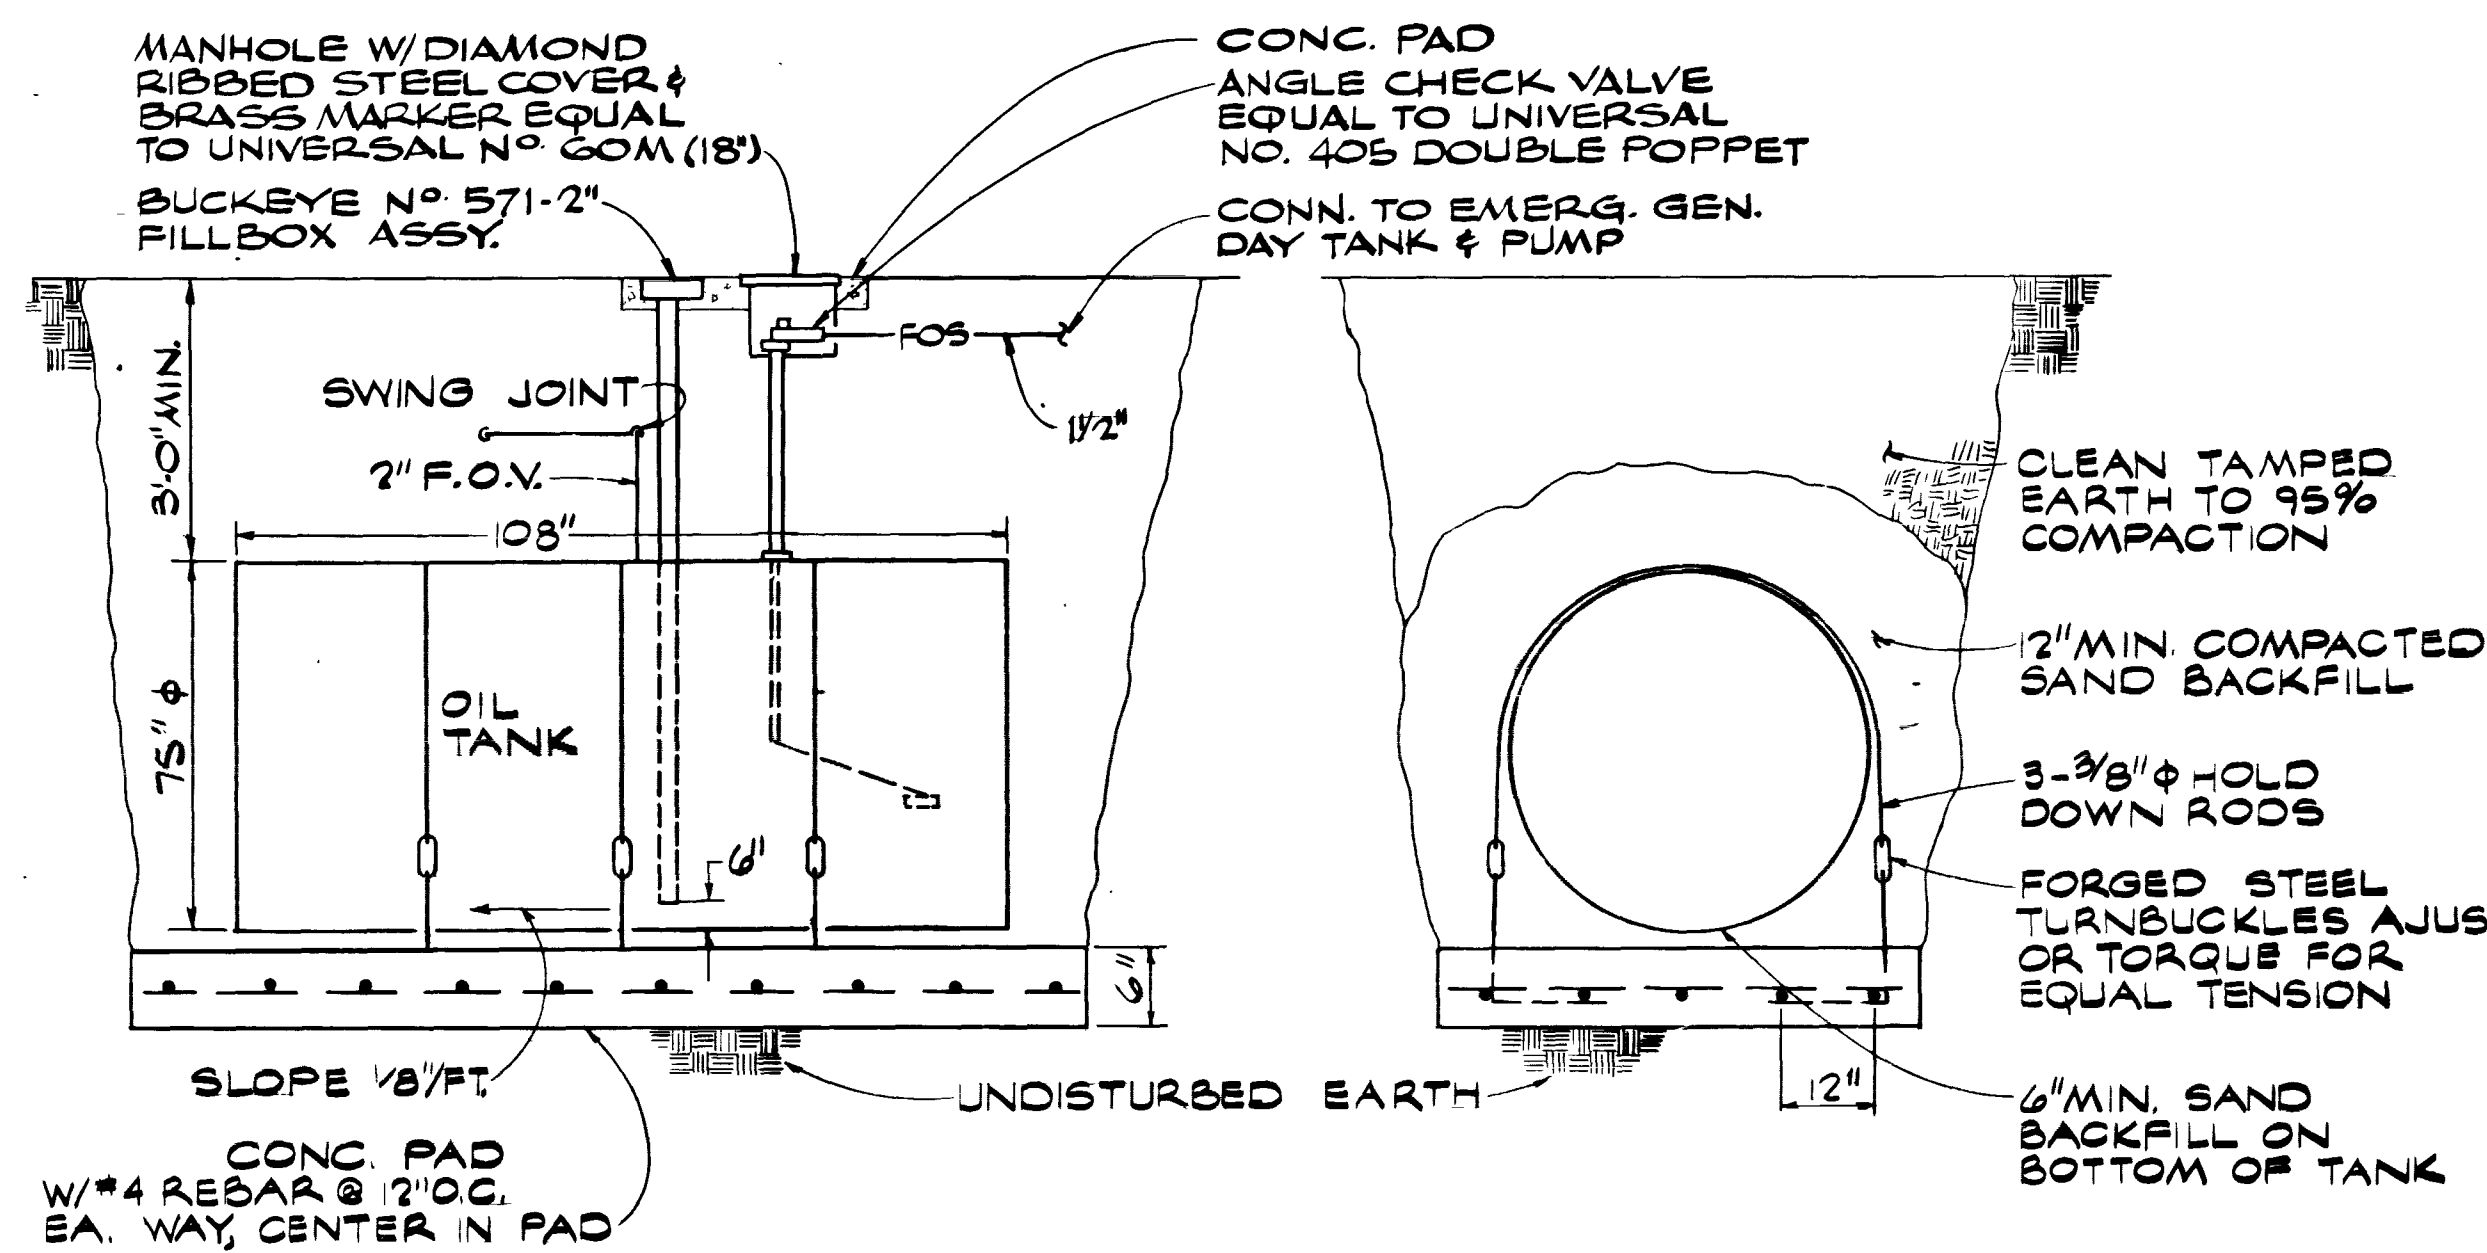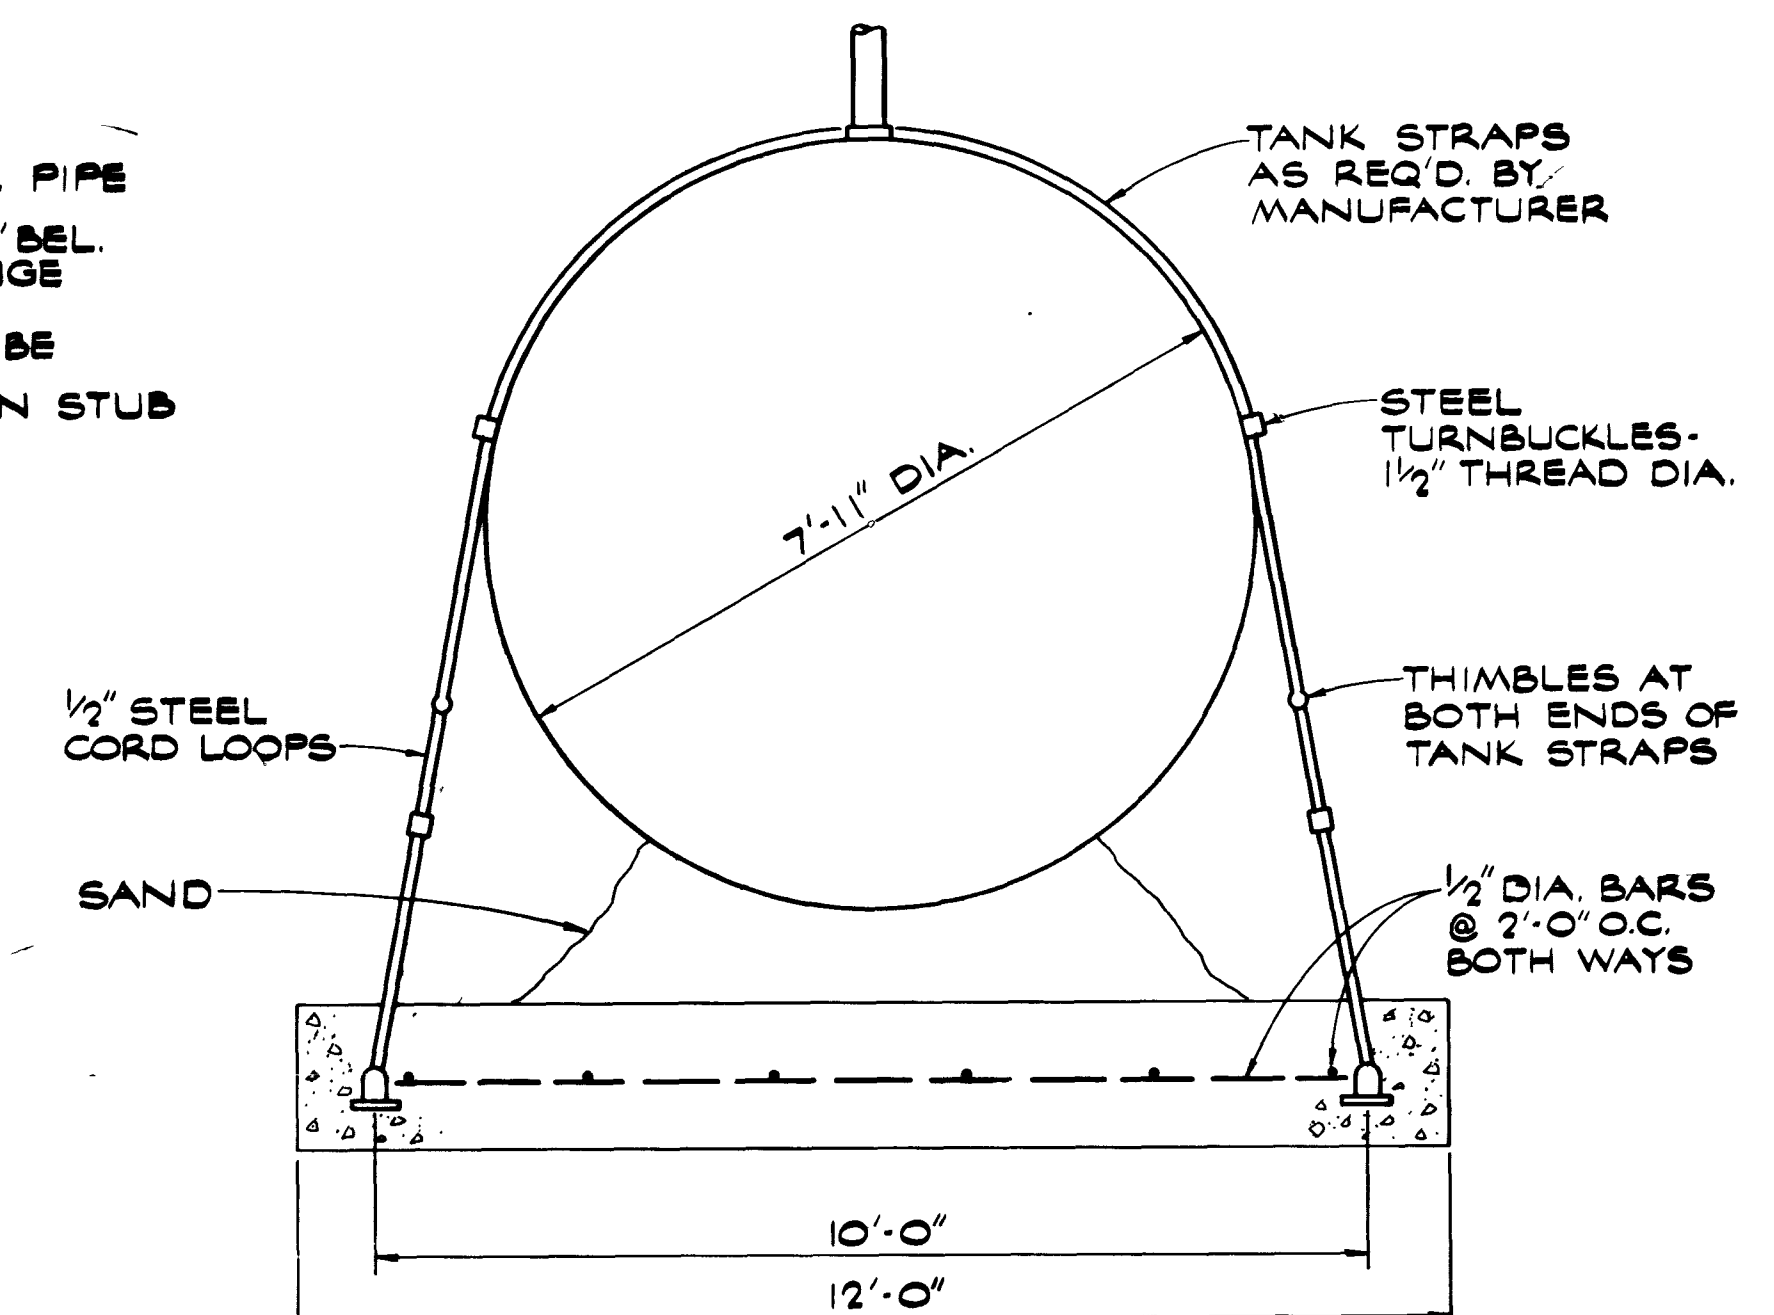


FUEL OIL STORAGE TANK
NO SCALE

6
P-5


NOTES

- TANK TO CONFORM TO NFPA & UL LABELLED.
- HOLD DOWN RODS TO BE PROTECTED W/ TWO APPLICATIONS OF KOPPER'S NO. 50 BITUMASTIC COATING. APPLICATION TO INCLUDE CLEANING & PAINTING.
- PIPING TO BE BURIED 7 FT. MIN.
- PROVIDE 18" x 18" x 6" CONCR. PAD AT EACH ACCESS W/ 1" CROWN.

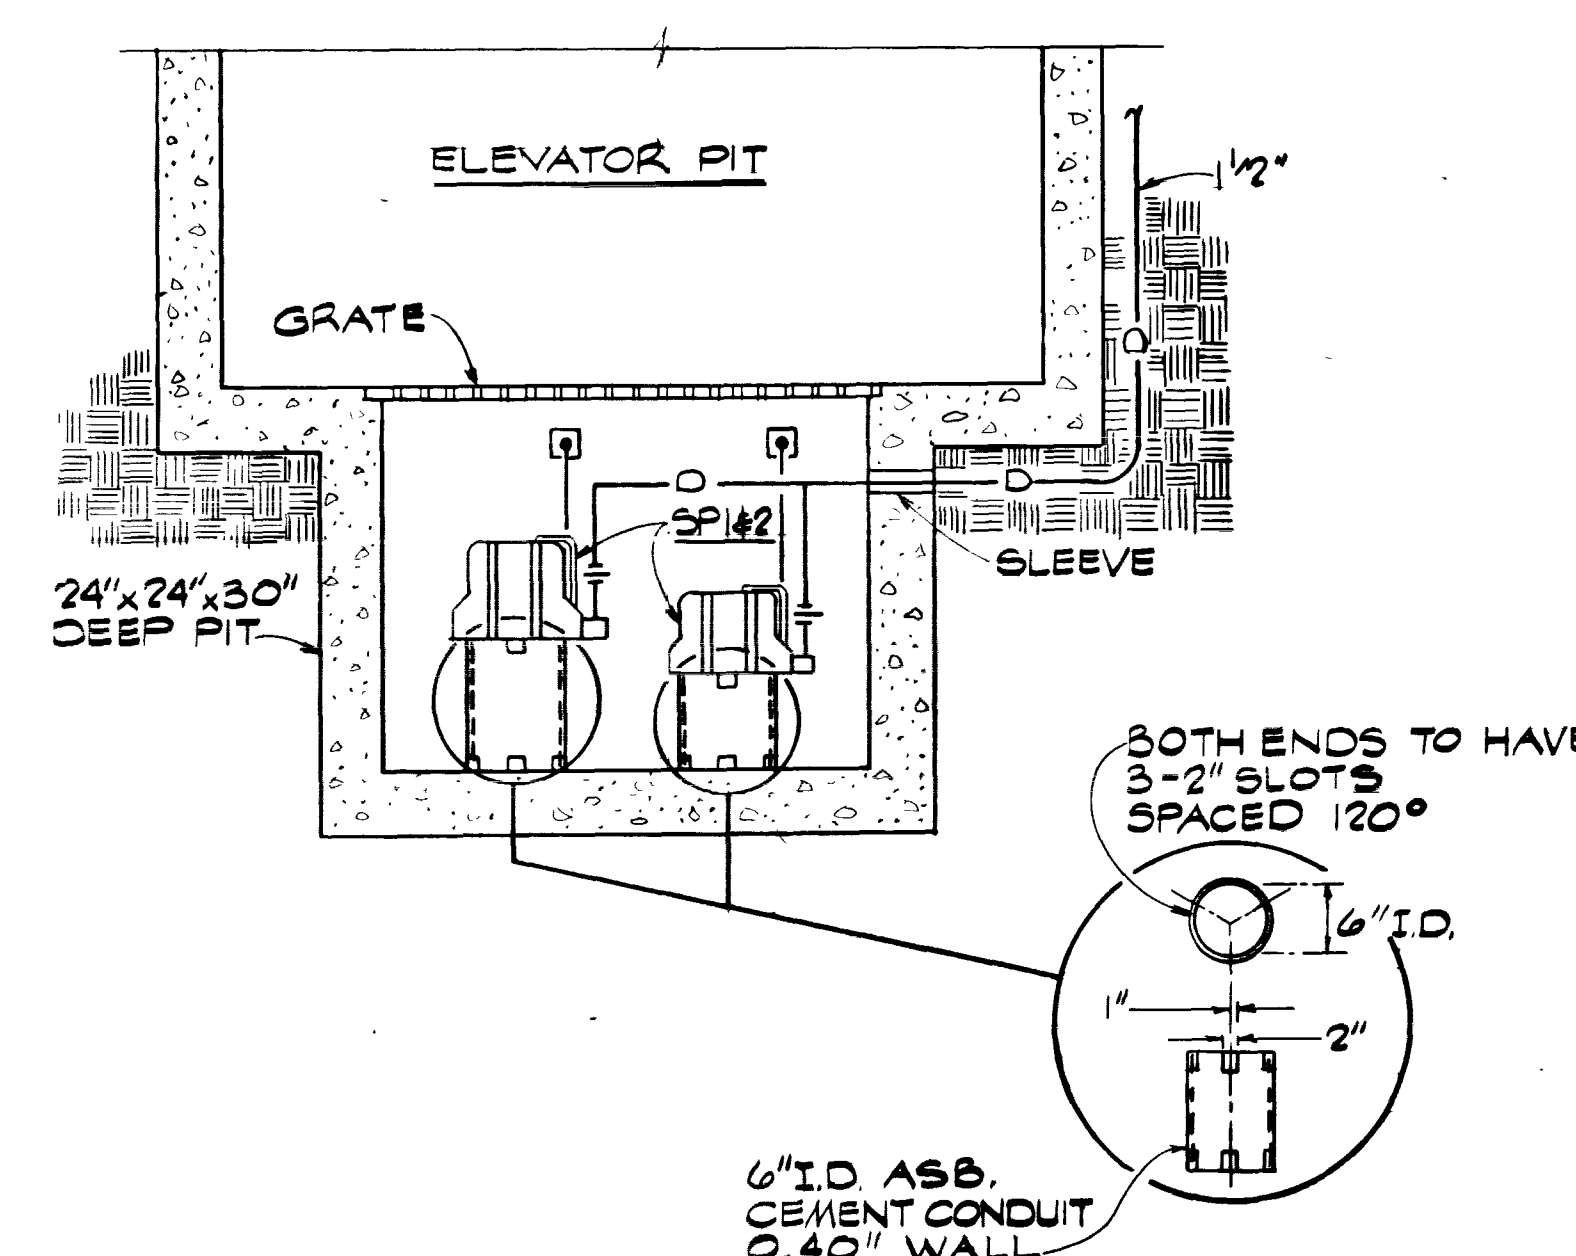

SUMP PUMP DETAIL
NO SCALE

7
P-5

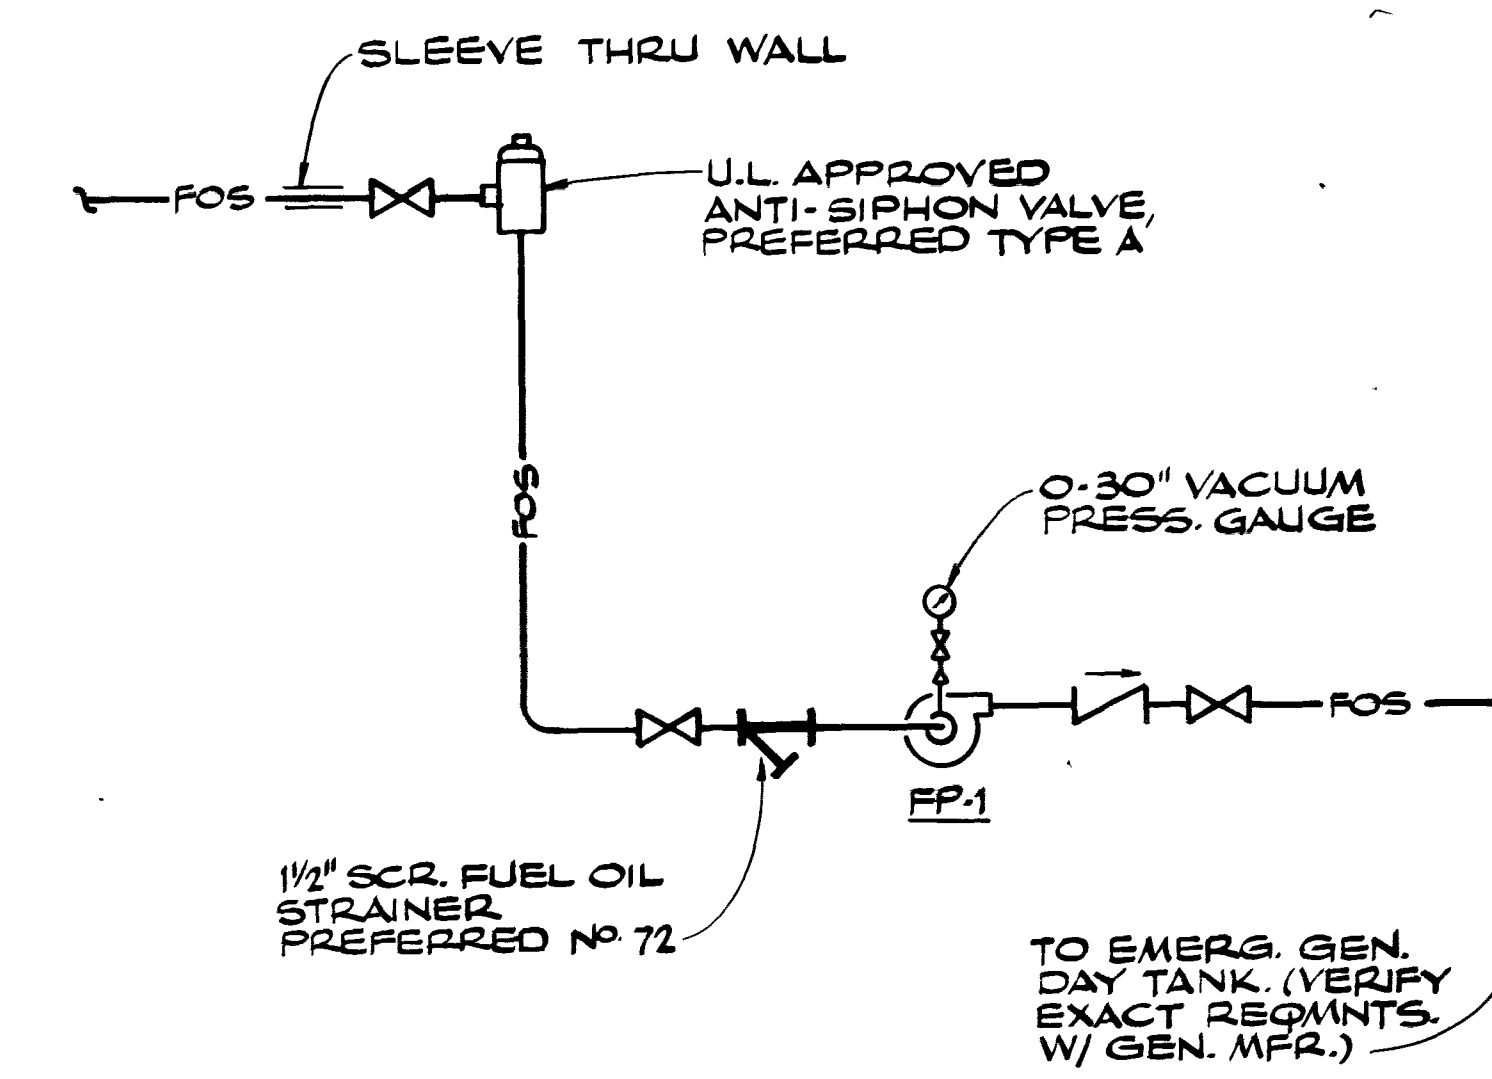

FUEL OIL PIPING DETAIL
NO SCALE

8
P-5

HARRIS SHARP & ASSOCIATES, INCORPORATED
2915 W. CHARLESTON BLVD. LAS VEGAS, NEVADA 89102 (702) 877-0125
ARCHITECTURE, PLANNING AND INTERIOR

CENTRAL FIRE STATION
VERIFY ALL DIMENSIONS AND CONDITIONS AT THE SITE


Sheet Title: DETAILS
Job Title: 482-1
Date: 8 NOV. 82
Drawn By: L.B.
Checked: E.P.B.
Sheet No: P-5
Or: 5
61 01 119
Dwg. # 630-74

CLEANOUT TO GRADE 


SWR COOLER GW & DRAIN PIPING (1)




WATER HEATING, SPENDING, ETC. 10




REVISED EDITION 4




STORAGE TANK DETAIL (6)




NOTES



FUEL OIL STORAGE TANK (4)



GROUP PLAN DETAIL (7)



FUEL OIL PIPING DETAIL (8)