




The detector check assembly and vault with non-traffic bearing cover, must be installed in accordance with the District's standard plate(s) 19 and with standard vault drawing C-475 Rev 3.

Any block wall or fence must be designed around the easement, so as to allow the District direct access to the vault from the adjacent right-of-way.

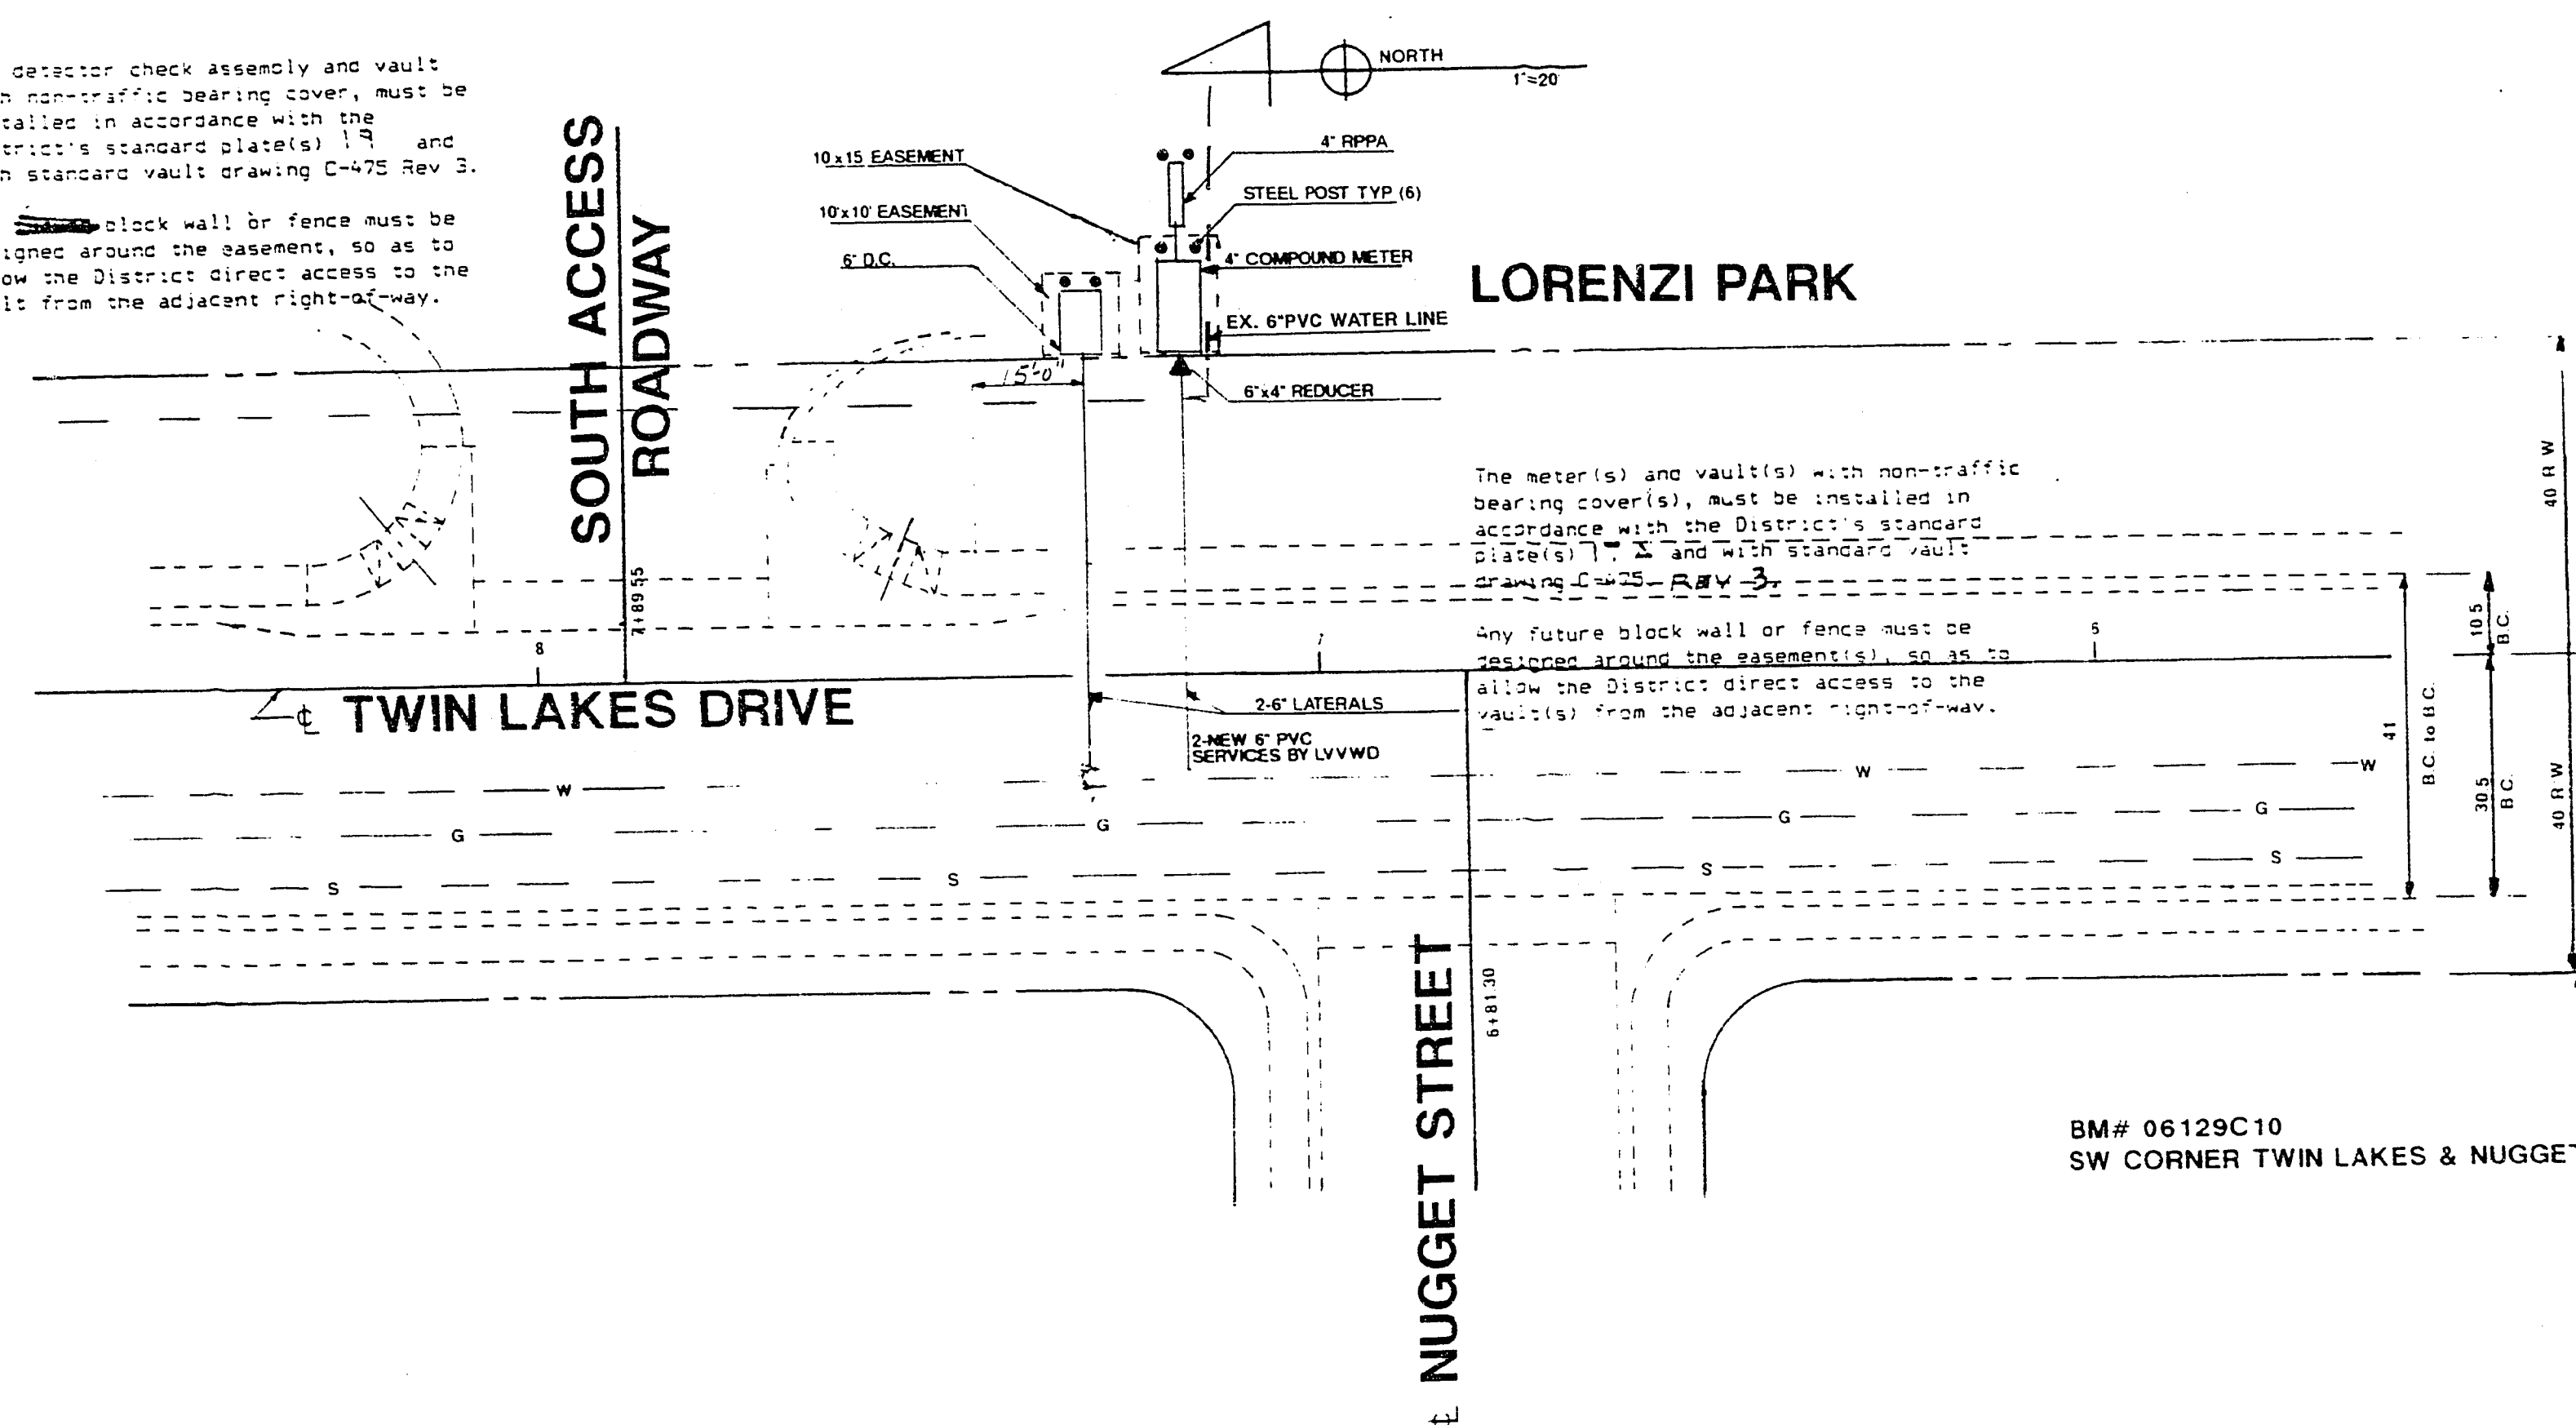

LAS VEGAS VALLEY WATER DISTRICT NOTES:


- ALL WORK TO CONFORM TO LAS VEGAS VALLEY WATER DISTRICT LATEST STANDARD PLATES AND SPECIFICATIONS OR CONTRACT DOCUMENTS WHICHEVER IS MORE STRINGENT.
- ALL WORK, EXCEPT AS MODIFIED HEREON OR BY NOTE NO. 1, SHALL BE DONE IN ACCORDANCE WITH THE MOST CURRENT DRAFT OR EDITION OF CURRENT STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OPPOSITE DEPOSITIONS CLARK COUNTY AREA.
- NOTICE TO BE GIVEN ENGINEERING DEPARTMENT OF THE LAS VEGAS VALLEY WATER DISTRICT 48 HOURS PRIOR TO ACTUAL CONSTRUCTION.
- NOT USED.
- ALL LINES TO BE PRESSURE TESTED IN ACCORDANCE WITH THE CONTRACT SPECIFICATIONS.
- NOT USED.
- NOT USED.
- DETECTOR TAPE REQUIRED IN ACCORDANCE WITH STANDARD PLATE NO. 27 AS FOLLOWS:
 - OVER ALL MAINS
 - OVER ALL SERVICE LATERALS
- CALL BEFORE YOU DIG - 1-800-227-2600.

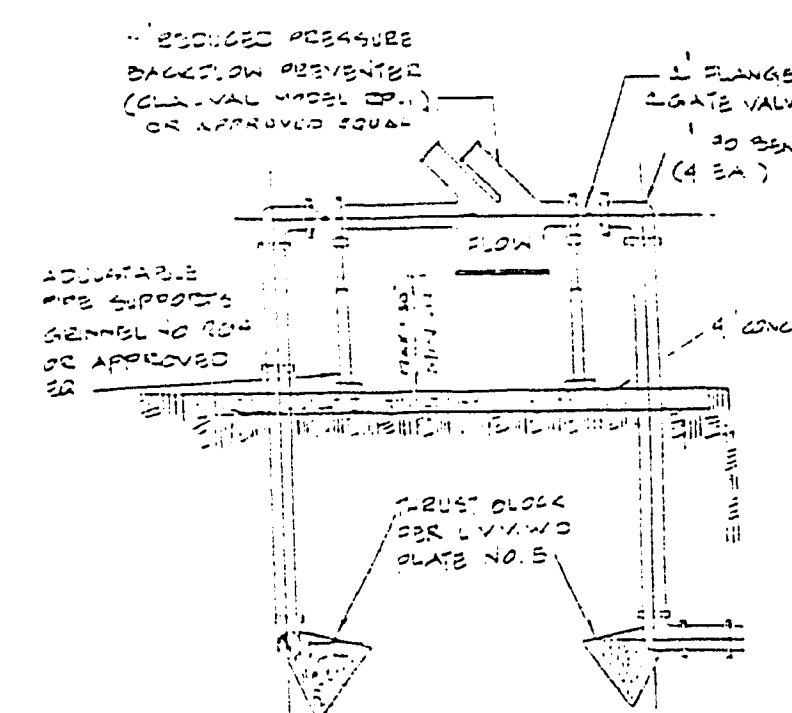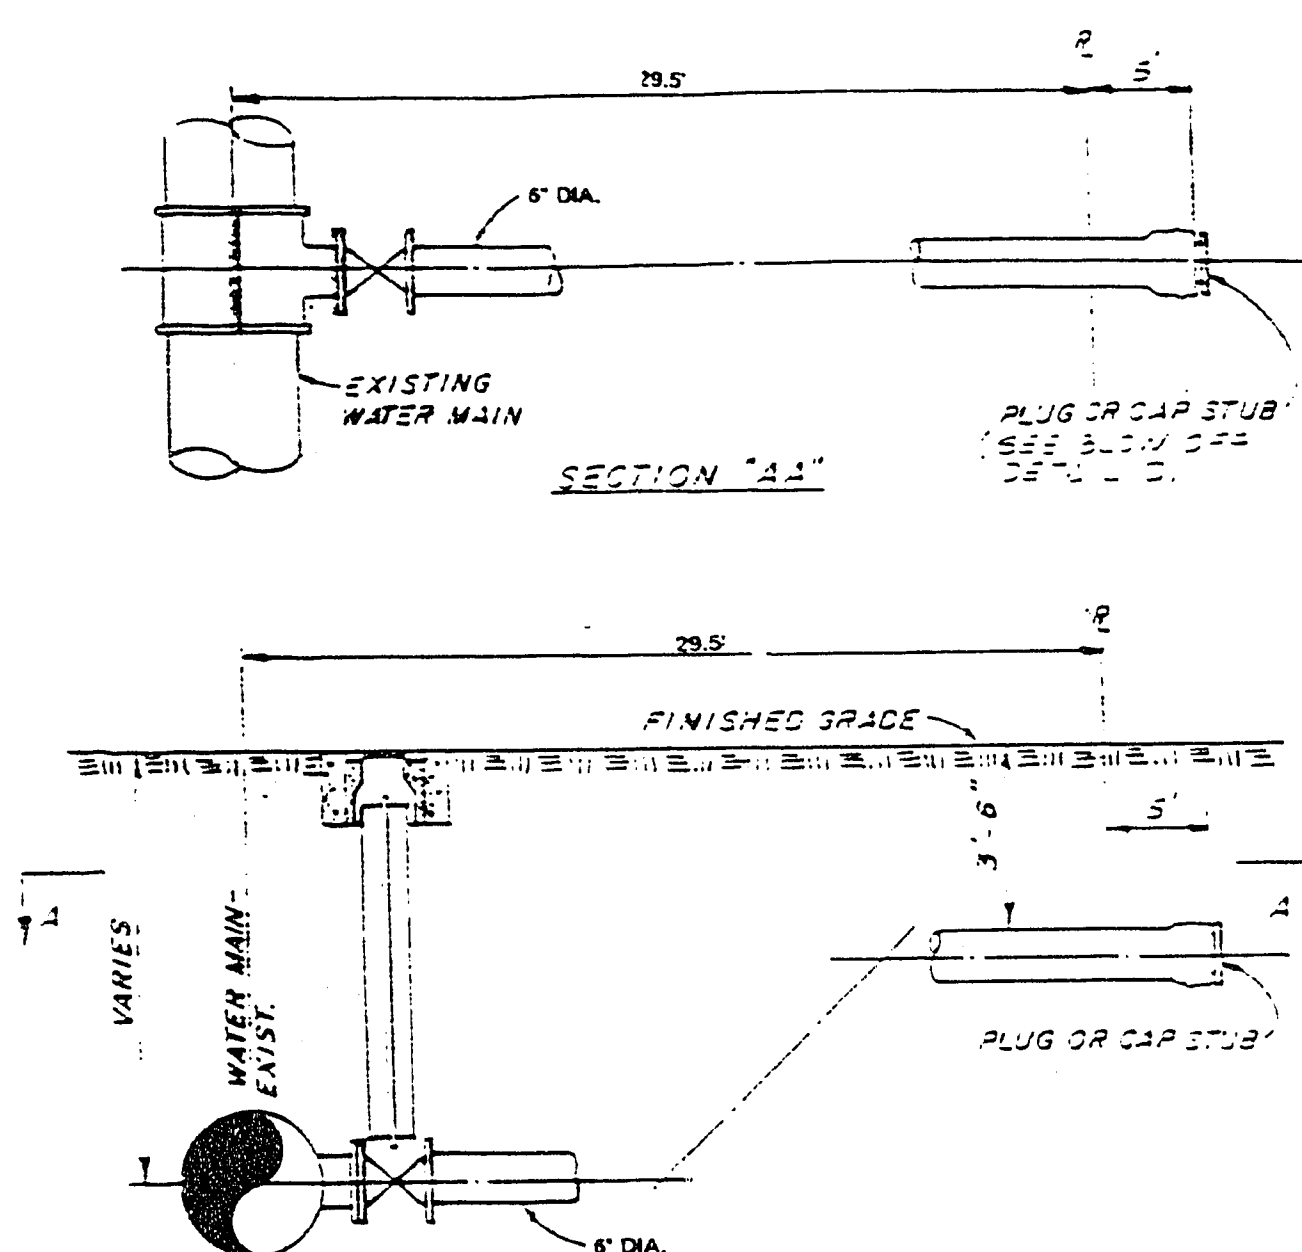

NOTES

- SERVICE LATERAL PIPE SHALL BE PVC PRESSURE PIPE AND SAME DESIGN PRESSURE AS MAIN.
- TAPPING FEE & VALVE SHALL BE REQUIRED ON EXISTING WATER MAINS.
- TESTING AND DISINFECTION SHALL BE REQUIRED.
- LAS VEGAS VALLEY WATER DISTRICT STANDARD PLATES SHALL BE USED UNLESS OTHERWISE SHOWN.



TYPICAL WATER LATERAL

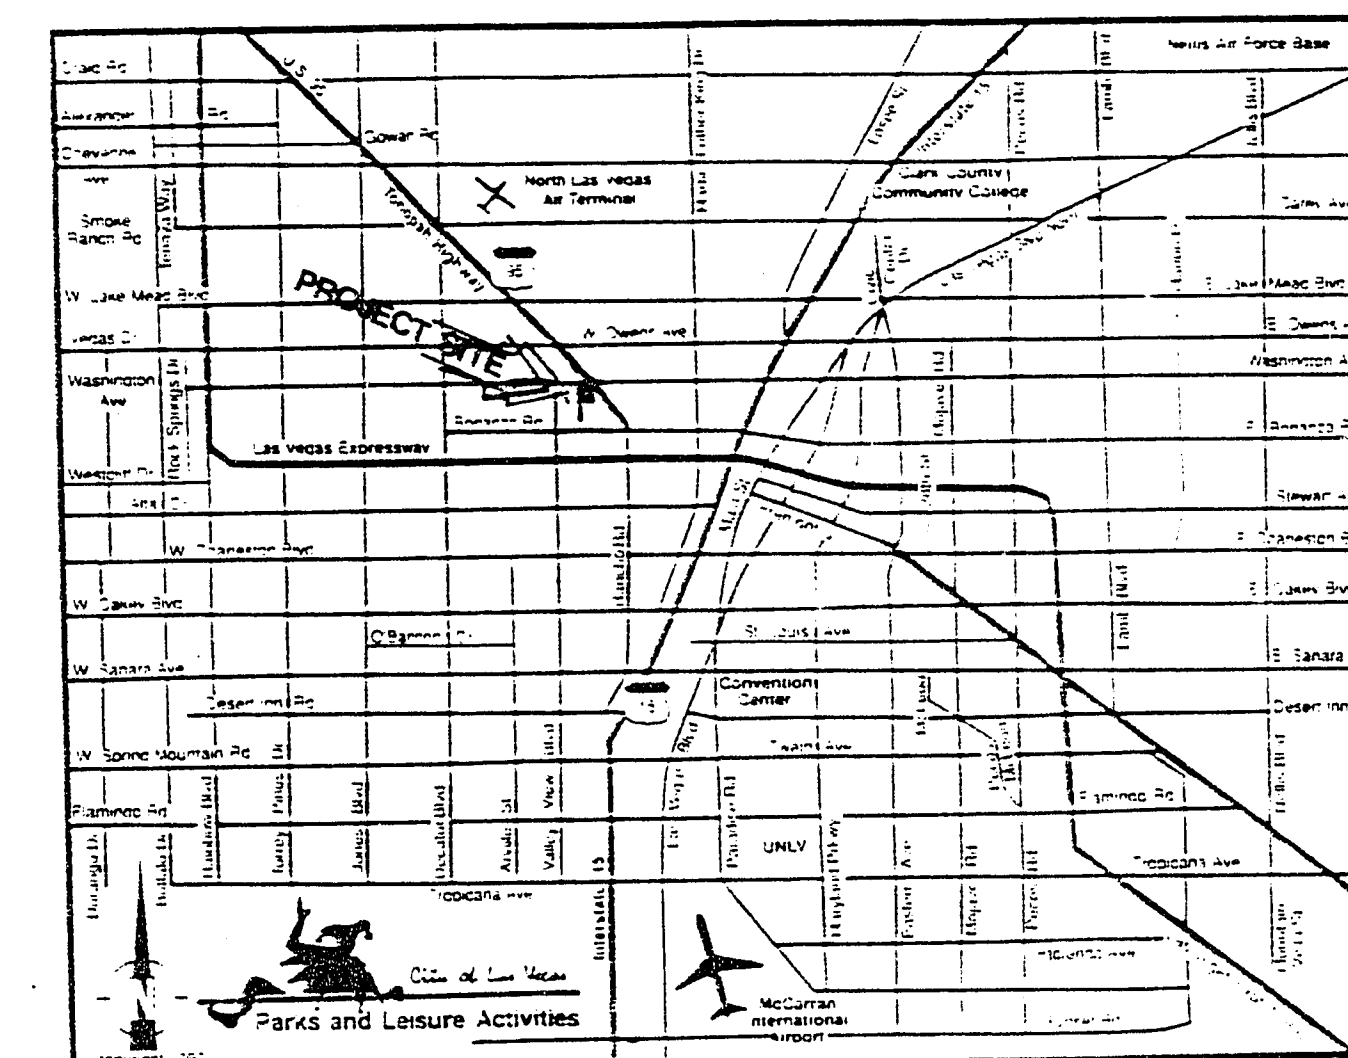

VICINITY MAP

DESIGNED BY: T. HANRAHAN
DATE: 8-10-90
LAS VEGAS VALLEY WATER DISTRICT
DATE: 3/30/90
C.L.V. FIRE MARSHALL

REVISIONS	DATE

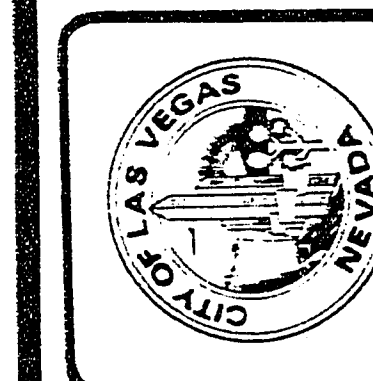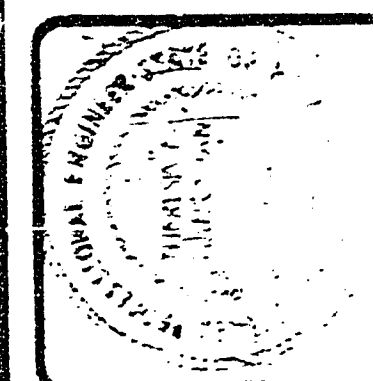

DESIGNED BY:	T. HANRAHAN
DATE:	8-10-90
DRAWING NUMBER:	650.19-41

SHEET NUMBER:	ONE
OF:	ONE