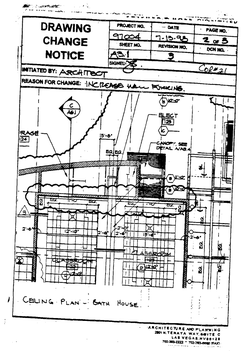

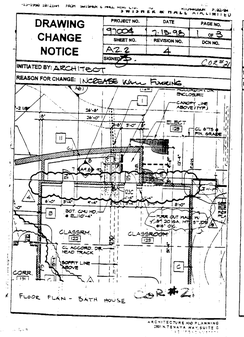

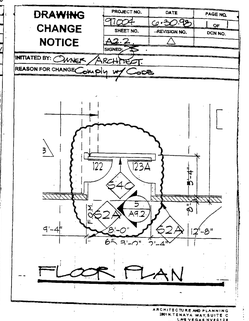

WALL LEGEND

SYMBOL	WALL DESCRIPTION	REQUIRED RATING	LISTED ASSEMBLY
	3 5/8" x 20 GA. METAL STUDS (U.N.O.) @ 16" O.C. w/ 5/8" TYPE "X" GYP. BD. EA. SIDE.	1 HR. NON-BRG.	UL-1
	6" x 20 GA. METAL STUDS @ 16" O.C. w/ 5/8" TYPE "X" GYP. BD. EA. SIDE.	1 HR NON-BRG.	UL-1
	6" CMU WALL, SEE STRUCTURAL DRAWINGS	1 HR BEARING & NON-BRG.	UL-2
	8" CMU WALL, SEE STRUCTURAL DRAWINGS	1 HR BEARING & NON-BRG.	UL-2
A	EXTERIOR INSUL. FINISH SYSTEM o/ CMU WALL		
B	5/8" TYPE "X" GYP. BD. o/ 1 1/2" Z-CHANNELS (U.N.O.) @ 24" O.C. w/ RIGID INSULATION		
C	5/8" TYPE "X" GYP. BD. o/ 1 1/2" Z-CHANNELS (U.N.O.) @ 24" O.C. o/ CMU WALL		
D	3 5/8" x 20 GA. METAL STUDS (U.N.O.) @ 16" O.C. w/ 5/8" TYPE "X" GYP. BD. EA. SIDE. W/ SOUND INSULATION	1 HR NON-BRG.	UL-1

GENERAL NOTES:

A. THE GENERAL CONTRACTOR SHALL REVIEW THE CONTRACT DOCUMENTS AND ADVISE THE ARCHITECT OF ANY DISCREPANCIES IN THE DIMENSIONS OR DRAWINGS PRIOR TO CONSTRUCTION.

B. ALL PROJECT CONSTRUCTION TO CONFORM WITH ANSI A117.1-1992 WHERE REQUIRED PER UBC 1994 EDITION. FEDERAL LAW REQUIRES THAT CONSTRUCTION MEET ALL REQUIREMENTS OF THE AMERICAN DISABILITIES ACT GUIDELINES.

C. ARCHITECTURAL FINISHED FIRST FLOOR ELEVATIONS ASSUMED TO BE 100'-0" REFER TO CIVIL FOR PAD ELEVATIONS

D. PROVIDE MOISTURE RESISTANT GYP. BOARD AT ALL WALLS WITHIN 2' OF FRONT AND SIDES OF URINAL AND WATER CLOSETS AND AT ALL WALLS WITHIN TUB / SHOWER ENCLOSURES PER UBC SECTION 807.1.2 AND 807.1.3

E. ALL DIMENSIONS ARE TO FACE OF STUD OR CMU WALL UNLESS NOTED OTHERWISE.

A-27 A2.2

KEY NOTES:

1 ROOF DRAIN AND OVERFLOW DAYLIGHT TO EXTERIOR. PROVIDE CONCRETE SPLASH BLOCK WHERE REQUIRED.
2 FIRE SPRINKLER RISER
3 UNDER COUNTER REFRIGERATOR.
4 LOCKER ROOM BENCH, SEE SPECS.
5 LOCKERS SEE SPECS.
6 CHAINLINK FENCE AND GATES
7 ROOF HATCH W/ ACESS LADDER.
8 FIRE EXTINGHISHER CABINET.
9 ELECTRIC WATER COOLER
10 PUBLIC PAY PHONE
11 SHELVING SEE INTERIOR ELEVATIONS
12 WALL/BASE CABINETS W/COUNTERTOP
13 H.C. POWER ASSIST. PEDESTAL
62A SIGN TYPES & ANNOTATION SEE SIGN SCHEDULE SHEET A4.0

ALONG GRID LINES 8 & 9 SHOULD BE 4" METAL STUD WALLS. THE NORTH WALL OF FITNESS ROOM 114 SHOULD BE 6" METAL STUD WALL.

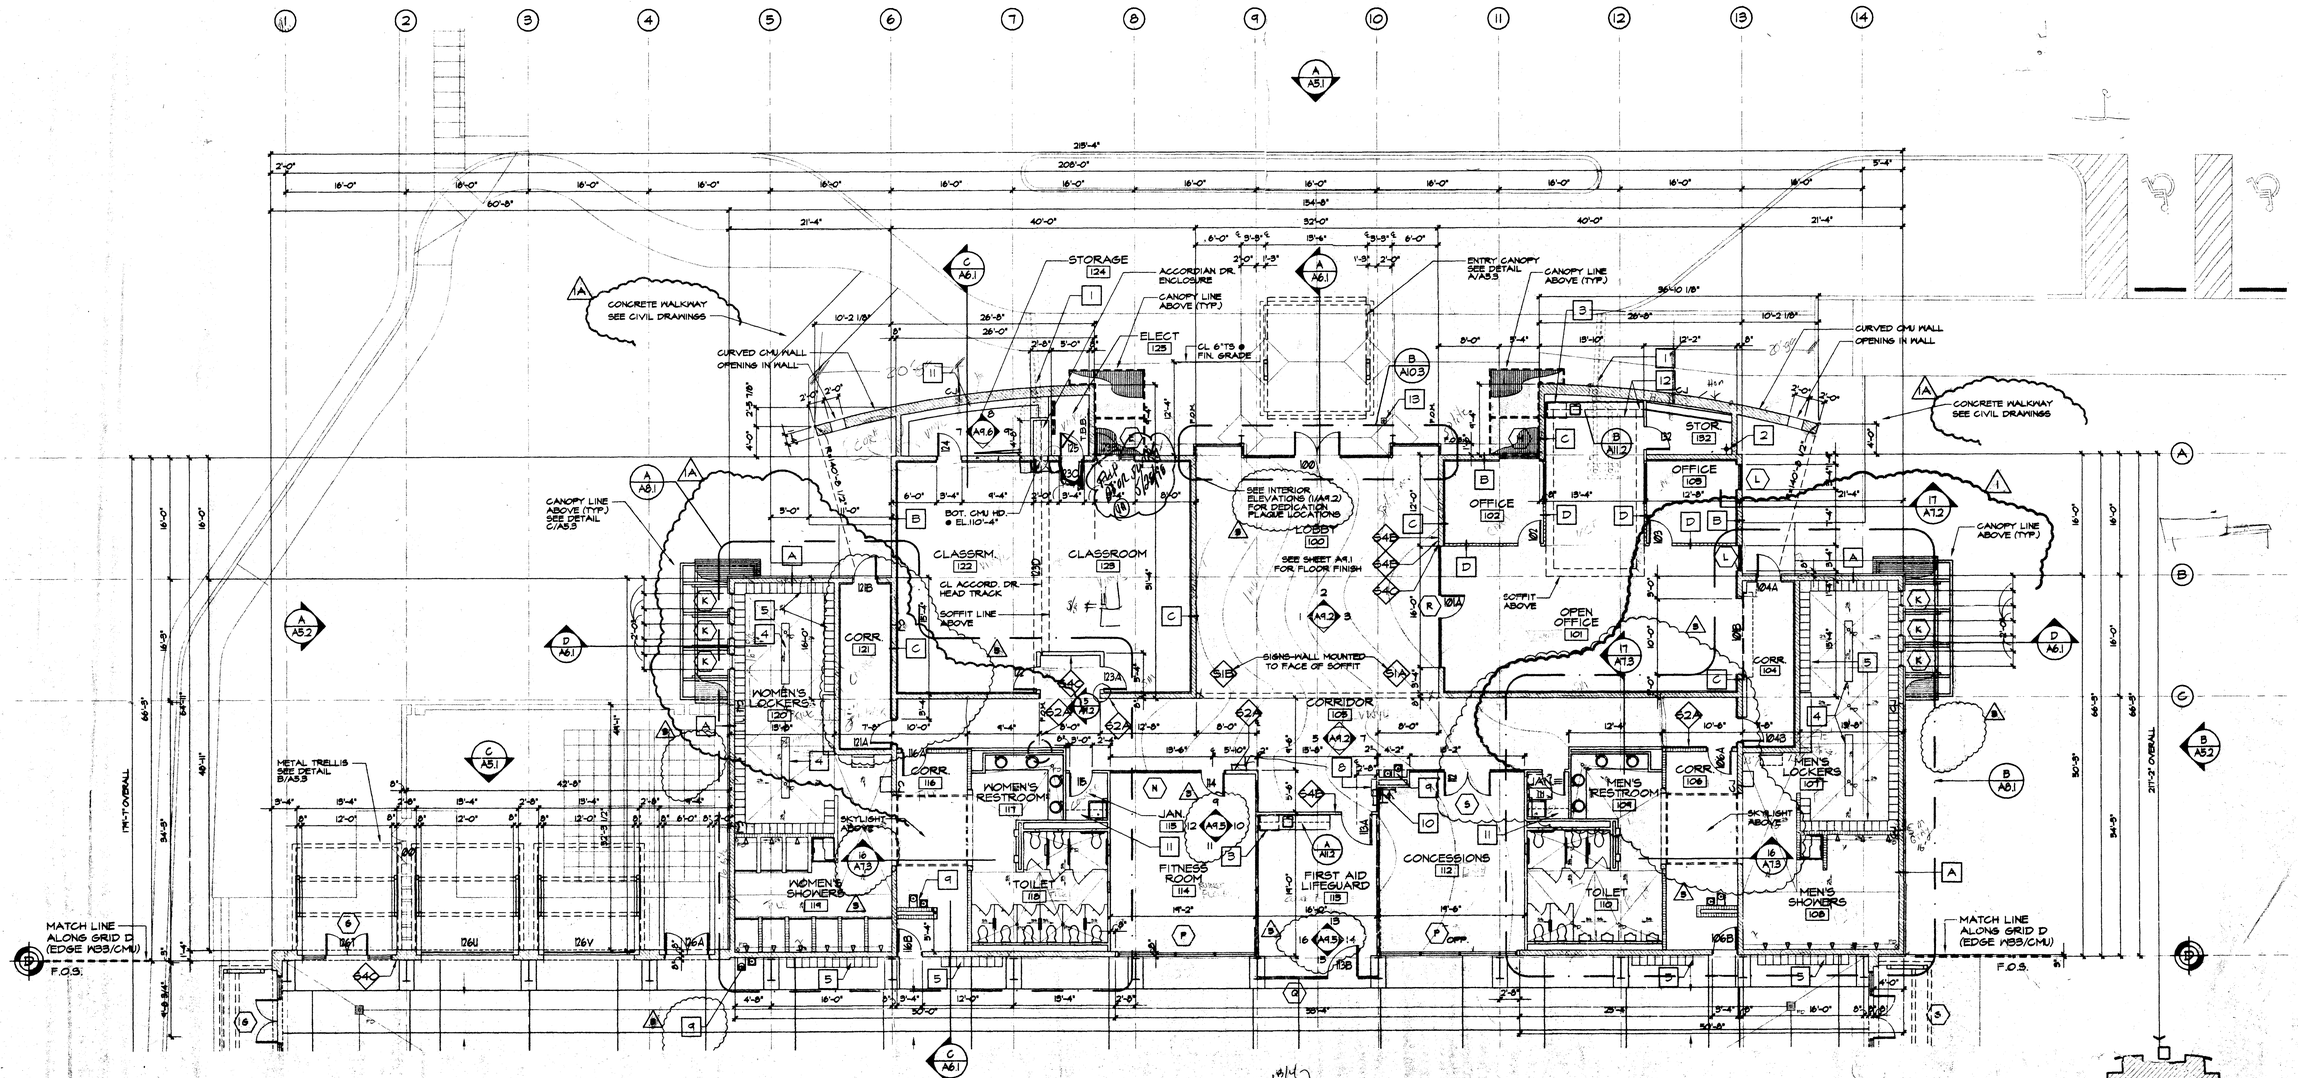

PARTIAL FLOOR PLAN - BATH HOUSE

1/8" = 1'-0"



BUILDING KEY PLAN

seal

revisions
1 PLAN CHECK COMMENTS 11-26-97
2 PLAN CHECK COMMENTS 12-17-97
3 COORDINATION / OWNER COMMENTS 2-26-98
4 ADDENDUM #1 3-11-98

Swisher & Hall Architects Architecture and Planning Copyright 1996 ©

SWISHER & HALL
A.I.A., LIMITED
ARCHITECTURE AND PLANNING
2801 NORTH TENAYA WAY, SUITE C
LAS VEGAS, NEVADA 89128
702.369.2222 702.369.6069 (FAX)

sheet title: PARTIAL FLOOR PLAN BATH HOUSE
job title: MUNICIPAL POOL AT DULA CENTER CITY OF LAS VEGAS

job no. 97004.00
date 1-26-98
drawn by SrB
checked by

issued for BID SET

sheet no. A2.2
22 Of 104

G74-22

J:\97004\DWGS\70440202.DWG Mon Feb 16 14:18:14 1998

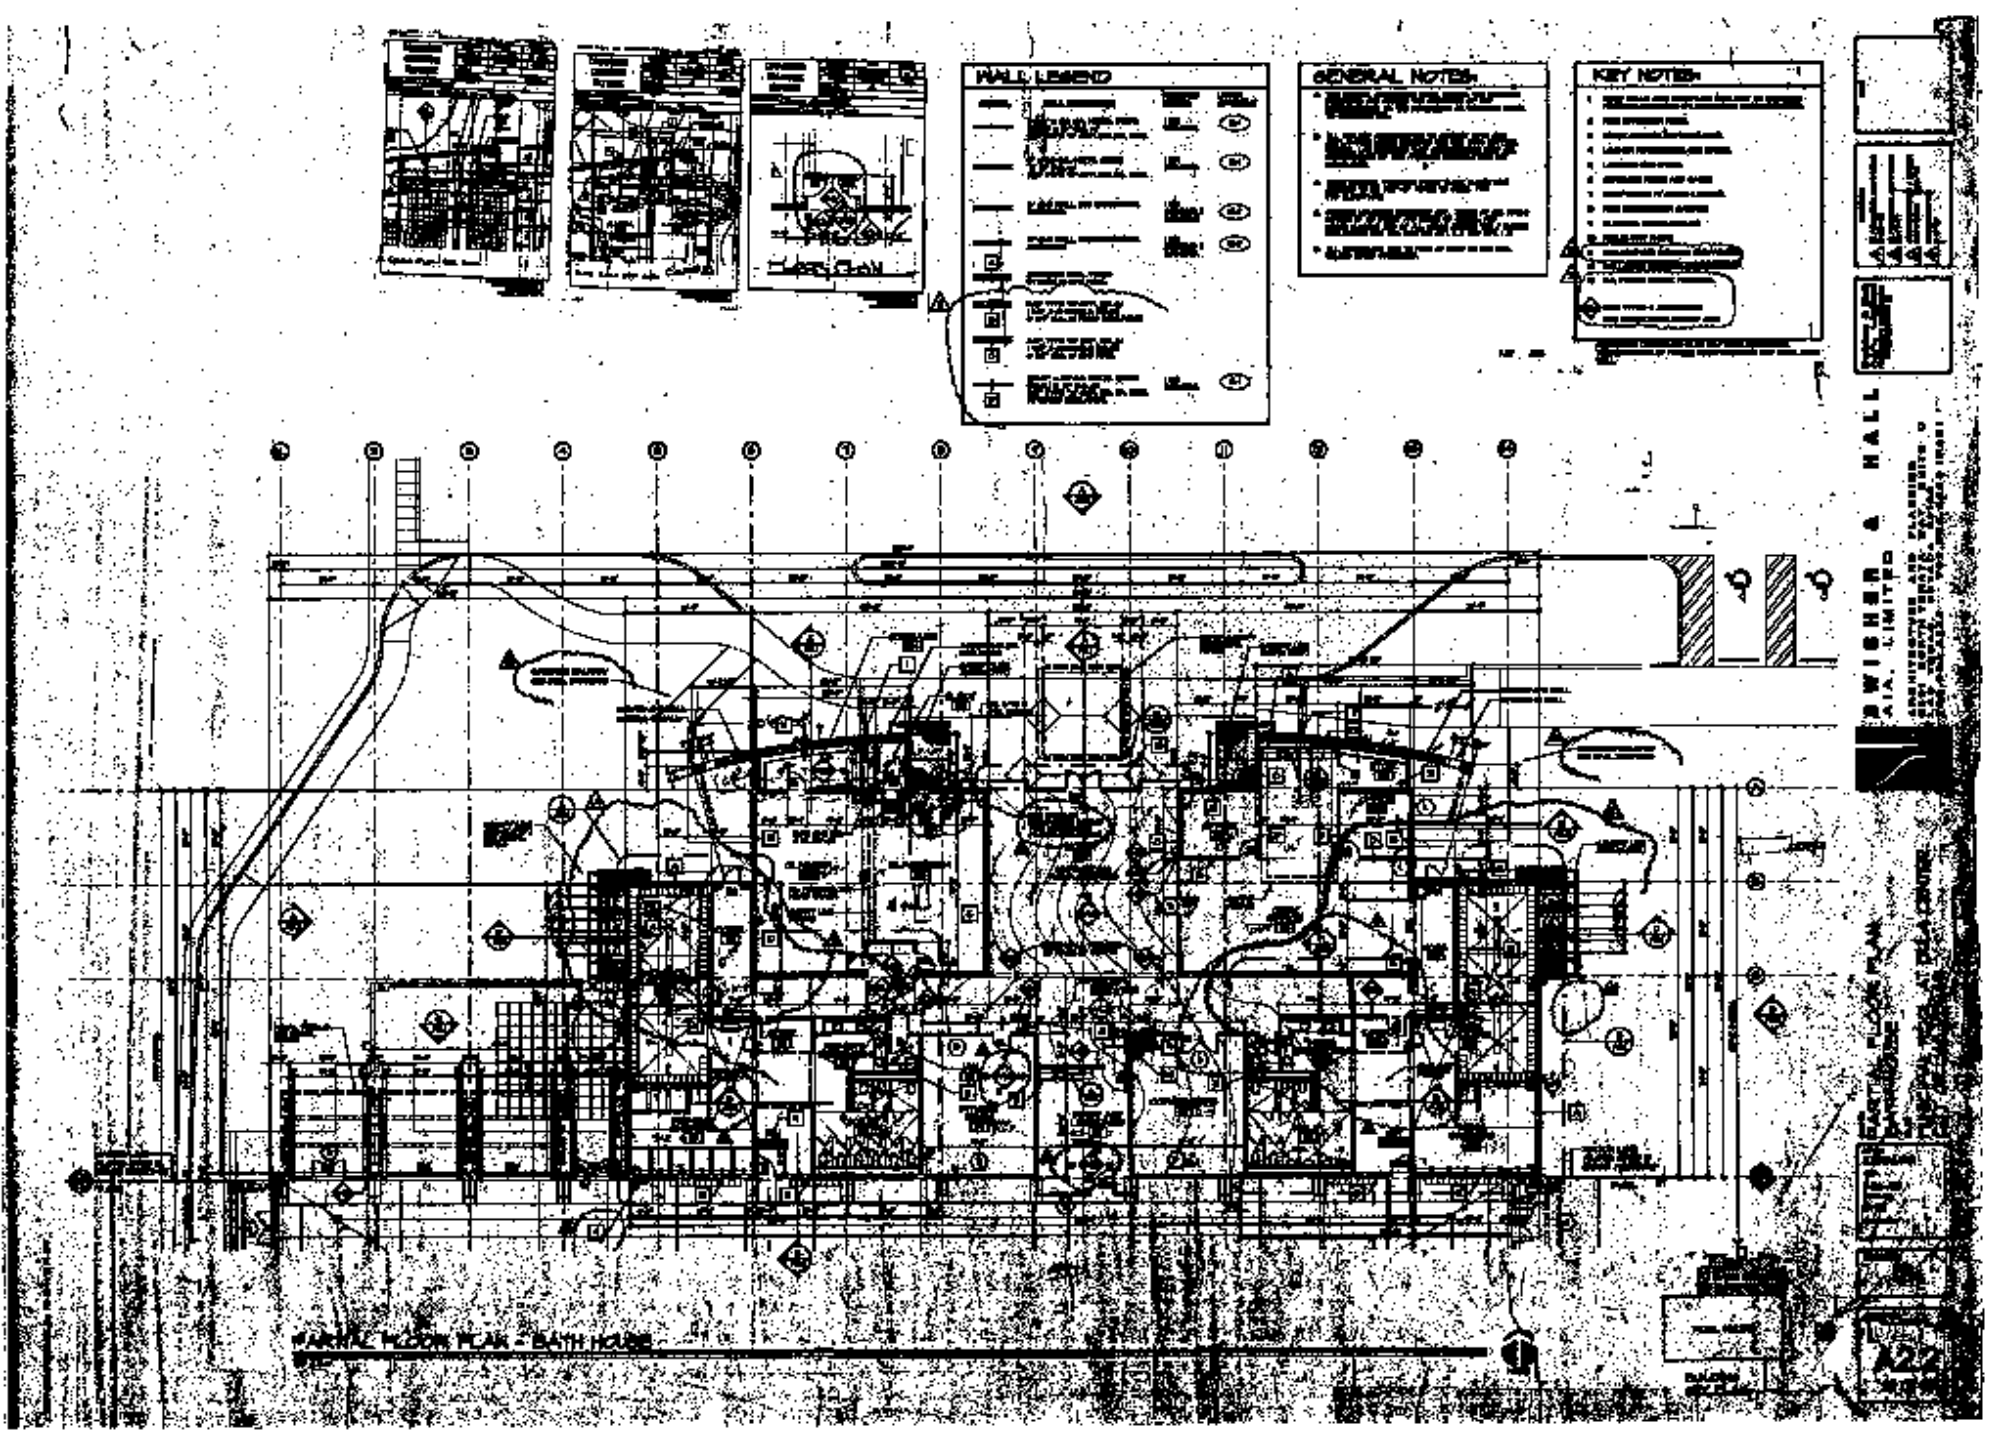
WALL LEGEND
GENERAL NOTES
KEY NOTES
PARTIAL FLOOR PLAN - BATH HOUSE
A2.2