


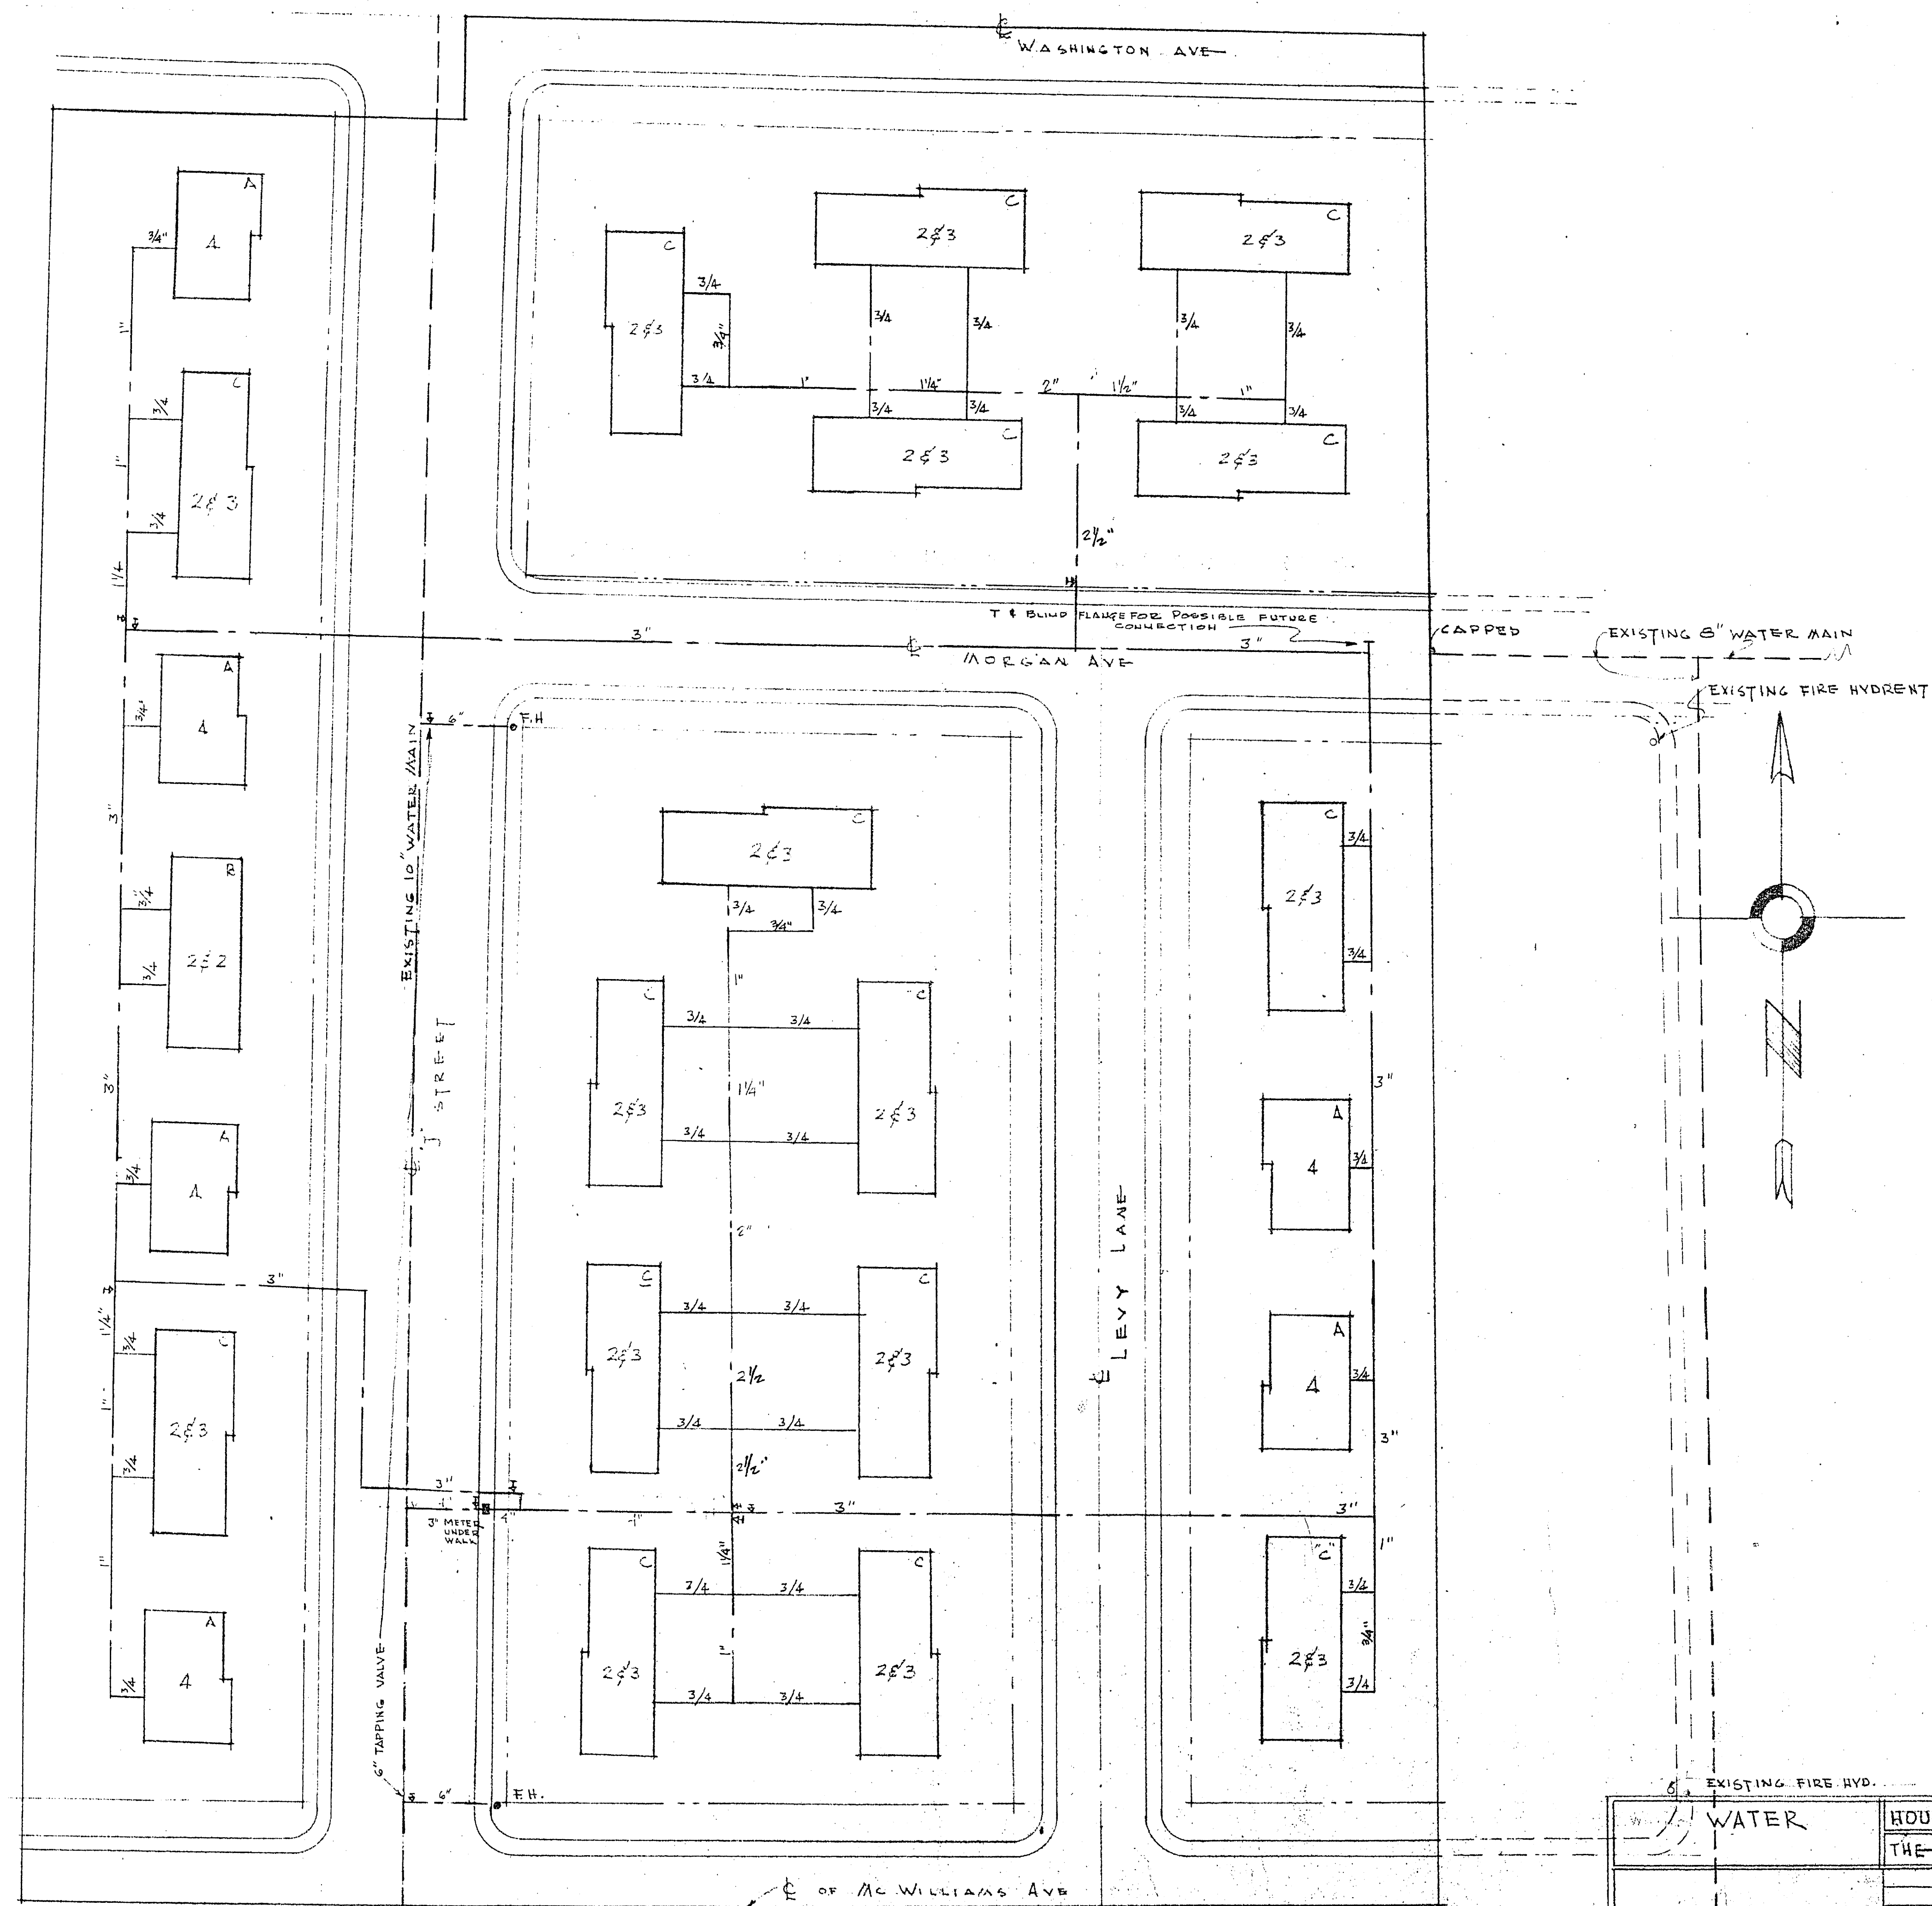

LEGEND


— WATER LINES - DOMESTIC

--- EXISTING WATER MAINS

--- WATER LINES TO FIRE HYDRENT


• FH FIRE HYDRENT

- NOTES:
1. ESTIMATED - WATER PRESSURE 35#
 2. PIPE 3" & LARGER SHALL BE CLASS 150 TRANSITE-PIPE 2 1/2" & SMALLER SHALL BE DIPPED & WRAPPED GALV. STEEL T. & C. PIPE
 3. FIRE HYDRENTS SHALL BE 6" C.I. CLASS 150 AND SHALL BE OBTAINED BY CONTRACTOR FROM LAS VEGAS CITY FIRE DEPARTMENT AND SHALL BE INSTALLED BY CONTRACTOR.
 4. WATER METER SHALL BE 3" SET IN CONC. VAULT UNDER SIDEWALK WITH CAST IRON LID.
 5. PROVIDE CONC ACCESS BOX WITH CAST IRON LID OVER ALL VALVES (SET LID FLUSH WITH FINISH GRADE).

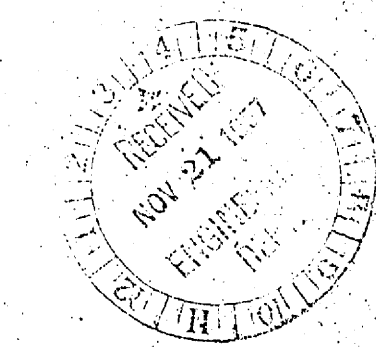

WATER		HOUSING PROJECT FOR THE HOUSING AUTHORITY OF THE CITY OF LAS VEGAS NEVADA		Job	DATE
		PROJECT NO. NEV. 2-2		8-5-57	
ELMO C. BRUNER A.I.A. ARCHITECT DU 4-0370 903 No. 5TH - LAS VEGAS - NEVADA		DRAWN BY		J.B.	
		CHECKED BY			
		SHEET OR		5-8	11
REVISIONS		VERIFY ALL DIMENSIONS ON THE SITE			

SCALE 1" = 30'-0"



1. This plan shows the layout of the building and the location of the various rooms and corridors.
 2. The rooms are labeled with numbers and the corridors are labeled with letters.
 3. The plan is oriented with North at the top.

4. The plan is a simplified representation of the actual building and should not be used for detailed architectural purposes.
 5. The plan is intended to provide a general overview of the building layout and to show the relative positions of the various rooms and corridors.

