


- WATER NOTES**
1. ALL WORK TO CONFORM TO LAS VEGAS VALLEY WATER DISTRICT STANDARD PRACTICES.
 2. ALL WORK, EXCEPT AS NOTIFIED HEREOF BY THIS SPECIFICATION, SHALL BE DONE IN ACCORDANCE WITH THE MOST CURRENT EDITION OF THE "STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OF OFF-SITE IMPROVEMENTS", CLAY COUNTY AREA.
 3. NOTICE TO BE GIVEN ENGINEERING DEPARTMENT OF THE LAS VEGAS VALLEY WATER DISTRICT 48 HOURS PRIOR TO ACTUAL CONSTRUCTION.
 4. SERVICE SADDLES OR TAPPED COLLARS WILL BE REQUIRED ON ALL 3/4\"/>

- FIRE DEPARTMENT NOTES**
1. FIRE HYDRANTS TO BE PROVIDED IN ACCORDANCE WITH STANDARD PRACTICE NO. 27 WHERE INDICATED AND AS FOLLOWS: (A) OVER ALL RIGHTS MUST BE INSTALLED AT 6 FEET FROM BACK OF CURB. (B) OVER ALL SERVICE LATERALS MUST BE INSTALLED AT RIGHT ANGLES TO MAINS.
 2. FOR CURVED LINES WITH RADIUS OVER 300', 12\"/>

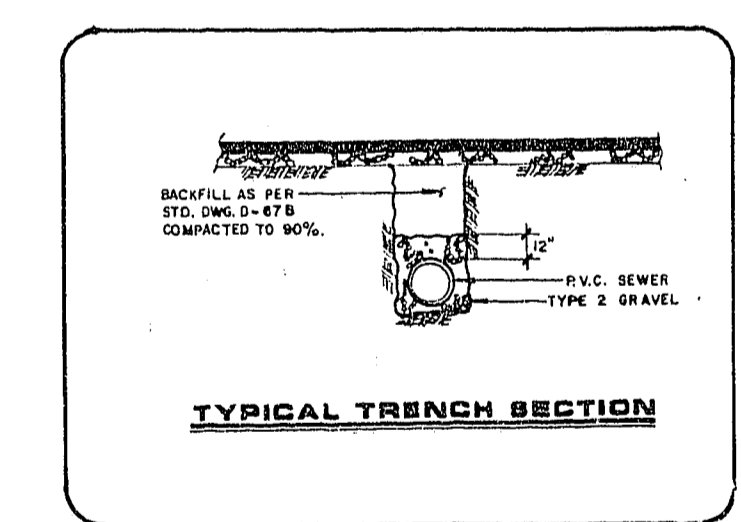




Avoid cutting underground utility lines. It's costly.

Call before you Dig.

1-800-227-2600
UNDERGROUND SERVICE USA

WATER QUANTITIES

1. STANDARD FIRE HYDRANT W/6\"/>	22 EA
2. 10\"/>	3260 LF
3. 8\"/>	5600 LF
4. 6\"/>	3150 LF
5. 4\"/>	245 LF
6. 2\"/>	4 EA
7. 2\"/>	4 EA
8. 1\"/>	149 EA
9. 1\"/>	149 EA

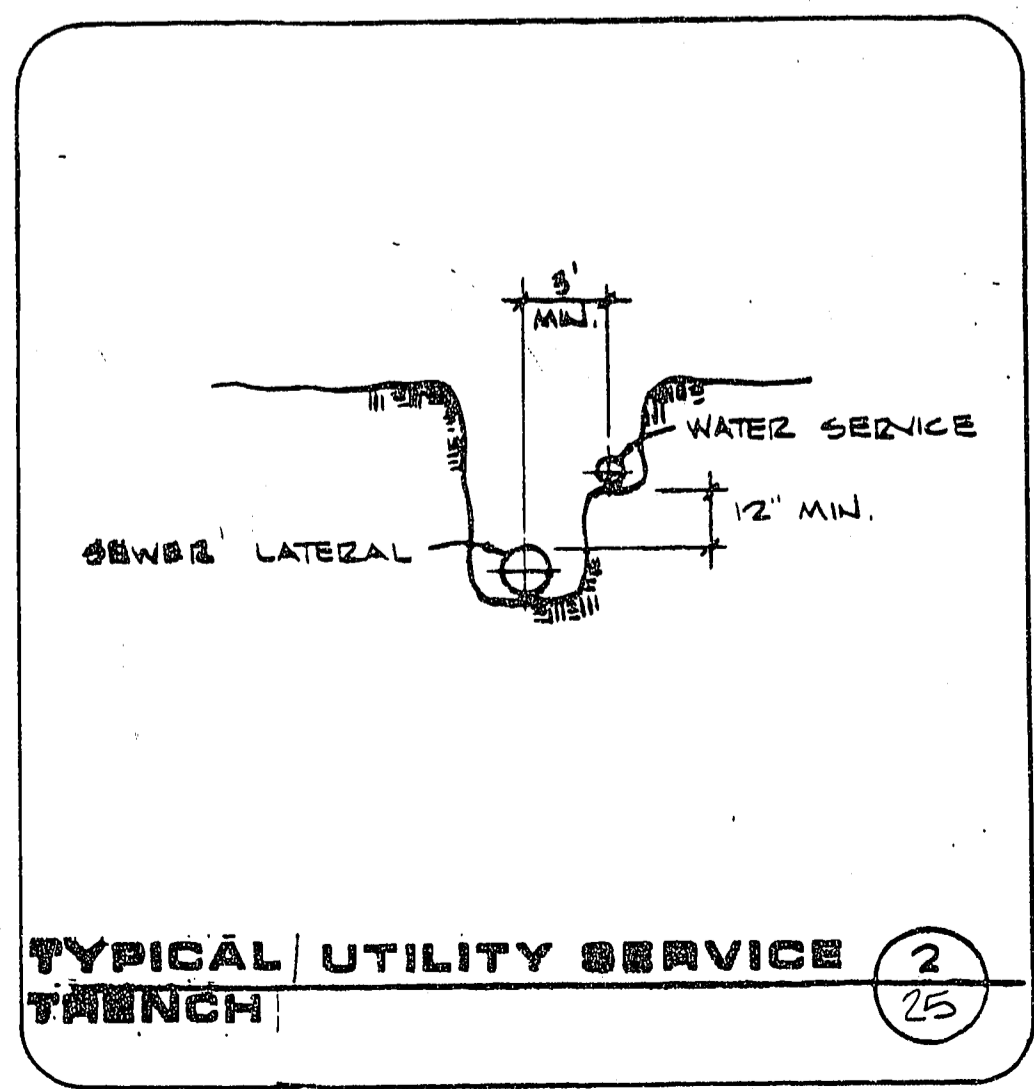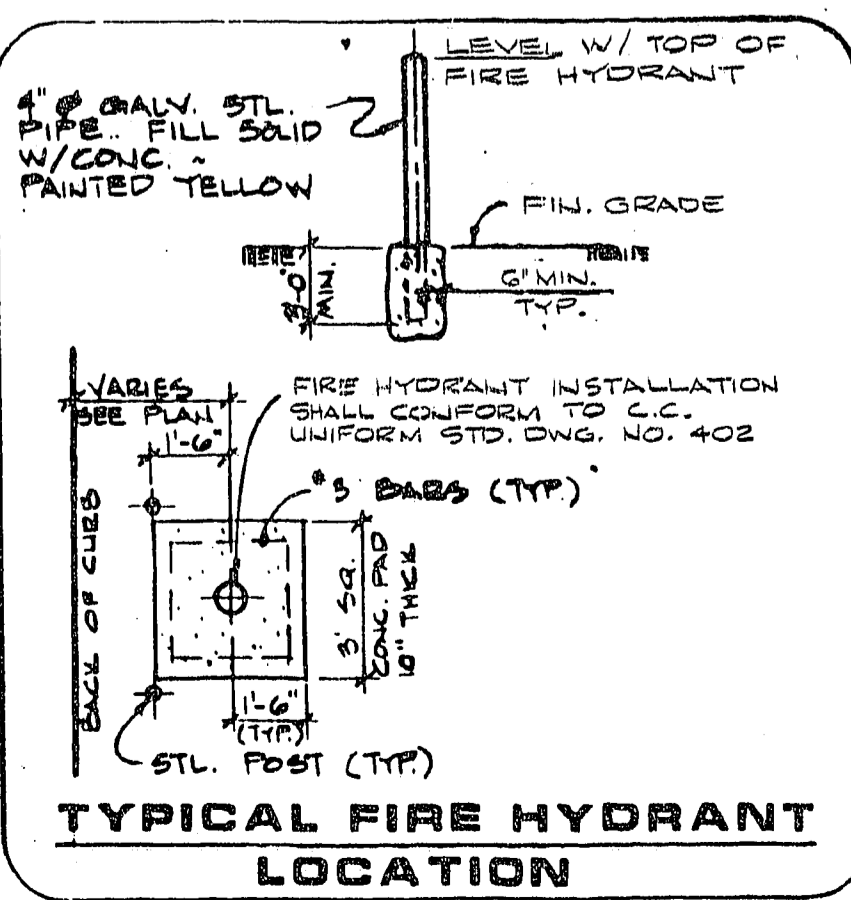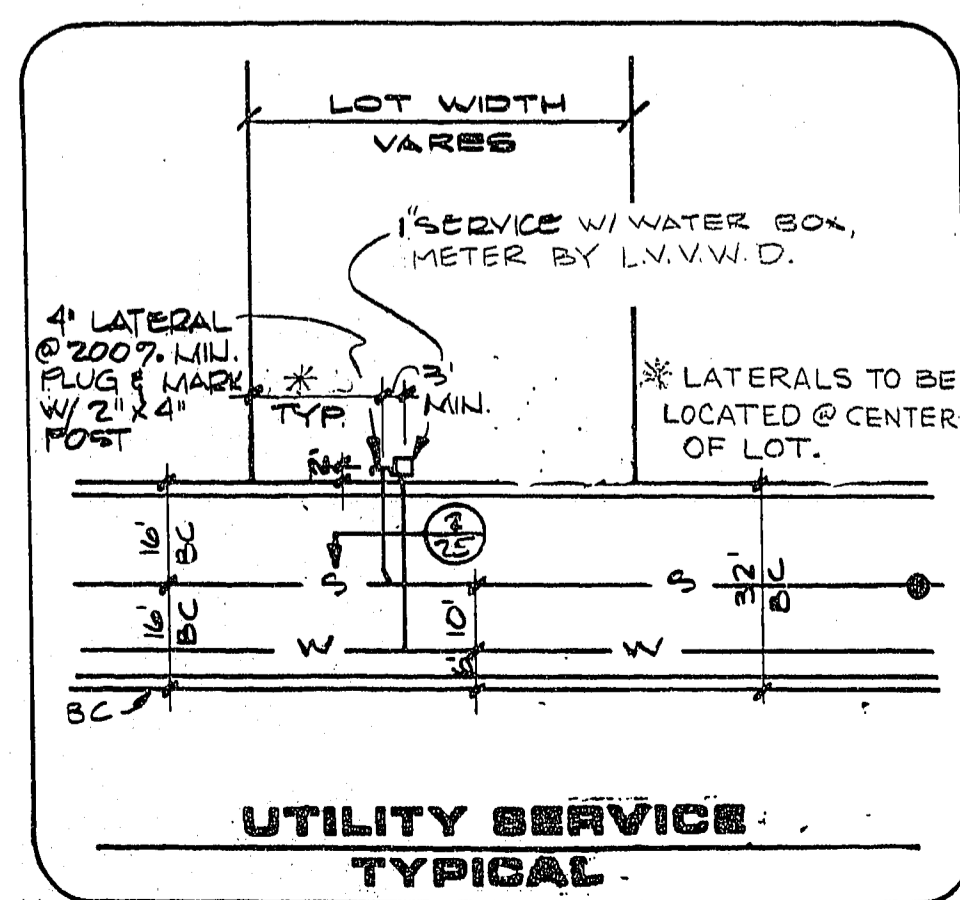

APPROVALS

NEVADA POWER COMPANY approves the point of service to the street light system. This shall not be deemed to consent to the placement of the light poles which may be in conflict with Nevada Power Company's prior rights and/or facilities.

T/8/87
(Date)
BY NEVADA POWER COMPANY

Don A. Donna 14 7/1/87
LAS VEGAS VALLEY WATER DISTRICT DATE

CLV CHIEF LAND DEVELOPMENT AND FLOOD CONTROL 8/10/87 DATE

REVISIONS

REV	DATE	DESCRIPTION
1	7/1/87	ISSUED FOR PERMITS
2	7/1/87	ISSUED FOR PERMITS
3	7/1/87	ISSUED FOR PERMITS
4	7/1/87	ISSUED FOR PERMITS

DESIGNED BY: DANIEL A. WALLACE
CHECKED BY: DANIEL A. WALLACE
DATE: 7/1/87

FOOTHILLS COUNTRY CLUB UNIT NO. 2 AT PECCOLE RANCH UTILITY PLAN NOTES & MISCELLANEOUS

G.C. WALLACE, INC. Engineering/Architecture
1555 SOUTH RAINBOW BLVD. LAS VEGAS, NEVADA 89102

SHEET 25 OF 36 SHEETS

JOB NO. 543.324