



SUMMER - WINTER CHANGEOVER CONTROL
NO SCALE

LEO18B1008 CHANGE OVER STAT 55-85 RANGE SET: 85°

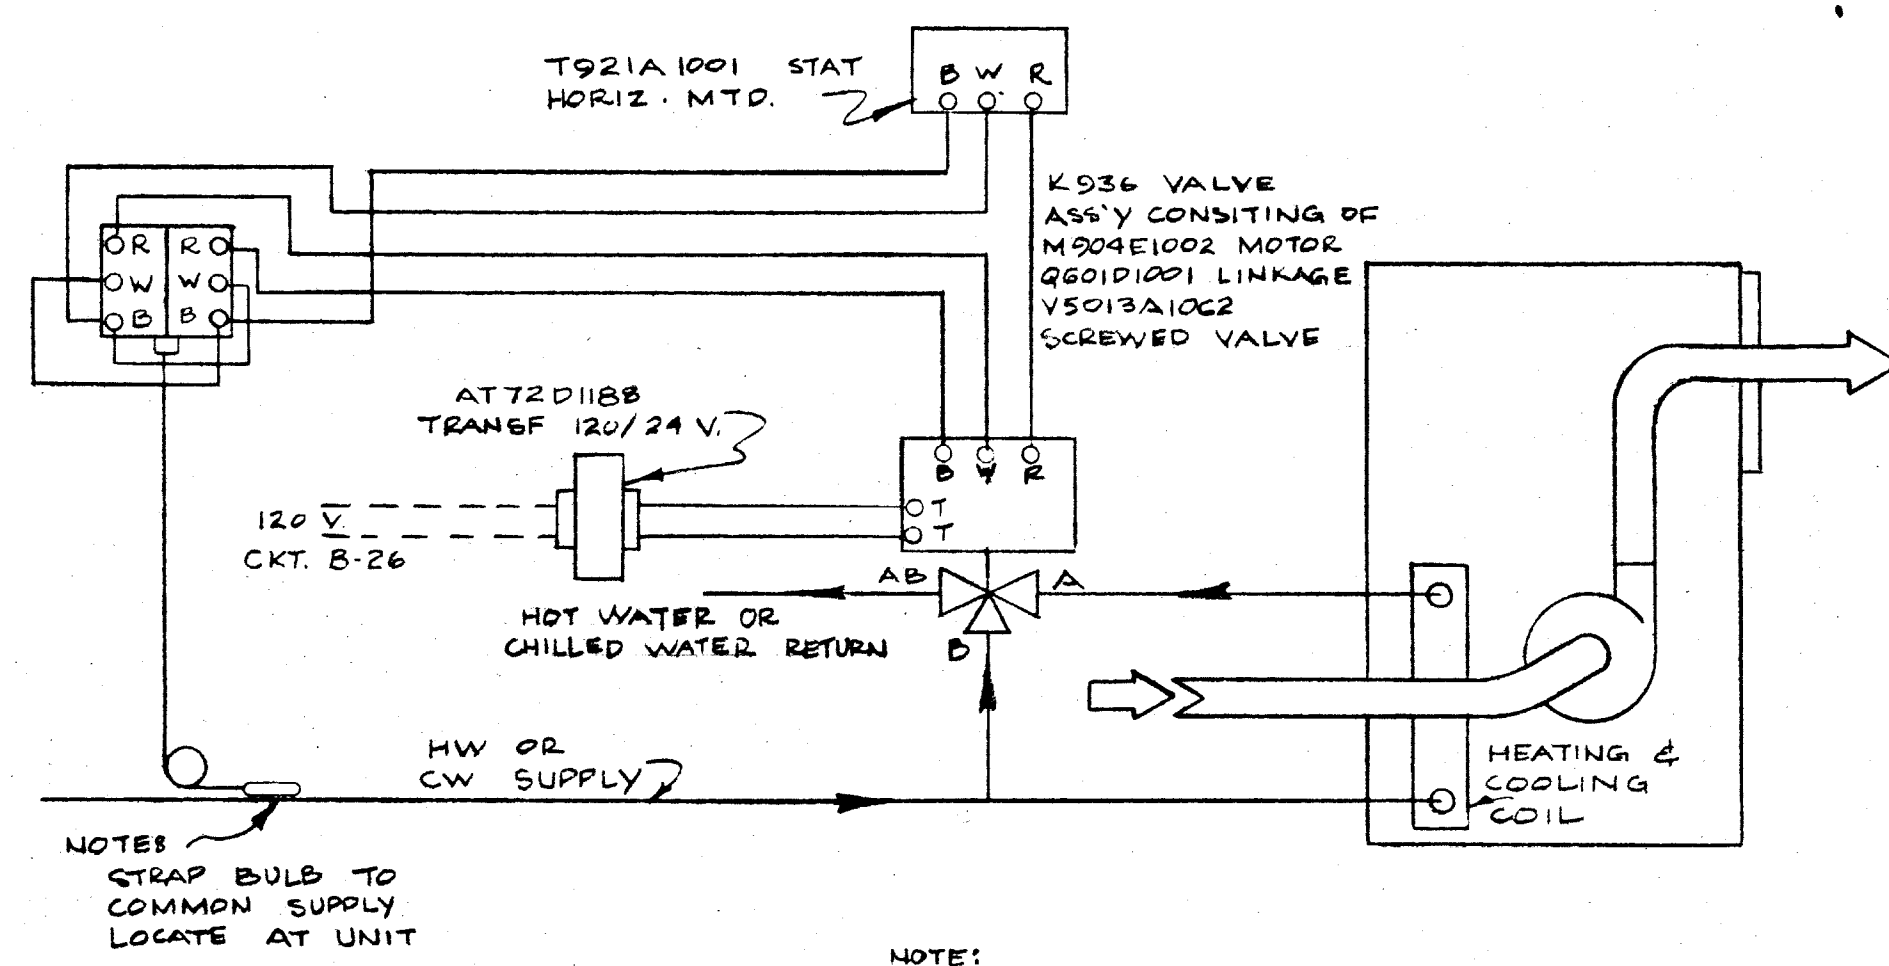



A.C. #1 & #2 CONTROL
NO SCALE

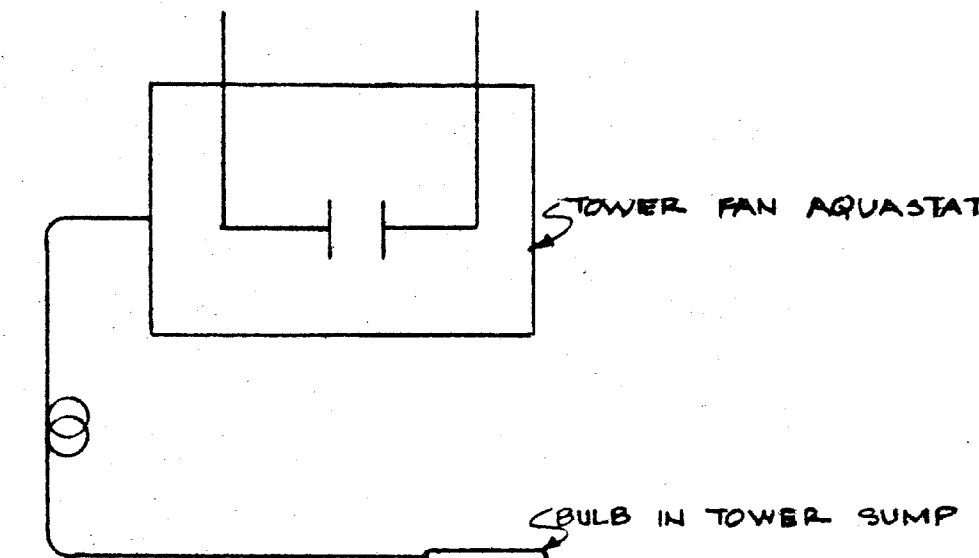

TOWER FAN CONTROL
NO SCALE

GRILLE, REGISTER & DIFFUSER SYMBOLS			
SYMBOL	DESCRIPTION	ACCESSORIES	REMARKS
	SUPPLY REGISTER	OPPOSED BLADE DAMPER EXTRACTOR WHEN SHOWN	T-647
	SUPPLY GRILLE	EXTRACTOR WHEN SHOWN	T-647
	RETURN OR EXHAUST REGISTER	OPPOSED BLADE DAMPER	T-78
	RETURN OR EXHAUST GRILLE		T-70F
	ROUND SUPPLY DIFFUSER	EXTERNALLY ADJUSTABLE VOLUME CONTROL DAMPER, EQUALIZING GRID	PA
	ROUND SUPPLY DIFFUSER	EXTERNALLY ADJUSTABLE VOLUME CONTROL DAMPER, EQUALIZING GRID	P5
	SQUARE SUPPLY DIFFUSER	EXTERNALLY ADJUSTABLE VOLUME CONTROL DAMPER, EQUALIZING GRID	3-WAY DAMP
	RECTANGULAR DIFFUSER	EXTERNALLY ADJUSTABLE VOLUME CONTROL DAMPER, EQUALIZING GRID	
	DOOR GRILLE	FLANGES BOTH SIDES	T-08 W

1. THE ABOVE NUMBERS APPLY TO T&B REGISTERS
2. FLOOR REGISTERS BASED ON T&B AEROLINE SERIES.

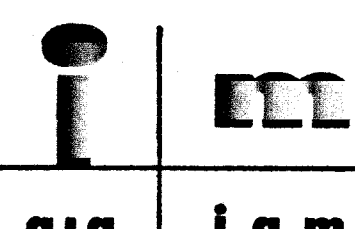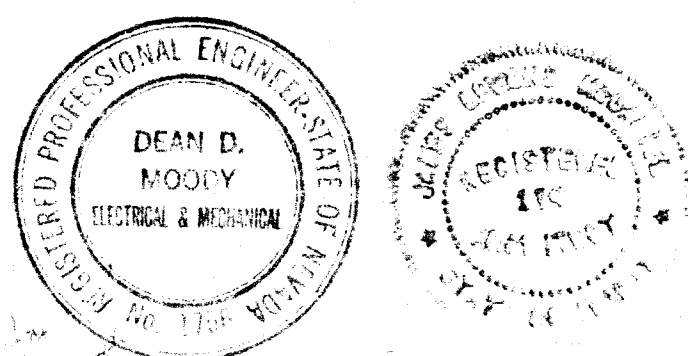

James Brooks McDaniel Architect
Maryland Parkway & Boulevard du Montparnasse 382-4350

Job title: RECREATION CENTER
CITY OF LAS VEGAS
LAS VEGAS NEVADA

Drawn by: KVV
Checked by: EAA
Job number: 52-12
Scale: AS NOTED
Date: MARCH 5, 1968

AIR CONDITIONING 513-278

CONTROLS 513-278

24-BULB DRAWINGS MAY 8, 1968

no. date revision by chk
1
2
3

sheet number

M3