



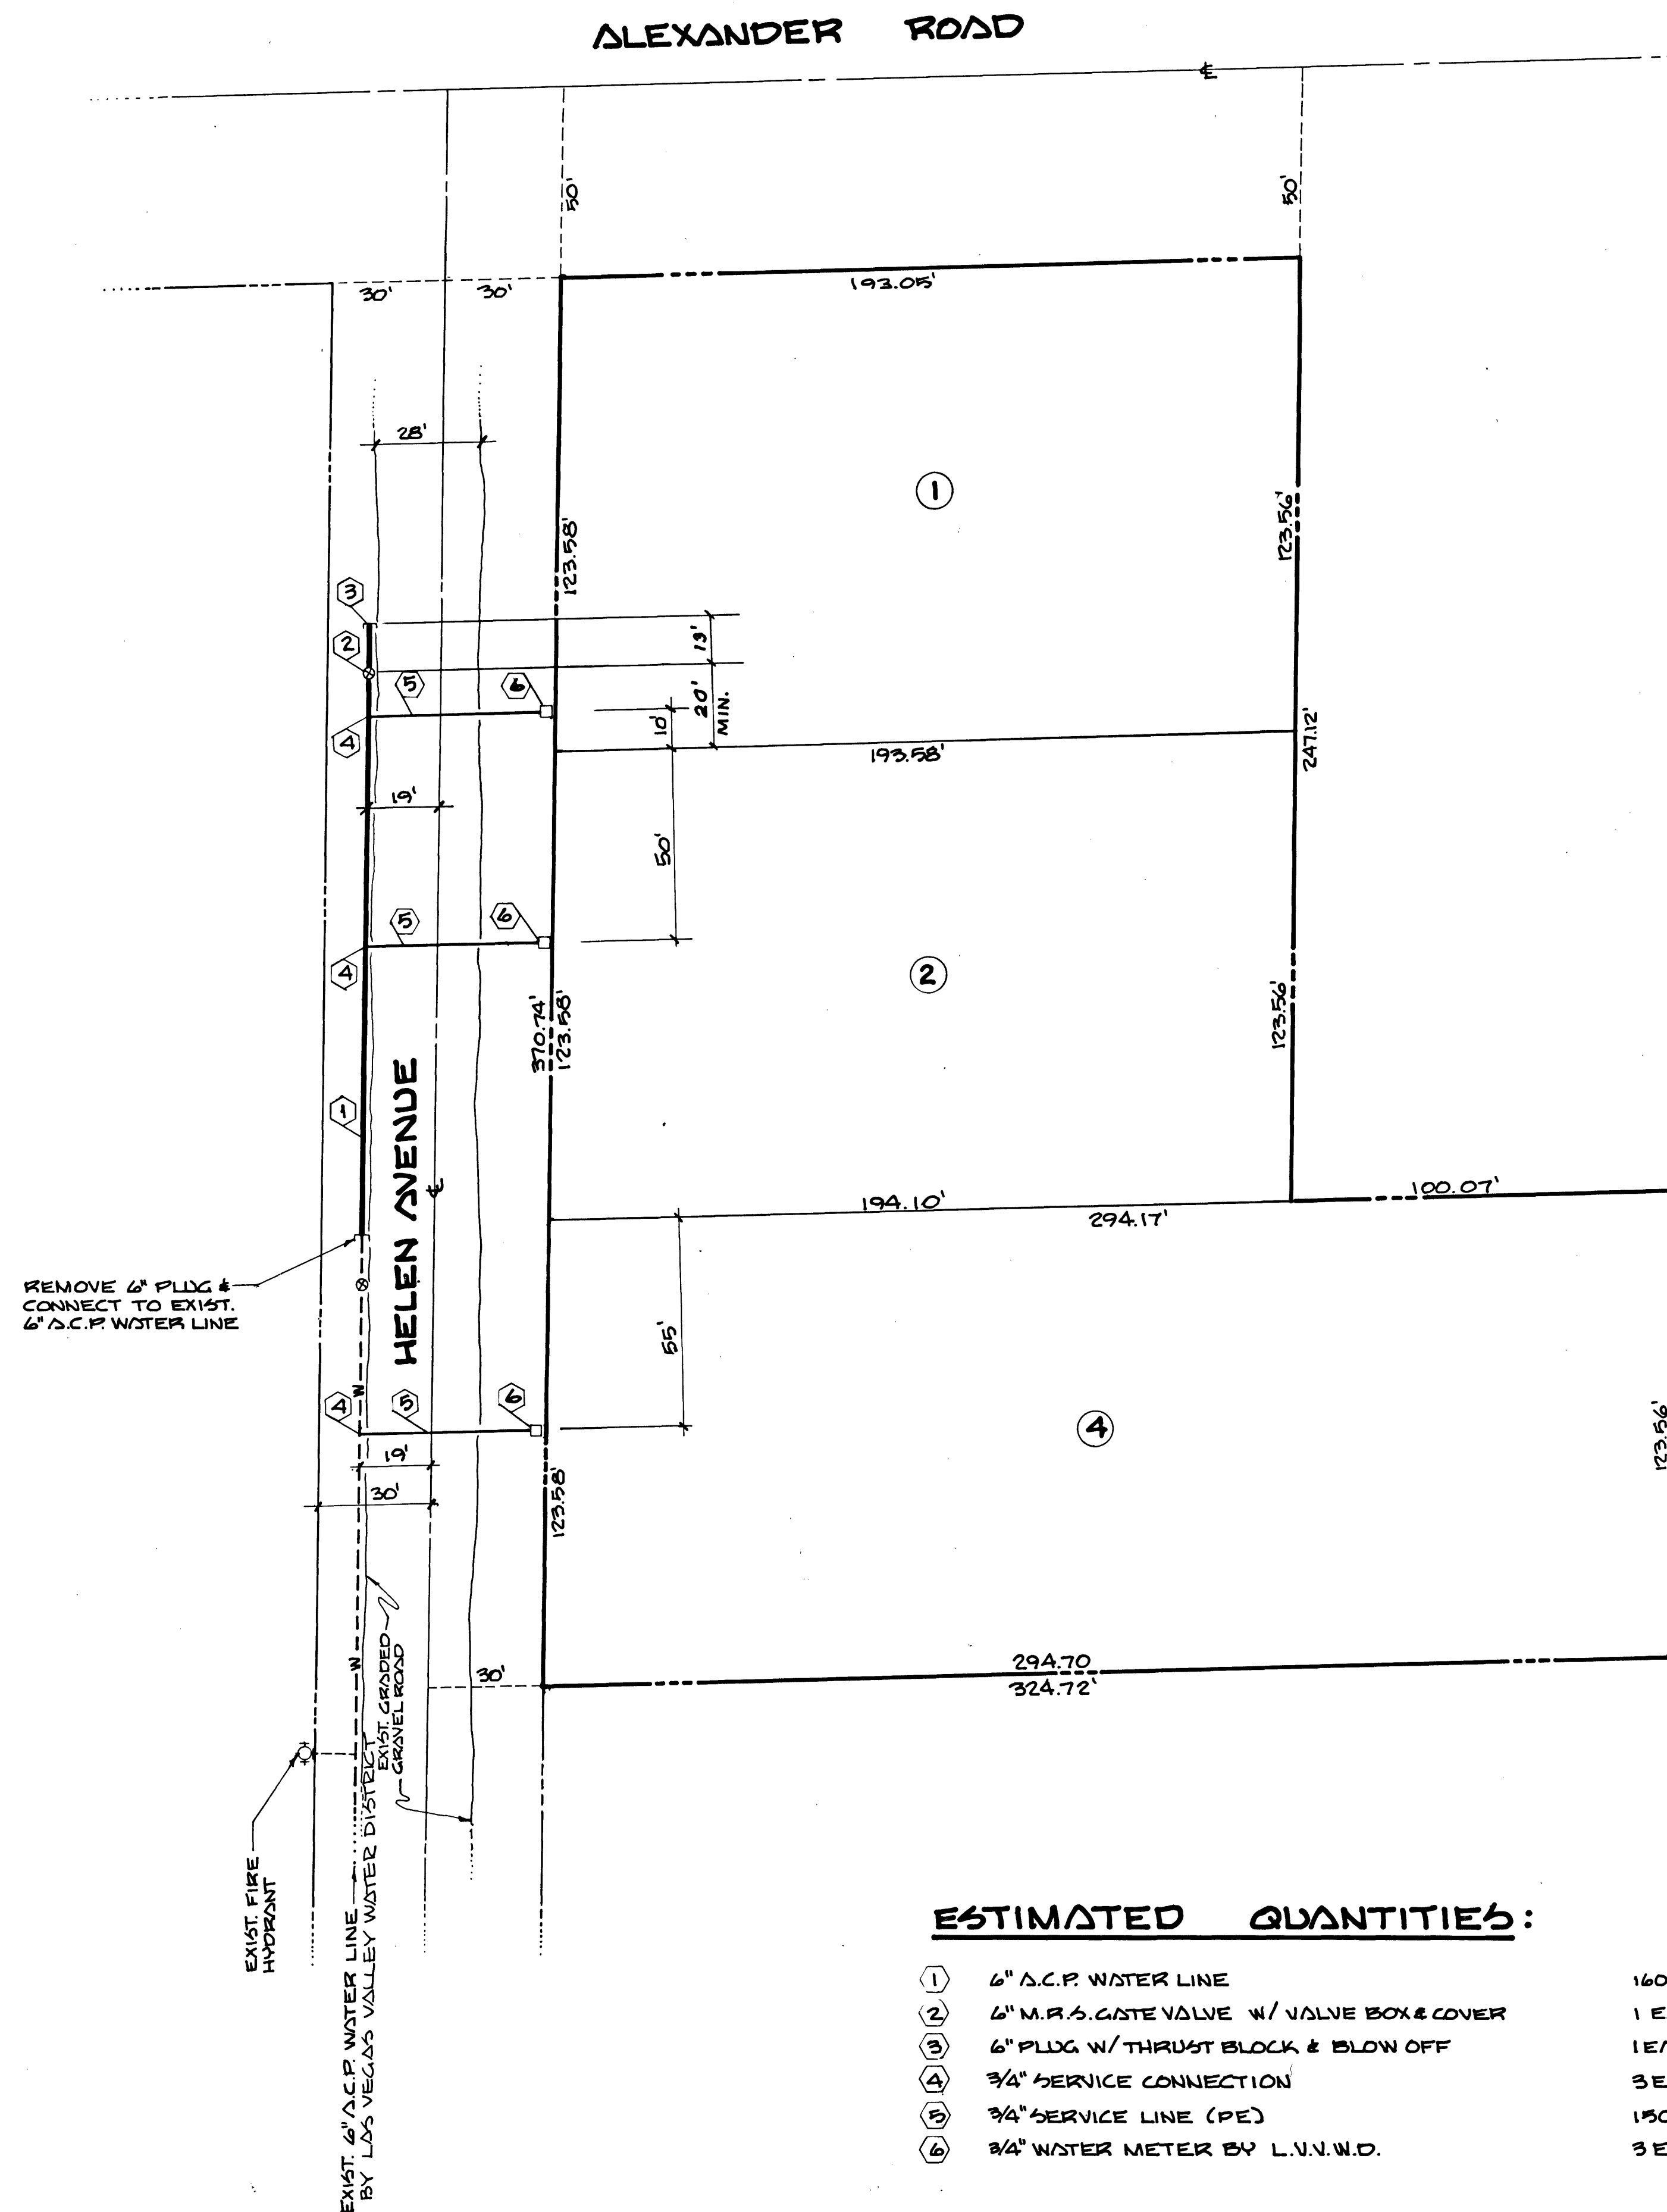


ESTIMATED QUANTITIES:

①	6" A.C.P. WATER LINE	160 L.F.
②	6" M.P.S. GATE VALVE W/ VALVE BOX & COVER	1 EA.
③	6" PLUG W/ THRUST BLOCK & BLOW OFF	1 EA.
④	3/4" SERVICE CONNECTION	3 EA.
⑤	3/4" SERVICE LINE (PE)	150 L.F.
⑥	3/4" WATER METER BY L.V.V.W.D.	3 EA.

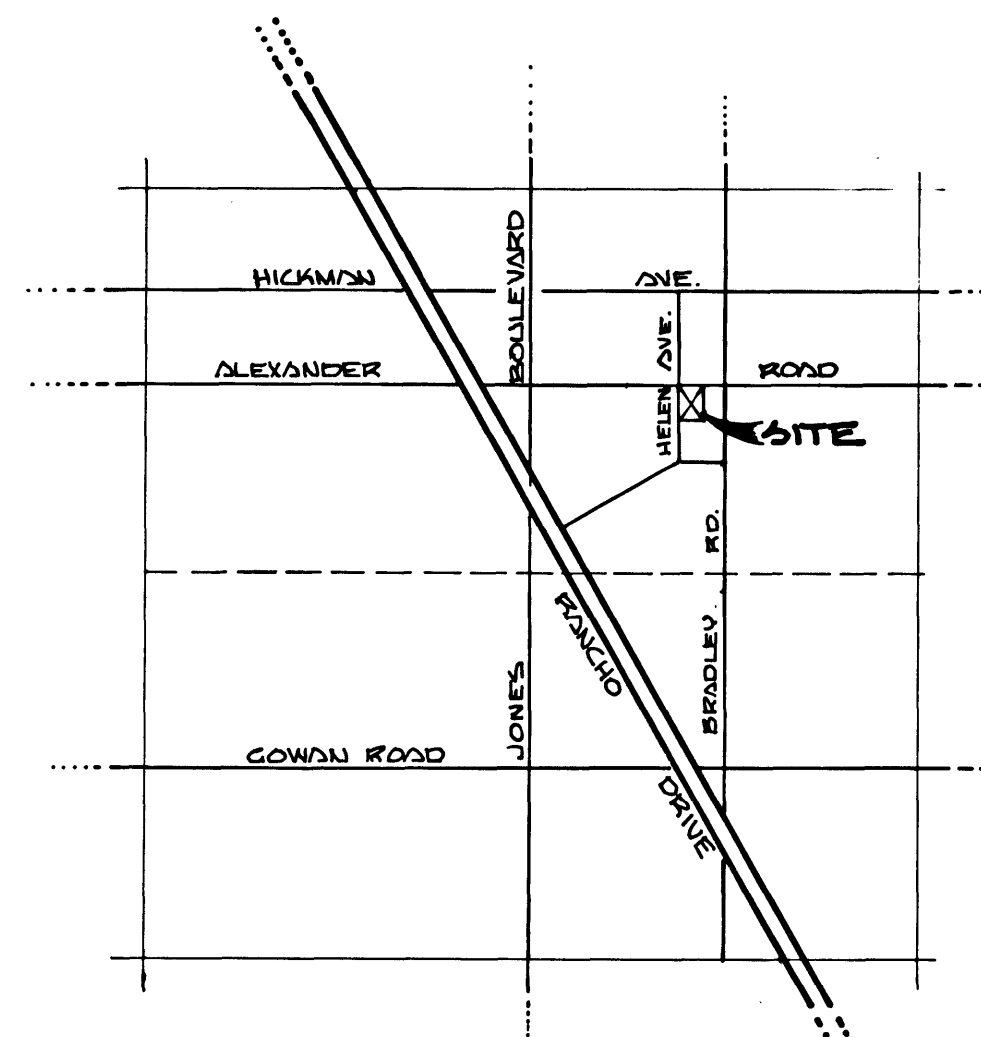

VICINITY MAP
NO SCALE

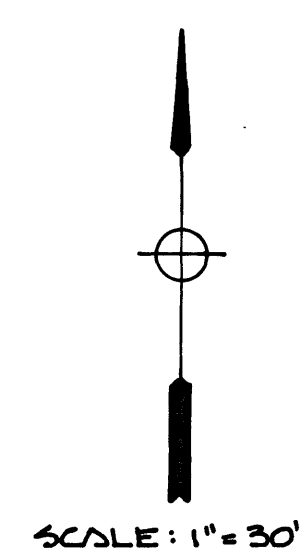

WATER LINE NOTES:


- All work to conform to Las Vegas Valley Water District standard plates.
- All work, except as modified hereon or by Note No. 1 shall be done in accordance with the most current draft or edition of Uniform Standard Specifications for Public Works Construction Offsite Improvements Clark County Area.
- Notice to be given Engineering Department of the Las Vegas Valley Water District 48 hours prior to actual construction.
- Service saddles or tapped collars will be required on all services, double tap collars are not permitted.
- All lines to be pressure tested to 200 psi.
- All valve boxes shall have concrete collars at surface of paved areas.
- Deflection angle shall not exceed 2 1/4 degrees per 13 foot section of pipe for pipe sizes smaller than 14 inches and shall not exceed 2 degrees for pipe sizes between 14" and 16".
- All meters shall be located outside of driveways.
- Detector tape required in accordance with Standard Plate No. 27 where indicated and as follows:
 - Over all mains not installed at 4 feet from back of curb.
 - Over all service laterals not installed at right angles to mains.
- Service laterals for lot 4 will be tapped on existing main by owner's contractor under direction of the Las Vegas Valley Water District.

APPROVALS:

<i>[Signature]</i>	8-1-78
CITY OF LAS VEGAS FIRE DEPT.	DATE
<i>[Signature]</i>	8-18-78
CLV. QUALITY CONTROL ENGINEER	DATE
<i>[Signature]</i>	10-11-78
LAS VEGAS VALLEY WATER DIST.	DATE
<i>[Signature]</i>	8-21-78
CLV FIELD OPERATIONS ENGINEER	DATE

RESIDENTIAL:

FIREFLOW - 150 G.A.L. / MIN.
AREA - 1.93 ACRES

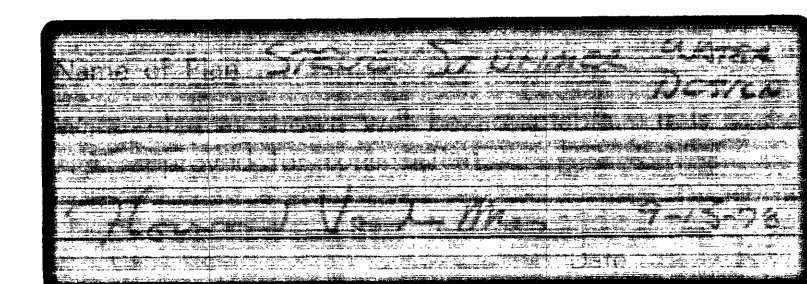

NOTE: UTILITY INFORMATION WAS DERIVED FROM DATA FURNISHED BY UTILITY COMPANIES' CONTRACTOR. MUST CONFIRM LOCATION OF UTILITIES BEFORE COMMENCING EXCAVATION.



DATE	7/25/78	DESIGN	A.M.	DRAWN	J.H.B.	CHECK	A.M.	SCALE	1"=30'
	DATE								
PREPARED FOR:	STEVE STUDMER								
DATE	7/25/78								
DESIGN	BAUGHMAN & TURNER								
DRAWN	MINING ENGINEERS								
CHECK	LAND SURVEYORS								
SCALE	LAS VEGAS, NEVADA 89102								
2335 WEST CHARLSTON BOULEVARD 702-870-8771									
WATER DESIGN SECTION 12, TOWNSHIP 20 SOUTH, RANGE 60 EAST, M.D.B. & M. CITY OF LAS VEGAS, CLARK COUNTY, NEVADA									
SHEET 1 OF 1 PROJ. NO.									

XC 1771 565-114 OS334

