
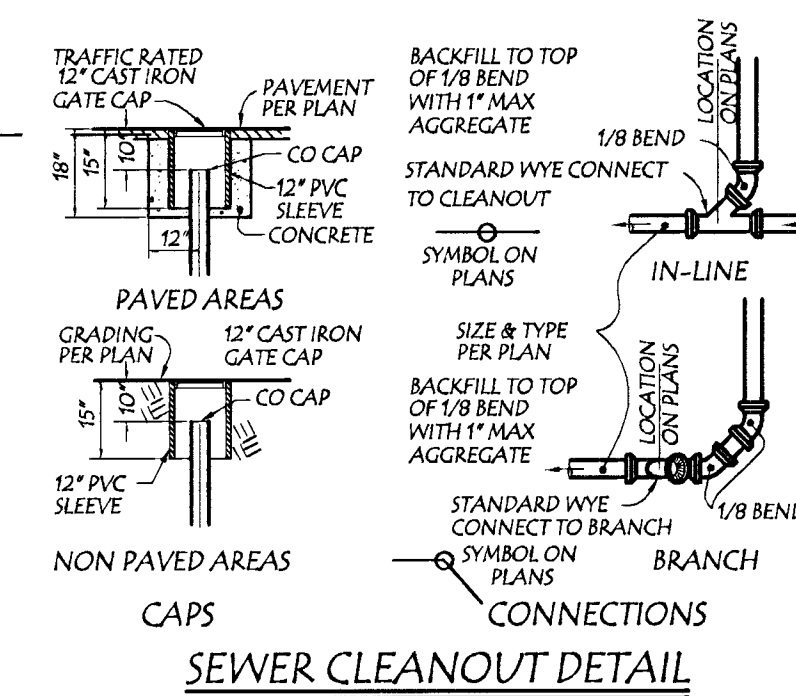


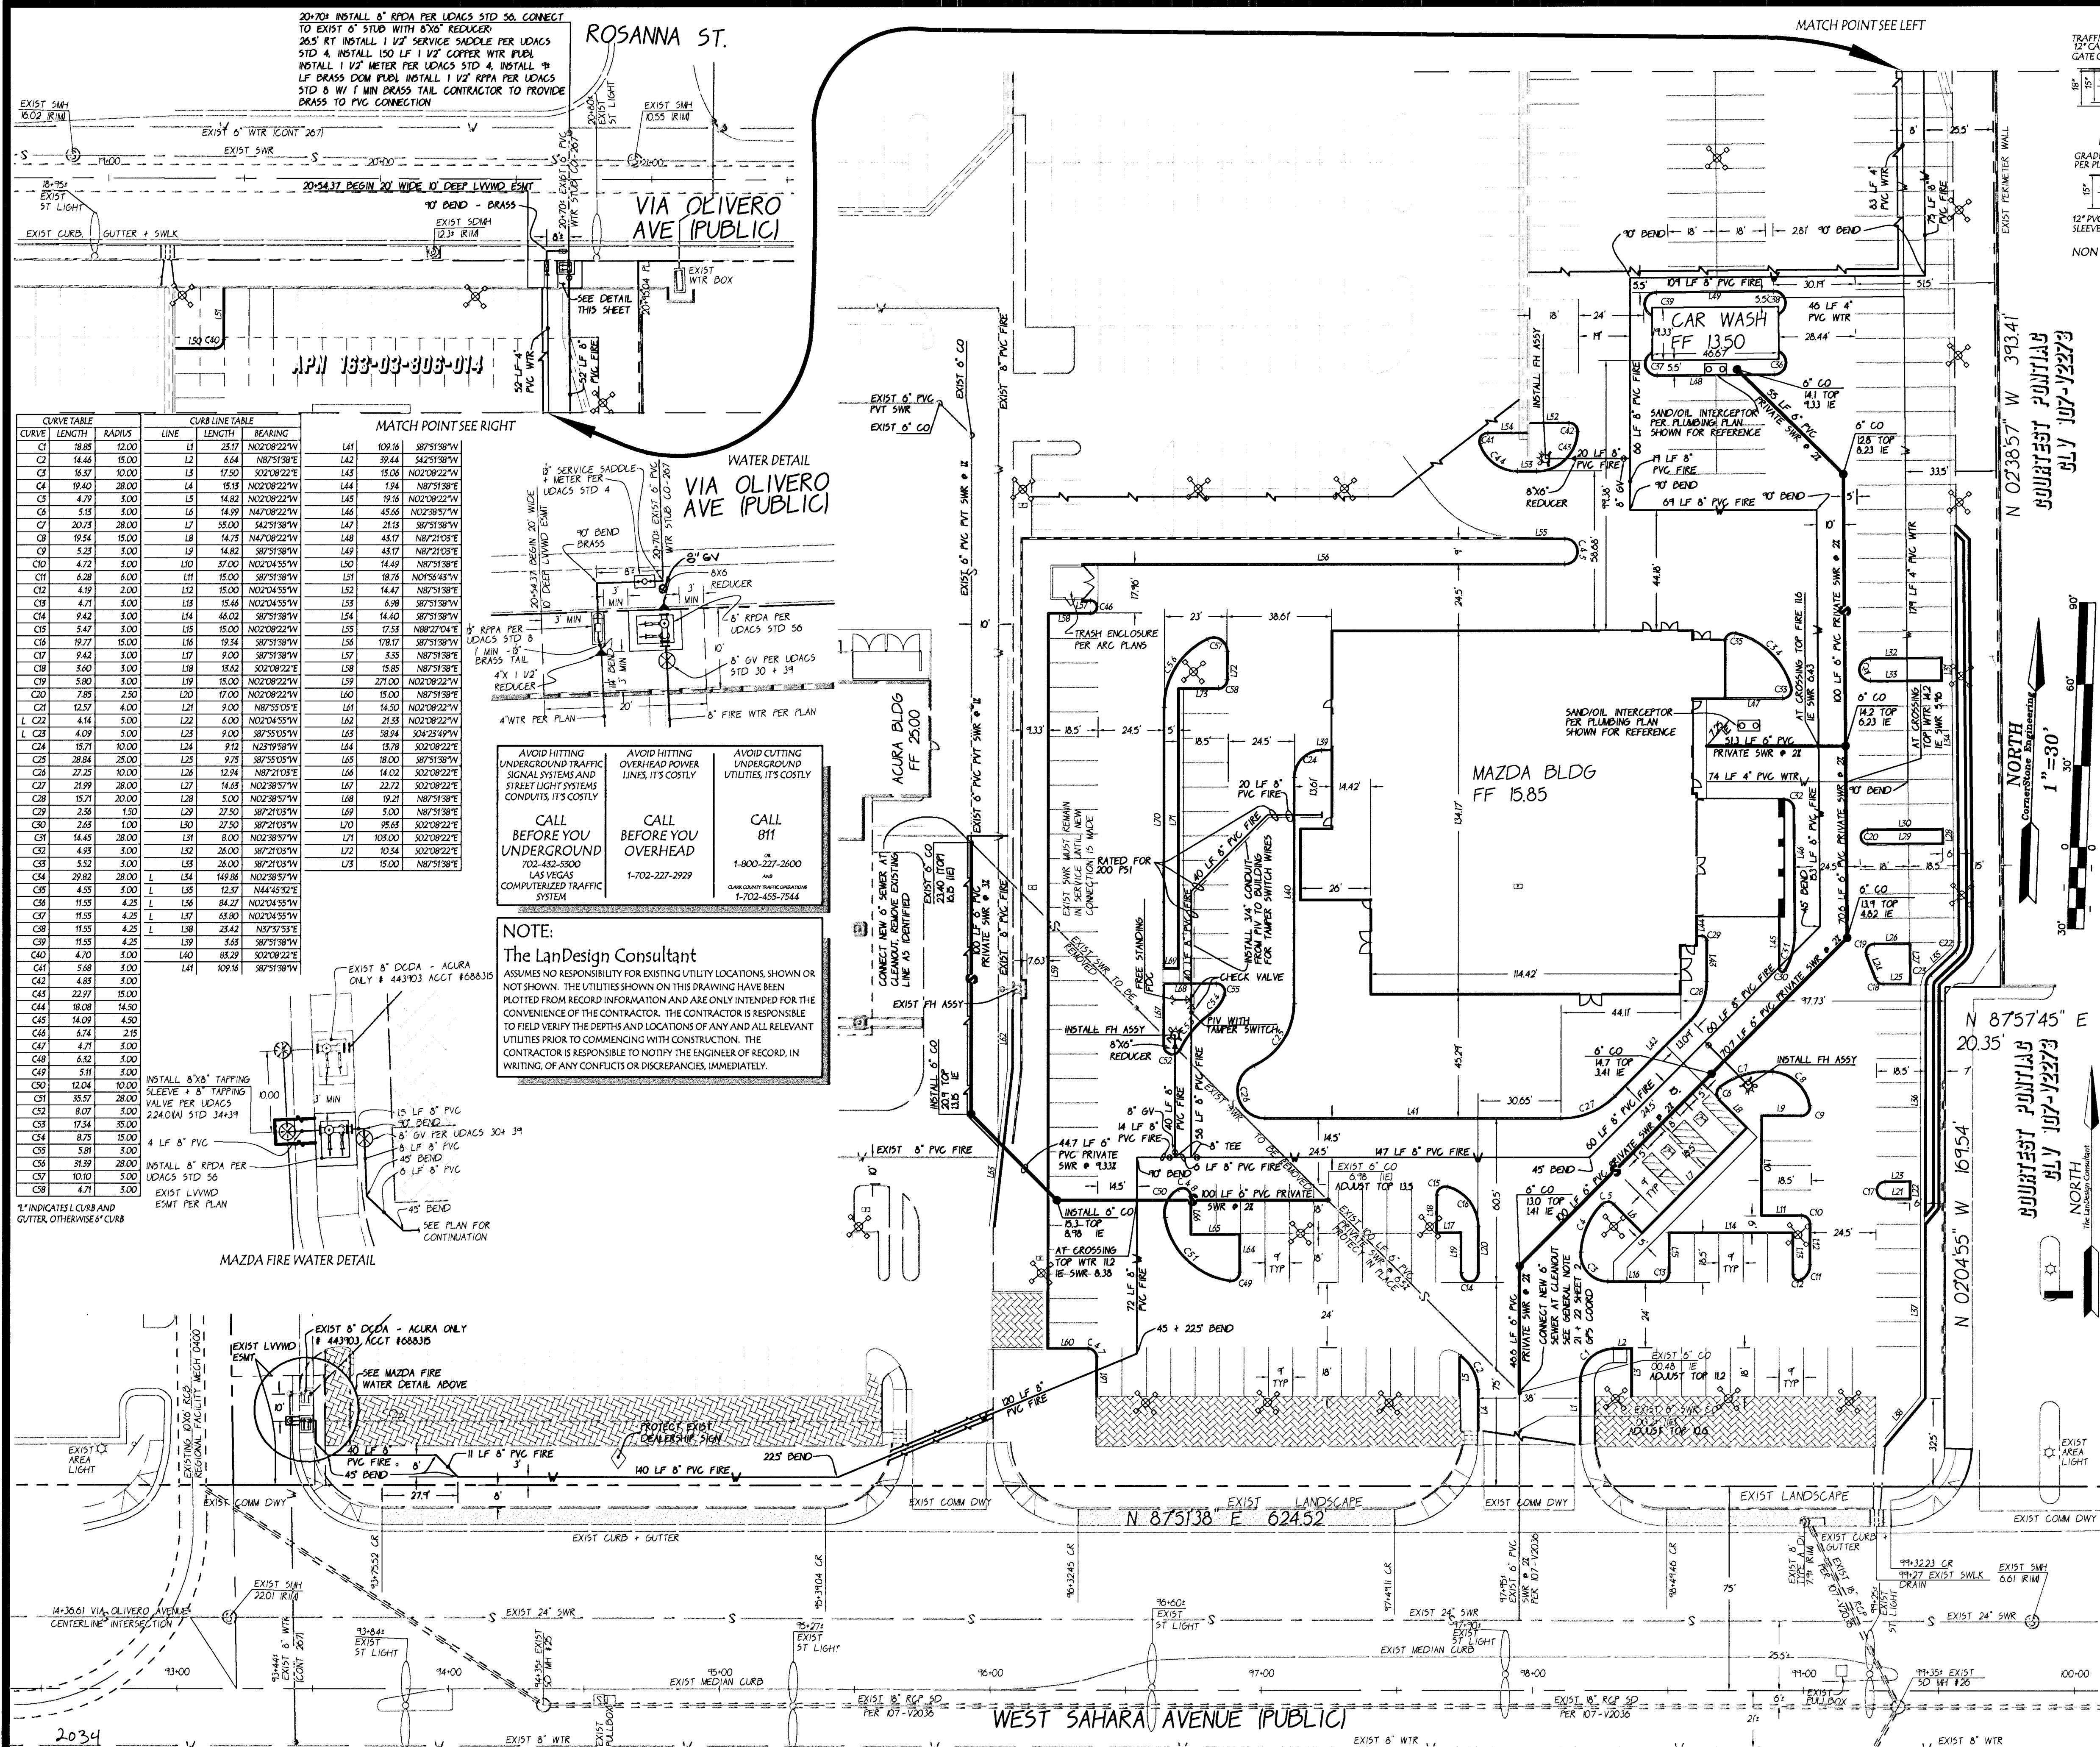

INSTALLATION OF
REDUCED PRESSURE DETECTOR ASSEMBLY: (RPDA)
2 ~ 8"

ANY BLOCK WALL OR OTHER FENCE MATERIAL SHALL BE DESIGNED AND CONSTRUCTED AROUND THE OUTSIDE OF THE EASEMENT, SO AS TO ALLOW THE DISTRICT DIRECT ACCESS FROM THE ADJACENT RIGHT OF WAY.

REDUCED PRESSURE PRINCIPLE ASSEMBLY (RPPA)

NO WATER SHALL BE TAKEN FROM A SERVICE REQUIRING BACKFLOW PREVENTION UNTIL THE REDUCED PRESSURE PRINCIPLE ASSEMBLY HAS BEEN SUCCESSFULLY TESTED BY THE DISTRICT.

ANY BLOCK WALL OR OTHER FENCE MATERIAL SHALL BE DESIGNED AND CONSTRUCTED AROUND THE OUTSIDE OF THE EASEMENT(S) TO ALLOW THE DISTRICT DIRECT ACCESS FROM THE ADJACENT RIGHT OF WAY. EASEMENTS SHALL BE CLEARLY MARKED OR STAKED PRIOR TO THE START OF CONSTRUCTION.

WATER CROSSINGS

POTABLE WATER SYSTEMS (WDACS) FOR WATER AND STORM MAIN CROSSINGS
AND CLEARANCES.

ROCKS, BLOCK WALL, OR FENCE

BACKFLOW ASSEMBLIES, AND PIPING FROM THE ADJACENT RIGHT-OF-WAY.

LATERALS SHALL BE MARKED ACCORDING TO THE 2009 DESIGN AND

LINE. A MARK ON THE CURB IS ALSO REQUIRED. PLACE 3" 3-INCHES HIGH DIRECTLY OVER THE LATERAL CROSSING ON THE TOP OF THE CURB.

FIRE HYDRANT INSTALLATION

[illegible]

(IE: WV, BOX, WMH, ANNODE BOX, FH, TEL BOX, ETC)

ALL DIMENSIONS TO UTILITIES ARE TO CENTERLINE OF PIPE UNLESS INDICATED OTHERWISE. CONTRACTOR SHALL VERIFY HORIZONTAL

DATE 10/9/10

COUNTY OR CITY LAWS. FIRE FLOW 1075 CRM @ 20 PSI RESIDUAL

6/1/2012 PM
LAS VEGAS VALLEY WATER DISTRICT ENGINEERING SERVICES MANAGER

CENTRAL CONTROL OF

SUMMARY PLAN

PLANET MAZDA

WEST SAHARA AV

SHEET 5

171

Land Lesion

Consultant

107V 5888 TEL: 702-547-0047