


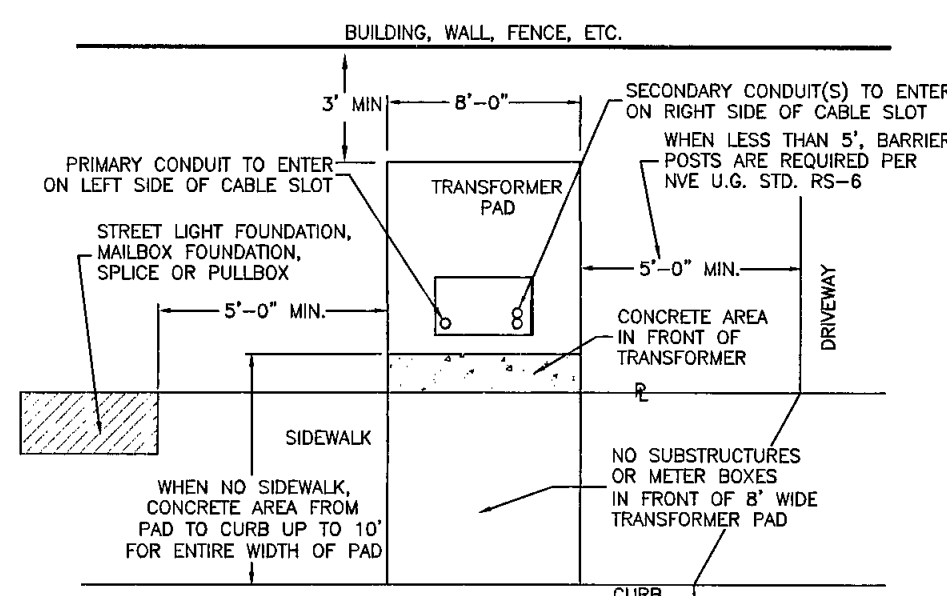

THREE-PHASE TRANSFORMER LOCATION DETAIL


NVE U.G. STD. RS-5 & RS-35 OR RS-37

[illegible]


SOURCE FC OR RISER	PROJECT CONNECTED LOAD (1Ø)			SOURCE FC OR RISER
	PH.	EX: KVA	ADDED KVA	TOTAL KVA
FC2518	AØ	692	167	859
NW1215	BØ	617	167	684
	CØ	567	167	734

PURPOSE OF PROJECT:
TO PROVIDE 3 PHASE 277/480V
SERVICE TO AN 800A PANEL FOR
SOMERSET ACADEMY PHASE 3

T,R,S: 1960-21
APN: 12521102001

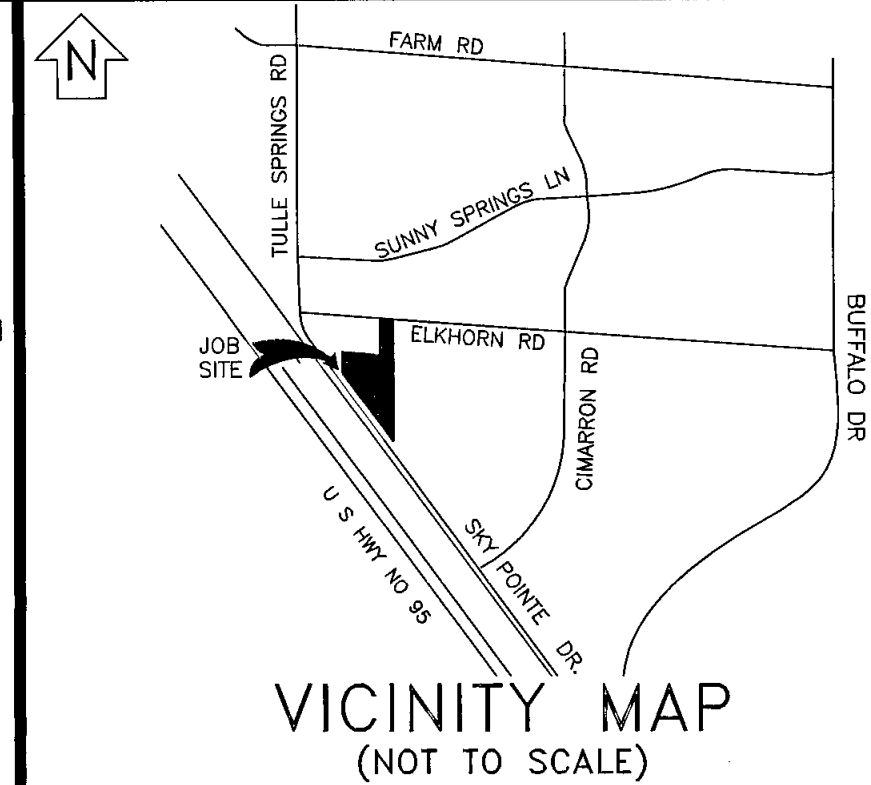

EVERY EFFORT HAS BEEN MADE TO IDENTIFY ALL NVE FACILITIES. THE CUSTOMER SHALL CONFIRM THE EXISTENCE AND LOCATION OF THESE FACILITIES.

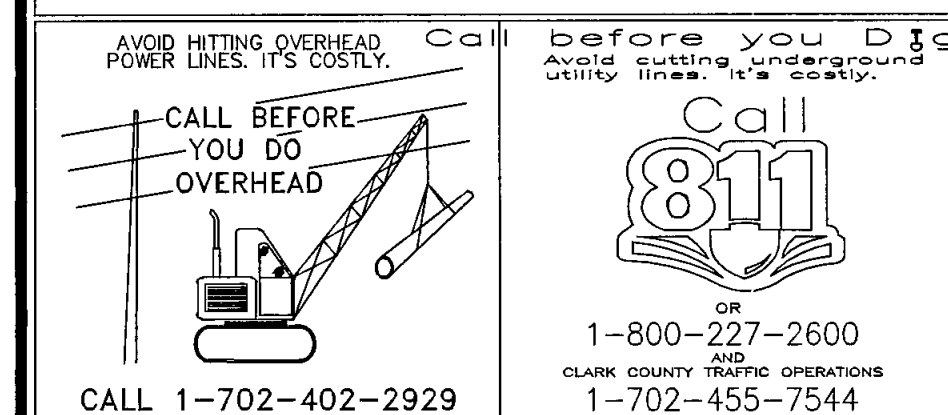

REVISIONS

[illegible]

TYPE OF EASEMENT:		JPA NOTES:	
AERIAL	☐	EMBARGO CONTACT:	_____
STANDARD	☐	PHONE NUMBER:	_____
R/W-31	☐	DATE OF CONTACT:	_____
UNDERGROUND	☒	_____	TO SET NEW POLES
AS BUILT UNDERGROUND	☐	_____	TO STAKE NEW POLES
R.O.E./R/W-5-COM	☐	_____	TO PROVIDE _____ POLES
3rd PARTY	☐	_____	FT. CLASS _____
UNDERGROUND BY EXHIBIT	☐	_____	FT. CLASS _____
(N-DOT) PERMIT	☐	_____	FT. CLASS _____
(SLM) PERMIT	☐	_____	TO DIG POLE HOLES
RAILROAD-UPRR-PERMIT	☐	_____	TO REMOVE EX. POLES
NO. NEVADA WATER PERMIT	☐	_____	
NOT REQUIRED	☐	_____	
Misc. Info.	☐	JPA#:	N/A

EXHIBIT 'A'

ADDITIONAL INFORMATION:

COORDINATOR: J. ROBERT BATES
PHONE: 702-402-6745
DESIGNER: DAVE SCHMITT
DCA:
INSPECTOR: 402-3008
STAND BY: 402-4117, 402-4114, 402-4118
DISTRICT: LAS VEGAS NORTH
CUSTOMER INFORMATION:
APPLICANT SOMERSET ACADEMY OF LAS VEGAS
ENGINEER: HARRIS 702-269-1575
CONTACT: RICH RIAL 376-0527
APPROVAL DATE: 12/02/2013
GOVERNMENT INFORMATION:
AGENCY: CITY OF LAS VEGAS
APPROVAL DATE:

FOR EACH SERVICE POINT (POINT OF DELIVERY), ENERGY FOR EACH TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. ENERGY FOR ALL NON-TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. CONTACT NPC METER OPERATIONS FOR MULTIPLE RATE CLASS INSTALLATIONS


NVEnergy™ 

SOMERSET ACADEMY PH 3
HIGH SCHOOL
7038 SKY POINTE DR

H# 52083 DWG# 715-183-2-UTL

PROJ. ID: 3000428178	SCALE: 1" = 50'
SHEET #: 1 OF 1	DATE: 11/07/2013

DATE: 11/07/2010

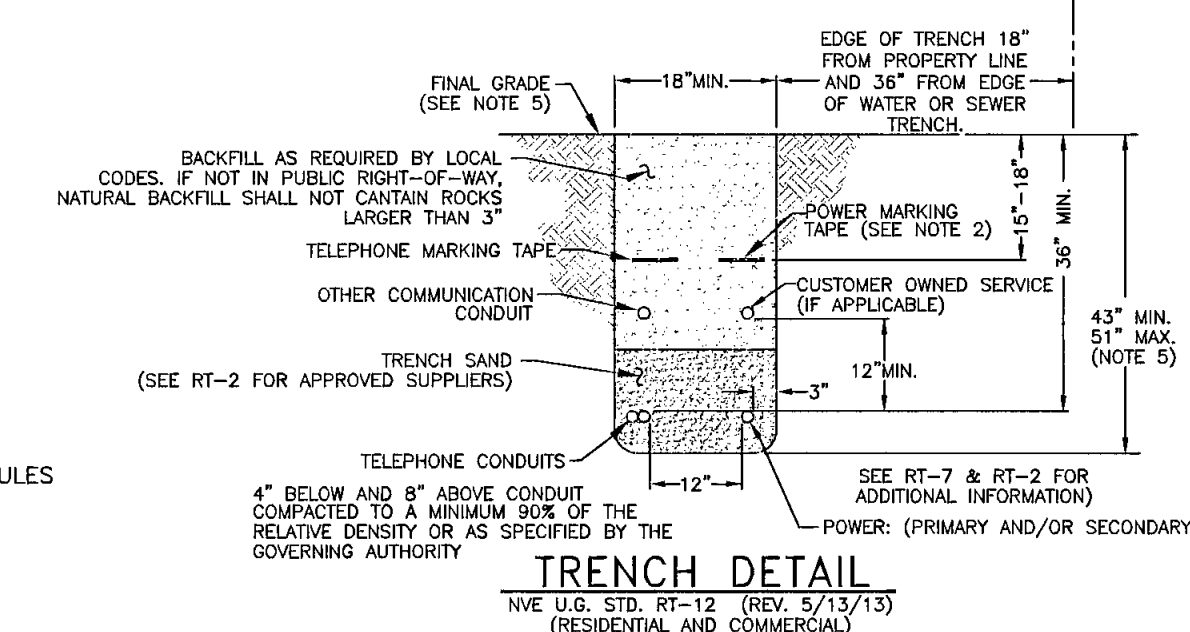

APPROVED FOR CONSTRUCTION

THIS APPROVAL IS FOR WORK IN CLV R/W & EASEMENT ONLY. OBTAINING PERMISSIONS OR EASEMENTS FOR WORK SHOWN ON PRIVATE PROPERTY IS THE RESPONSIBILITY OF THE UTILITY.

D. M. H. Delmon 3/11/2019
APPROVAL

CIVIL LINETYPE LEGEND

	PROPOSED	EXISTING
CENTERLINE	_____	_____
PROPERTY LINE/ROW	_____	_____
CURB	_____	_____
EDGE OF PAVEMENT	_____	_____
EDGE OF SIDEWALK	''' '''	''' '''
SEWER LINE *	8" S	8" S
WATER LINE *	8" W	8" W
GAS LINE *	2" G	2" G
TELEPHONE LINE *	TEL	TEL
CABLE LINE *	CATV	CATV
STORM DRAIN LINE *	12" SD	12" SD
FIRE HYDRANT		
STREET LIGHT		
STREET LIGHT SERVICE		