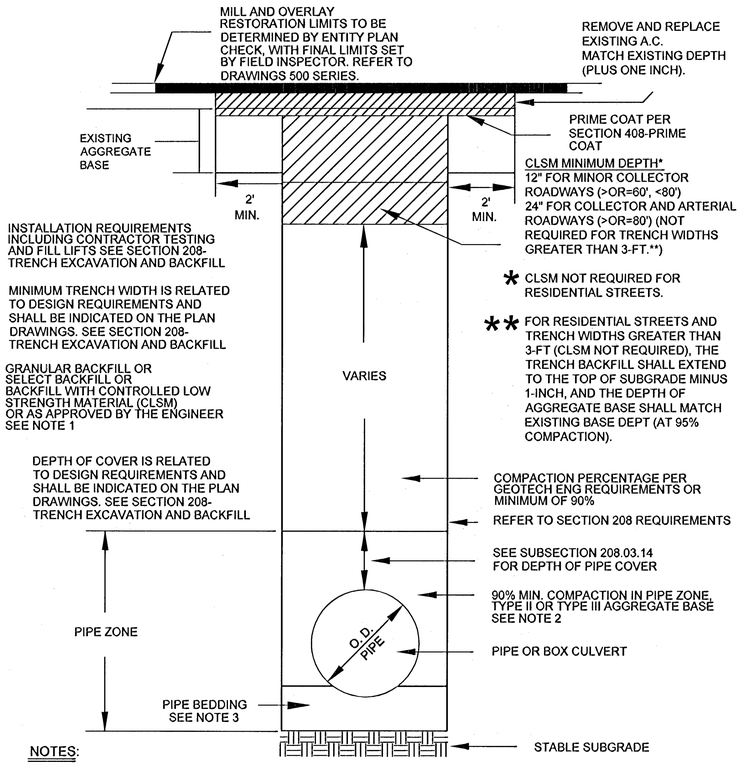

NOTES:

1. NO STONES OR LUMPS GREATER THAN 3" PERMITTED IN TRENCH 2' OR LESS IN WIDTH.
2. TRENCH WIDTH, BEDDING, SUBGRADE AND PIPE ZONE REQUIREMENTS FOR UTILITY INSTALLATIONS SHALL CONFORM TO THE RESPECTIVE ENTITY REQUIREMENTS.
3. CRUSHED ROCK MAY BE USED FOR PIPE BEDDING ONLY IF MATERIAL USE HAS BEEN SPECIFICALLY APPROVED BY THE GOVERNING AGENCY. SEE STANDARD DRAWING NO. 505 FOR PIPE BEDDING METHODS.
4. LAS VEGAS VALLEY WATER DISTRICT REQUIRES PIPE BEDDING AND BACKFILL WITHIN THE PIPE ZONE TO BE OF THE SAME MATERIAL.

RTC STD DWG 503

PROPOSED FACILITIES:

1 PROP. 2" PE CAP (140-3060)

ABANDONED FACILITIES:

		QTY.
1	ABANDON EX. 2" PE '06 MOP 55#	828'
2	ABANDON EX. 1/2" PE '06 SVC	1,204'

CONSTRUCTION NOTES:

1. Suggested gas line locations are to clear substructures. Locate in the Field.
2. All pipeline construction shall conform to applicable jurisdictional specifications.
3. Gas mains shall be purged per the Operations Manual.
4. Do not scale this drawing.
5. Any changes in the Main location must be authorized by SWG Engineer.
6. Trenching and backfill to conform with uniform standard specs. section 208 and RTC standard 503.

RTC NOTES:

PAVEMENT REPAIR SHALL CONFORM TO RTC STANDARD(S):

A1 503

Know what's **below.** **Call** before you dig.

AS-BUILT DRAWING-PRESSURE TEST DATA

PIPE DIA. _____ TEST MEDIUM: ☐ AIR ☐ NITROGEN ☐ WATER ☐ SOAP — TEST METHOD: ☐ GAUGE ☐ CHART GAUGE/ PRESS REC SN#
PIPE LENGTH _____
PIPE TYPE _____
MIN. DURATION _____ START _____ END _____
TEST PRES. (PSIG) _____
TIME _____
DATE _____
PERFORMED BY _____

SYSTEM	D_N_VALLEY_W
DR. NO.	21DS10009738
SEGMENT M.A.O.P.	N/A
SYSTEM M.A.O.P.	60 psig
SYSTEM M.O.P.	55 psig

PURGE PLAN WAS COMPLETED IN ACCORDANCE WITH THE OPERATIONS MANUAL GUIDELINES BY:

PRINT: _____ DATE: _____

SIGNATURE: _____

CUSTOMER 52

NO.	DESCRIPTION	BY	DATE	APPVD.
1.				
2.				
3.				
4.				

REVISIONS

SOUTHWEST GAS CORPORATION

TAX CODES	UNIT NO.	UNIT TYPE	INSTL. (PROPOSED)	RETIRED (PROPOSED)	INSTL. (COMPLETED)	RETIRED (COMPLETED)
	3760102	2" PE		828'		
	3800101	1/2" PE		1,204'		

PROPERTY UNITS

AS-BUILT DRAWING-PRESSURE TEST DATA

PIPE DIA. _____ TEST MEDIUM: ☐ AIR ☐ NITROGEN ☐ WATER ☐ SOAP — TEST METHOD: ☐ GAUGE ☐ CHART GAUGE/ PRESS REC SN#
PIPE LENGTH _____
PIPE TYPE _____
MIN. DURATION _____ START _____ END _____
TEST PRES. (PSIG) _____
TIME _____
DATE _____
PERFORMED BY _____

VISUAL INSPECTION CERTIFICATION

I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT I HAVE PERFORMED

NAME _____ DATE _____

AS-BUILTS ACCEPTED BY _____ DATE _____
POSTED BY _____ DATE _____
POSTING QC'D BY _____ DATE _____

CONSTRUCTION

INSPECTOR _____
FOREMAN _____
REVIEWED BY _____

PERMIT INFORMATION

CITY OF LAS VEGAS

TAX CODE 02-0200

ISOLATION AREA	W.R. NO.
329	2017567
LOCATION	ATLAS #/TILE #
T19S R60E SEC 20 M.D.M.	x585y560

ENGINEER/TECH: FRANCELL RODRIGUEZ		PHONE: 702-365-2311
ACCOUNT REP: MIKE BAILEY		PHONE: 702-528-7744
PROJECT CONTACT: MARK KENNEDY		PHONE: 702-727-9267
SHEET NO: 2 OF 3	SCALE: N.T.S.	DATE: 12/19/14
DWN. BY: ZONE ENG	CHKD. BY:	APPVD. BY:

TITLE

SPINNAKER VILLAGE IV ABANDON

14 8949 107Y 4917