

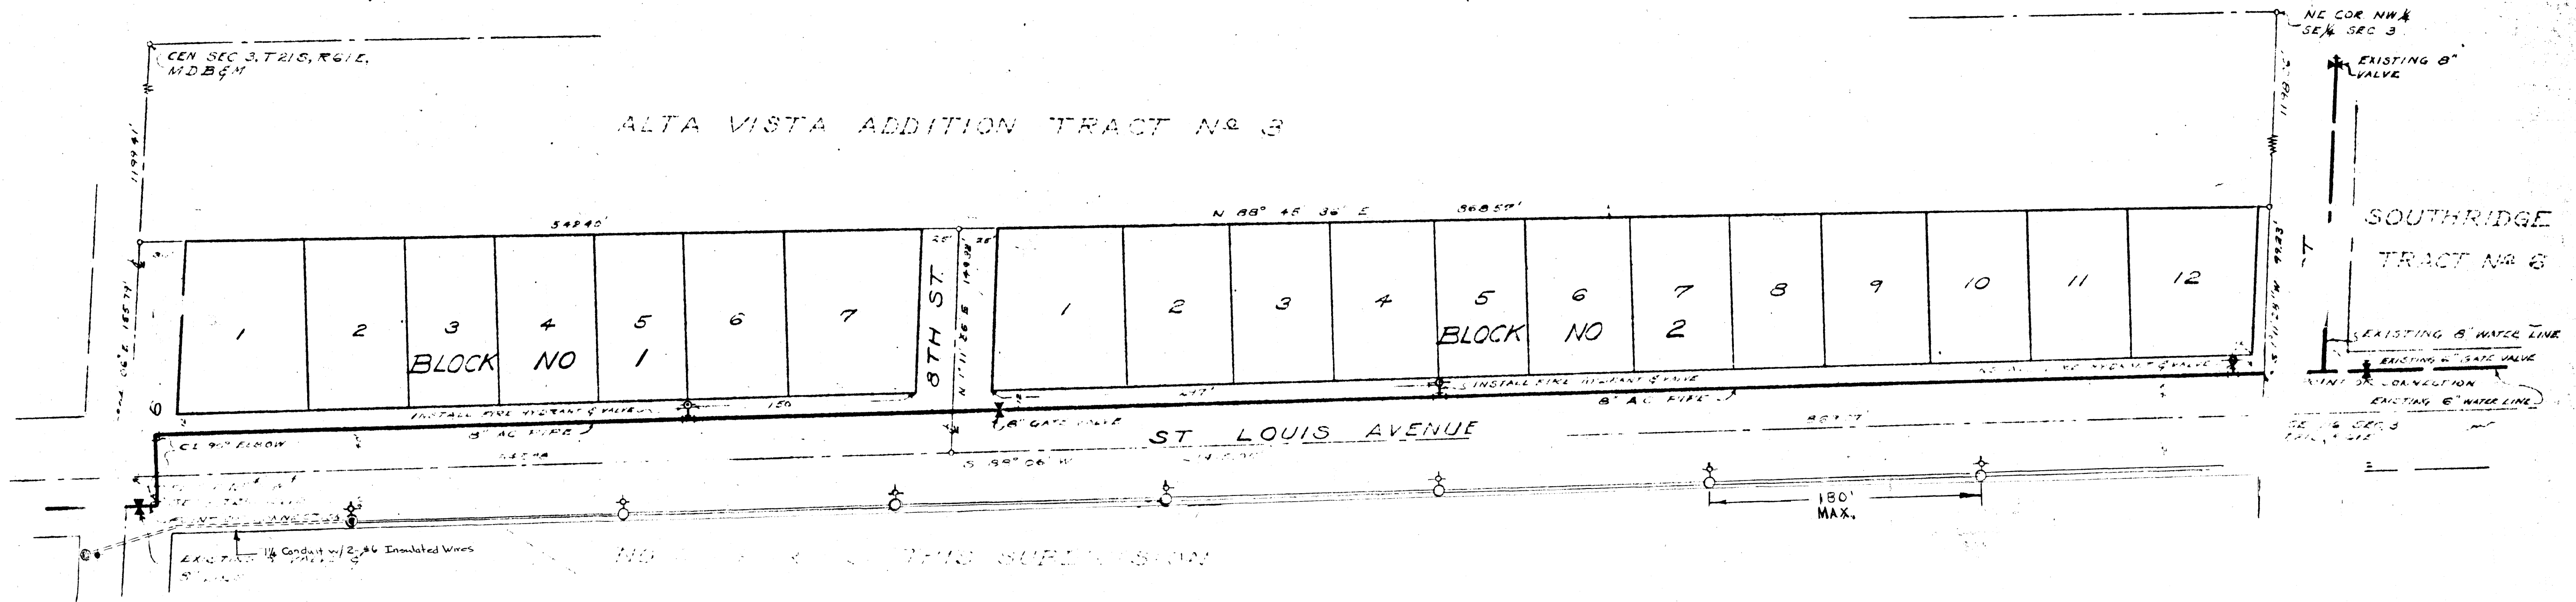


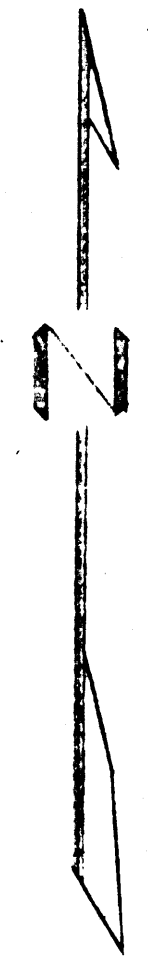

LEGEND  
ST. LIGHTING SYSTEM

2- +O PROPOSED 3 GA. STANDARD  
6- +O PROPOSED 11 GA. STANDARD  
+P EXISTING POLES & LINES

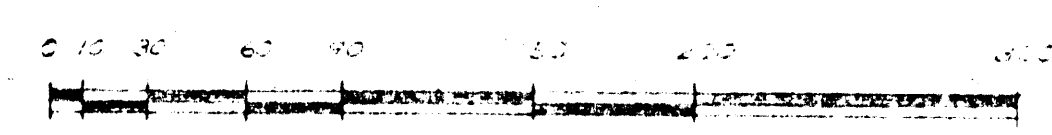

*B. J. Bessent*  
CITY ELECTRICIAN  
*John R. Thomas* 6-23-59  
60. NEVADA POWER CO.  
*R. Platter*  
CITY ENGINEER

City of Las Vegas, Nevada  
Office of the City Engineer  
Approved By: *R. Platter*  
Date: *June 26, 1959*

STREET LIGHTING

- SPECIFICATIONS —
- STANDARDS SHALL RECEIVE TWO FINISH COATS OF AN APPROVED ALUMINUM PAINT, FIRST COAT PRIOR TO ERECTION, SECOND COAT AFTER ERECTION.
  - CONTRACTOR SHALL BE RESPONSIBLE FOR WIRE CLEARANCE FROM OTHER LINES, POLES, PRIVATE PROP., ETC.
  - STANDARDS SHALL BE EQUAL TO PUMCO DESIGN FB 330-BI-6 & FB 1130-BI-6 WITH MODS. L 39 & 14.
  - LUMINAIRES SHALL BE IES TYPE III EQUAL TO LM CAT. # LC5A31 WITH 2500 LUMEN 6.6A.P.S. 35 GROUP REPLACEMENT LAMPS.
  - FOUNDATION SHALL BE CONSTR. & LOCATED IN ACCORDANCE WITH C.I.V. SPECIFICATIONS.
  - OVERHEAD WIRE SHALL BE #6 M.H.D. BARE COPPER WIRE IN MAST ARM SHALL BE #85 KYRR.
  - MAXIMUM SPACING OF POLES SHALL BE 180 FEET.

| CITY OF LAS VEGAS NEVADA<br>ENGINEERING DEPT.                          |                   |                |
|------------------------------------------------------------------------|-------------------|----------------|
| PROPOSED STREET LIGHTING<br>ST. LOUIS AVE; 6th ST. to MARYLAND PARKWAY |                   |                |
| DESIGNED BY                                                            | DATE              | SCALE 1" = 60' |
| DRAWN BY                                                               | FIELD BOOK NO.    | WORK ORDER NO. |
| CHECKED BY                                                             | DRAWING NO.       |                |
| APPROVED<br>CITY ENGR.                                                 | <i>R. Platter</i> | 207-V-42       |