


PURPOSE OF PROJECT:
 REPLACE EXISTING BAD/FAULTED
 DIRECT BURY 1/0 CABLE
 WITH CONDUITED 1/0 CABLE

T,R,S: 2062 32
 APN: 140

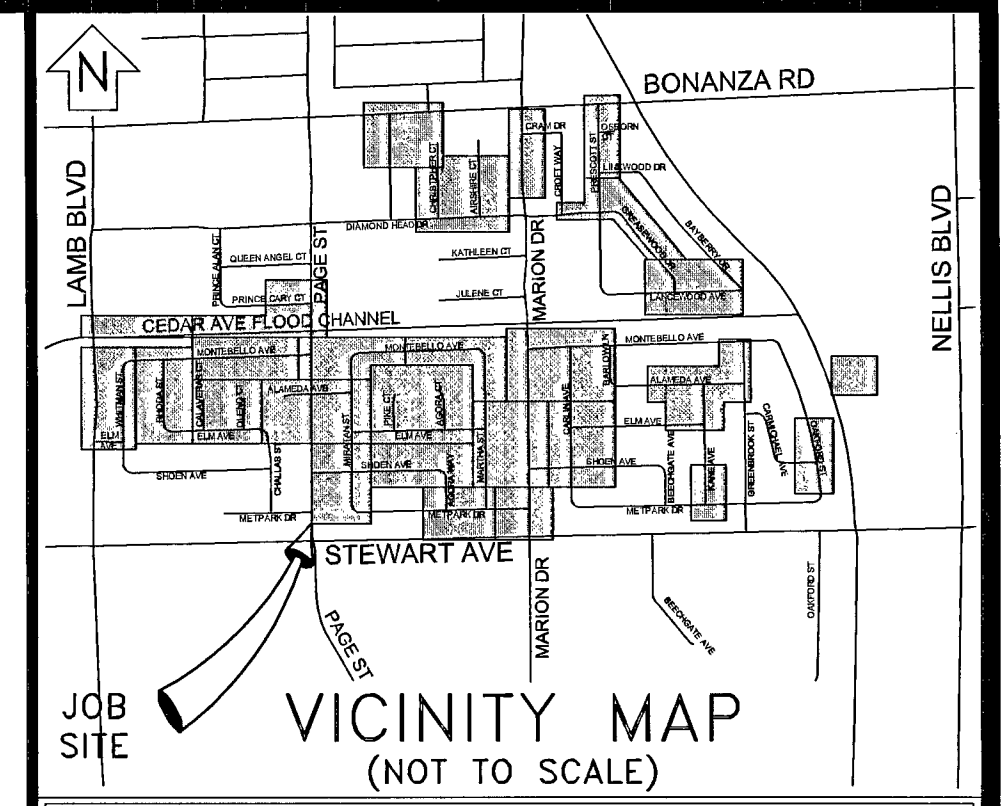

EVERY EFFORT HAS BEEN MADE TO IDENTIFY ALL NVE FACILITIES. THE CUSTOMER SHALL CONFIRM THE EXISTENCE AND LOCATION OF THESE FACILITIES.

AVOID HITTING OVERHEAD POWER LINES. IT'S COSTLY.
 CALL BEFORE YOU DO OVERHEAD

Call before you Dig
 Avoid cutting underground utility lines. It's costly.
 Call 811
 OR
 1-800-227-2600
 CLARK COUNTY TRAFFIC OPERATIONS
 1-702-455-7544

REVISIONS

NO.	DESCRIPTION	DATE	G.A.

TYPE OF EASEMENT:	JPA NOTES:
AERIAL	EMBARQ CONTACT: _____
STANDARD	PHONE NUMBER: _____
R/W-31	DATE OF CONTACT: _____
UNDERGROUND	TO SET NEW POLES
AS BUILT UNDERGROUND	TO STAKE NEW POLES
R.O.E./R/W-5-COM	TO PROVIDE _____ POLES
3rd PARTY	_____ FT. CLASS
UNDERGROUND BY EXHIBIT	_____ FT. CLASS
(N-DOT) PERMIT	_____ FT. CLASS
(BLM) PERMIT	TO DIG POLE HOLES
RAILROAD-UPRR-PERMIT	TO REMOVE EX. POLES
SO. NEVADA WATER PERMIT	
NOT REQUIRED	
Misc. Info.	JPA#: _____ N/A

EXHIBIT 'A'

NVE INFORMATION:
 COORDINATOR: ROBERT BATES
 PHONE: 402-6745
 DESIGNER: THOMAS FOWLER
 DCA: N/A
 INSPECTION SCHEDULING: 402-3008
 STAND BY: 402-4117, 402-4116, 402-4118
 DISTRICT: LAS VEGAS NORTH


CUSTOMER INFORMATION:
 APPLICANT: NVE
 ENGINEER: NVE
 CONTACT: NVE
 APPROVAL DATE: _____
 GOVERNMENT INFORMATION:
 AGENCY: CITY OF LAS VEGAS
 APPROVAL DATE: _____

FOR EACH SERVICE POINT (POINT OF DELIVERY), ENERGY FOR EACH TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. ENERGY FOR ALL NON-TENANT SPACE WILL BE MEASURED THROUGH ONE WATTHOUR METER. CONTACT NVE METER OPERATIONS FOR MULTIPLE RATE CLASS INSTALLATIONS

NVEnergy

STEWART CABLE
 REPLACEMENT PHASE A
 BONANZA - NELLIS -
 STEWART - LAMB

PROJ. ID: M31342
 SHEET #: 27 OF 28
 DATE: 07/19/2010

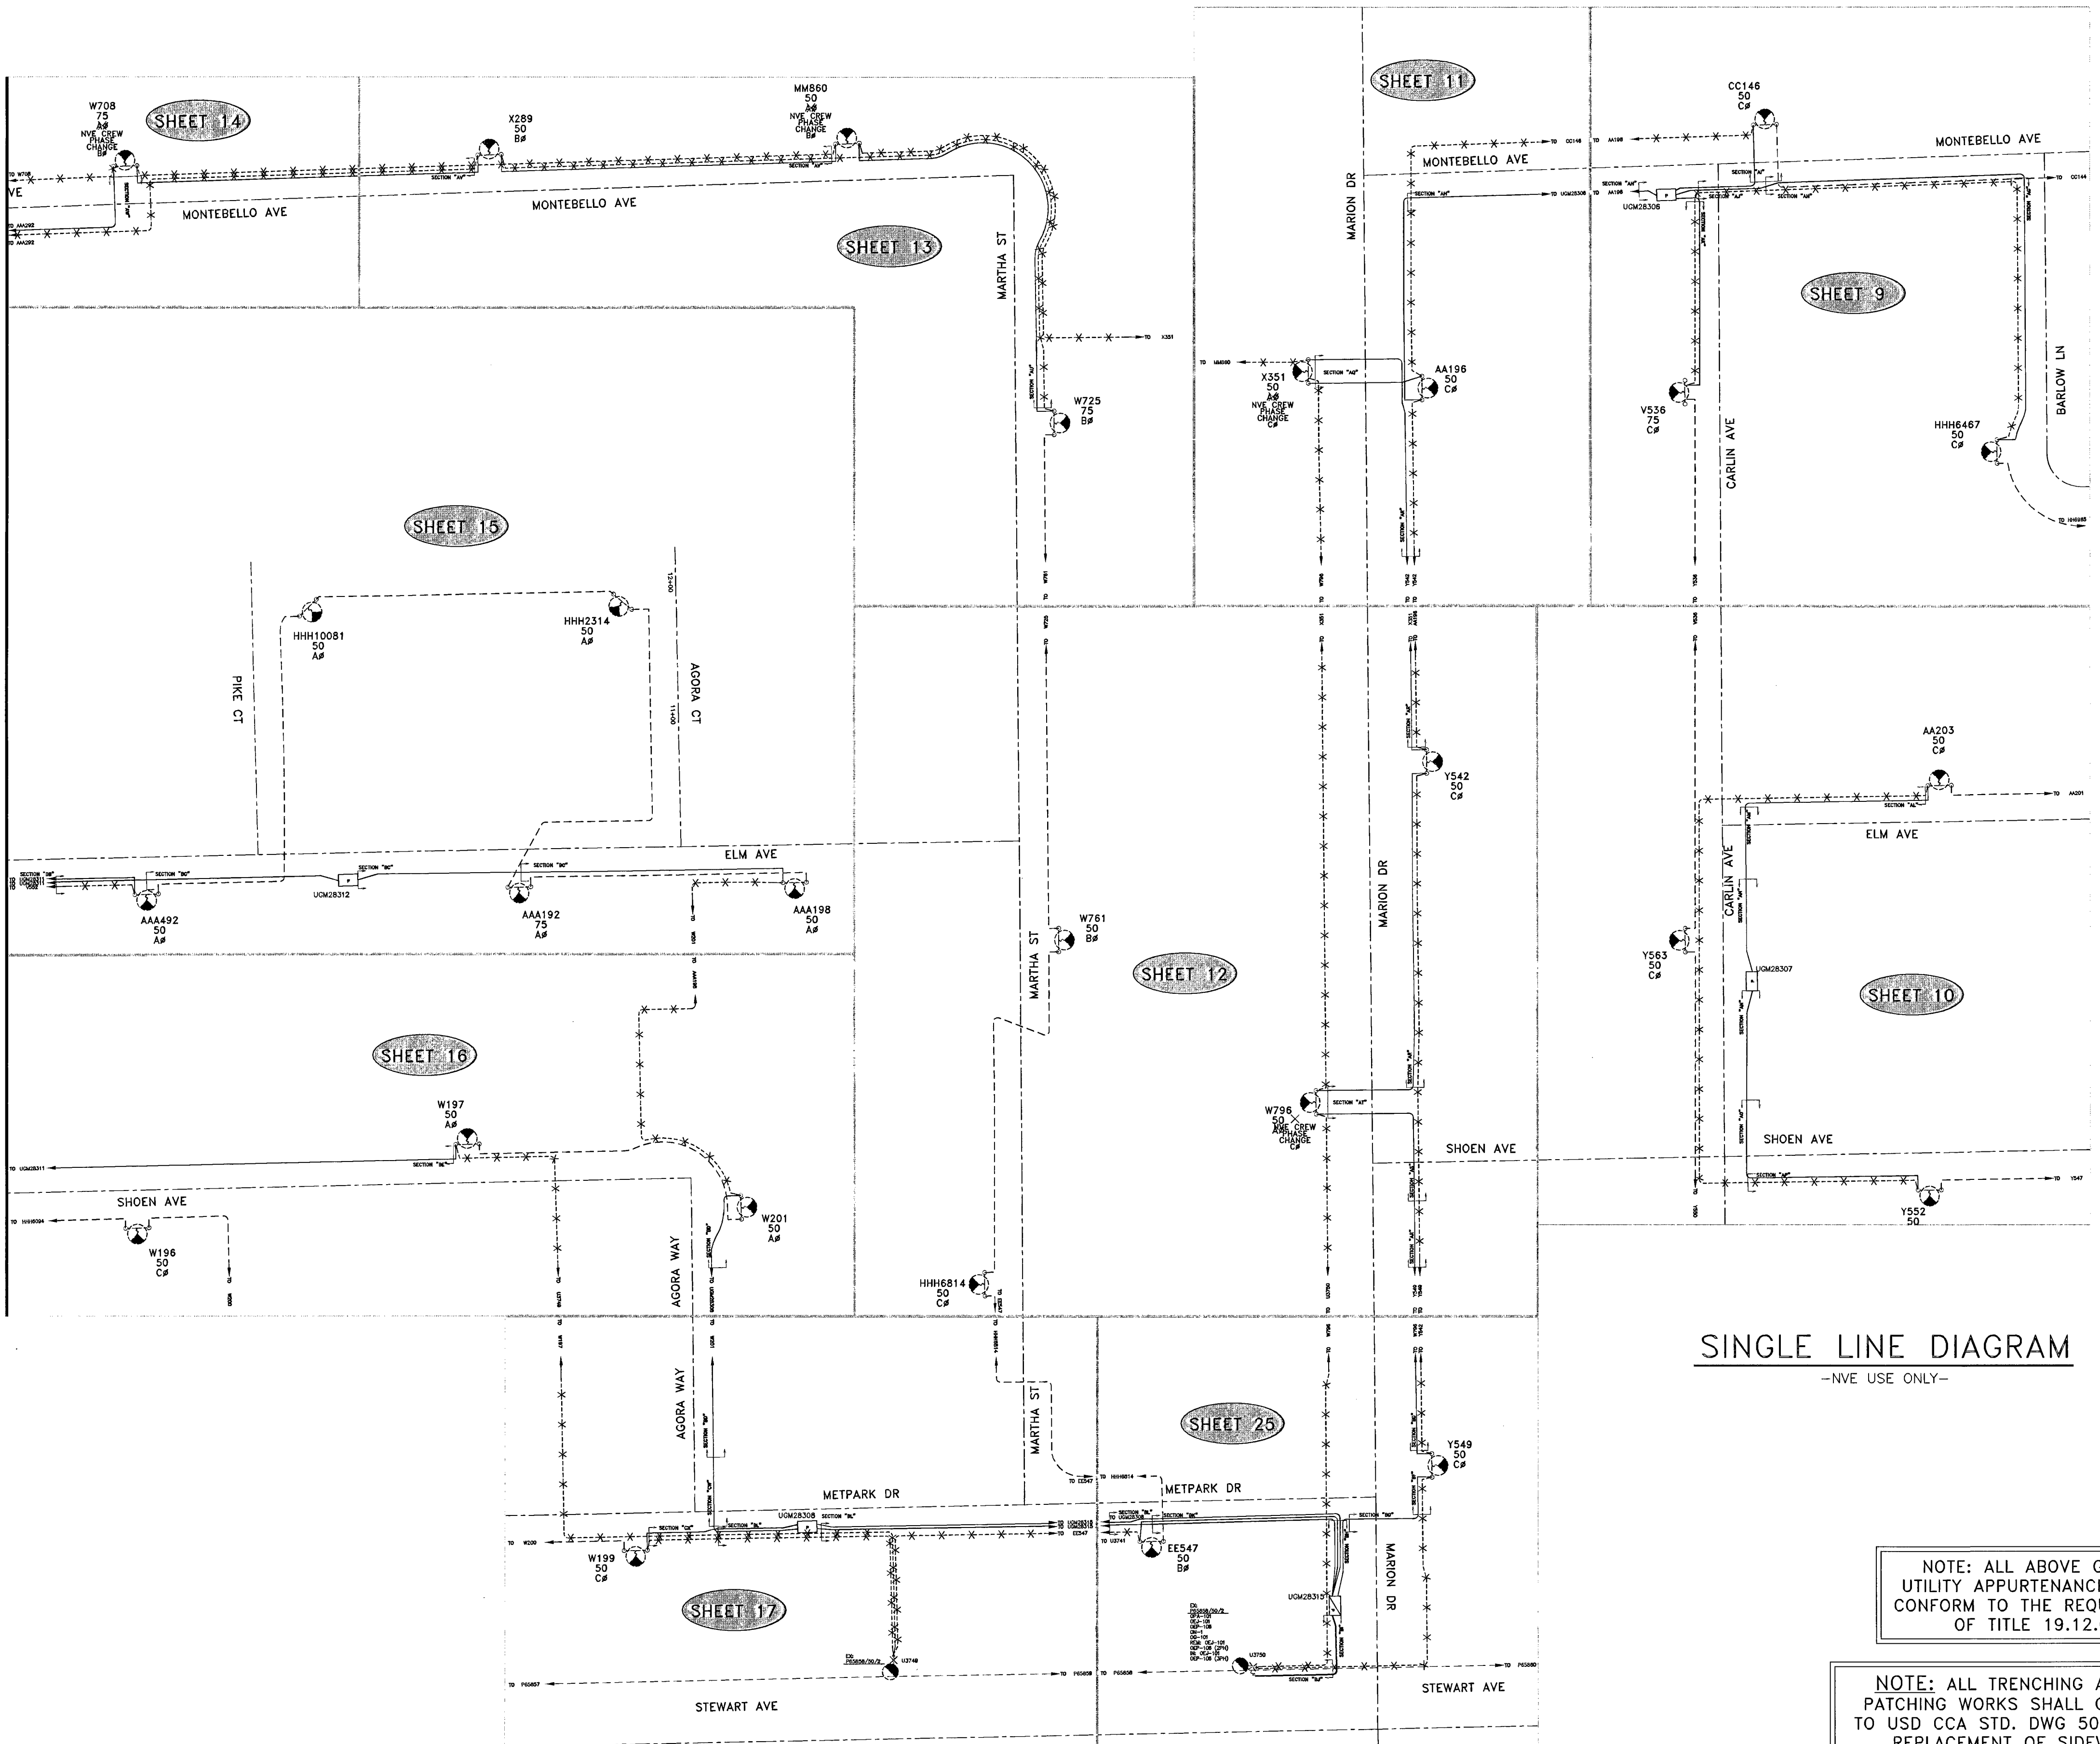

SINGLE LINE DIAGRAM
 -NVE USE ONLY-

NOTE:
 SINGLE LINE PRINTS FOR NVE
 CONSTRUCTION USE ONLY.
 NOT TO SCALE

NOTE: ALL ABOVE GROUND
 UTILITY APPURTENANCES SHALL
 CONFORM TO THE REQUIREMENTS
 OF TITLE 19.12.040

NOTE: ALL TRENCHING AND AC
 PATCHING WORKS SHALL CONFORM
 TO USD CCA STD. DWG 500 SERIES.
 REPLACEMENT OF SIDEWALK,
 CURB, GUTTER, CROSS GUTTER,
 AND OTHER WORKS SHALL CONFORM
 TO THE USD CCA STANDARD DRAWINGS.

MATCH LINE 'A' - SEE SHEET 26

H# 38603 DWG# 10715269-PWR

SINGLE LINE

124414