




Know what's below.
Call before you dig.

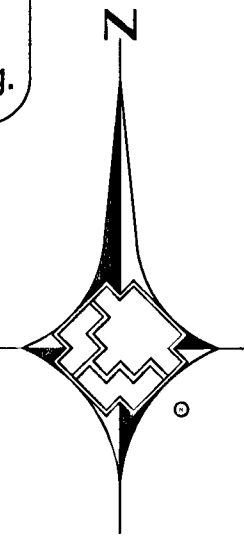

0 1" = 40'

ABANDONED FACILITIES:

2 ABANDON 2" STL '57 MOP 43#


PROPOSED FACILITIES:

- 2 PROP. 2" PE MAIN
- 4 PROP. 2" PE 90° ELBOW (140-3067)
- 5 PROP. 2" PE CAP (140-3060)

RTC NOTES:

PAVEMENT REPAIR SHALL CONFORM TO RTC STANDARD(S):

- A1 500.3
- A2 500.4
- A3 500.5

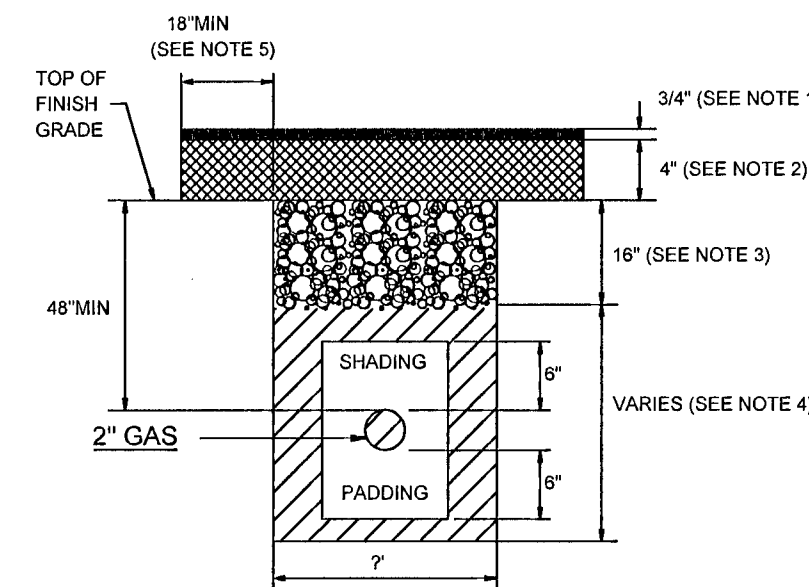


NOTE:
1. 3/4 INCH OPEN GRADE
2. 4 INCH MINIMUM DENSE GRADE OR MATCH EXISTING, WHICHEVER IS GREATER
3. BASE AGGREGATE (AS PER NDOT SPECIFICATIONS, SECTION 704). A MINIMUM OF 16 INCHES TO BE LAID IN MAXIMUM 8 INCH LOOSE LIFTS. 95% COMPACTION REQUIRED.
4. BACKFILL WITH SELECT MATERIAL TO BOTTOM OF BASE AGGREGATE (AS PER NDOT SPECIFICATIONS, SECTION 207). 90% COMPACTION REQUIRED.
5. LIMITS OF PAVING TO BE DETERMINED BY THE NDOT INSPECTOR.

NDOT TRENCH DETAIL

NTS

METHOD OF PATCHING ROADWAY WHERE TRENCHING IS NECESSARY FOR UTILITY OR OTHER INSTALLATIONS

NDOT INFO		
TIE INTO EX. 2" STL GAS	"CH" 124+10.05	"CH" 129+13.85
REFERENCE POINT STA	C/L 25TH ST. "CH" 110+47.39	C/L 25TH ST. "CH" 110+47.39
DISTANCE FROM REFERENCE POINT TO TIE-IN POINT	1,370.66'	1,866.46'
LENGTH OF PIPE INSTALLED IN NDOT R.O.W.	29'	19'

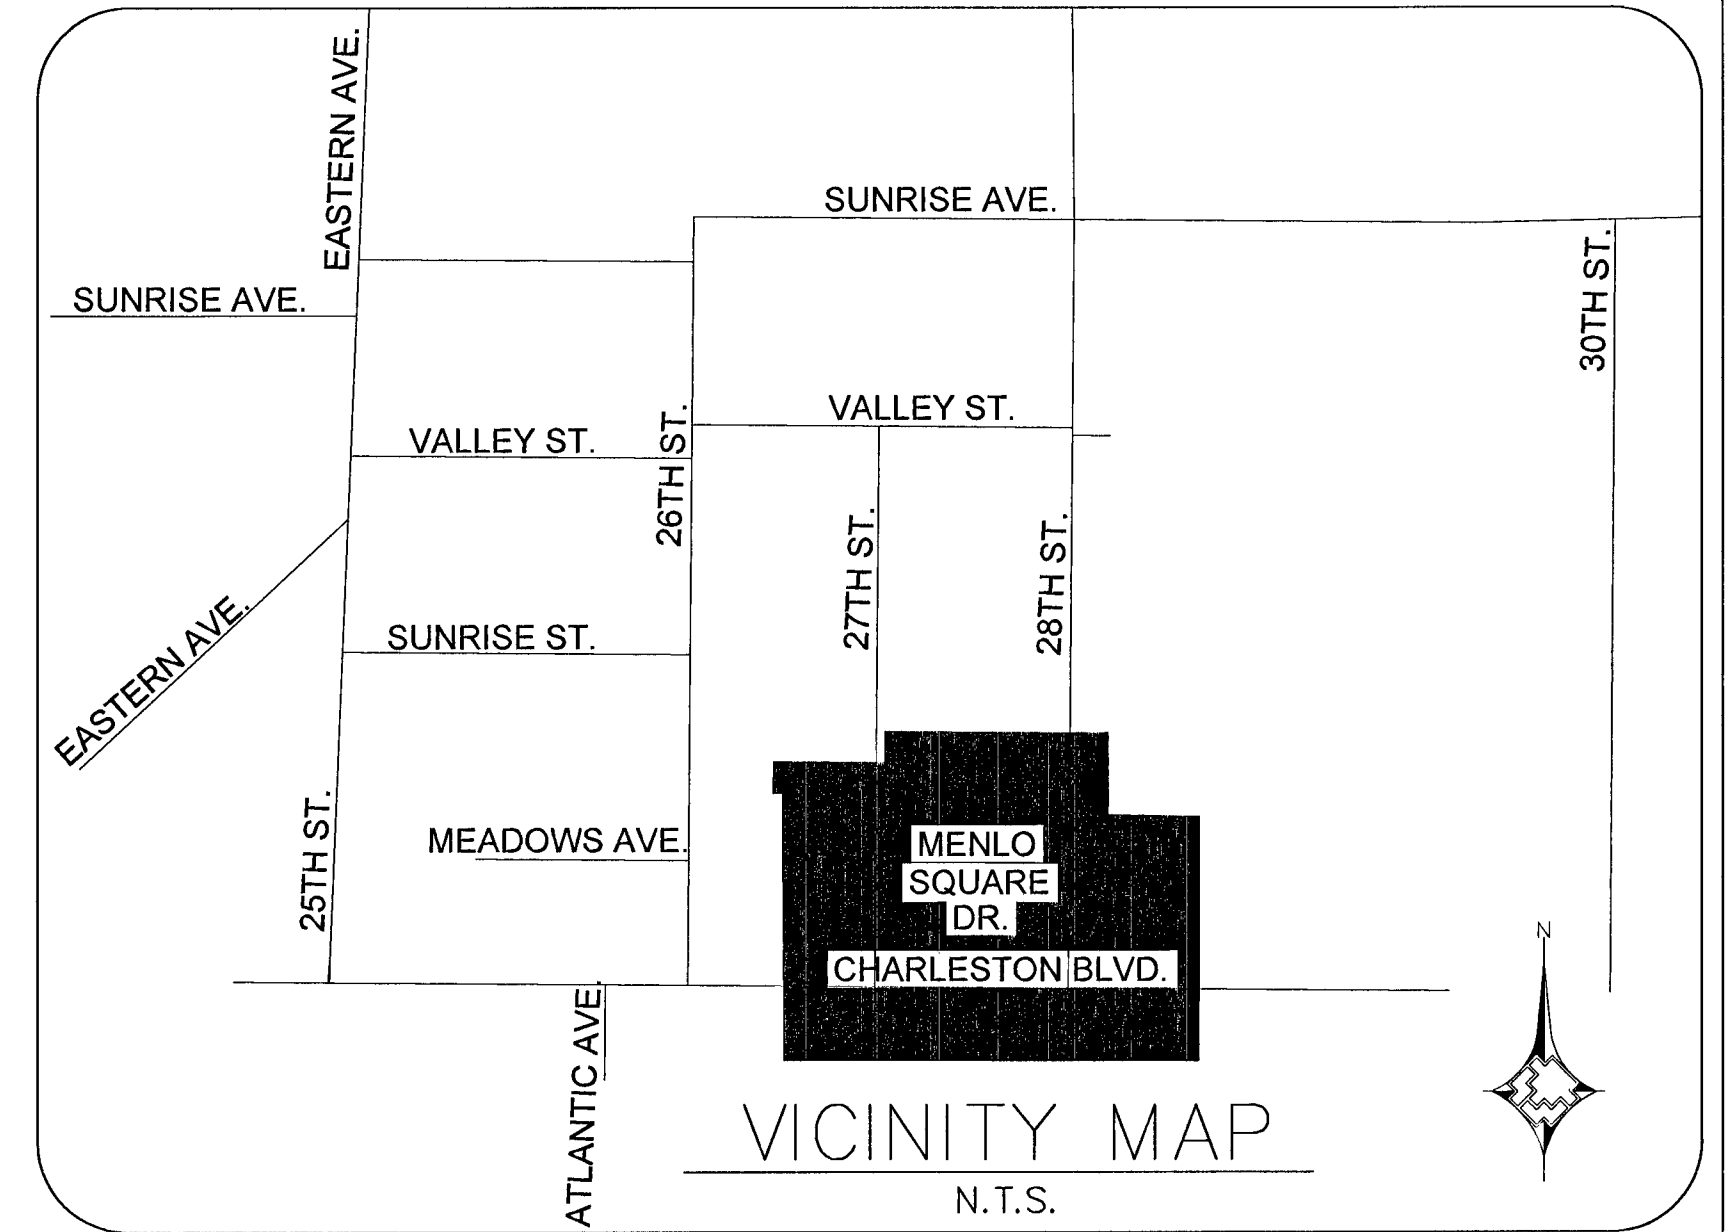

LEGEND:

- EXISTING GAS LINE
- GAS LINE TO BE ABANDONED
- EXISTING GAS SERVICE
- PROPOSED MAIN GAS LINE (NEW)
- PROPOSED SERVICE LATERAL (NEW)
- PROPOSED SERVICE LINE (NEW)
- RIGHT OF WAY LINE
- STREET CENTERLINE
- PROPERTY LINE
- BACK OF CURB
- MATCHLINE
- EASEMENT
- SAWCUT & PATCH
- EXISTING ANODELESS RISER
- EXISTING ANODE RISER
- EXISTING GAS LIGHT
- EXISTING GAS VALVE

SWG FACILITIES IN NDOT R/W FOR NDOT R/W PERMIT ONLY

- NEW GAS FACILITIES
- ABANDONED GAS FACILITIES
- EXISTING GAS FACILITIES

Clark County Public Works
Development Review
APPROVED FOR PERMITTING

Night Work - Yes No

Encroachment Permit # _____

By: _____ Date: _____

MATCHLINE - SEE SHEET 17

MATCHLINE - SEE SHEET 15
FOR CONTINUATION

1. _____ 2. _____ 3. _____ 4. _____				AS-BUILT DRAWING-PRESSURE TEST DATA				VISUAL INSPECTION CERTIFICATION				CONSTRUCTION				ISOLATION AREA				W.R. NO.				ENGINEER/TECH: PATRICK DENISON				PHONE: 702-365-2139							
NO. DESCRIPTION BY DATE APPVD				PIPE DIA. _____ TEST MEDIUM _____ TEST METHOD _____				I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, JOINTS, MECHANICAL JOINTS, AND WELDS THAT I HAVE PERFORMED				INSPECTOR _____ DATE _____				98, 99				1694310				ACCOUNT REP: _____				PHONE: _____							
REVISIONS				PIPE LENGTH _____ GAUGE _____				NAME _____ DATE _____				FOREMAN _____				T20S, R61E, SEC 36				x839y512				PROJECT CONTACT: PATRICK DENISON				PHONE: 702-365-2139							
TAX CODES UNIT UNIT INSTL. RETIRED INSTL. RETIRED				PIPE TYPE _____ GAUGE/ PRESS REC SN# _____				TEST PRES. (PSI) _____ DATE _____				REVISED BY _____				T21S, R61E, SEC 1				x839y514				SHEET NO: 18 OF 22				SCALE: 1" = 40'				DATE: 03/14/14			
PROPERTY UNITS				MIN. DURATION _____ START _____ END _____				AS-BUILTS ACCEPTED BY _____ DATE _____				PERMIT INFORMATION				ATLAS #/TILE #				DWN. BY: ZONE ENG				CHKD. BY: _____				APPVD. BY: _____							
SOUTHWEST GAS CORPORATION				TEST PRES. (PSI) _____ START _____ END _____				POSTED BY _____ DATE _____				CLARK COUNTY, CITY OF LAS VEGAS, NDOT				T20S, R61E, SEC 36 & T21S, R61E, SEC 1 M.D.M.				x839y514				SI-CLV SUNRISE & 27TH											