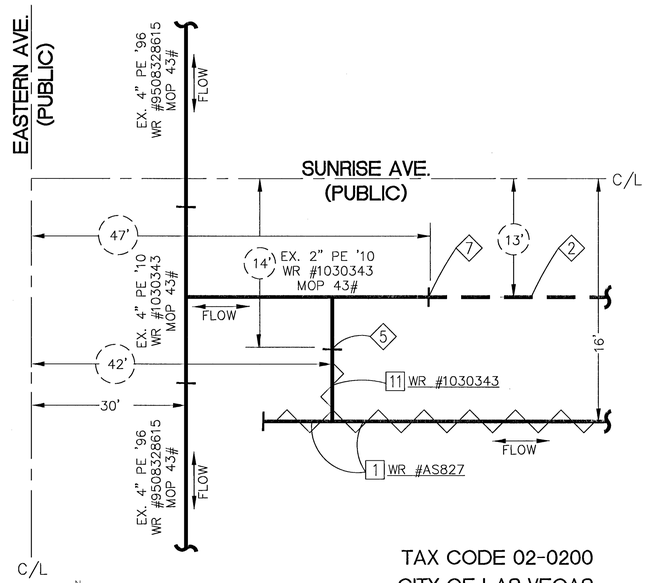

TAX CODE 02-0200
CITY OF LAS VEGAS

A TIE-IN DETAIL (SEE SHEET 4)

N.T.S.

ABANDONED FACILITIES:

- 1 ABANDON 2" STL '56 MOP 43#
- 4 ABANDON 2" PVC '61 MOP 43#
- 5 ABANDON 2" PVC '66 MOP 43#
- 8 ABANDON 6" STL '96 MOP 43#
- 11 ABANDON 2" PE '10 MOP 43#
- 18 ABANDON & REMOVE 2" PE '09 MOP 43#
- 22 ABANDON 2" PE '89 MOP 43#
- 23 ABANDON 2" PE '09 MOP 43#
- 26 ABANDON 4" PE '96 MOP 43#

PROPOSED FACILITIES:

- 1 PROP. 4" PE MAIN
- 2 PROP. 2" PE MAIN
- 4 PROP. 2" PE 90° ELBOW (140-3067)
- 5 PROP. 2" PE CAP (140-3060)
- 7 PROP. 2" PE COUPLING (140-3504)
- 8 PROP. 4" PE CAP (140-3062)
- 11 PROP. 4" PE COUPLING (140-3530)
- 12 PROP. 2" HVTT (160-8171)
- 15 PROP. 4" PE FULL FLOW TEE (140-3076)

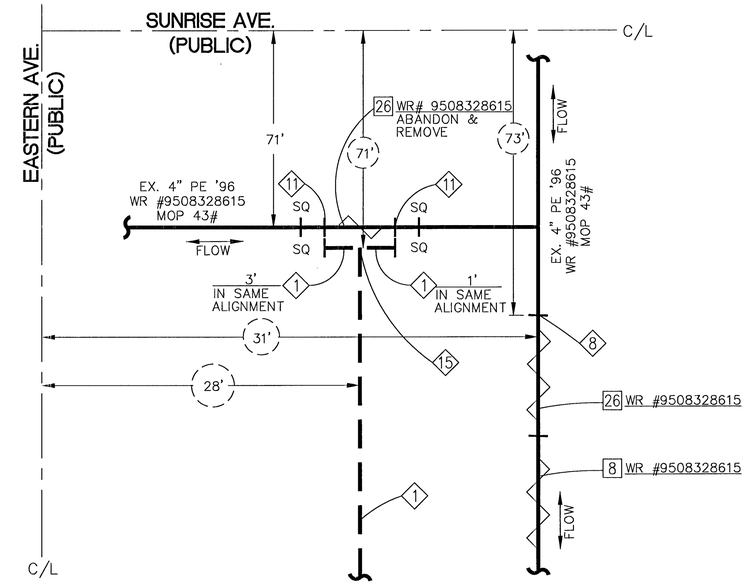

TAX CODE 02-0200
CITY OF LAS VEGAS

B TIE-IN DETAIL (SEE SHEET 4)

N.T.S.

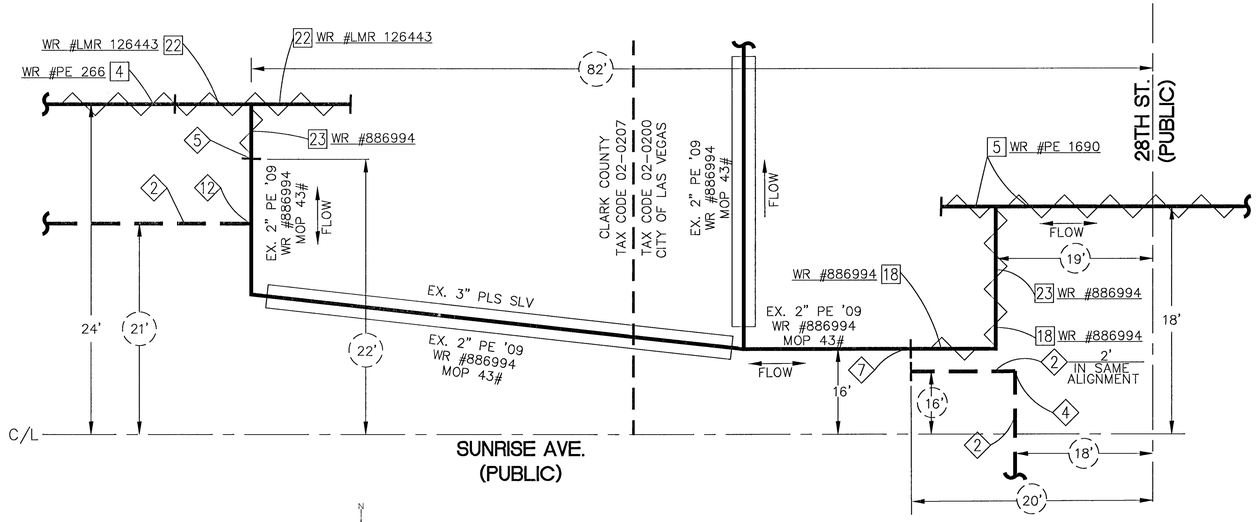

C TIE-IN DETAIL (SEE SHEET 6)

N.T.S.

TAX CODE 02-0207
CLARK COUNTY

TAX CODE 02-0200
CITY OF LAS VEGAS

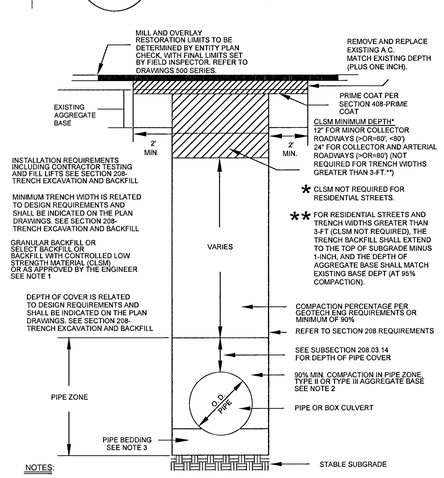

NOTES:

1. NO STONES OR LUMPS GREATER THAN 3" PERMITTED IN TRENCH 2' OR LESS IN WIDTH.
2. TRENCH WIDTH, BEDDING, SUBGRADE AND PIPE ZONE REQUIREMENTS FOR UTILITY INSTALLATIONS SHALL CONFORM TO THE RESPECTIVE ENTITY REQUIREMENTS.
3. CRUSHED ROCK MAY BE USED FOR PIPE BEDDING ONLY IF MATERIAL USE HAS BEEN SPECIFICALLY APPROVED BY THE GOVERNING AGENCY. SEE STANDARD DRAWING NO. 505 FOR PIPE BEDDING METHODS.
4. LAS VEGAS VALLEY WATER DISTRICT REQUIRES PIPE BEDDING AND BACKFILL WITHIN THE PIPE ZONE TO BE OF THE SAME MATERIAL.

RTC STD DWG 503

Clark County Public Works
Development Review
APPROVED FOR PERMITTING

Night Work - Yes No

Encroachment Permit #_____

By: _____ Date: _____

811
Know what's **below.**
Call before you dig.

NO.	DESCRIPTION	BY	DATE	APPVD
1.				
2.				
3.				
4.				

REVISIONS

SOUTHWEST GAS CORPORATION

TAX CODES	UNIT NO.	UNIT TYPE	INSTL.	RETIRED	INSTL.	RETIRED
			PROPOSED		COMPLETED	

PROPERTY UNITS

SEE SHEET 2

AS-BUILT DRAWING-PRESSURE TEST DATA

PIPE DIA. _____ TEST MEDIUM: ☐ AIR ☐ NITROGEN ☐ WATER ☐ SOAP
PIPE LENGTH _____ TEST METHOD: ☐ GAUGE ☐ CHART ☐ GAUGE/PRESS REC SN#
PIPE TYPE _____
MIN. DURATION _____ START _____ END _____
TEST PRES. (PSI) _____
TIME _____
DATE _____
PERFORMED BY _____

SEE SHEET 2

VISUAL INSPECTION CERTIFICATION

I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, SOLVENT CEMENT, MECHANICAL JOINTS, AND WELDS THAT HAVE BEEN PERFORMED

NAME _____ DATE _____

SEE SHEET 2

AS-BUILTS ACCEPTED BY _____ DATE _____
POSTED BY _____ DATE _____
POSTING QC'D BY _____ DATE _____

CONSTRUCTION

INSPECTOR _____
FOREMAN _____
REVIEWED BY SEE SHEET 2

PERMIT INFORMATION

CLARK COUNTY, CITY OF LAS VEGAS, NDOT
TAX CODE
02-0200, 02-0340, 02-0207

ISOLATION AREA	W.R. NO.
98, 99	1694310

LOCATION	ATLAS #/TILE #
T20S, R61E, SEC 36 & T21S, R61E, SEC 1 M.D.M.	x639y512 x639y514 x636y512 x636y514

ENGINEER/TECH: PATRICK DENISON		PHONE: 702-365-2139
ACCOUNT REP:		PHONE:
PROJECT CONTACT: PATRICK DENISON		PHONE: 702-365-2139
SHEET NO: 19 OF 22	SCALE: N.T.S.	DATE: 03/14/14
DWN. BY: ZONE ENG	CHKD. BY:	APPVD. BY:

TITLE

SI-CLV SUNRISE & 27TH