

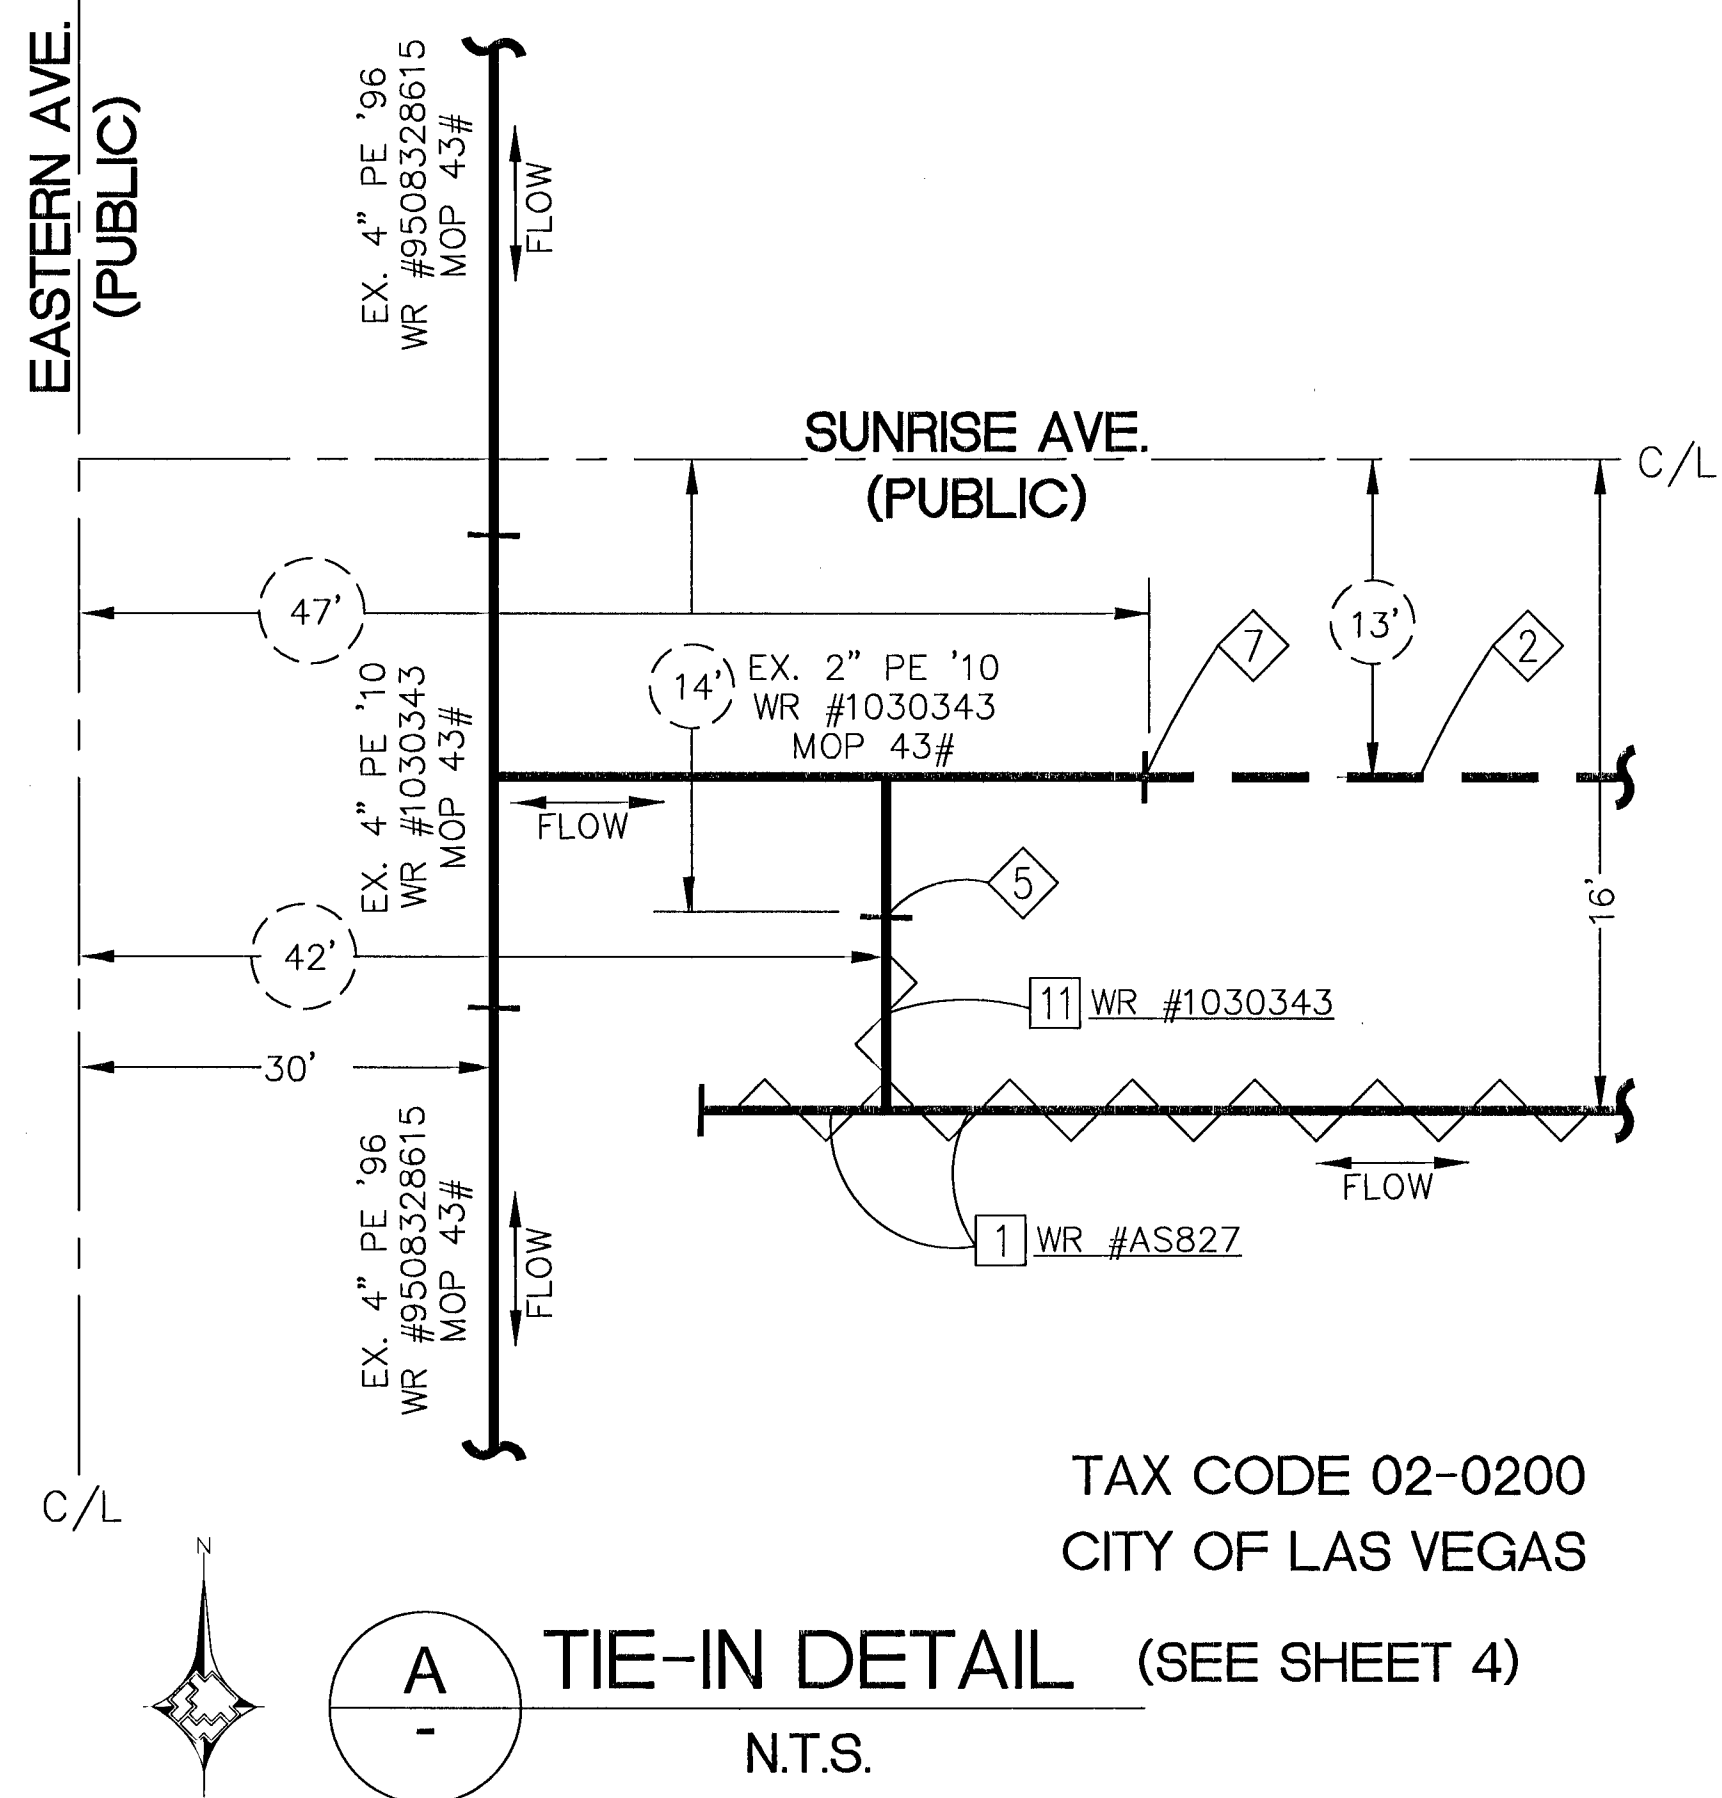
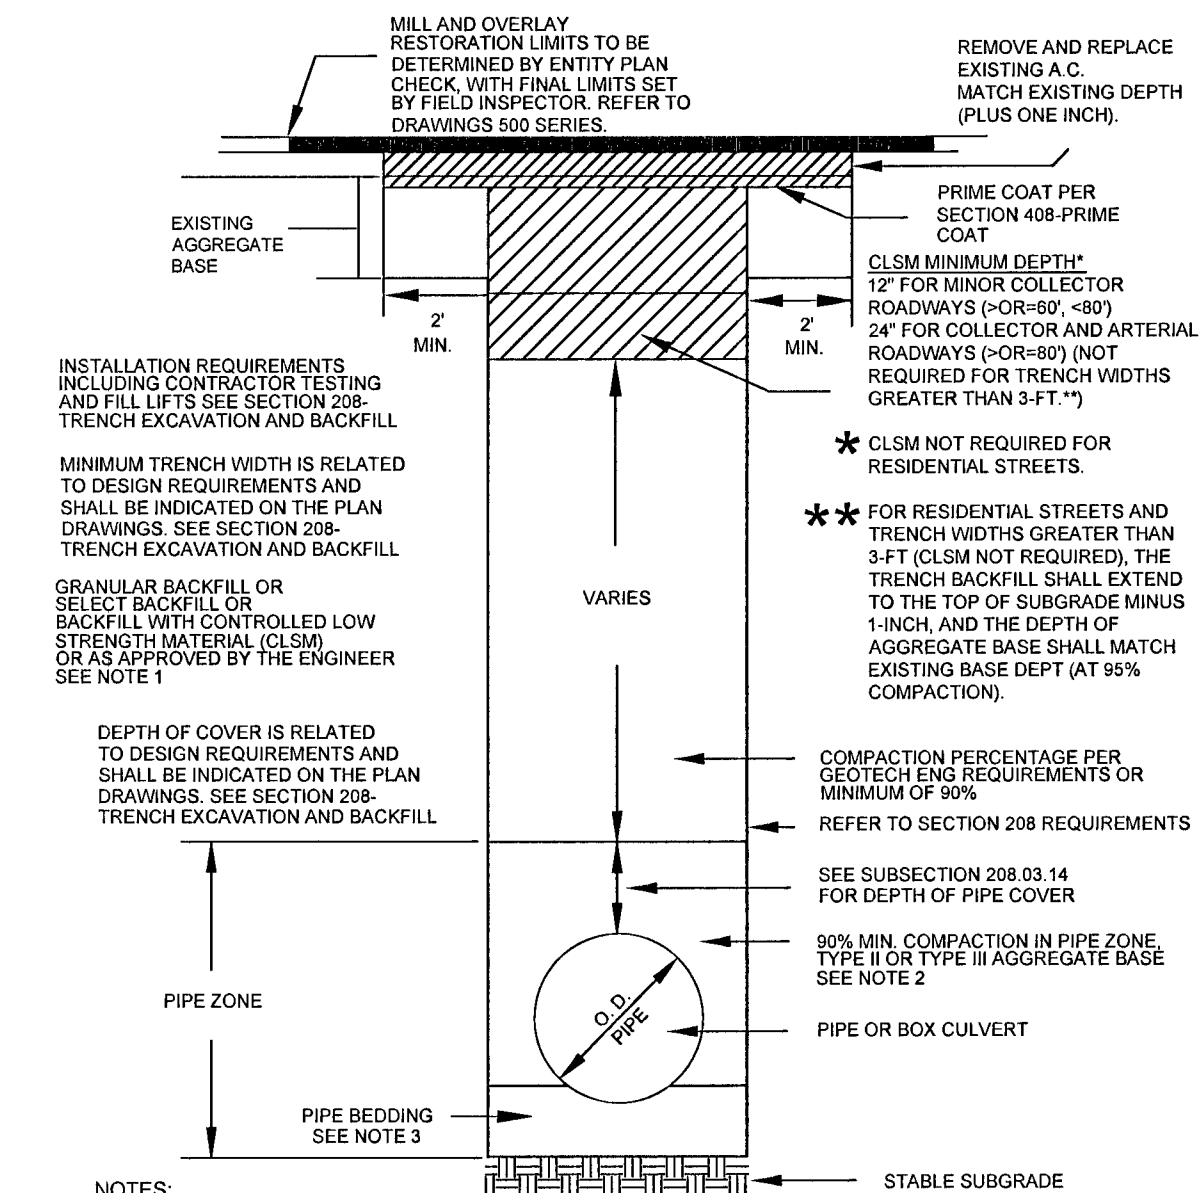


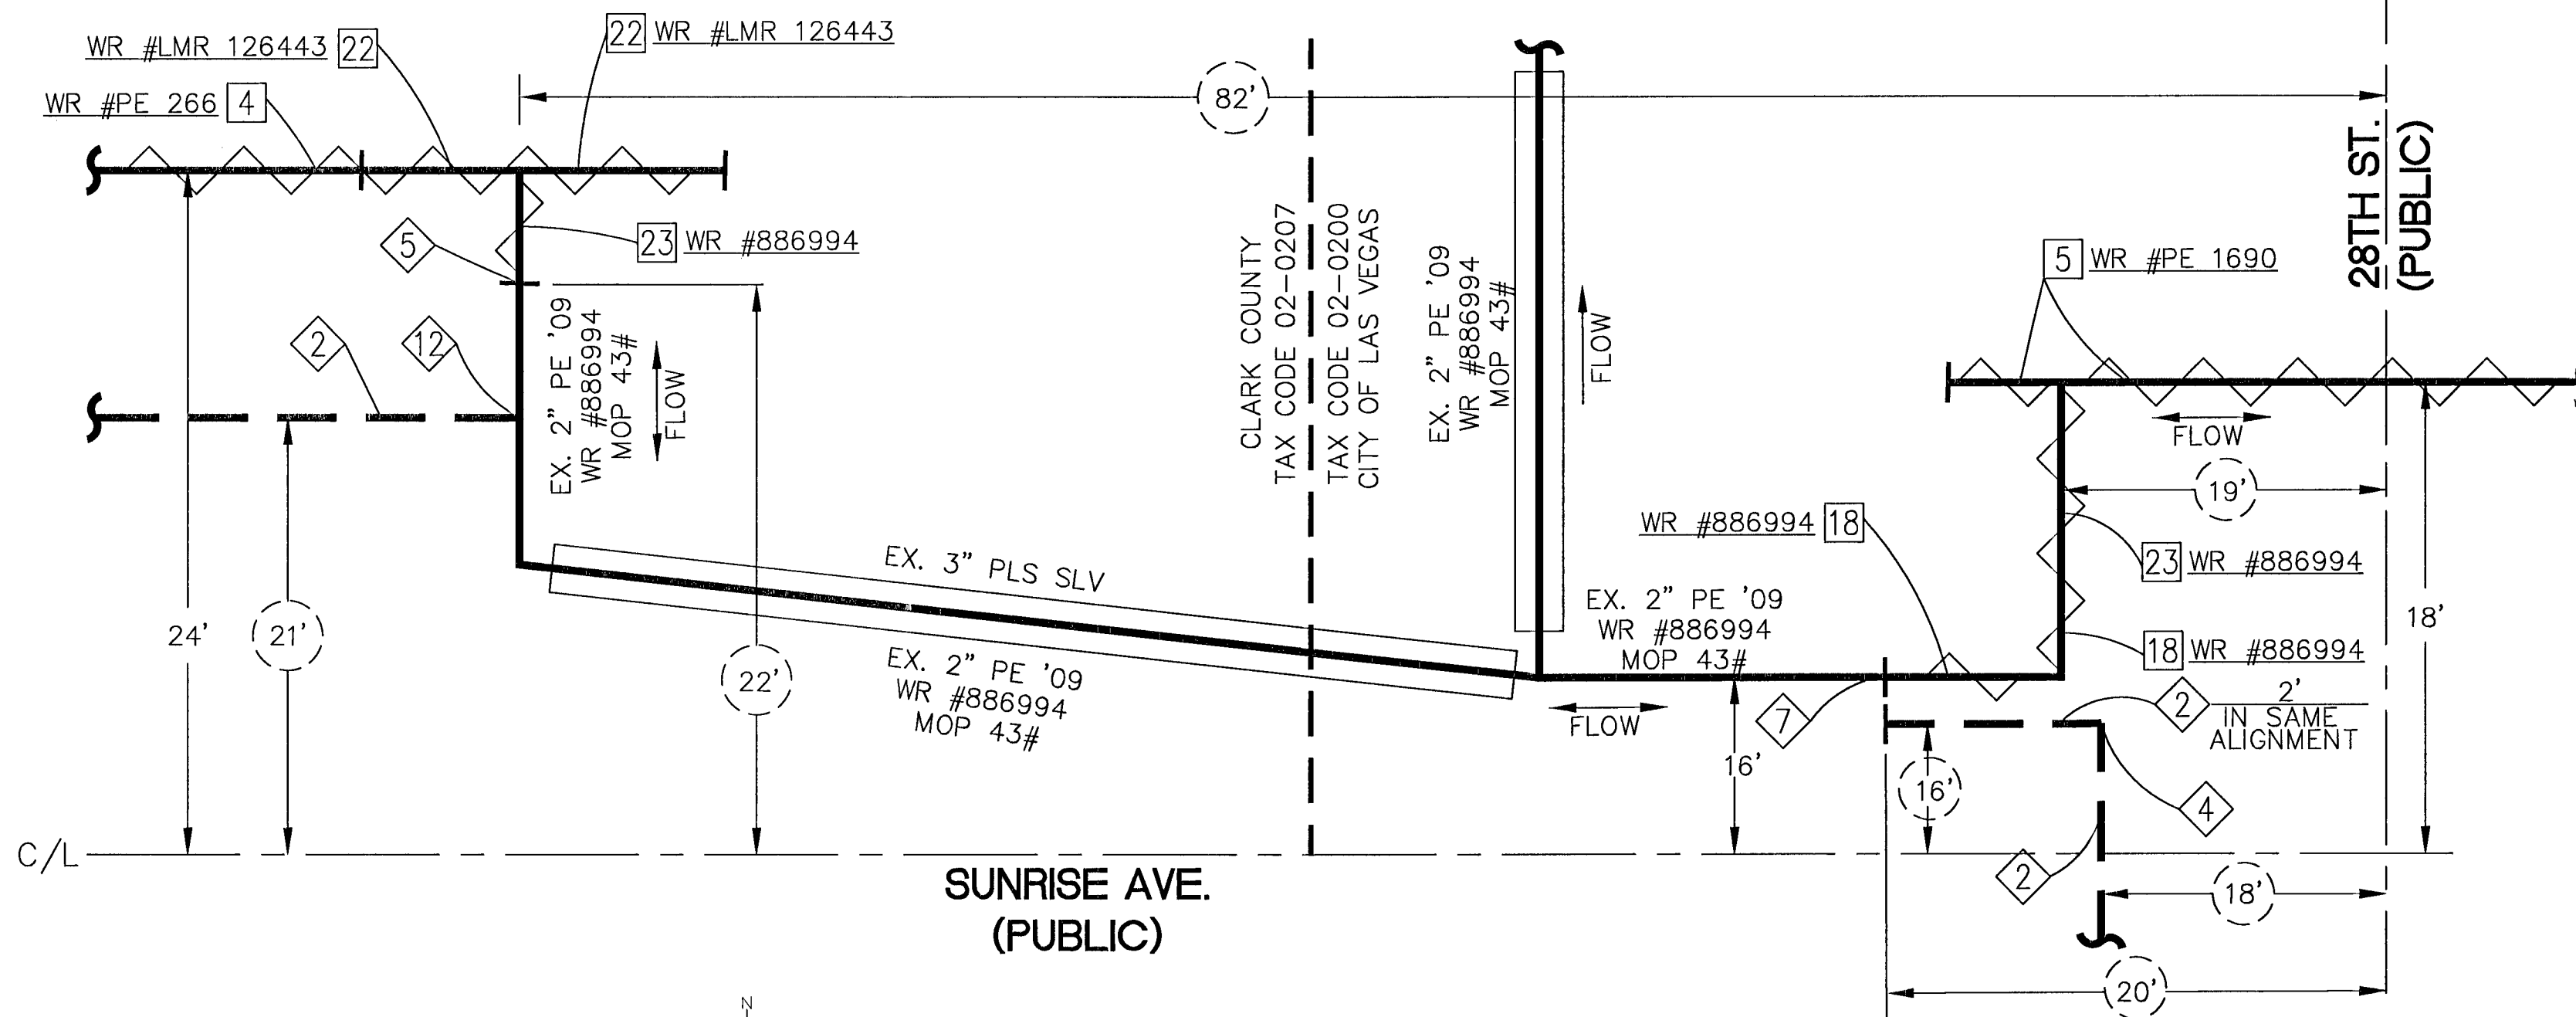

- ABANDONED FACILITIES:**
- 1 ABANDON 2" STL '56 MOP 43#
 - 4 ABANDON 2" PVC '61 MOP 43#
 - 5 ABANDON 2" PVC '66 MOP 43#
 - 8 ABANDON 6" STL '96 MOP 43#
 - 11 ABANDON 2" PE '10 MOP 43#
 - 18 ABANDON & REMOVE 2" PE '09 MOP 43#
 - 22 ABANDON 2" PE '89 MOP 43#
 - 23 ABANDON 2" PE '09 MOP 43#
 - 26 ABANDON 4" PE '96 MOP 43#

- PROPOSED FACILITIES:**
- 1 PROP. 4" PE MAIN
 - 2 PROP. 2" PE MAIN
 - 4 PROP. 2" PE 90° ELBOW (140-3067)
 - 5 PROP. 2" PE CAP (140-3060)
 - 7 PROP. 2" PE COUPLING (140-3504)
 - 8 PROP. 4" PE CAP (140-3062)
 - 11 PROP. 4" PE COUPLING (140-3530)
 - 12 PROP. 2" HVTT (160-8171)
 - 15 PROP. 4" PE FULL FLOW TEE (140-3076)

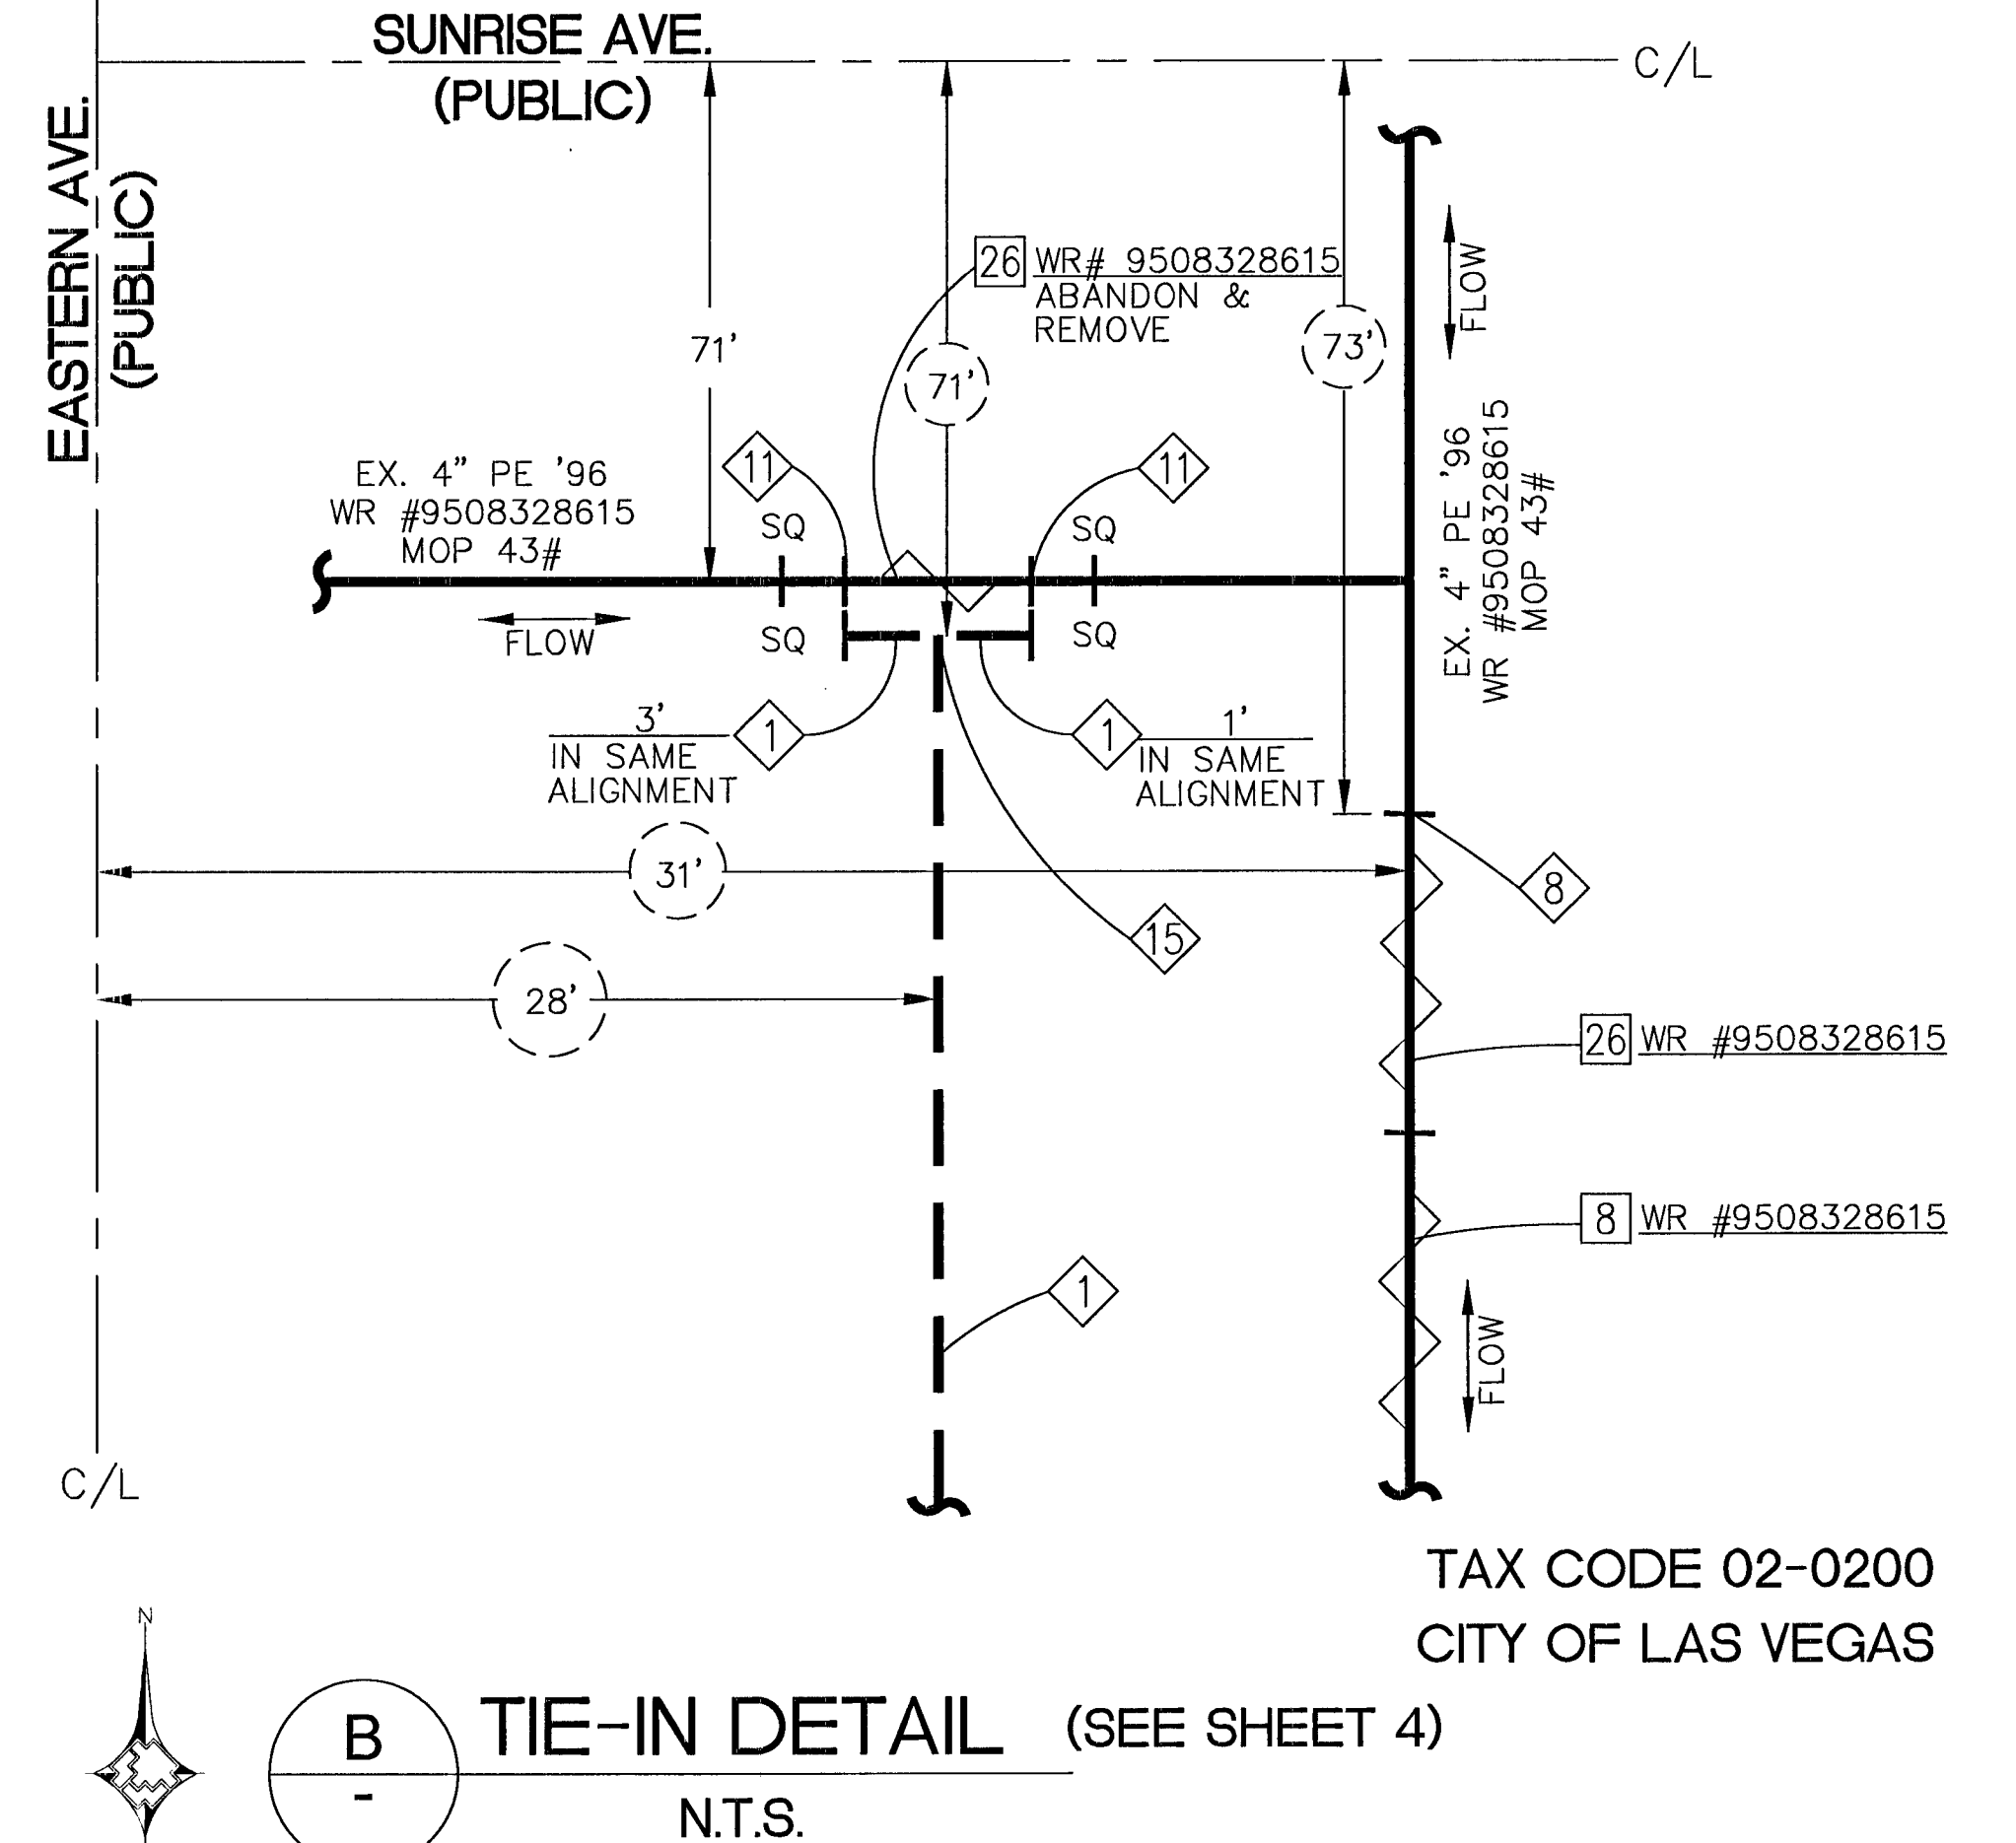

Clark County Public Works
Development Review
APPROVED FOR PERMITTING

Night Work - Yes No

Encroachment Permit # _____

By: _____ Date: _____



NO.	DESCRIPTION	BY	DATE	APPVD
1.				
2.				
3.				
4.				
REVISIONS				
SOUTHWEST GAS CORPORATION				
TAX CODES	UNIT	UNIT TYPE	INSTL.	RETIRED
			PROPOSED	COMPLETED
PROPERTY UNITS				

AS-BUILT DRAWING-PRESSURE TEST DATA			
PIPE DIA.	TEST MEDIUM	TEST METHOD	
PIPE LENGTH	☐ AIR	☐ GAUGE	
PIPE TYPE	☐ WATER	☐ CHART	
MIN. DURATION	SOAK	PRESS REC SN#	
TEST PRES. (PSI)	START	END	
TIME			
DATE			
PERFORMED BY			

VISUAL INSPECTION CERTIFICATION	
I HAVE VISUALLY INSPECTED ALL HEATED FUSIONS, PORTLAND CEMENT, MECHANICAL JOINTS, AND WELDS THAT HAVE BEEN PERFORMED	
NAME	DATE
FOREMAN	
REVIEWED BY	
AS-BUILTS ACCEPTED BY	DATE
POSTED BY	DATE
POSTING QC'D BY	DATE

CONSTRUCTION	
INSPECTOR	
FOREMAN	
REVIEWED BY	
PERMIT INFORMATION	
CLARK COUNTY, CITY OF LAS VEGAS, NDOT	
TAX CODE 02-0200, 02-0340, 02-0207	

ISOLATION AREA	W.R. NO.
98, 99	1694310
LOCATION	ATLAS #/TILE #
T20S, R61E, SEC 36 & T21S, R61E, SEC 1 M.D.M.	x639y512 x639y514 x636y512 x636y514

ENGINEER/TECH: PATRICK DENISON	PHONE: 702-365-2139
ACCOUNT REP:	PHONE:
PROJECT CONTACT: PATRICK DENISON	PHONE: 702-365-2139
SHEET NO: 19 OF 22	SCALE: N.T.S.
DWN. BY: ZONE ENG	CHKD. BY:
DATE: 03/14/14	APPVD. BY:
TITLE	
SI-CLV SUNRISE & 27TH	

RTC STD DWG 503