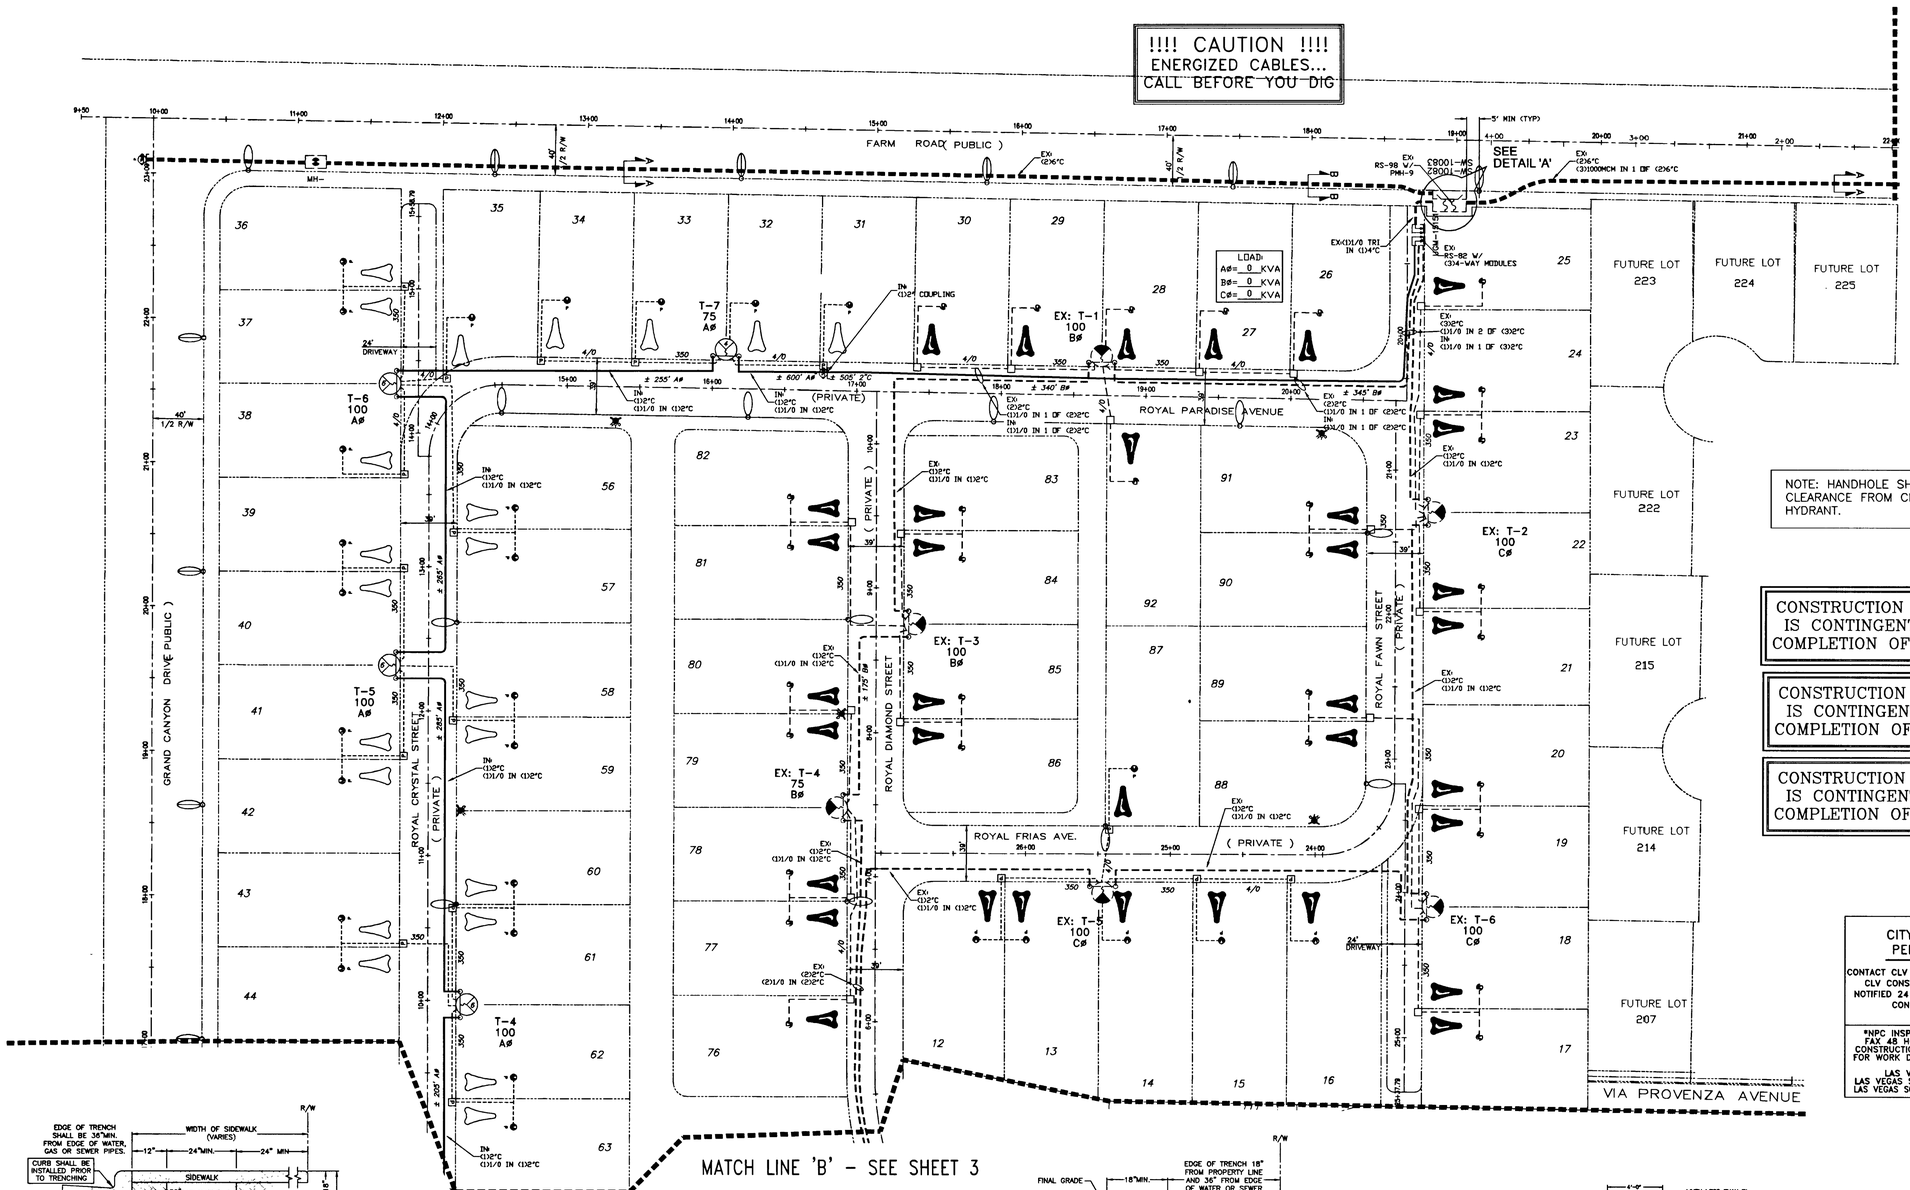

NOTE: HANDHOLE SHOULD HAVE 6' CLEARANCE FROM CENTER OF FIRE HYDRANT.

CONSTRUCTION OF THIS JOB IS CONTINGENT UPON THE COMPLETION OF WR# 171570

CONSTRUCTION OF THIS JOB IS CONTINGENT UPON THE COMPLETION OF WR# 170227

CONSTRUCTION OF THIS JOB IS CONTINGENT UPON THE COMPLETION OF WR# 169371

CITY OF LAS VEGAS PERMIT REQUIRED*

CONTACT CLV LAND DEVELOPMENT (229-6371)
CLV CONSTRUCTION SERVICES MUST BE NOTIFIED 24 HOURS PRIOR TO COMMENCING CONSTRUCTION (229-6337)

*NPC INSPECTOR MUST BE NOTIFIED BY FAX 48 HOURS PRIOR TO COMMENCING CONSTRUCTION & WILL VERIFY CITY PERMIT FOR WORK DONE IN STREETS OR SIDEWALK.
FAX PERMIT TO:
LAS VEGAS NORTH: 657-4354
LAS VEGAS SOUTH (HENDERSON): 558-4740
LAS VEGAS SOUTH (SPRING VALLEY): 252-4828

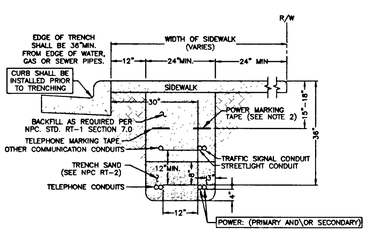

SIDEWALK TRENCH DETAIL
NPC U.G. STD. RT-7 (REV. 4/8/02)
(RESIDENTIAL OR COMMERCIAL)

61401

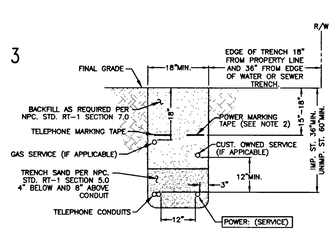

TRENCH DETAIL
NPC U.G. STD. RT-8 (REV. 4/8/02)
(RESIDENTIAL SERVICE)



TRANSFORMER LOCATION DETAIL
NPC U.G. STD. RS-5

UNLESS OTHERWISE NOTED:

ALL SERVICE CONDUCTOR: 4/0 AL. TRI.
ALL TRANSFORMERS: 7200-120/240V-1ø PM
COMBINED A/C TONNAGE: 9 TONS
NUMBER OF UNITS: 39
MAIN SIZE: 320 AMPS
ESTIMATED KVA PER UNIT: 12.6 KVA
SQ. FT. OF LARGEST HOME: 3608 FT²

T,R,S: 1960-18
APN: 125

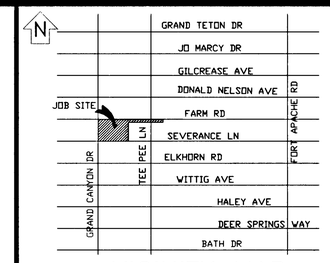

VICINITY MAP
(NOT TO SCALE)

EVERY EFFORT HAS BEEN MADE TO IDENTIFY ALL NPC FACILITIES. THE CUSTOMER SHALL CONFIRM THE EXISTENCE AND LOCATION OF THESE FACILITIES.

AVOID HITTING OVERHEAD POWER LINES. IT'S COSTLY.
CALL BEFORE YOU DO OVERHEAD
CALL 1-702-227-2929

AVOID CUTTING UNDERGROUND UTILITY LINES. IT'S COSTLY.
Call before you Dig.
1-800-227-2600
UNDERGROUND SERVICE (USA)

REVISIONS

NO.	DESCRIPTION	DATE	G.A.

DCA

TYPE OF EASEMENT:
- AERIAL ☐
- STANDARD ☐
- R/W-31 ☐
- UNDERGROUND ☐
- AS BUILT UNDERGROUND ☐
- R.O.E./R/W-5-COM ☐
- 3rd PARTY ☐
- UNDERGROUND BY EXHIBIT ☐
- (N-DOT) PERMIT ☐
- (BLM) PERMIT ☐
- RAILROAD-UPRR-PERMIT ☐
- SO. NEVADA WATER PERMIT ☐
- NOT REQUIRED ■
- Misc. Info. ☐

JPA NOTES:
- SPRINT CONTACT: N/A
- PHONE NUMBER: N/A
- DATE OF CONTACT: N/A
- ____ TO SET NEW POLES
- ____ TO STAKE NEW POLES
- ____ TO PROVIDE ____ POLES
- ____ FT. CLASS ____
- ____ FT. CLASS ____
- ____ FT. CLASS ____
- ____ TO DIG POLE HOLES
- ____ TO REMOVE EX. POLES
- N/A
- JPA#: N/A

NPC INFORMATION:

COORDINATOR: TRISHA GARVIN
PHONE: 657-4308
DESIGNER: GCW
DCA: 657-4355-DEBBIE
INSPECTOR: 378-3725
SCHEDULING: 657-4114,657-4116,657-4118
DISTRICT: LAS VEGAS

CUSTOMER INFORMATION:

DEVELOPER: TOLL BROTHERS
ENGINEER: TETRA TECH
CONTACT: CRAIG 203-0235
APPROVAL DATE: 04/16/2003

GOVERNMENT INFORMATION:

AGENCY: CITY OF LAS VEGAS
APPROVAL DATE: Walter Amoot 12/3/03

NEVADA POWER COMPANY

TERRA BELLA
UNIT 2

10T44744-2-NPC

PROJ. ID: 172876 | SCALE: 1" = 50'
SHEET #: 2 OF 3 | DATE: 01/28/2003