
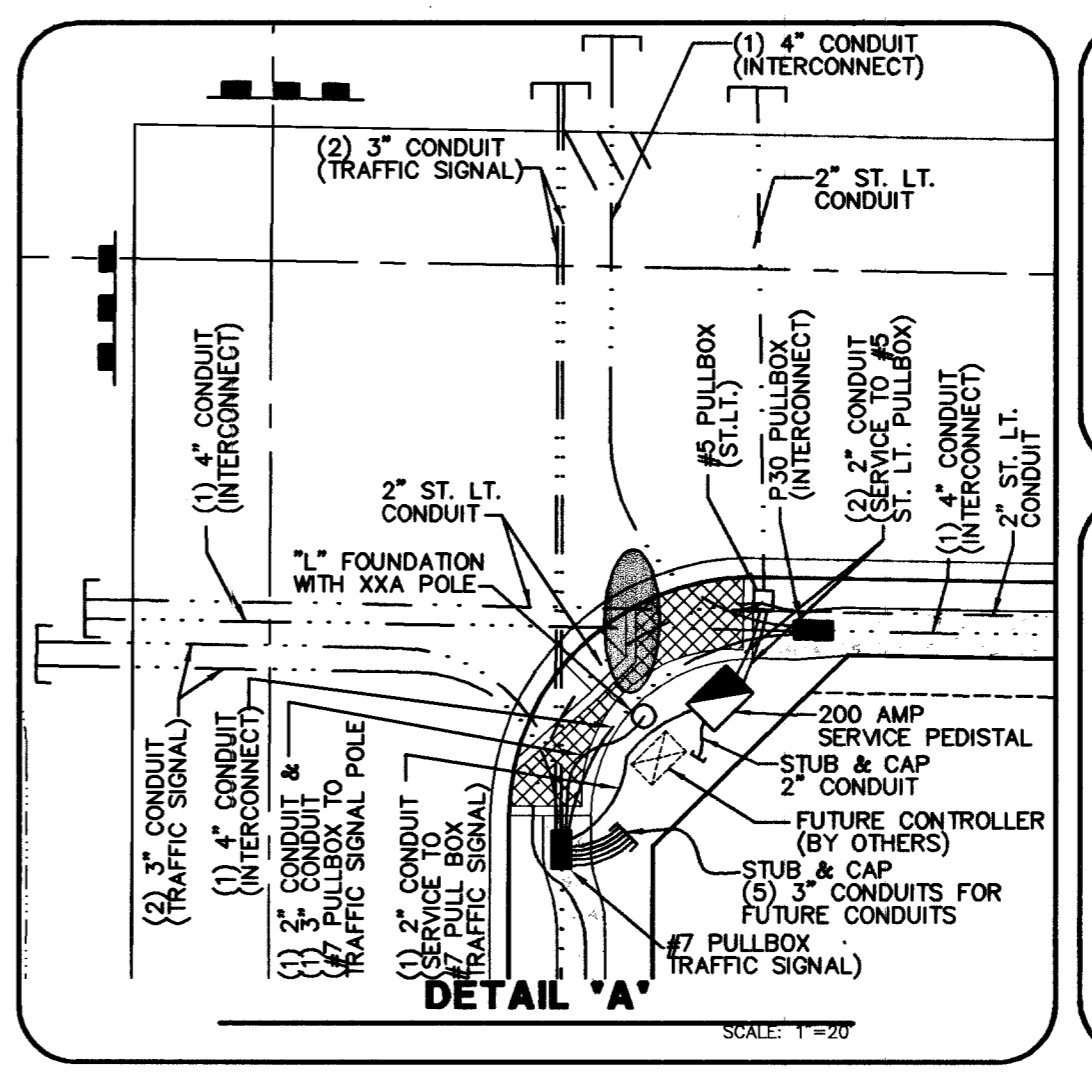


DATE: 8/14/09

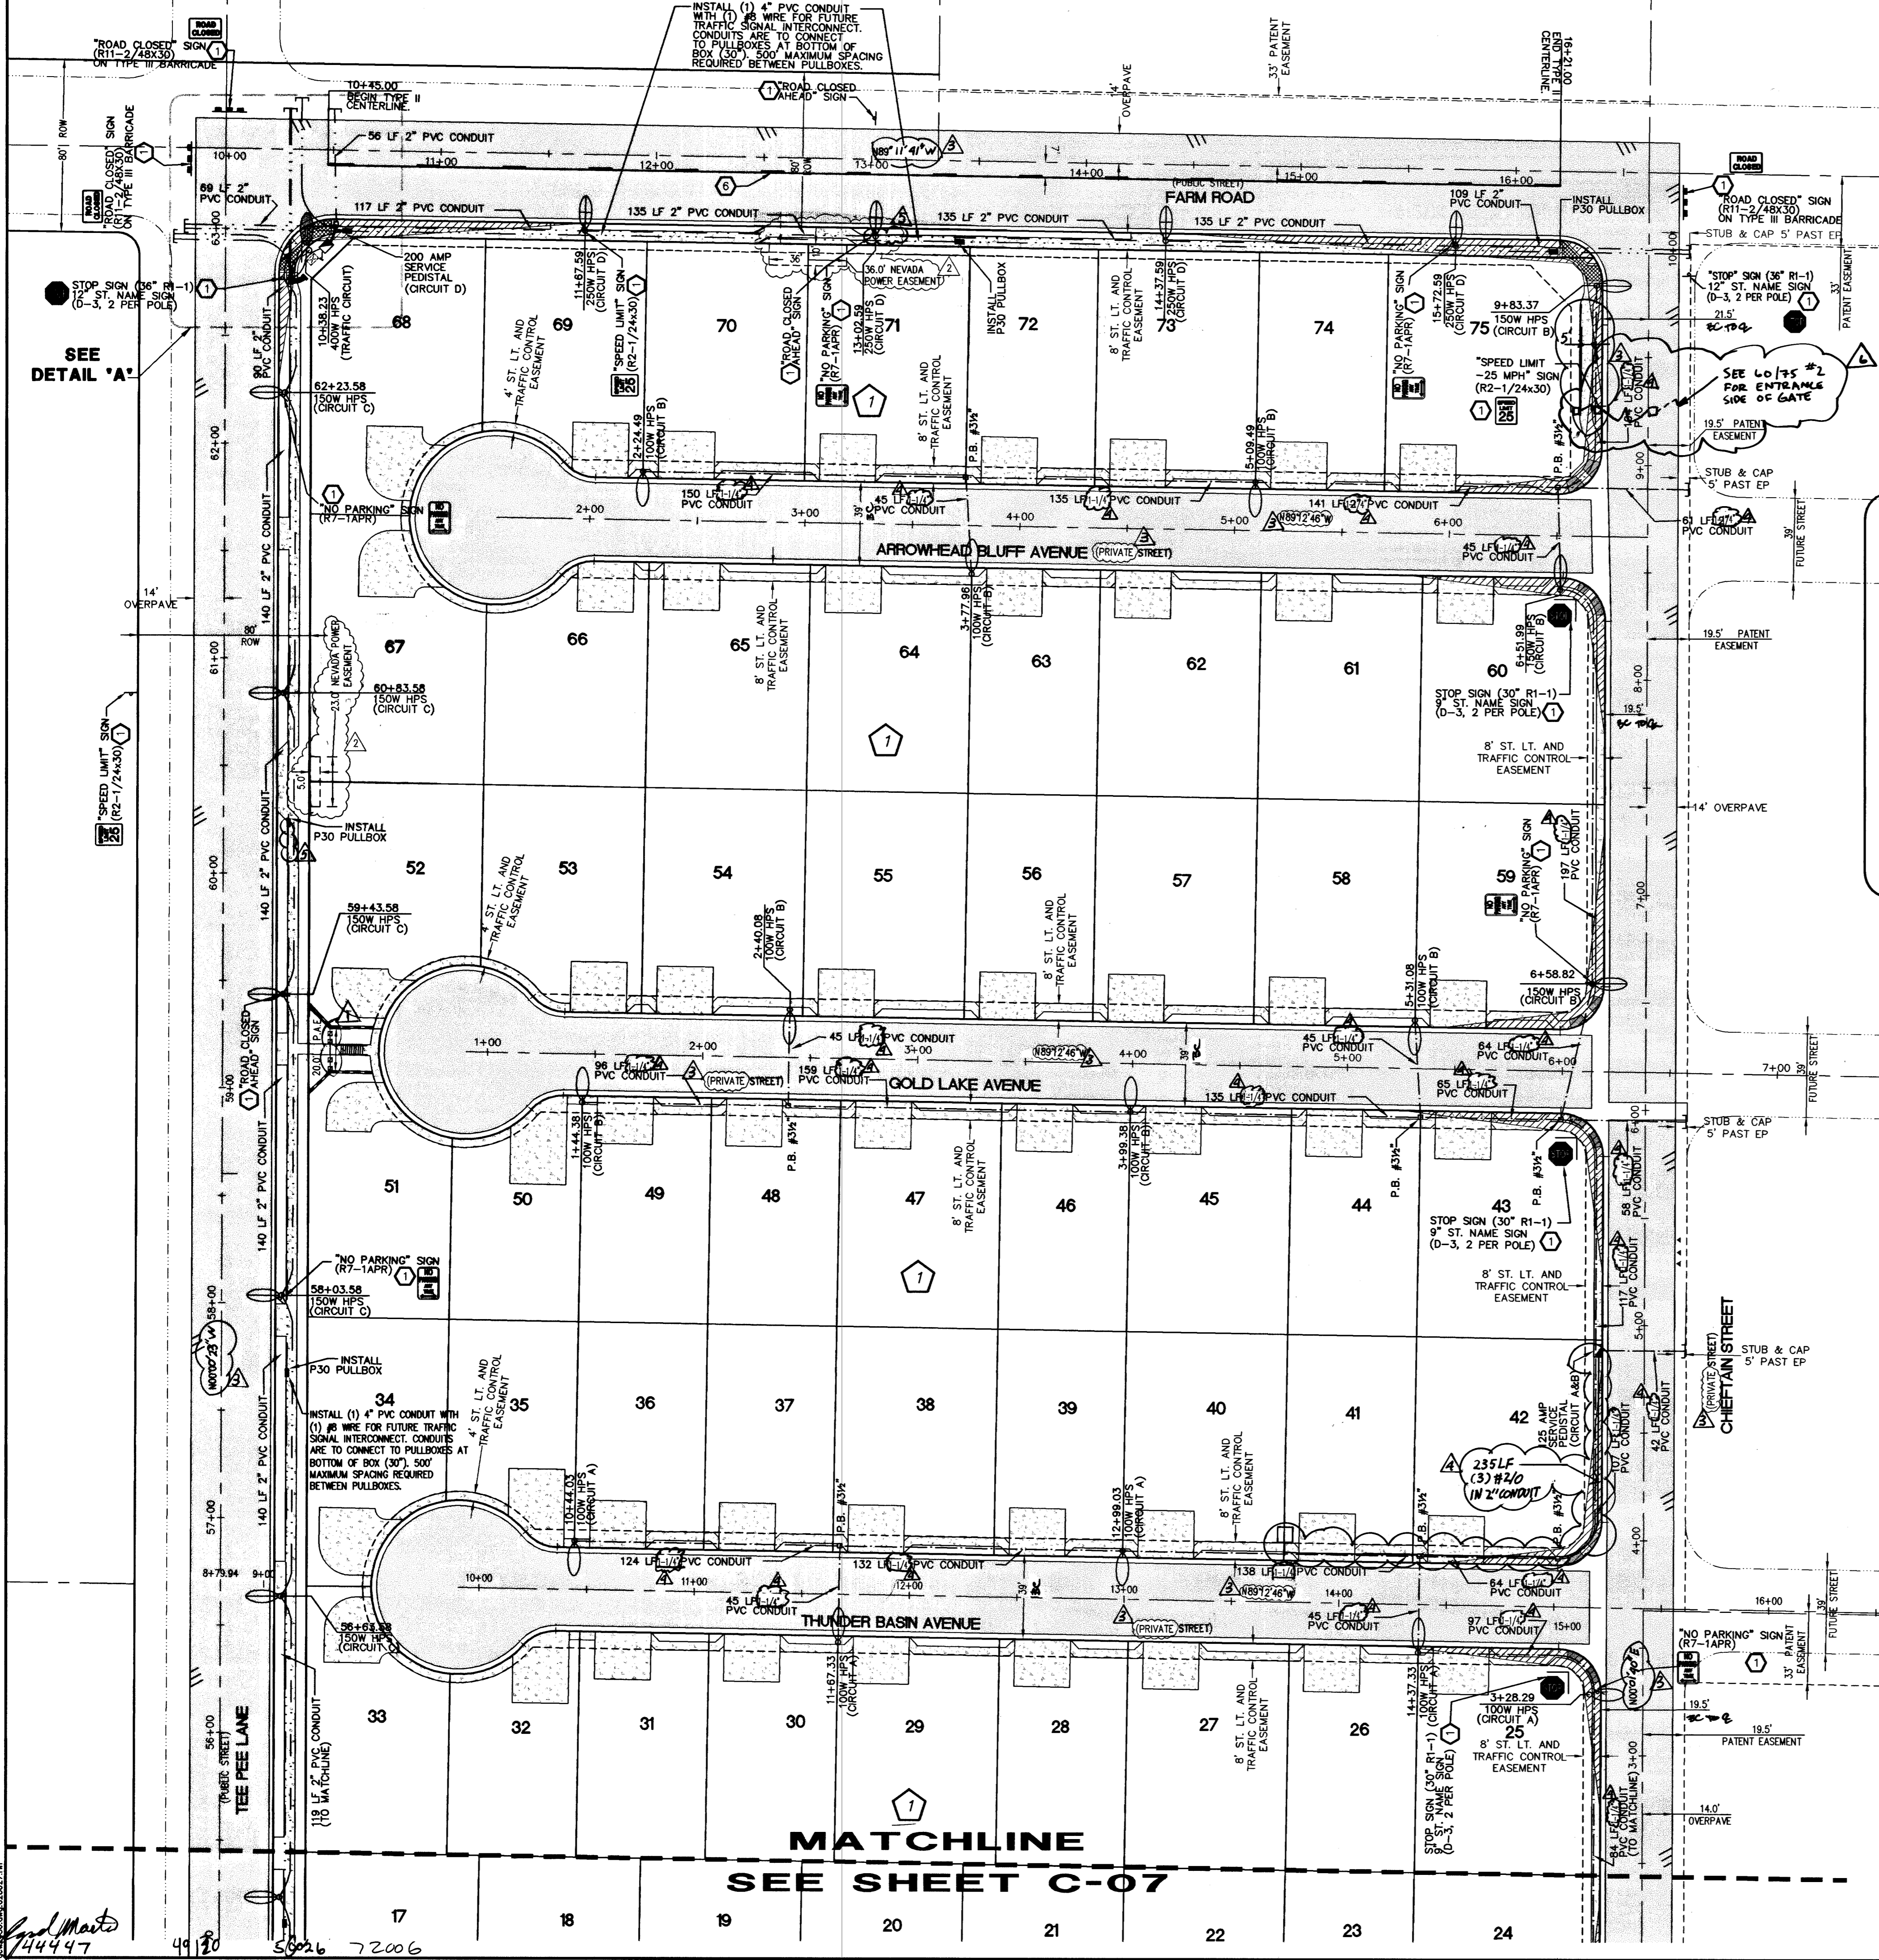

125	AMP 240V PAD MOUNT SERVICE
2	WITH
2	2 POLE 60 AMP CIRCUIT BREAKER(S)
1	1 POLE 15 AMP CIRCUIT BREAKER(S)
0	1 POLE 40 AMP CIRCUIT BREAKER(S)
0	1 POLE 60 AMP CIRCUIT BREAKER(S)
2	2 POLE 60 AMP CONTRACTOR(S)
1	BY-PASS SWITCH PER CONTRACTOR

200	AMP 240V PAD MOUNT SERVICE
2	WITH
2	2 POLE 60 AMP CIRCUIT BREAKER(S)
1	1 POLE 15 AMP CIRCUIT BREAKER(S)
2	1 POLE 30 AMP CIRCUIT BREAKER(S)
1	1 POLE 40 AMP CIRCUIT BREAKER(S)
2	1 POLE 60 AMP CIRCUIT BREAKER(S)
1	2 POLE 30 AMP CONTRACTOR(S)
2	2 POLE 60 AMP CONTRACTOR(S)
1	BY-PASS SWITCH PER CONTRACTOR

LEGEND

- SIGHT VISIBILITY RESTRICTED ZONE (SVRZ)
- 9" or 12" STREET NAME SIGN (D3, 2 PER POLE)
- STOP SIGN W/ POST (30" OR 36" WHERE SHOWN R1-1)
- TRAFFIC SIGN (AS INDICATED)
- END OF ROAD MARKERS (18" RED REFLECTORIZED DIAMONDS)
- TYPE 3 BARRICADE
- EDGE OF PAVEMENT (EP)
- NO. 3/4 CONCRETE PULL BOX W/ METAL COVER
- 3" PVC CONDUIT
- 4" PVC CONDUIT W/ (1) # WIRE

TRANSFORMER

- 400W HPS LUMINAIRE TOWN CENTER TYPE POLE & 15' ARM.
- 250W HPS LUMINAIRE TOWN CENTER TYPE POLE & 8' ARM.
- 150W HPS LUMINAIRE TOWN CENTER TYPE POLE & 8' ARM OR TOWN CENTER APPROVED LIGHTING
- 100W HPS LUMINAIRE TOWN CENTER TYPE POLE & 8' ARM OR TOWN CENTER APPROVED LIGHTING
- 125/200 AMP SERVICE PEDIestal W/ 60 AMP BREAKER FOR STREETLIGHT AND 15 AMP BREAKER FOR PHOTOCELL PER CCAUSD'S 330 & 331.

30 LOT NUMBER

3 BLOCK NUMBER

2" PVC CONDUIT W/ (2) #4 & (1) #8 CONDUCTORS (ST. LT.) (RESIDENTIAL STREET)

2" PVC CONDUIT W/ (4) #4 & (1) #8 CONDUCTORS (ST. LT.)

CALL BEFORE YOU DIG


1-702-593-6111

1-800-227-2600


UNDERGROUND SERVICE (USA)

AVOID HITTING OVERHEAD POWER LINES. IT'S COSTLY.

CALL BEFORE YOU DIG. Avoid cutting the underground utility lines. It's costly.

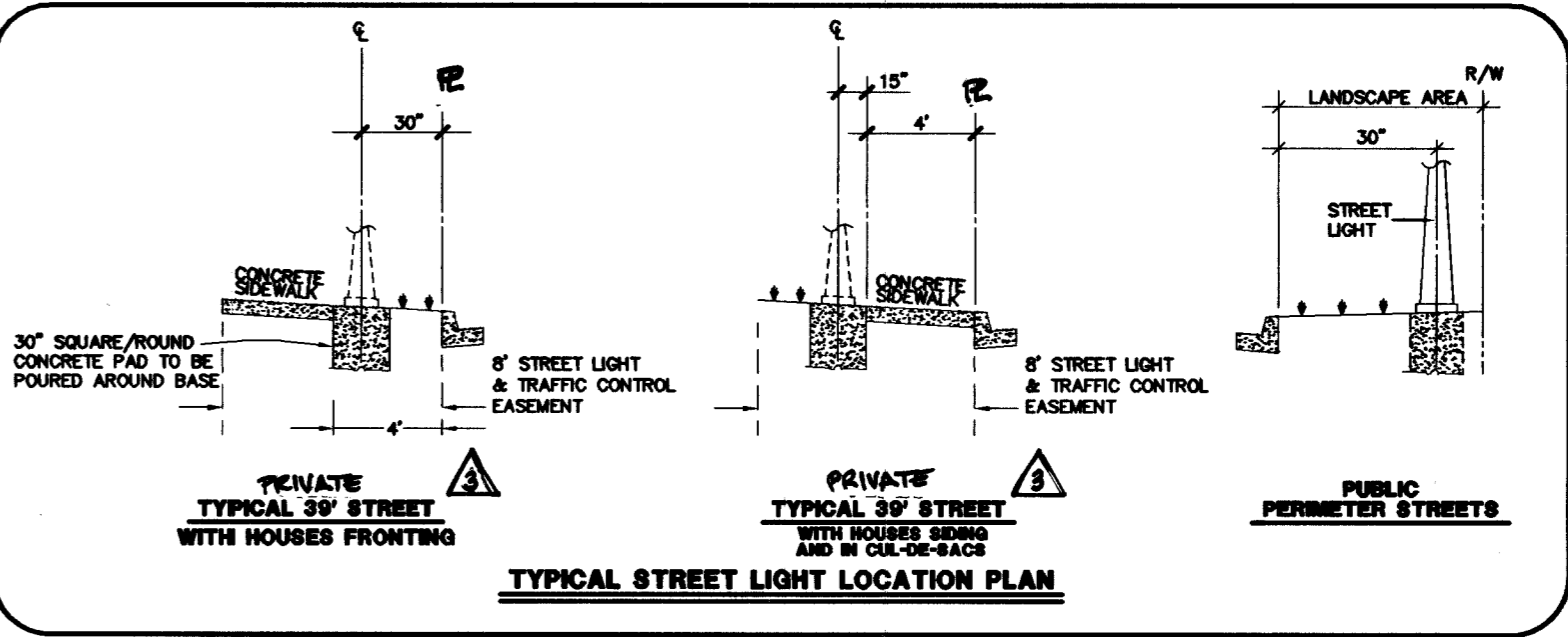


TRAFFIC LUMINAIRE ARE TO BE WIRED CONTINUOUSLY TO METER PEDESTAL USING 2-#10 STR. & 1-#8 GREEN T.H.W. WIRE. 10' OF SLACK SHALL BE LEFT IN POLE. EACH LUMINAIRE SHALL BE FUSED INDIVIDUALLY WITH A 10 AMP FUSE IN BOTTOM OF METER PEDESTAL.

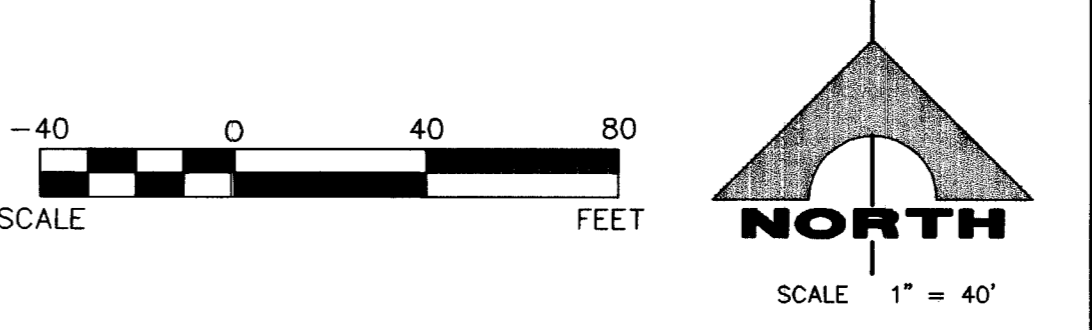

- CONSTRUCTION NOTES**
- INSTALL NEW SIGN(S).
 - INSTALL 3 FOOT WIDE WHITE BROKEN LINE WITH 3 FOOT WIDE GAP.
 - INSTALL 8 INCH WIDE SOLID WHITE LINE.
 - INSTALL 8 INCH WIDE SOLID YELLOW TRANSITION LINE.
 - INSTALL 10 FOOT WIDE WHITE PAINTED PEDESTRIAN CROSSWALK.
 - INSTALL TYPE II CENTER LINE PER CCAUSD NO. 244.
 - INSTALL 4 INCH WIDE WHITE PAINTED EDGE LINE.
 - INSTALL TYPE I CENTER LINE PER CCAUSD NO. 244.

TRAFFIC QUANTITIES

STREET NAME SIGNS (9"-2 PER POLE)	3 PR.
STREET NAME SIGNS (12"-2 PER POLE)	2 PR.
STOP SIGN (30" R1-1)	3 EA.
STOP SIGN (36" R1-1)	2 EA.
100 W.H.P.S. LUMINAIRE W/POLE	11 EA.
150 W.H.P.S. LUMINAIRE W/POLE	8 EA.
250 W.H.P.S. LUMINAIRE W/POLE	4 EA.
NO. 3 1/2" P.B. W/METAL COVER	2 EA.
2" SOH. 40 PVC CONDUIT	2 EA.
125 AMP SERVICE PEDIestal	1 EA.
200 AMP SERVICE PEDIestal	1 EA.
1" W/SH 40 PVC CONDUIT	1 EA.

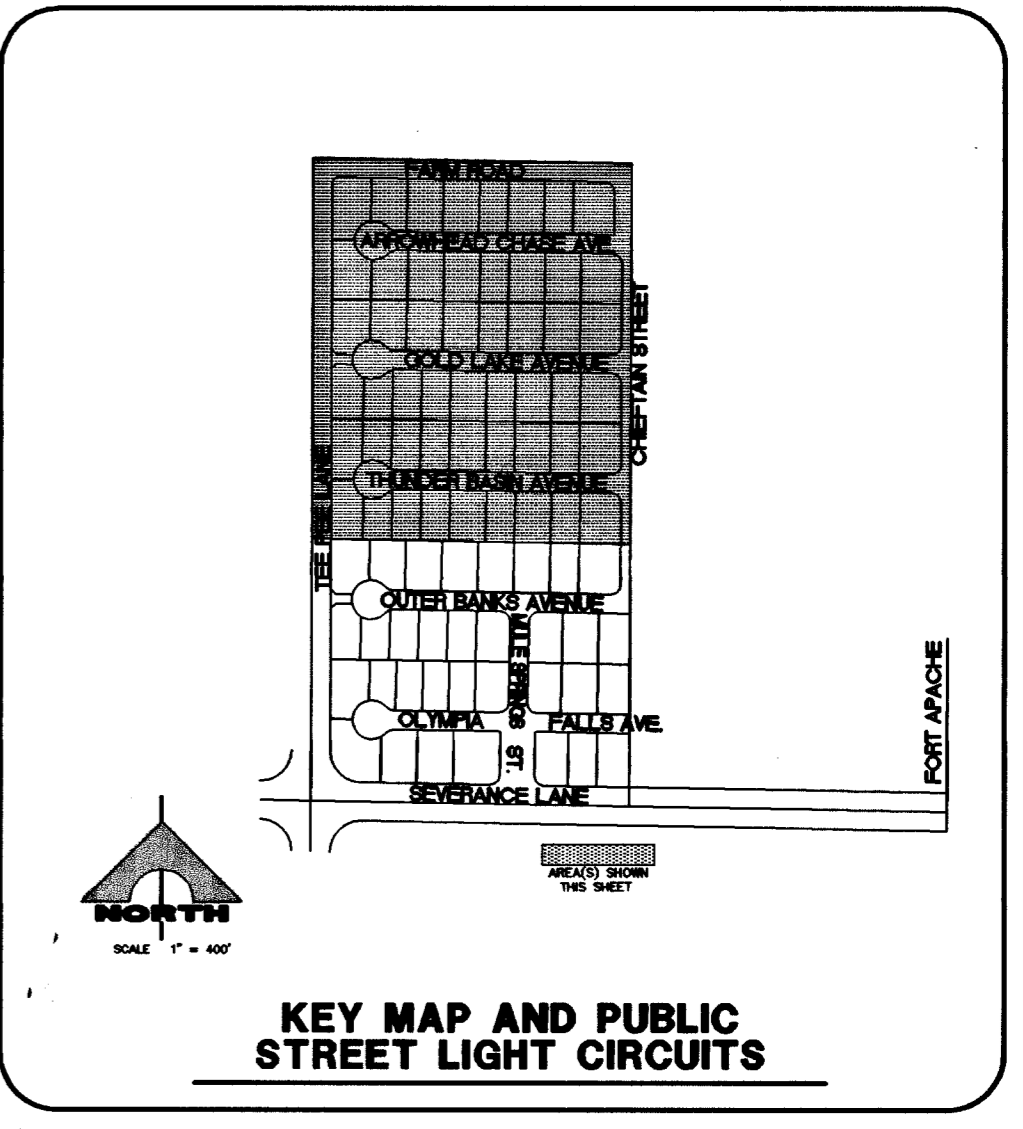

Handwritten notes: 144447, 50226, 72006

MATCHLINE SEE SHEET C-07

DESIGN: TS
DRAWN: JWS
CHECK: JWS
ISSUE DATE: 8/14/09
PLOT DATE: 08-29-09
PLOT TIME: 11:20:03

G. C. WALLACE, INC.
Engineers/Planners/Surveyors
1555 SOUTH RAINBOW BLVD./LAS VEGAS, NEVADA 89146
TELEPHONE: (702) 804-2000 • FAX: (702) 804-2299

PROJECT: PARDEE HOMES OF NEVADA TOWN CENTER ASSEMBLAGE L-TC 60/70 #1 TRAFFIC AND STREET LIGHT PLAN I

SHEET C-6 OF 24 SHTS