
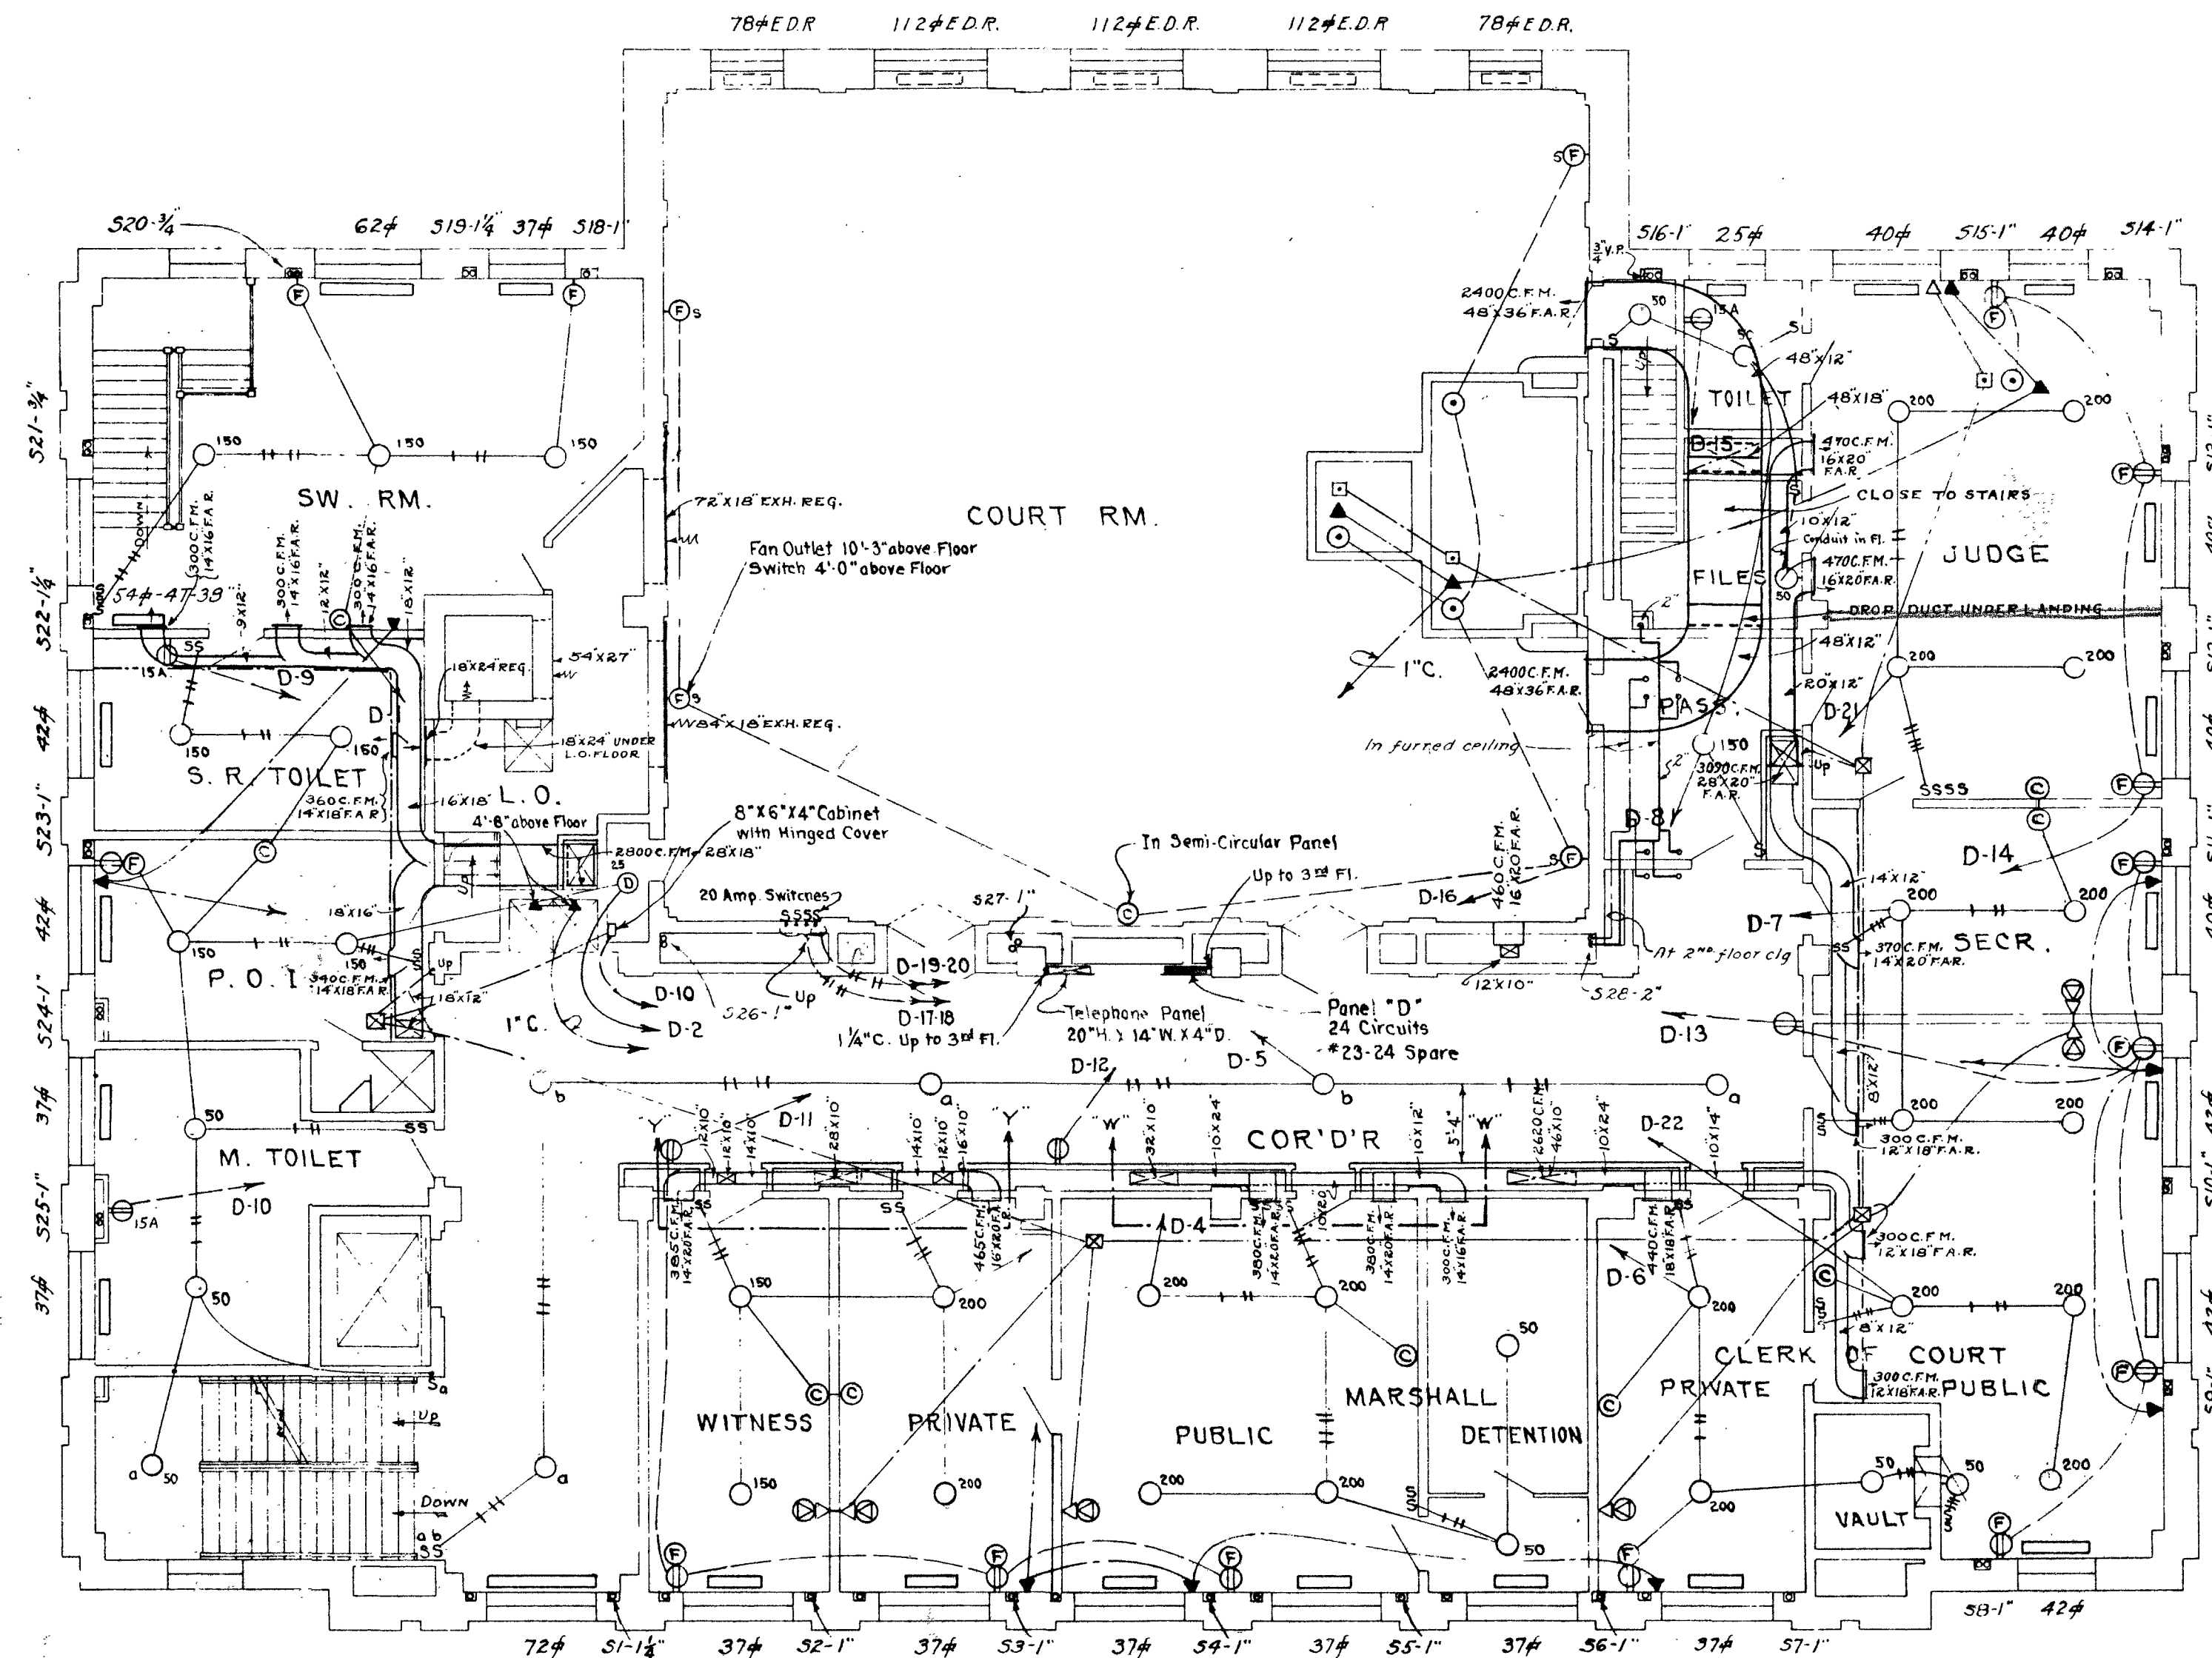
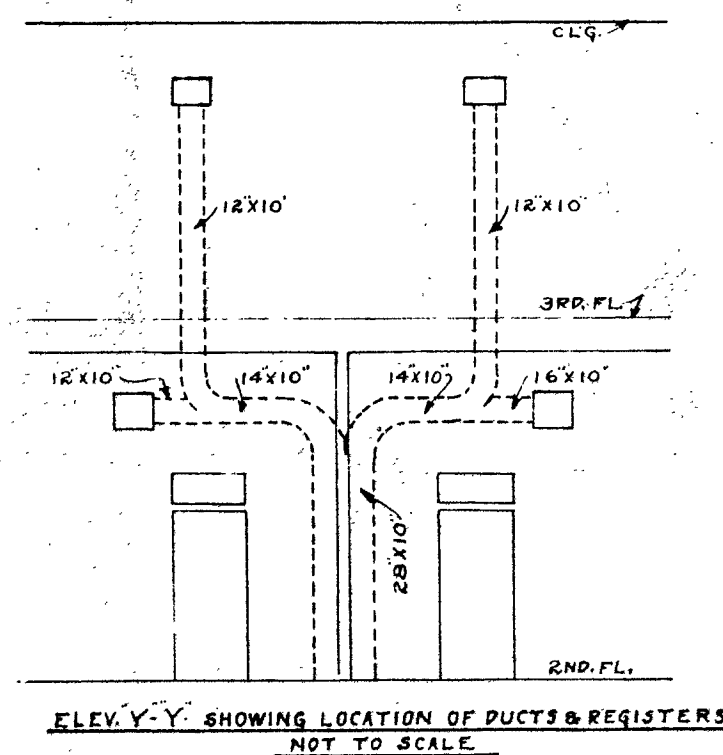


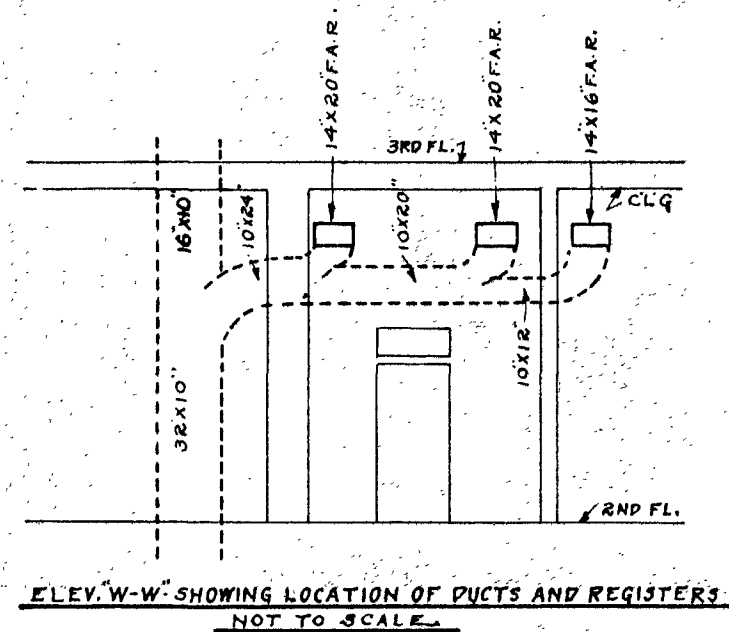

Electrical Note :-
All Ceiling Outlets to be 100 Watts unless
otherwise Noted or Indicated.
For Symbols, see Misc. Dwg. # 311 C.

Note:
All radiators on this floor to be 4 tube, 26\"/>

POFFICE Heating & Lighting

Scanned by GSA Region 9
FEB 8 1998

HEATING & LIGHTING



0061
24X

BUILDING U.S.P.O. COURT HOUSE ETC.	
CITY LAS VEGAS-NEV.	
DESIGNED BY HIXSON	DATE 11/29/46
CHECKED BY [Signature]	DATE 11/29/46
DRAWING NO. 41-1.57	

J. A. Whitten
ACTING SUPERVISING ARCHITECT
TREASURY DEPARTMENT
APPROVED: LOUIS A. SIMON
SUPER. ARCHITECTURAL DIVISION
T. O. BROOKS, 7773126
CHIEF, ARCHITECTURAL DIVISION
U. S. DEPARTMENT OF THE TREASURY