

1. Suggested gas line locations are to clear substructures. Locate in the Field.
2. All pipeline construction shall conform to applicable jurisdiction specifications.
3. Gas mains shall be purged per the Operations Manual.
4. Do not scale this drawing.
5. Any changes in the Main location must be authorized by SWG Engineer.
6. Trenching and Pavement Replacement are to conform with RTC Standards.
7. Contact Engineering for bypass information.
8. All main tie-ins requiring tees are to be full-flow tees unless otherwise stated.
9. Request for surveying and/or staking will be submitted to Engineering 72 hours in advance, minimum.
10. City of Las Vegas permit required.

1. PERMANENT REPAIR IN VEGAS DRIVE TO BE COMPLETED BY THE CITY OF LAS VEGAS PER THE VEGAS DRIVE IMPROVEMENTS PROJECT.
2. BACKFILL TO COMPLY WITH RTC STANDARD 503 WITH TYPE II OR SLURRY USED AS BACKFILL, NOT CRUSHED ROCK.

SYSTEM	VEGAS DRIVE 6 4 1256
DR. NO.	21DR10002596
SEGMENT M.A.O.P.	120 PSIG
SYSTEM M.A.O.P.	120 PSIG
SYSTEM M.O.P.	120 PSIG

PURGE PLAN WAS COMPLETED IN ACCORDANCE
WITH THE OPERATIONS MANUAL GUIDELINES BY:


PRINT: _____ DATE: _____

SIGNATURE: _____



MATERIAL LIST				
ITEM#	QTY. (DESIGN)	QTY. (AS-BUILT)	STOCK ID#	DESCRIPTION
①	349'		100-1024	Pipe STL CTD X-52 4-1/2"ODX0.237"WT DRL NMDA
②	2		140-3309	Cap Steel Weld 4" STD WT Grade B 49 CFR NMDA (TESTING ONLY)
③	2		140-4057	Elbow STL Weld 4" 90 Degree LR STD WT NMDA Grade B
④				
⑤				
⑥				

1	ABANDON & REMOVE 4" STL '68 MOP 120# MAOP 120#	343'
---	---	------

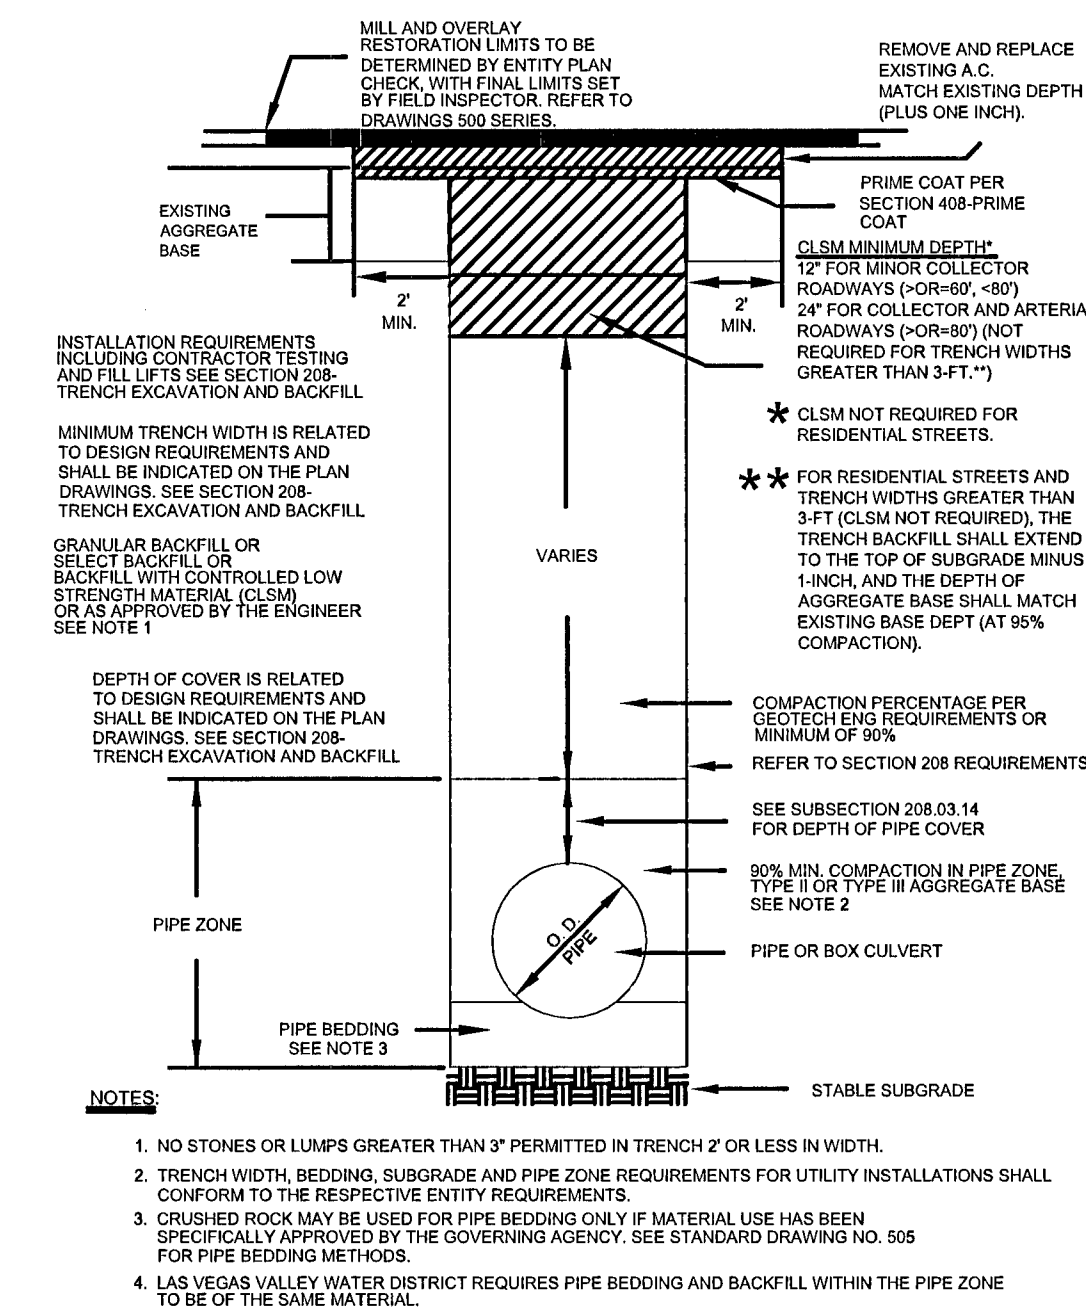

SIGNATURE _____
DATE _____

WELDS CUT OUT:

PIPE TO SOIL _____

ANODE INSTALLED?

YES NO

☐ ☐

IF YES, PIPE TO SOIL _____

2 ☐ TAR WRAP
3 ☐ ASPHALT
4 ☐ PRITEC
6 ☐ FUSION BONDED EPOXY
8 ☐ PLASTIC TAPE WRAP
9 ☐ EXTRUDED POLY COATING
10 ☐ OTHER

E ☐ EXCELLENT
G ☐ GOOD
F ☐ FAIR
P ☐ POOR
N ☐ NO COATING

IF EXPOSED. EXTERNAL		IF CUT OR COUPON. INTERNAL	
EG	☐ GOOD		☐ IG
ESC	☐ SLIGHT CORROSION		☐ ISC
EHC	☐ HEAVY CORROSION		☐ IHC

CPM Utility Plan Approval

CPM Project Name Legion Drive Improvements
CPM Hansen # 11554 Date 4/16/14
CPM Project Manager Lorrie Unnert Dunford x6738
Approved by: [Signature]

1. CONTACT CP SUPERVISER AT (702) 365-2359 AND CP DEPARTMENT AT (702) 365-2388 AT LEAST 48 HOURS PRIOR TO COORDINATE INSTALLATION
2. THIS WR AFFECTS THE FOLLOWING CP AREAS:
CPID#: R-10 1-B
WMIS#: 21DCP0021139
AREA: VEGAS DR/DECATUR BLVD

[illegible]